



■ Modification Bulletin

Project Name: Addison Natural Gas Project

CHA Project No: 28757

Modification Bulletin No: Trans-09

To: Vermont Gas Systems, Inc.

Date: 5/13/16

Description:

The following plan sets for the Addison Natural Gas Project are issued for construction:

- “Addison Natural Gas Project Transmission Mainline” (Construction) dated IFC 05/2016
- “Addison Natural Gas Project Transmission Mainline (EPSC)” dated IFC 05/2016

Updates have been made to the following sections of the document titled “Technical Specifications for ANGP Prepared by CHA” dated April 29, 2015:

- Section 137000 Welding
- Section 312333 Trenching, Pipe Laying, and Backfilling
- Section 138000 Coatings

Please note that all additions to the technical specifications documents are shown as ***bold and italicized***. All deletions are shown as ~~strikethrough~~.


Attachments:

- “Addison Natural Gas Project Transmission Mainline” (Construction) dated IFC 05/2016
- “Addison Natural Gas Project Transmission Mainline (EPSC)” dated IFC 05/2016
- “Technical Specifications for ANGP Prepared by CHA” dated April 29, 2015 (Entire document attached)


Issued By: Brendan Kearns, CHA Engineer

V:\Projects\ANY\K3\28757\Construction\Clarifications


ADDISON NATURAL GAS PROJECT TRANSMISSION MAINLINE

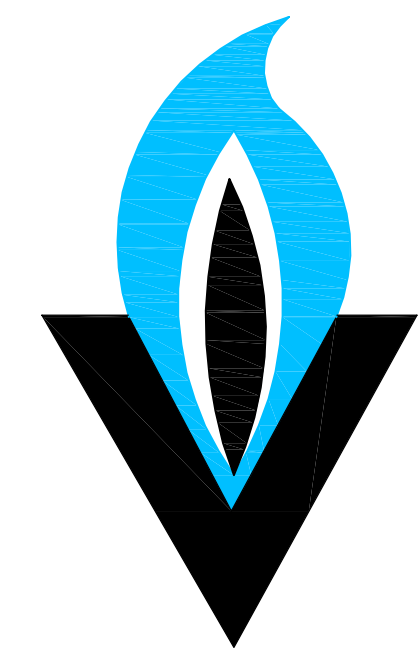

Vermont Gas

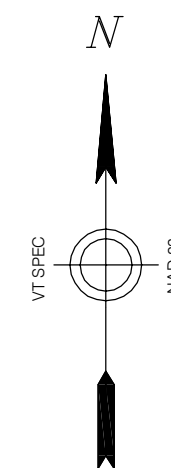

NEW YORK

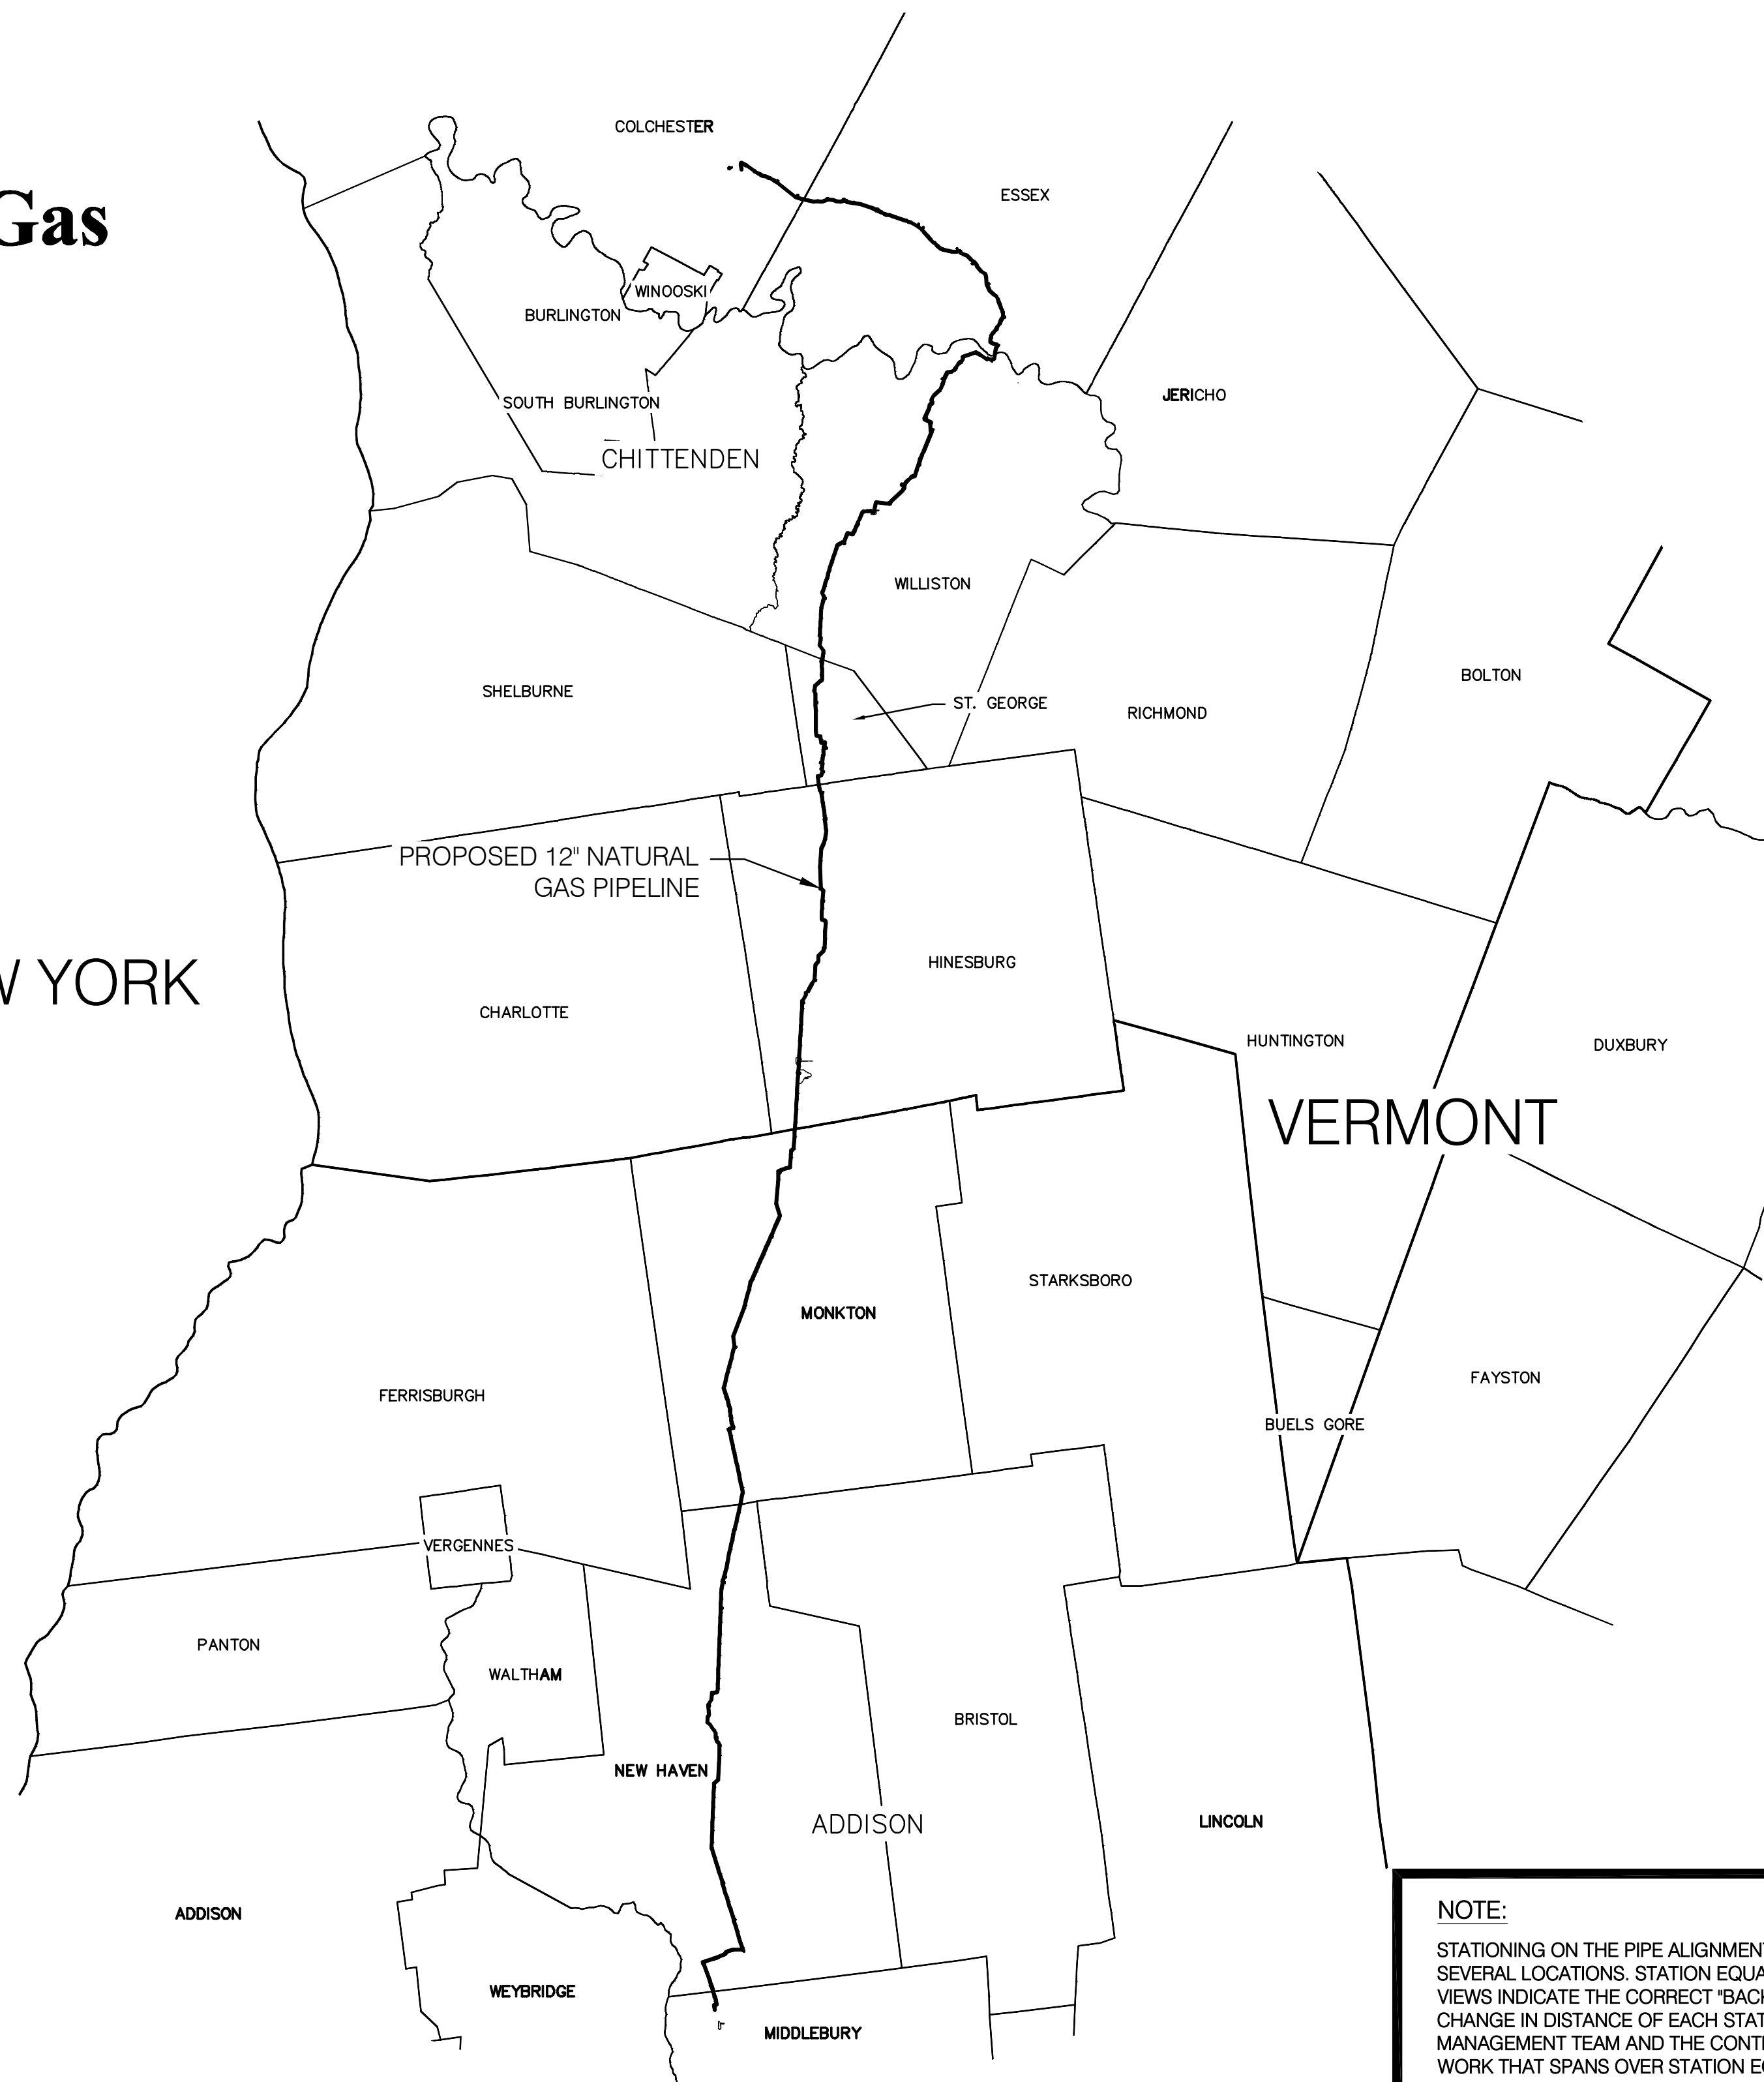

SCALE 1" = 12,000'

NOTE:
STATIONING ON THE PIPE ALIGNMENT UTILIZES STATION EQUATIONS IN SEVERAL LOCATIONS. STATION EQUATION CALL-OUTS NOTED ON THE PLAN VIEWS INDICATE THE CORRECT "BACK " AND "AHEAD" STATIONS AS WELL AS THE CHANGE IN DISTANCE OF EACH STATION EQUATION. THE CONSTRUCTION MANAGEMENT TEAM AND THE CONTRACTOR SHOULD PROPERLY DOCUMENT WORK THAT SPANS OVER STATION EQUATIONS IN ORDER TO PROVIDE ACCURATE FIELD RECORDS FOR THE OWNER.


NOTE:
THE ALIGNMENT AND EPSC PLAN SETS DATED 05/2016 SUPERSEDE ALL PREVIOUSLY ISSUED FOR CONSTRUCTION PLAN SETS AND INCORPORATE ALL PROJECT CHANGES SUBSEQUENT TO THE 2015 ISSUED FOR CONSTRUCTION PLAN SETS DATED 04/02/15. THE PLAN CHANGES ARE INDICATED BY REVISION CLOUDS AND/OR DENOTED IN THE REVISION BOX, WITH THE EXCEPTION OF THE FOLLOWING MODIFICATIONS: REMOVAL OF THE CATHODIC PROTECTION TEST LEAD LOCATIONS, THE ADDITIONAL SHEETS FOR TRENCH BREAKER LOCATIONS, THE ADDITIONAL SHEETS FOR DEPTH OF COVER, AND THE ADDITIONAL SHEETS FOR PIPE PROFILES AT JURISDICTIONAL STREAM CROSSINGS.

DRAWING INDEX

DRAWING NUMBER	DRAWING TITLE
ANGP-T-G-001	COVER SHEET
ANGP-T-G-002	INDEX SHEET
ANGP-T-G-003	LEGEND & NOTES
ANGP-T-G-004 TO 006	CONSTRUCTION CONFIGURATION DETAILS
ANGP-T-G-007 TO 010	ACCESS ROAD DETAILS
ANGP-T-G-011	NOT INCLUDED
ANGP-T-G-012 TO 020C	CONSTRUCTION DETAILS
ANGP-T-G-021	STATION AND VALVE DETAILS
ANGP-T-G-022	WILLISTON PIPEYARD
ANGP-T-G-023	PLANK ROAD PIPEYARD

DRAWING #	REV #	DRAWING TITLE	DRAWING #	REV #	DRAWING TITLE
ANGP-T-C-001A	1	ALIGNMENT SHEET	ANGP-T-C-048	1	ALIGNMENT SHEET
ANGP-T-C-001B	1	ALIGNMENT SHEET	ANGP-T-C-049	2	ALIGNMENT SHEET
ANGP-T-C-002	2	ALIGNMENT SHEET	ANGP-T-C-050	2	ALIGNMENT SHEET
ANGP-T-C-003	1	ALIGNMENT SHEET	ANGP-T-C-051	3	ALIGNMENT SHEET
ANGP-T-C-004	1	ALIGNMENT SHEET	ANGP-T-C-051A	0	STREAM CROSSING PROFILE
ANGP-T-C-005	2	ALIGNMENT SHEET	ANGP-T-C-052	1	ALIGNMENT SHEET
ANGP-T-C-006	1	ALIGNMENT SHEET	ANGP-T-C-053	0	ALIGNMENT SHEET
ANGP-T-C-007	1	ALIGNMENT SHEET	ANGP-T-C-054	0	ALIGNMENT SHEET
ANGP-T-C-008	1	ALIGNMENT SHEET	ANGP-T-C-055	1	ALIGNMENT SHEET
ANGP-T-C-009	1	ALIGNMENT SHEET	ANGP-T-C-056	0	ALIGNMENT SHEET
ANGP-T-C-010	1	ALIGNMENT SHEET	ANGP-T-C-057	0	ALIGNMENT SHEET
ANGP-T-C-011	1	ALIGNMENT SHEET	ANGP-T-C-058	0	ALIGNMENT SHEET
ANGP-T-C-012	2	ALIGNMENT SHEET	ANGP-T-C-059	1	ALIGNMENT SHEET
ANGP-T-C-013	1	ALIGNMENT SHEET	ANGP-T-C-060	1	ALIGNMENT SHEET
ANGP-T-C-014	2	ALIGNMENT SHEET	ANGP-T-C-061A	2	ALIGNMENT SHEET
ANGP-T-C-015	3	ALIGNMENT SHEET	ANGP-T-C-061AA	0	STREAM CROSSING PROFILE
ANGP-T-C-016	2	ALIGNMENT SHEET	ANGP-T-C-061B	2	ALIGNMENT SHEET
ANGP-T-C-017	1	ALIGNMENT SHEET	ANGP-T-C-062	2	ALIGNMENT SHEET
ANGP-T-C-018	0	ALIGNMENT SHEET	ANGP-T-C-063	2	ALIGNMENT SHEET
ANGP-T-C-019	0	ALIGNMENT SHEET	ANGP-T-C-064	0	ALIGNMENT SHEET
ANGP-T-C-020	1	ALIGNMENT SHEET	ANGP-T-C-065	0	ALIGNMENT SHEET
ANGP-T-C-021	1	ALIGNMENT SHEET	ANGP-T-C-065A	0	STREAM CROSSING PROFILE
ANGP-T-C-022	0	ALIGNMENT SHEET	ANGP-T-C-066	0	ALIGNMENT SHEET
ANGP-T-C-023B	1	ALIGNMENT SHEET	ANGP-T-C-067	0	ALIGNMENT SHEET
ANGP-T-C-024	1	ALIGNMENT SHEET	ANGP-T-C-068	1	ALIGNMENT SHEET
ANGP-T-C-025	1	ALIGNMENT SHEET	ANGP-T-C-069	1	ALIGNMENT SHEET
ANGP-T-C-026	0	ALIGNMENT SHEET	ANGP-T-C-070	1	ALIGNMENT SHEET
ANGP-T-C-027	1	ALIGNMENT SHEET	ANGP-T-C-071	0	ALIGNMENT SHEET
ANGP-T-C-028	1	ALIGNMENT SHEET	ANGP-T-C-072	0	ALIGNMENT SHEET
ANGP-T-C-028A	0	STREAM CROSSING PROFILE	ANGP-T-C-073	0	ALIGNMENT SHEET
ANGP-T-C-029	0	ALIGNMENT SHEET	ANGP-T-C-074	3	ALIGNMENT SHEET
ANGP-T-C-030	0	ALIGNMENT SHEET	ANGP-T-C-075	5	ALIGNMENT SHEET
ANGP-T-C-031	1	ALIGNMENT SHEET	ANGP-T-C-076	2	ALIGNMENT SHEET
ANGP-T-C-032	0	ALIGNMENT SHEET	ANGP-T-C-077	1	ALIGNMENT SHEET
ANGP-T-C-033	1	ALIGNMENT SHEET	ANGP-T-C-078	1	ALIGNMENT SHEET
ANGP-T-C-034	1	ALIGNMENT SHEET	ANGP-T-C-079	2	ALIGNMENT SHEET
ANGP-T-C-035	1	ALIGNMENT SHEET	ANGP-T-C-080	0	ALIGNMENT SHEET
ANGP-T-C-036	1	ALIGNMENT SHEET	ANGP-T-C-081	2	ALIGNMENT SHEET
ANGP-T-C-037	0	ALIGNMENT SHEET	ANGP-T-C-082A	0	ALIGNMENT SHEET
ANGP-T-C-038	0	ALIGNMENT SHEET	ANGP-T-C-082B	0	ALIGNMENT SHEET
ANGP-T-C-039	0	ALIGNMENT SHEET	ANGP-T-C-083A	0	ALIGNMENT SHEET
ANGP-T-C-039A	0	STREAM CROSSING PROFILE	ANGP-T-C-083B	0	ALIGNMENT SHEET
ANGP-T-C-040	1	ALIGNMENT SHEET	ANGP-T-C-084A	0	ALIGNMENT SHEET
ANGP-T-C-041	2	ALIGNMENT SHEET	ANGP-T-C-084B	1	ALIGNMENT SHEET
ANGP-T-C-042	2	ALIGNMENT SHEET	ANGP-T-C-085	0	ALIGNMENT SHEET
ANGP-T-C-042A	0	STREAM CROSSING PROFILE			
ANGP-T-C-043	2	ALIGNMENT SHEET			
ANGP-T-C-044	0	ALIGNMENT SHEET			
ANGP-T-C-045	0	ALIGNMENT SHEET			
ANGP-T-C-046	0	ALIGNMENT SHEET			
ANGP-T-C-047	1	ALIGNMENT SHEET			

DWG. NO.	REFERENCE DWG.	REV	DSN	CK	DESCRIPTION	INITIALS	DATE	INITIALS	DATE	YEAR:	W.O.	SCALE:	DWG.	REV.
		4	GJM	BCK	IFC 2016 EDITS (05/2016)	JLS	06/28/13	JLS	05/2016	2016		NOTED	ANGP-T-G-001	4
		3	BCK	TDB	CP TEST LEAD EDIT (9/14/15)	GIL	06/28/13	GJM	05/2016					
		2	GJM	TDB	VHB HDD AREA REVISIONS (6/24/15)	BZD	06/28/13	BCK	05/2016					
		1	BCK	TDB	COMPLETE PLAN SET RE-ISSUE (6/15/15)	MDF	06/28/13	GEW	05/2016					
						SAB	06/28/13	JEO	05/2016					

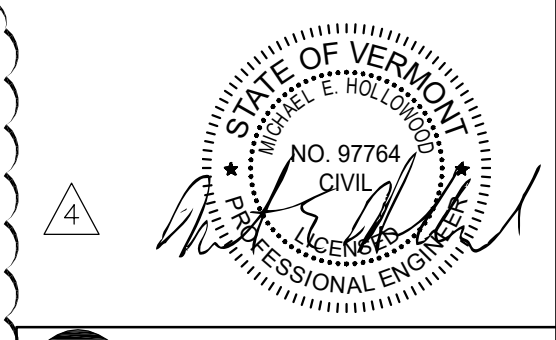


VHB Vanasse Hangen Brustlin, Inc.




38 Eastwood Drive, Suite 105
South Burlington, VT 05403
Main: (802) 795-0372 - www.ch2m.companies.com


CHITTENDEN AND ADDISON COUNTIES
VERMONT

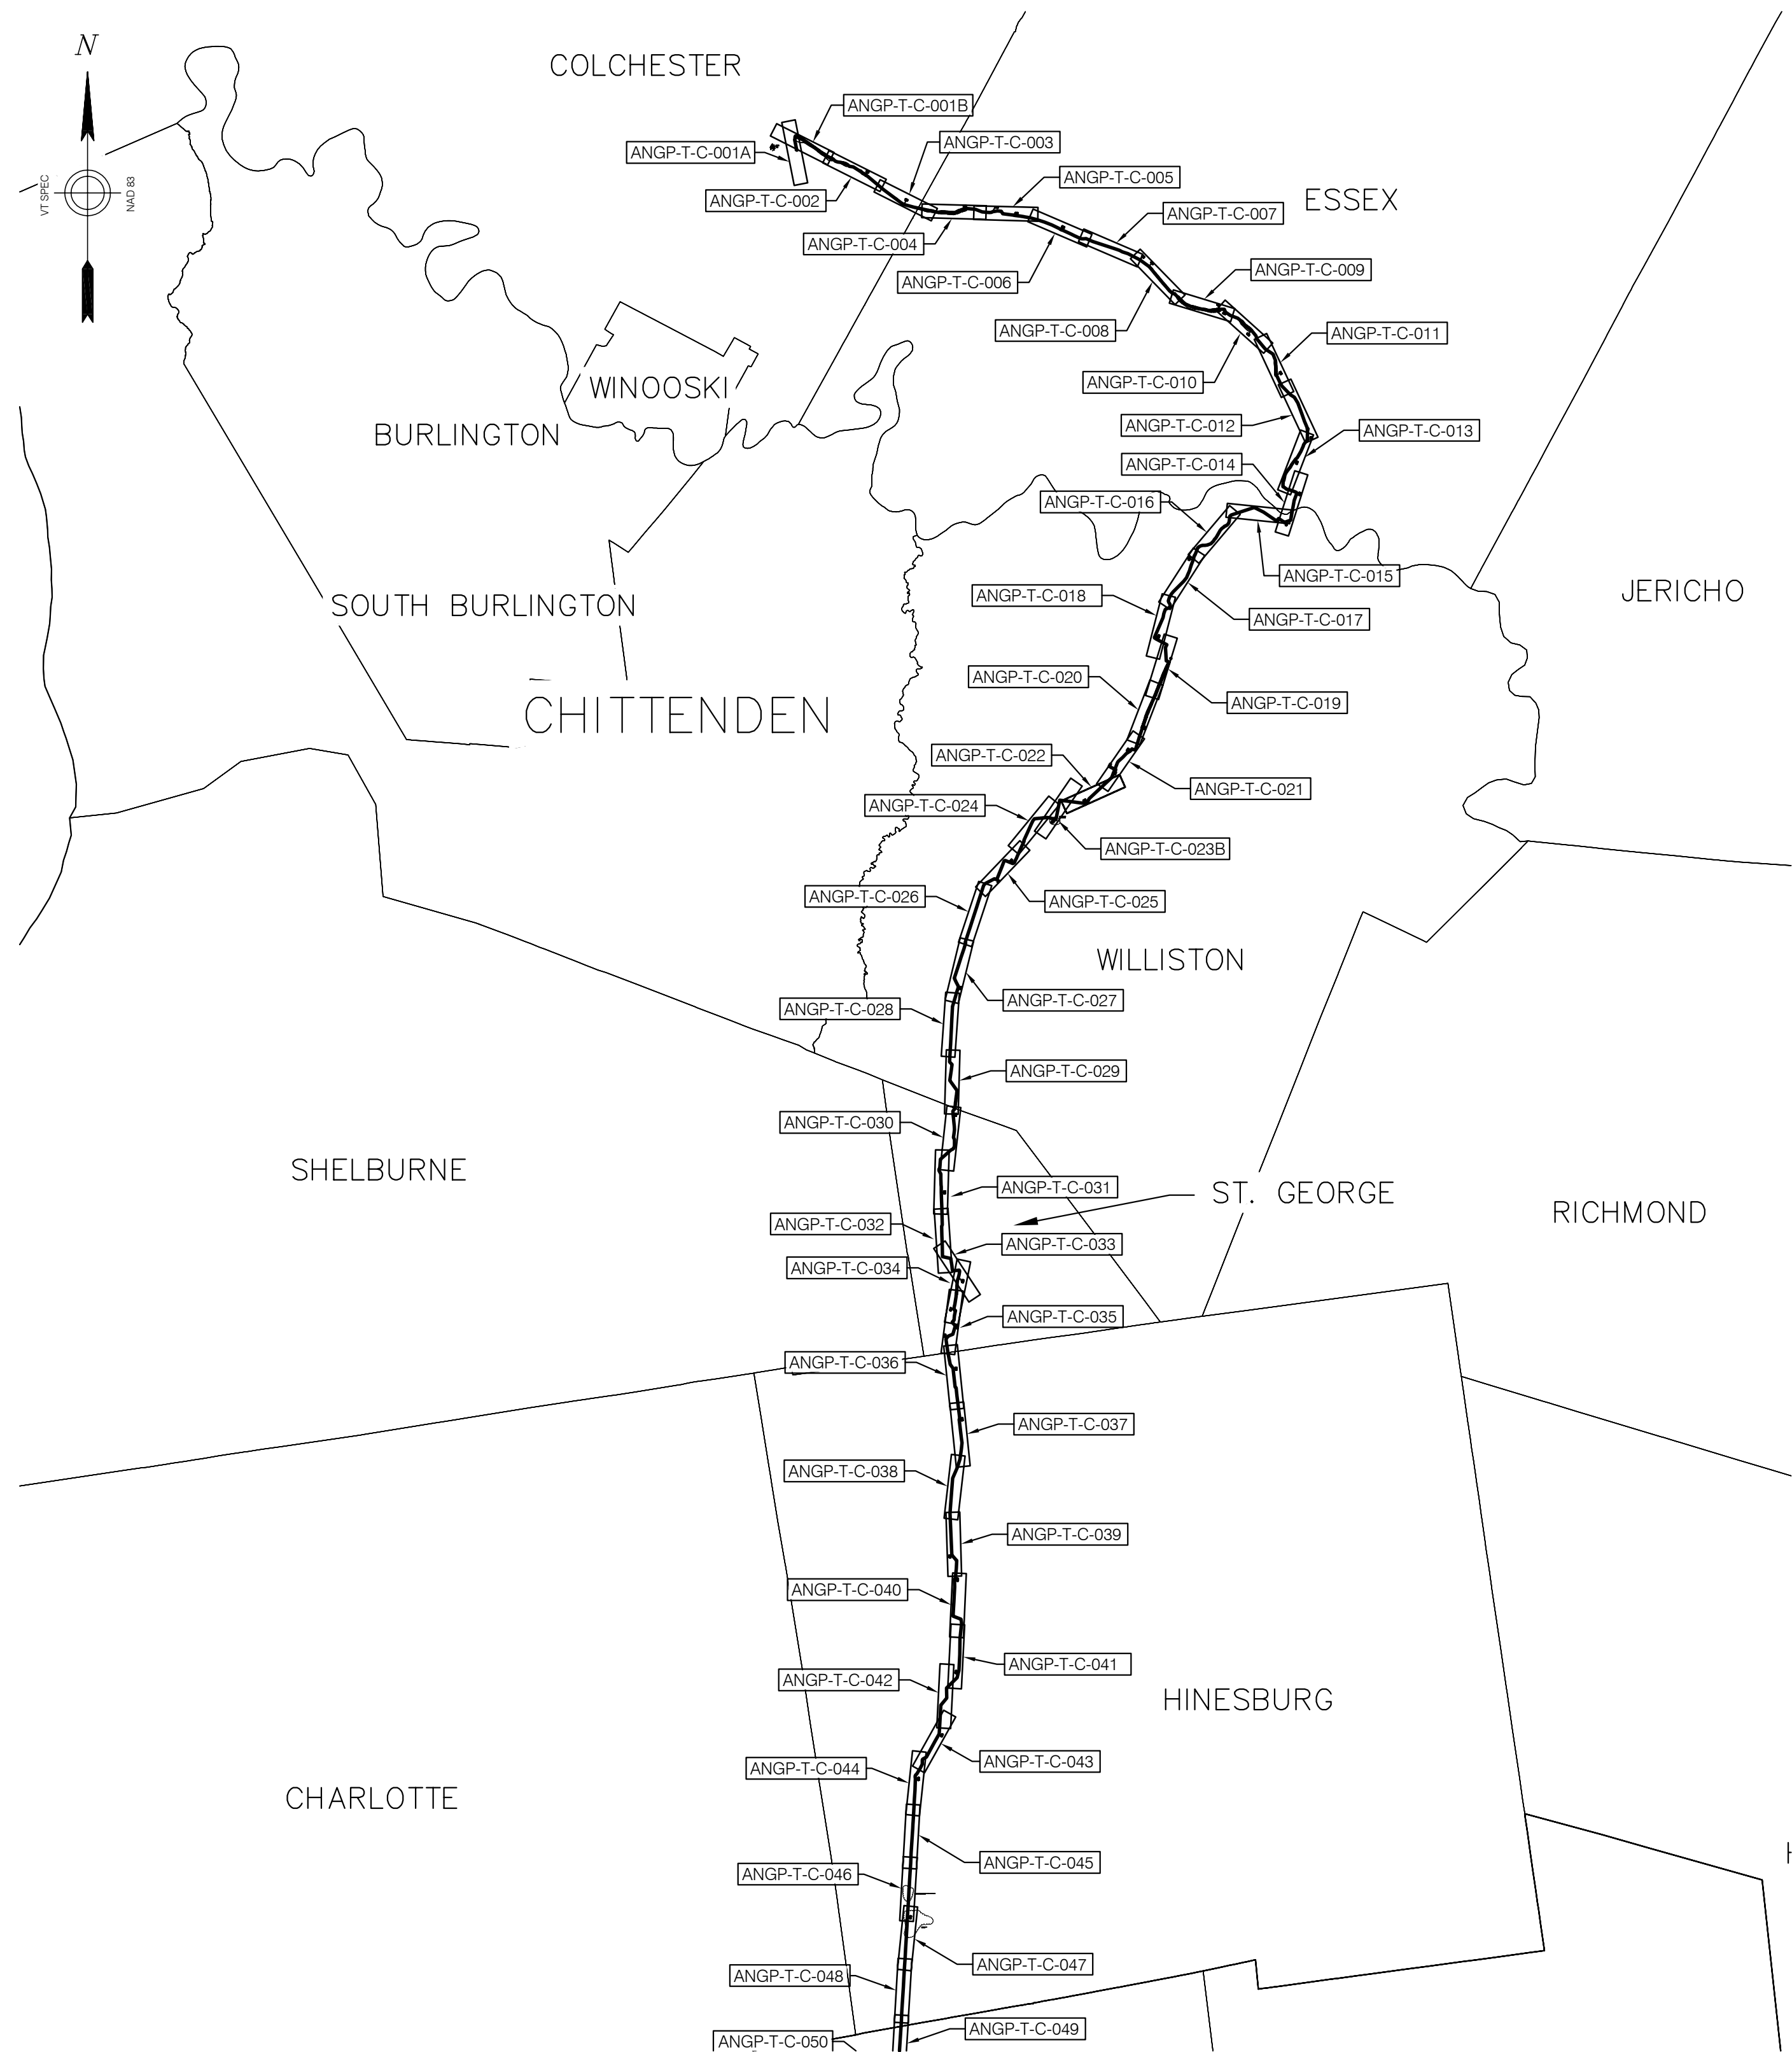

SCALE 1" = 500'

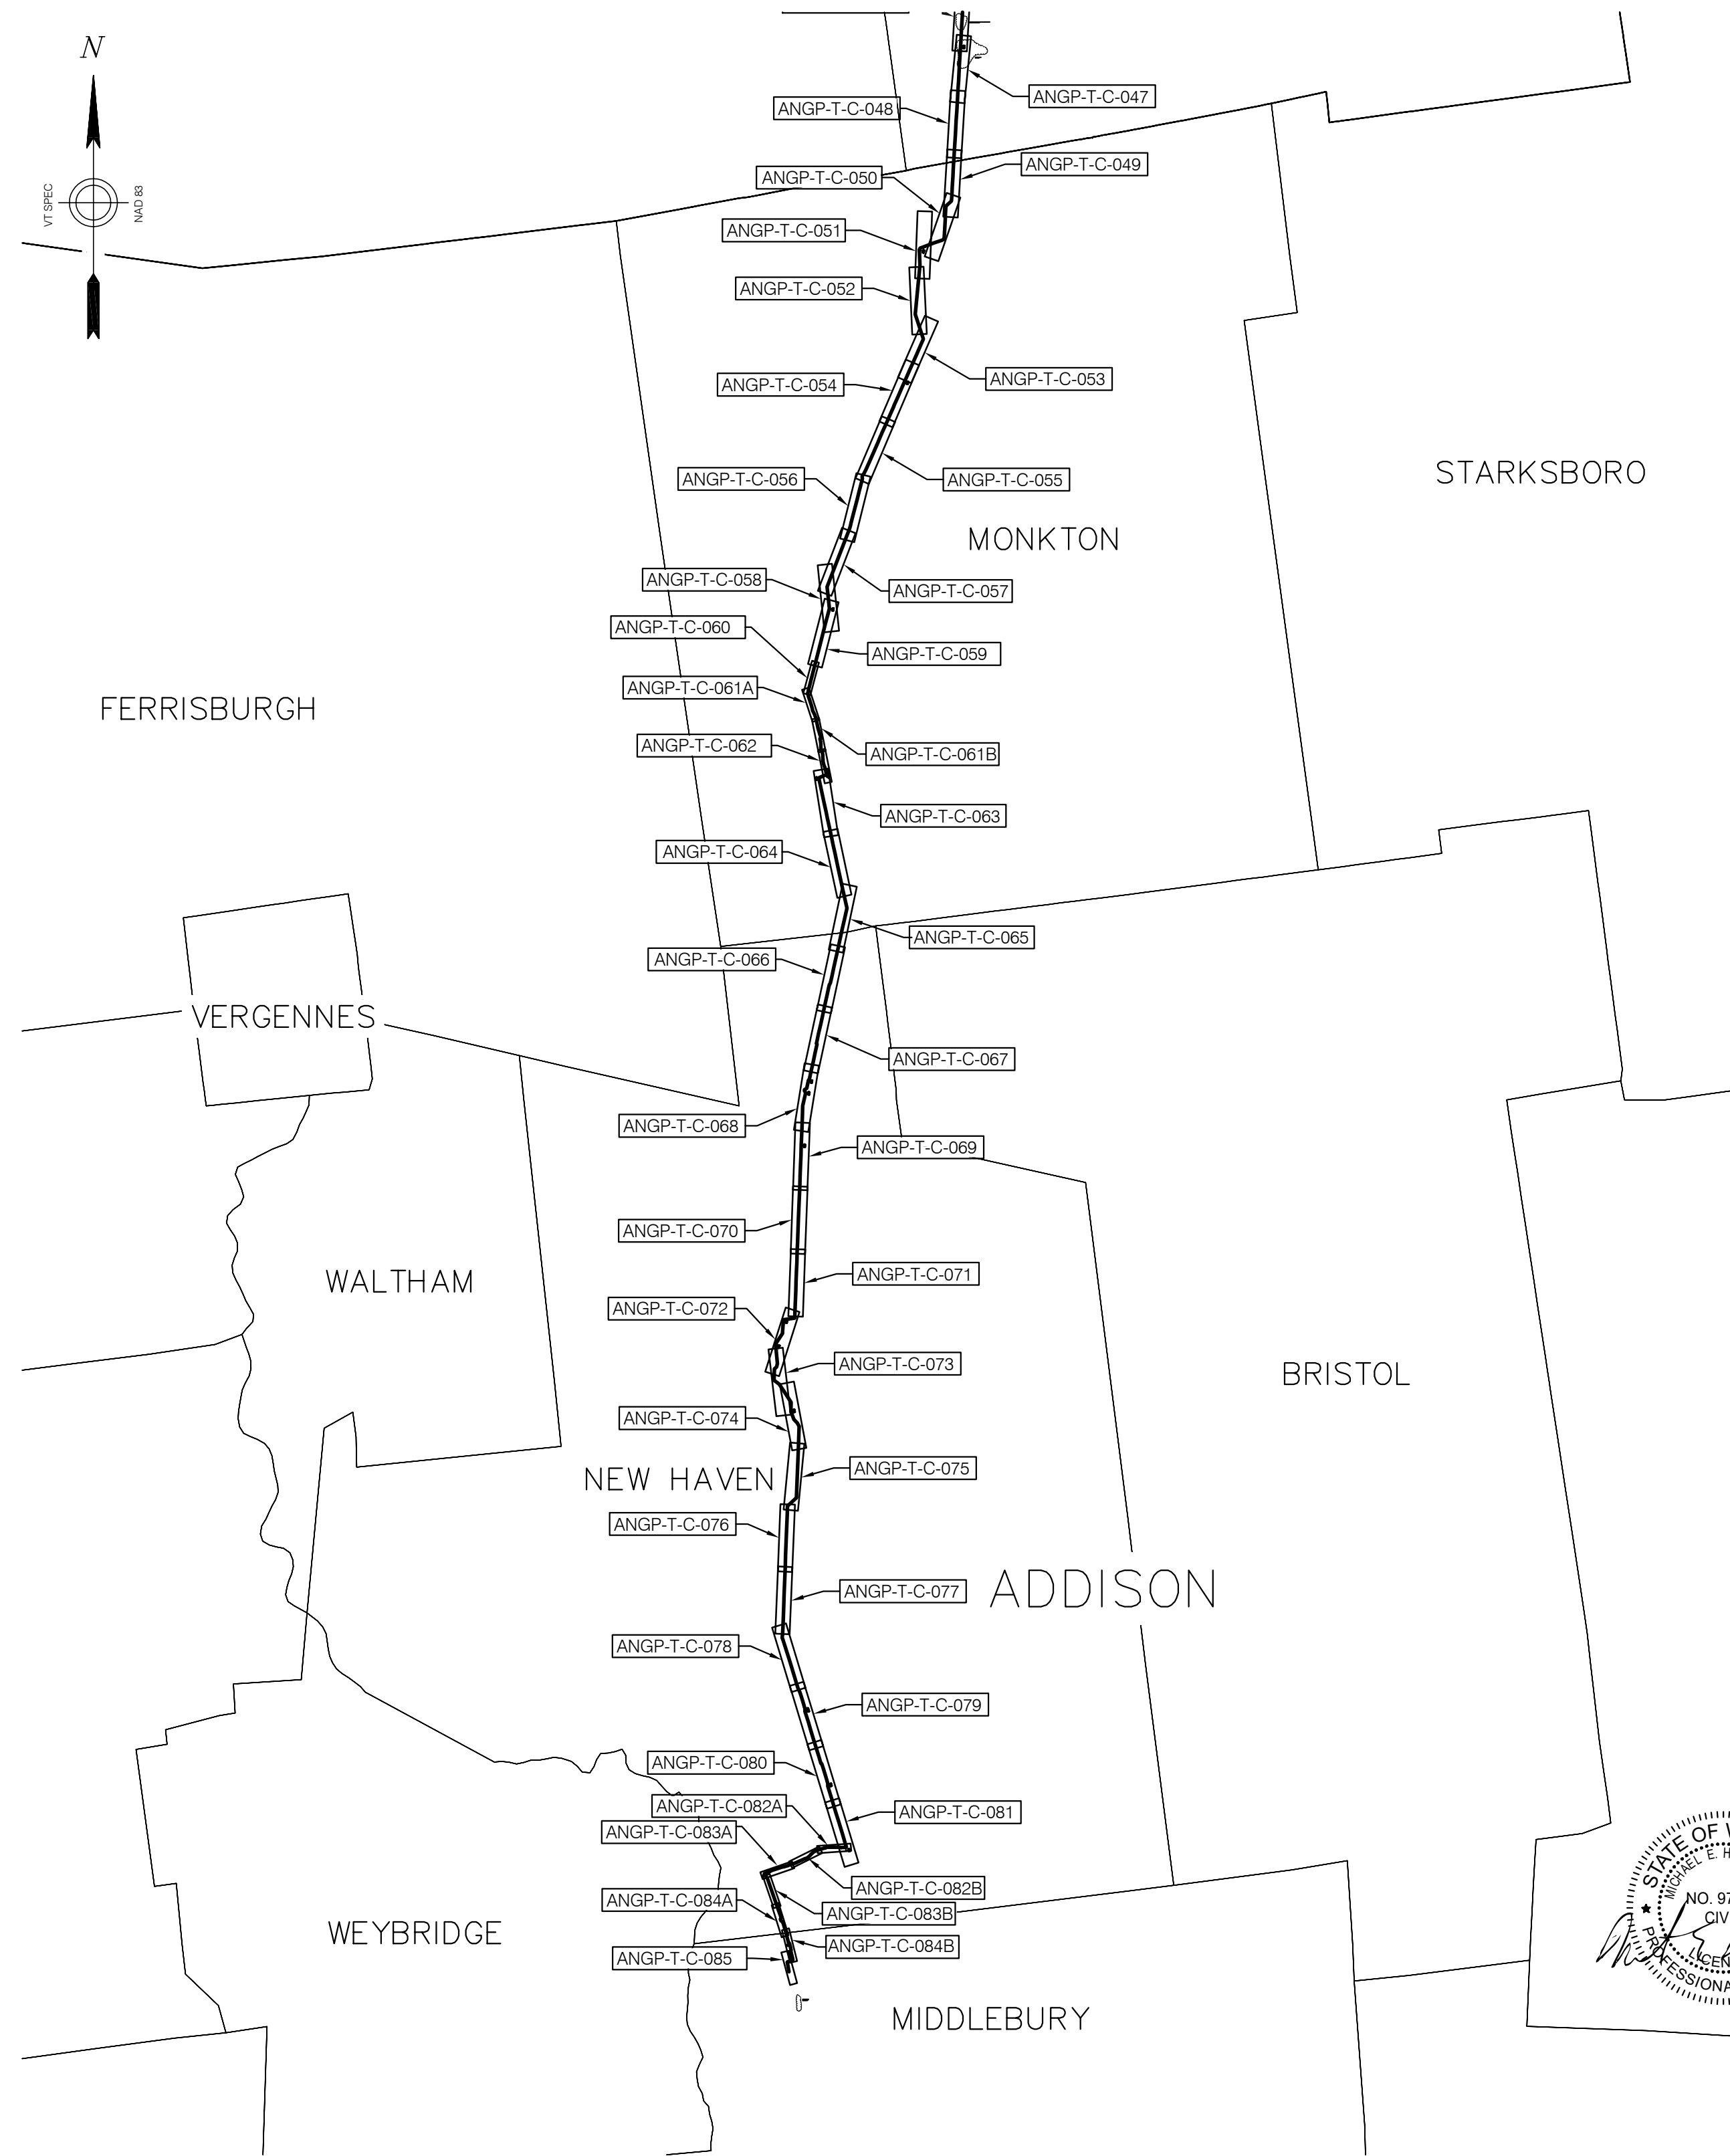

SCALE 1" = 500'

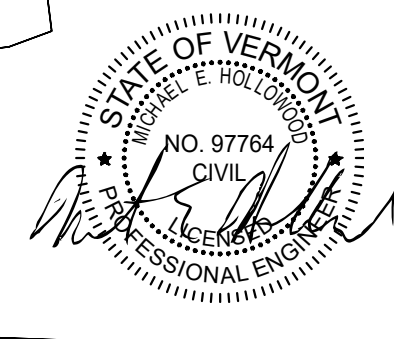

DWG. NO.	REFERENCE DWG.	REV	DSN	CK	DESCRIPTION	INITIALS	DATE	INITIALS	DATE	YEAR:	W.O.	SCALE:	DWG.	REV.
										2016		1"=500'	ANGP-T-G-002	0

	BID	CONSTRUCTION
ENVIRONMENTAL	JLS 06/28/13	JLS 05/2016
DRAFTING DESIGNER	GIL 06/28/13	GJM 05/2016
DRAFTING SUPERVISOR	BZD 06/28/13	BCK 05/2016
DESIGN ENGINEER	MDF 06/28/13	GEW 05/2016
DESIGN MANAGER	SAB 06/28/13	JEO 05/2016

VERMONT GAS
PROPOSED 12" PIPELINE
ADDISON NATURAL GAS PROJECT
INDEX SHEET
LOC. CHITTENDEN & ADDISON COUNTIES

CHA
38 Eastwood Drive, Suite 105
South Burlington, VT 05403
Main: (802) 795-0372 • www.chacompanies.com


VHB Vanasse Hangen Brustlin, Inc.

CHITTENDEN AND ADDISON COUNTIES

VERMONT

QUANTITIES

MATERIAL QUANTITIES (FT)

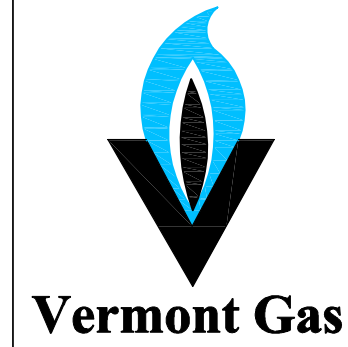


Vermont Gas

SHEET NUMBERS

Table with columns for PIPE and COATING types (1, 2, A, B, C) and their respective lengths in feet. Includes a 'TOTAL =' row at the bottom.

NOTE: STATIONING ON THE PIPE ALIGNMENT UTILIZES STATION EQUATIONS IN SEVERAL LOCATIONS. STATION EQUATION CALL-OUTS NOTED ON THE PLAN VIEWS INDICATE THE CORRECT 'BACK' AND 'AHEAD' STATIONS...

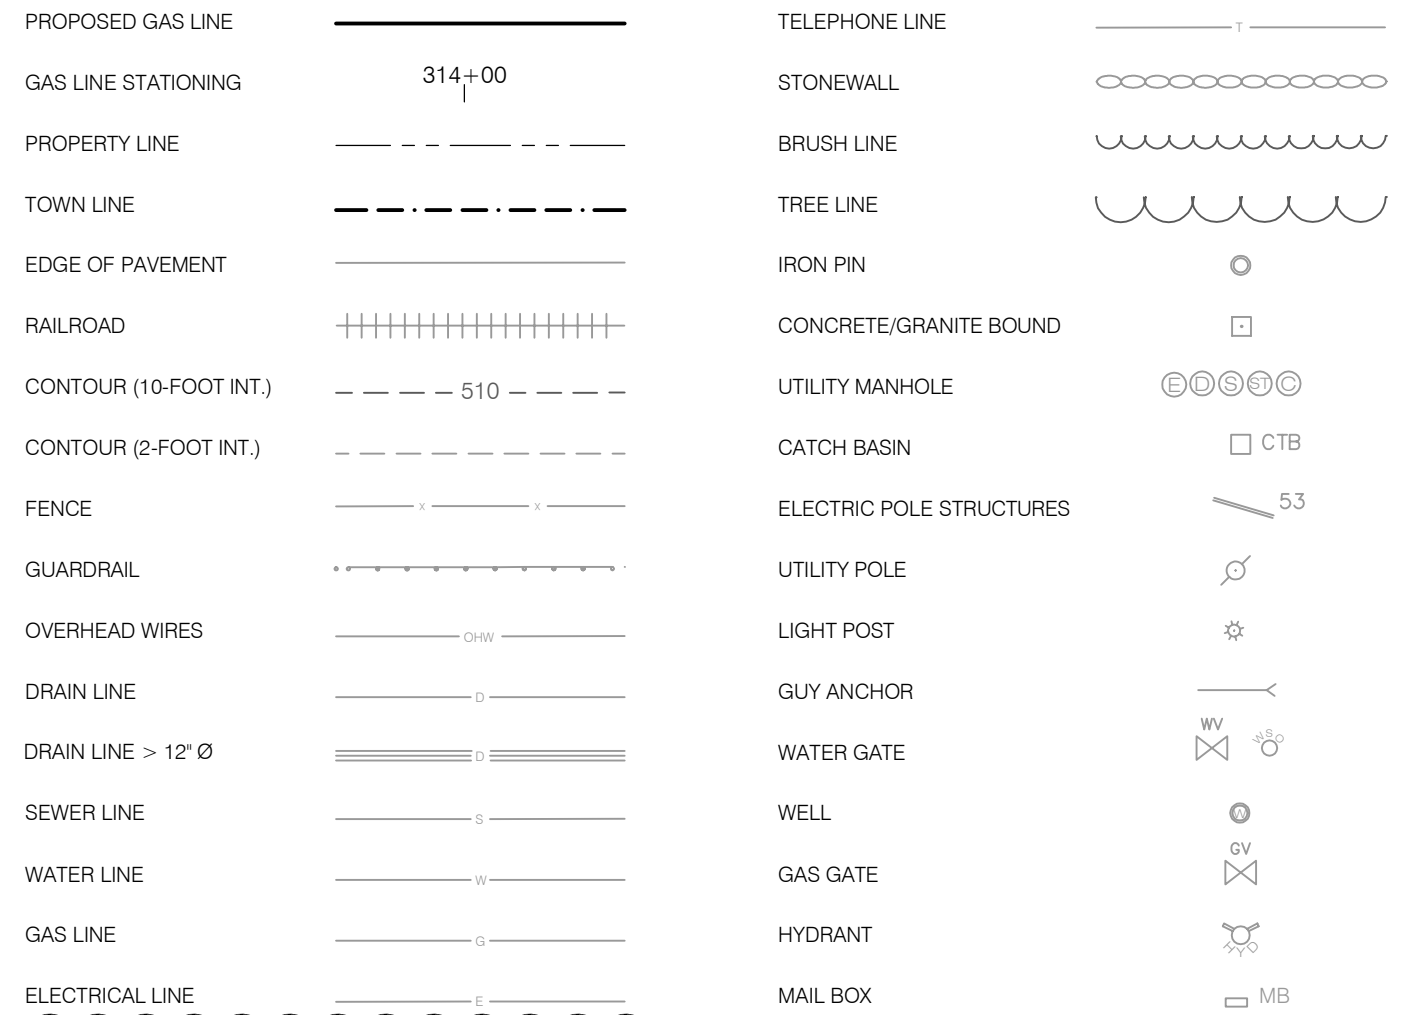


ABBREVIATIONS

Table of abbreviations and their meanings, such as ELFC for Electric Fence, FEMA for Federal Emergency Management Agency, etc.


CONSTRUCTION NOTES

- 1. PROPOSED PIPE IS 12.75" O.D. ITS WALL THICKNESS AND PROTECTIVE COATINGS VARY DEPENDING ON CLASS DETERMINATION AND SITE CONDITIONS.
2. AREAS WHERE THE PIPE IS INSTALLED IN ROCK TRENCH SHALL REQUIRE THE EPOXY POLYETHYLENE 10/40 COATED PIPE TO BE WRAPPED WITH TUFF NUFF ROCK SHIELD.
3. ALL CONSTRUCTION MUST CONFORM TO FEDERAL SPECIFICATIONS, PART 192 IN TITLE 49 GFR AND APPLICABLE, STATE AND LOCAL REGULATIONS.

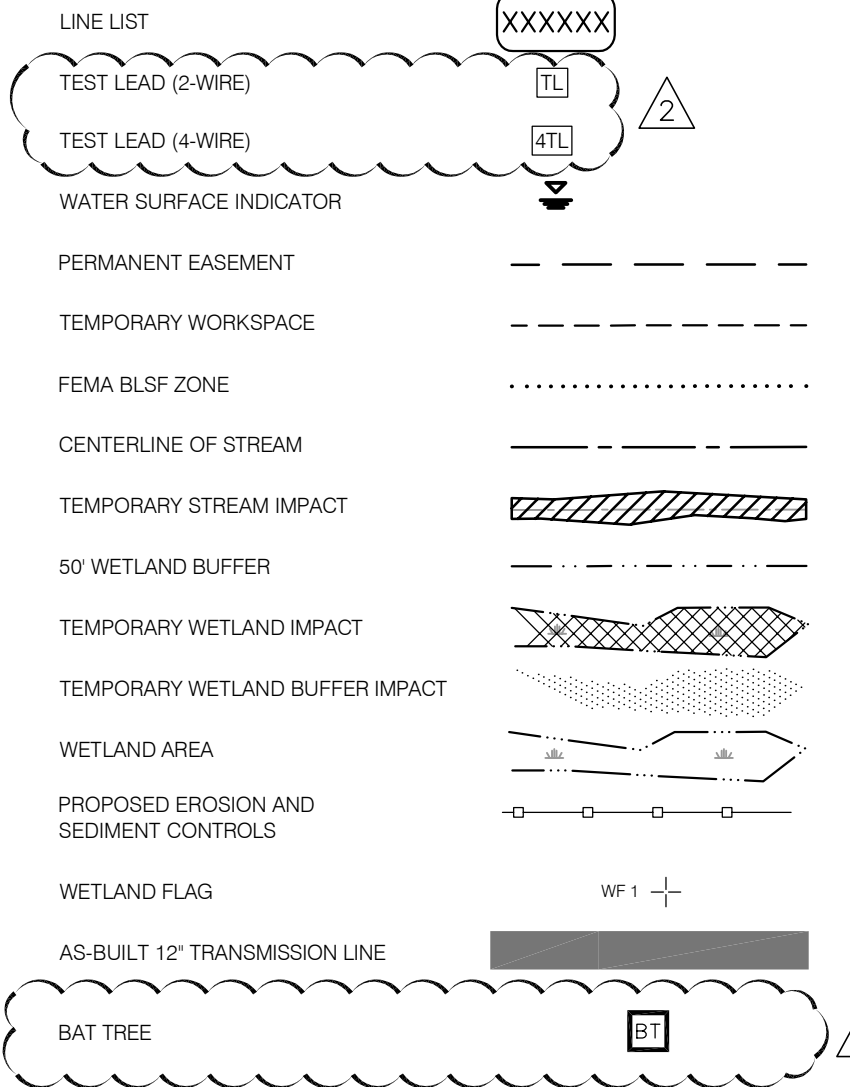


GENERAL NOTES

- 1. TOPOGRAPHICAL DETAIL SHOWN HEREON IS THE RESULT OF SURVEY CONDUCTED BY CHA IN THE SUMMER AND FALL OF 2012 AND THE COMPILATION OF EXISTING TOPOGRAPHIC DATA PROVIDED BY THE VERMONT AGENCY OF TRANSPORTATION (VTTRANS) AND THE VERMONT TRANSMISSION COMPANY (VELCO).
2. PROPERTY LINES SHOWN HEREON ARE BASED ON TAX MAP AND DO NOT REPRESENT A PROPERTY LINE RETRACEMENT SURVEY EFFORT.

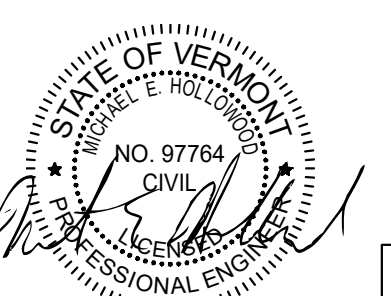

VHB Vanasse Hangen Brustlin, Inc.


Table with columns for DWG. NO., REFERENCE DWG., REV, DSN, CK, DESCRIPTION, BID, CONSTRUCTION, and project details like 'VERMONT GAS PROPOSED 12" PIPELINE ADDISON NATURAL GAS PROJECT'.

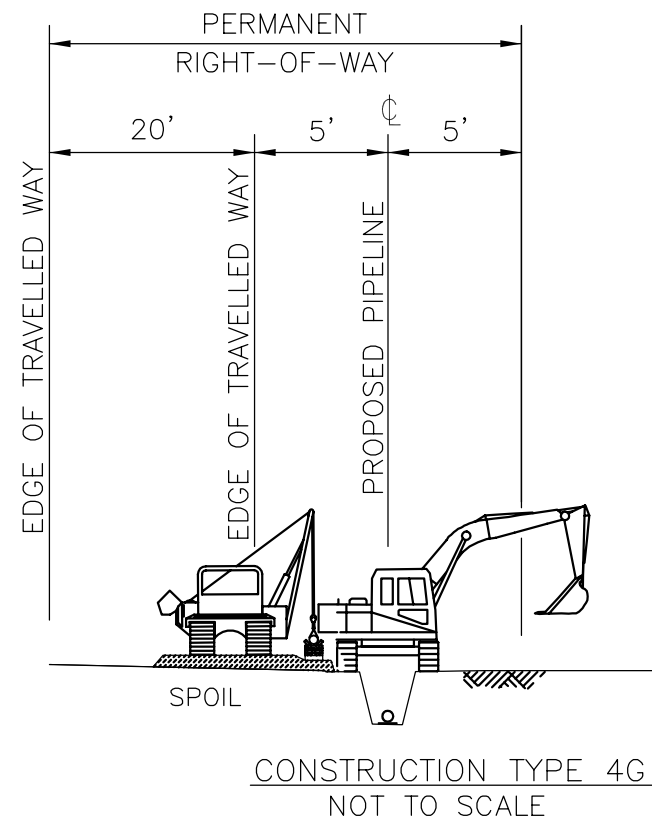

CONSTRUCTION TYPE 4G
NOT TO SCALE

NOTE:


1. THIS CONFIGURATION IS FOR ROADSIDE CONSTRUCTION SPACE AND DOES NOT DEPICT ADDITIONAL TEMP. WORKSPACE.
2. ADDITIONAL TEMP. WORKSPACE HAS BEEN TYPICALLY INCORPORATED ON THE ALIGNMENT SHEETS FOR AREAS SUCH AS ROAD, RIVER/STREAM/WATERBODY, AND ARCHEOLOGICAL SITE CROSSINGS WHERE HORIZONTAL DIRECTIONAL DRILL CONSTRUCTION HAS BEEN PROPOSED.
3. FOR AREAS DESIGNATED AS PRIME AGRICULTURAL SOILS (PAS) IN THE SOIL TYPE BAND OF THE EPSC SHEETS, SEE "CONSTRUCTION WITHIN PRIME AGRICULTURAL SOILS (PAS) AREAS" FOR SOIL SEGREGATION AND ASSOCIATED CONSTRUCTION PROCEDURES.
4. SEE ALIGNMENT SHEETS FOR LOCATIONS OF THIS CONFIGURATION.
5. SEE DETAIL #7 ON ANGP-T-G-015 FOR PIPELINE MINIMUM COVER REQUIREMENTS.

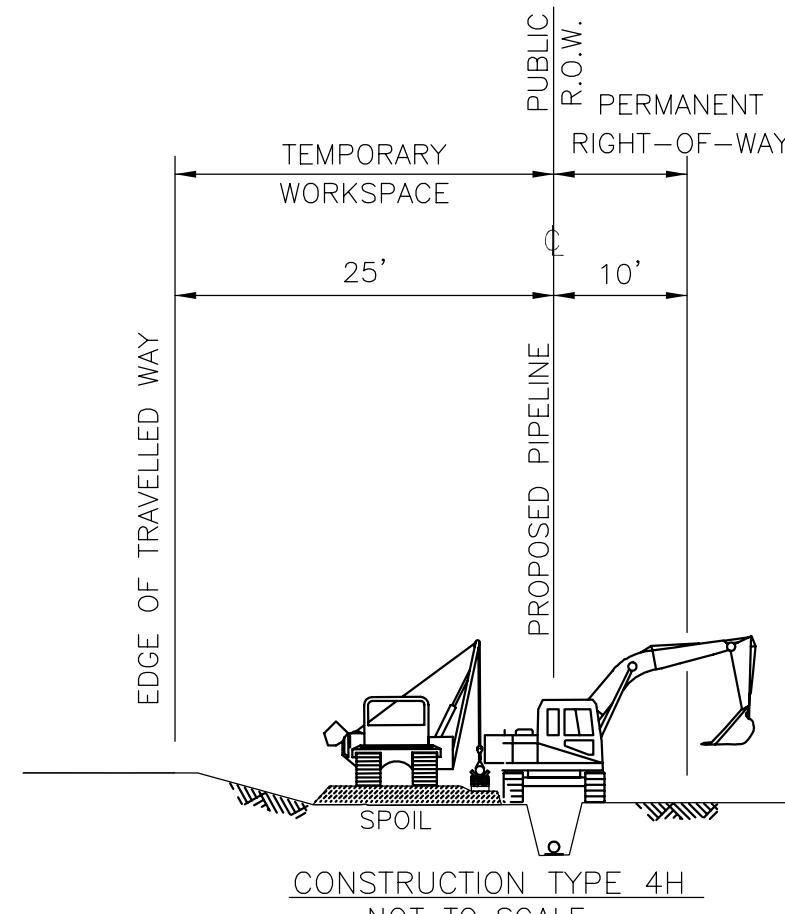

CONSTRUCTION TYPE 4H
NOT TO SCALE

NOTE:


1. THIS CONFIGURATION IS FOR ROADSIDE CONSTRUCTION SPACE AND DOES NOT DEPICT ADDITIONAL TEMP. WORKSPACE.
2. ADDITIONAL TEMP. WORKSPACE HAS BEEN TYPICALLY INCORPORATED ON THE ALIGNMENT SHEETS FOR AREAS SUCH AS ROAD, RIVER/STREAM/WATERBODY, AND ARCHEOLOGICAL SITE CROSSINGS WHERE HORIZONTAL DIRECTIONAL DRILL CONSTRUCTION HAS BEEN PROPOSED.
3. FOR AREAS DESIGNATED AS PRIME AGRICULTURAL SOILS (PAS) IN THE SOIL TYPE BAND OF THE EPSC SHEETS, SEE "CONSTRUCTION WITHIN PRIME AGRICULTURAL SOILS (PAS) AREAS" FOR SOIL SEGREGATION AND ASSOCIATED CONSTRUCTION PROCEDURES.
4. SEE ALIGNMENT SHEETS FOR LOCATIONS OF THIS CONFIGURATION.
5. SEE DETAIL #7 ON ANGP-T-G-015 FOR PIPELINE MINIMUM COVER REQUIREMENTS.

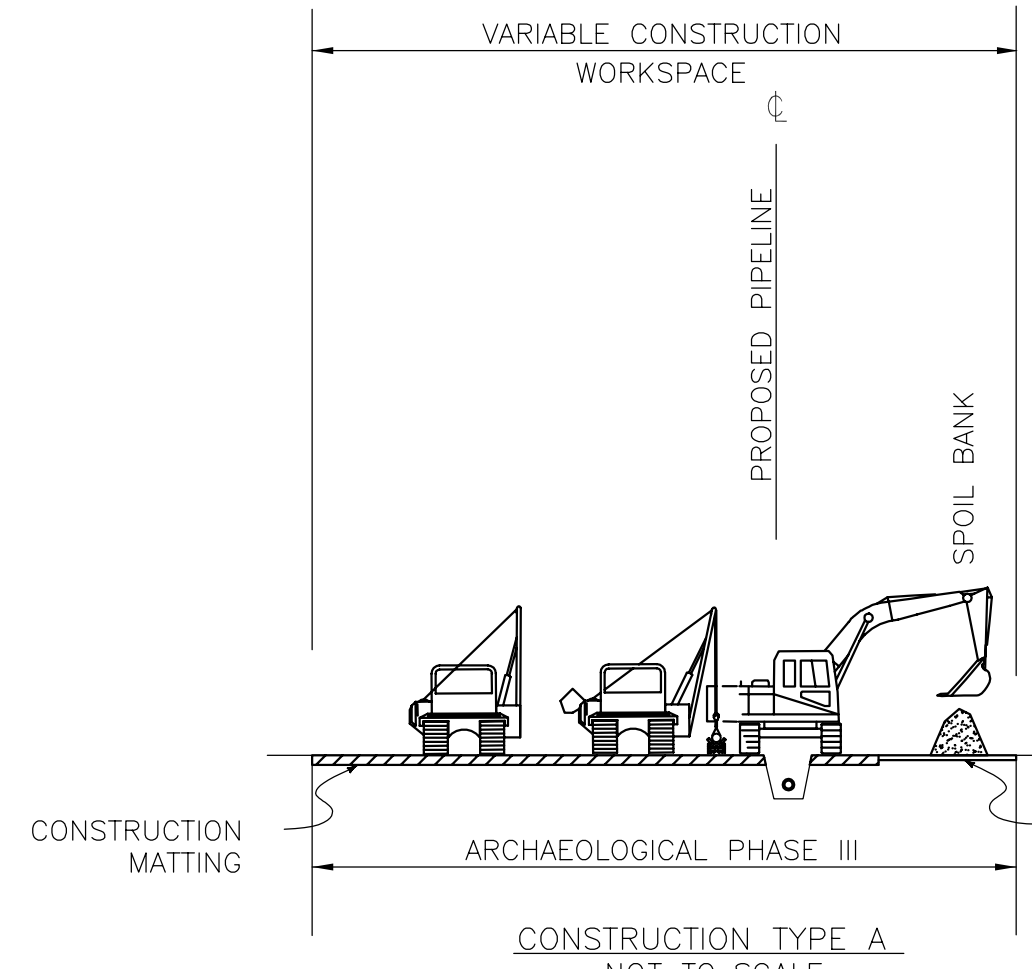

CONSTRUCTION TYPE A
NOT TO SCALE

NOTE:


1. THIS CONFIGURATION IS FOR VARIABLE CONSTRUCTION SPACE IN "ARCHEOLOGICAL PHASE III" AREAS AND DOES NOT DEPICT ADDITIONAL TEMP. WORKSPACE. THE PHASE III AREAS ARE AS FOLLOWS: VT-AD-483, LOCUS 2 (8/14/2013), VT-CH-414 (8/14/2013), VT-AD-456, LOCUS 3, VT-AD-1559, VT-AD-138, LOCUS 2 (8/14/2013), VT-AD-87, LOCUS 2 (8/14/2013), VT-AD-446, VT-AD-793, VT-AD-808 LOCUS 1 AND 2, VT-CH-103, VT-AD-1623.
2. ADDITIONAL TEMP. WORKSPACE HAS BEEN TYPICALLY INCORPORATED ON THE ALIGNMENT & EPSC SHEETS FOR AREAS SUCH AS ROAD, RIVER/STREAM/WATERBODY, AND ARCHEOLOGICAL SITE CROSSINGS WHERE HORIZONTAL DIRECTIONAL DRILL CONSTRUCTION HAS BEEN PROPOSED.
3. SEE ALIGNMENT & EPSC SHEETS FOR LOCATIONS OF THIS CONSTRUCTION CONFIGURATION.
4. WHEN BACKFILLING, SOILS SHALL BE REPLACED IN ORDER THEY WERE EXCAVATED, WITH TOPSOIL AS UPPER LAYER FILL AND COMPACT SUBSOIL TO DEPTH OF ADJACENT NATIVE SUBSOIL/TOPSOIL INTERFACE. REPLACE TOPSOIL AS UPPER LAYER AND BLEND TO EXISTING GRADE OF UNDISTURBED SOILS. DISPOSE OF EXCESS SUBSOIL AT SUITABLE LOCATION AS APPROVED BY THE OSPC.
5. SEE EPSC PLAN "ADDITIONAL ENVIRONMENTAL NOTES" FOR ADDITIONAL INSTRUCTIONS RELATED TO CONSTRUCTION IN "ARCHEOLOGICAL PHASE III" AREAS, INCLUDING FINAL STABILIZATION NOTES.
6. SEE DETAIL #7 ON ANGP-T-G-015 FOR PIPELINE MINIMUM COVER REQUIREMENTS.

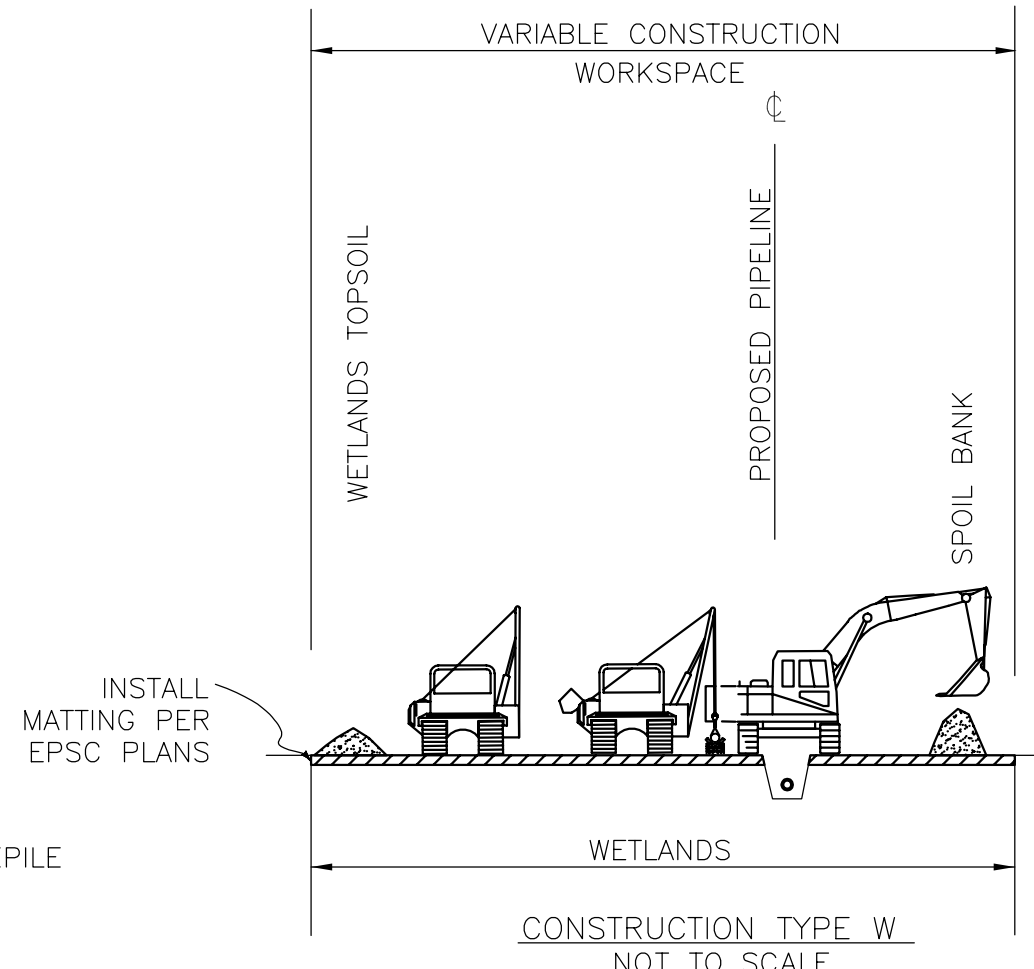

CONSTRUCTION TYPE W
NOT TO SCALE

NOTE:


1. THIS CONFIGURATION IS FOR VARIABLE CONSTRUCTION SPACE IN WETLANDS AND DOES NOT DEPICT ADDITIONAL TEMP. WORKSPACE.
2. ADDITIONAL TEMP. WORKSPACE HAS BEEN TYPICALLY INCORPORATED ON THE ALIGNMENT & EPSC SHEETS FOR AREAS SUCH AS ROAD, RIVER/STREAM/WATERBODY, AND ARCHEOLOGICAL SITE CROSSINGS WHERE HORIZONTAL DIRECTIONAL DRILL CONSTRUCTION HAS BEEN PROPOSED.
3. SEE ALIGNMENT & EPSC SHEETS FOR LOCATIONS OF THIS CONFIGURATION.
4. WHEN BACK-PILING, SOILS SHALL BE REPLACED IN ORDER THEY WERE EXCAVATED, WITH TOPSOIL AS UPPER LAYER FILL AND COMPACT SUBSOIL TO DEPTH OF ADJACENT NATIVE SUBSOIL/TOPSOIL INTERFACE. REPLACE TOPSOIL AS UPPER LAYER AND BLEND TO EXISTING GRADE OF UNDISTURBED SOILS. DISPOSE OF EXCESS SUBSOIL AT SUITABLE LOCATION AS APPROVED BY THE OSPC.
5. SEE EPSC PLAN "ADDITIONAL ENVIRONMENTAL NOTES" FOR ADDITIONAL INSTRUCTIONS RELATED TO CONSTRUCTION IN WETLANDS, INCLUDING FINAL STABILIZATION NOTES.
6. SEE DETAIL #7 ON ANGP-T-G-015 FOR PIPELINE MINIMUM COVER REQUIREMENTS.

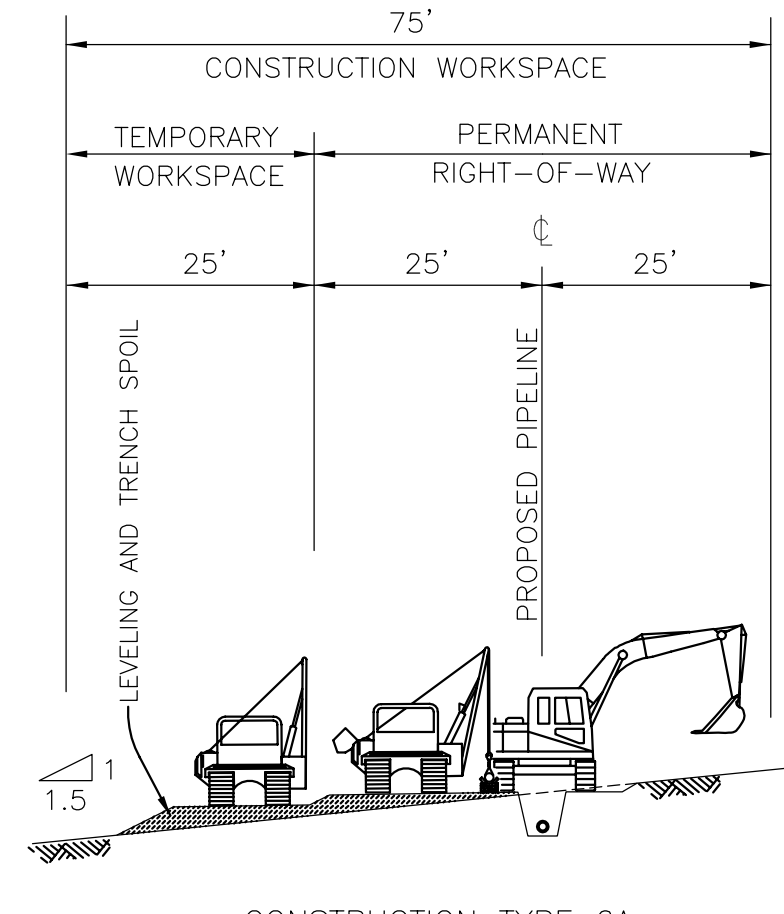

CONSTRUCTION TYPE 6A
NOT TO SCALE

NOTE:


1. THIS CONFIGURATION IS FOR SIDE HILL SLOPE CONSTRUCTION AND DOES NOT DEPICT ADDITIONAL TEMP. WORKSPACE.
2. ADDITIONAL TEMP. WORKSPACE HAS BEEN TYPICALLY INCORPORATED ON THE ALIGNMENT SHEETS FOR AREAS SUCH AS ROAD, RIVER/STREAM/WATERBODY, AND ARCHEOLOGICAL SITE CROSSINGS WHERE HORIZONTAL DIRECTIONAL DRILL CONSTRUCTION HAS BEEN PROPOSED.
3. FOR AREAS DESIGNATED AS PRIME AGRICULTURAL SOILS (PAS) IN THE SOIL TYPE BAND OF THE EPSC SHEETS, SEE "CONSTRUCTION WITHIN PRIME AGRICULTURAL SOILS (PAS) AREAS" FOR SOIL SEGREGATION AND ASSOCIATED CONSTRUCTION PROCEDURES.
4. SEE ALIGNMENT SHEETS FOR LOCATIONS OF THIS CONFIGURATION.
5. SEE DETAIL #7 ON ANGP-T-G-015 FOR PIPELINE MINIMUM COVER REQUIREMENTS.

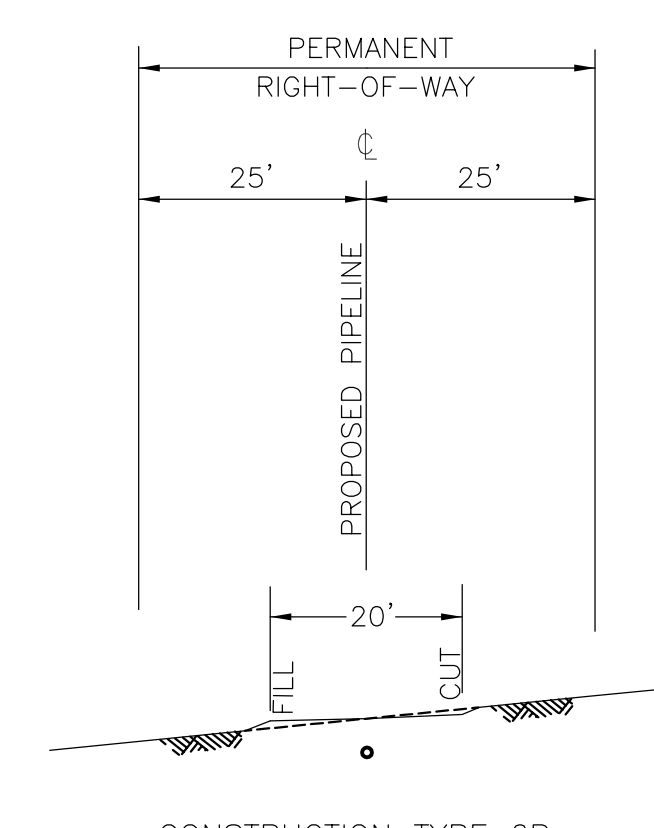

CONSTRUCTION TYPE 6B
NOT TO SCALE
POST CONSTRUCTION

NOTE:


1. THIS CONFIGURATION IS FOR SIDE HILL SLOPE CONSTRUCTION AND DOES NOT DEPICT ADDITIONAL TEMP. WORKSPACE.
2. ADDITIONAL TEMP. WORKSPACE HAS BEEN TYPICALLY INCORPORATED ON THE ALIGNMENT SHEETS FOR AREAS SUCH AS ROAD, RIVER/STREAM/WATERBODY, AND ARCHEOLOGICAL SITE CROSSINGS WHERE HORIZONTAL DIRECTIONAL DRILL CONSTRUCTION HAS BEEN PROPOSED.
3. SEE DETAIL #7 ON ANGP-T-G-015 FOR PIPELINE MINIMUM COVER REQUIREMENTS.

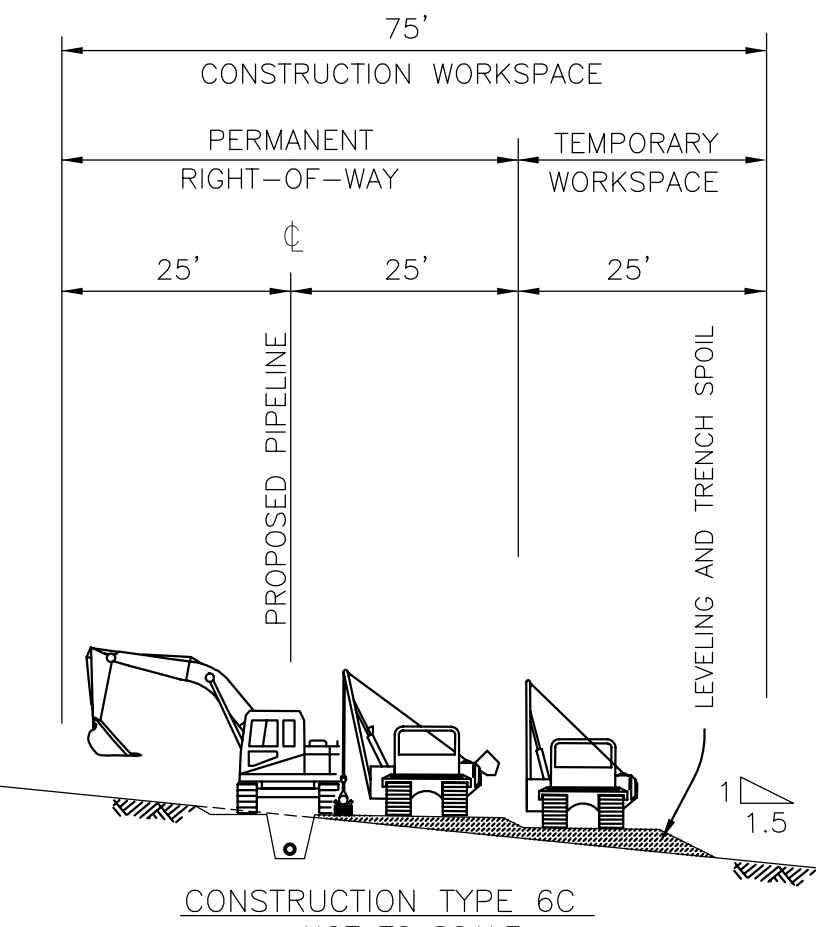

CONSTRUCTION TYPE 6C
NOT TO SCALE

NOTE:


1. THIS CONFIGURATION IS FOR SIDE HILL SLOPE CONSTRUCTION AND DOES NOT DEPICT ADDITIONAL TEMP. WORKSPACE.
2. ADDITIONAL TEMP. WORKSPACE HAS BEEN TYPICALLY INCORPORATED ON THE ALIGNMENT SHEETS FOR AREAS SUCH AS ROAD, RIVER/STREAM/WATERBODY, AND ARCHEOLOGICAL SITE CROSSINGS WHERE HORIZONTAL DIRECTIONAL DRILL CONSTRUCTION HAS BEEN PROPOSED.
3. FOR AREAS DESIGNATED AS PRIME AGRICULTURAL SOILS (PAS) IN THE SOIL TYPE BAND OF THE EPSC SHEETS, SEE "CONSTRUCTION WITHIN PRIME AGRICULTURAL SOILS (PAS) AREAS" FOR SOIL SEGREGATION AND ASSOCIATED CONSTRUCTION PROCEDURES.
4. SEE ALIGNMENT SHEETS FOR LOCATIONS OF THIS CONFIGURATION.
5. SEE DETAIL #7 ON ANGP-T-G-015 FOR PIPELINE MINIMUM COVER REQUIREMENTS.

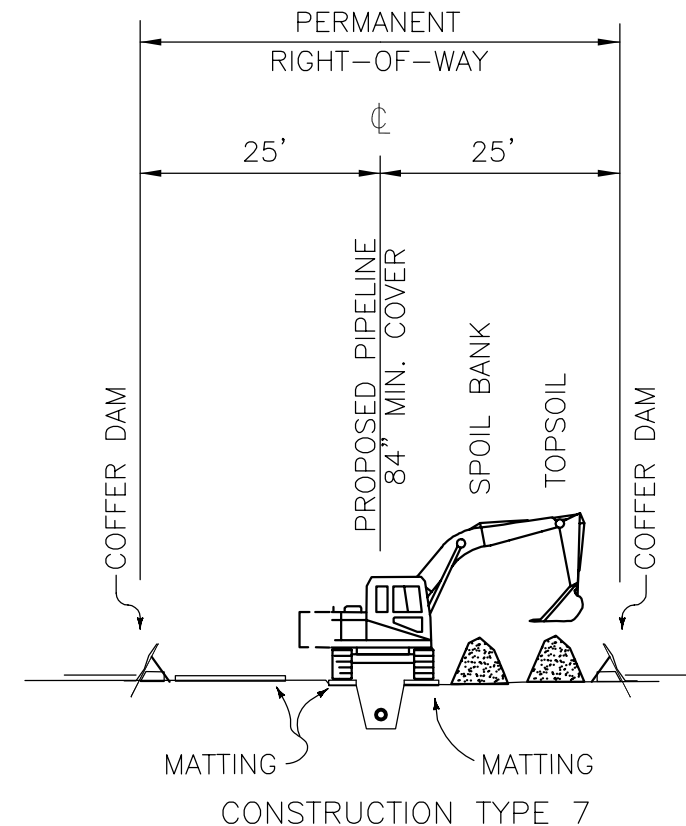

CONSTRUCTION TYPE 7
NOT TO SCALE

NOTE:


1. THIS CONFIGURATION IS FOR STREAM CROSSING AND DOES NOT DEPICT ADDITIONAL TEMP. WORKSPACE.
2. ADDITIONAL TEMP. WORKSPACE HAS BEEN TYPICALLY INCORPORATED ON THE ALIGNMENT SHEETS FOR AREAS SUCH AS ROAD, RIVER/STREAM/WATERBODY, AND ARCHEOLOGICAL SITE CROSSINGS WHERE HORIZONTAL DIRECTIONAL DRILL CONSTRUCTION HAS BEEN PROPOSED.
3. FOR AREAS DESIGNATED AS PRIME AGRICULTURAL SOILS (PAS) IN THE SOIL TYPE BAND OF THE EPSC SHEETS, SEE "CONSTRUCTION WITHIN PRIME AGRICULTURAL SOILS (PAS) AREAS" FOR SOIL SEGREGATION AND ASSOCIATED CONSTRUCTION PROCEDURES.
4. SEE ALIGNMENT SHEETS FOR LOCATIONS OF THIS CONFIGURATION.

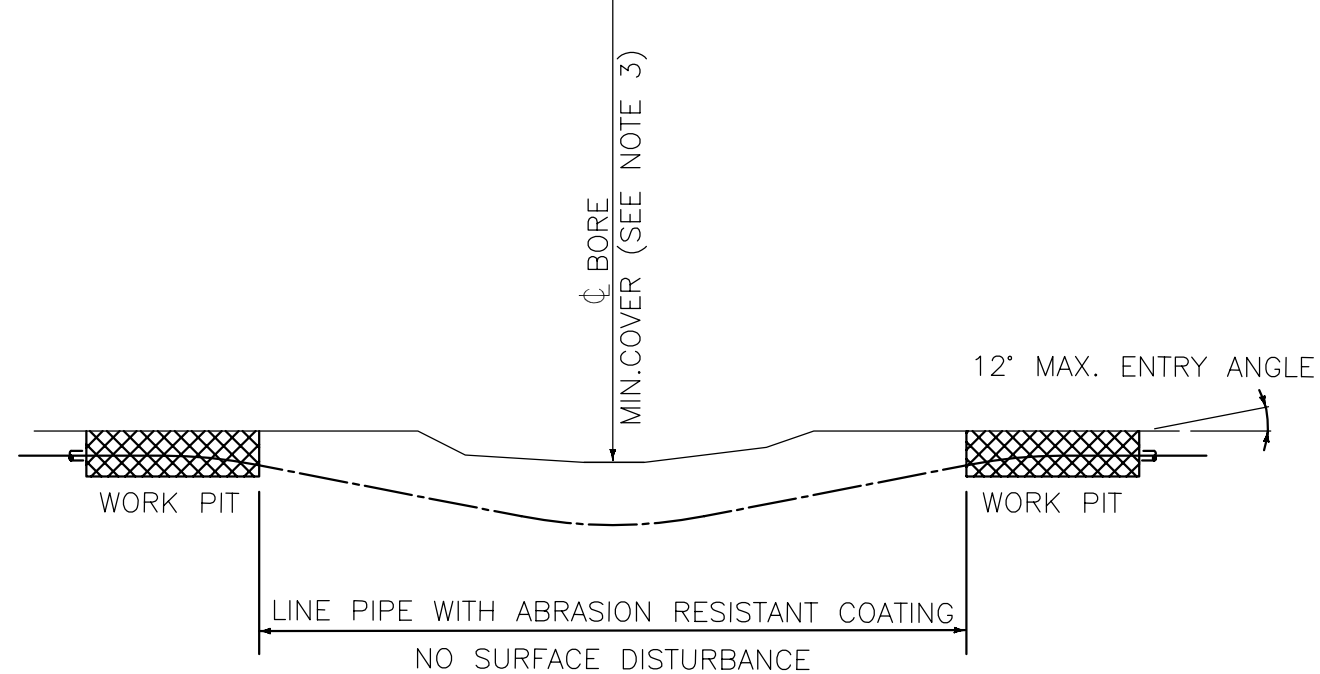

CONSTRUCTION TYPE 8
NOT TO SCALE

NOTE:


1. THIS CONFIGURATION IS FOR OPTIONAL STREAM OR ROAD CROSSING HORIZONTAL DIRECTIONAL DRILL.
2. SEE ALIGNMENT SHEETS FOR LOCATIONS OF THIS CONFIGURATION.
3. SEE TABLE ON ANGP-T-G-020 FOR COVER REQUIREMENTS.

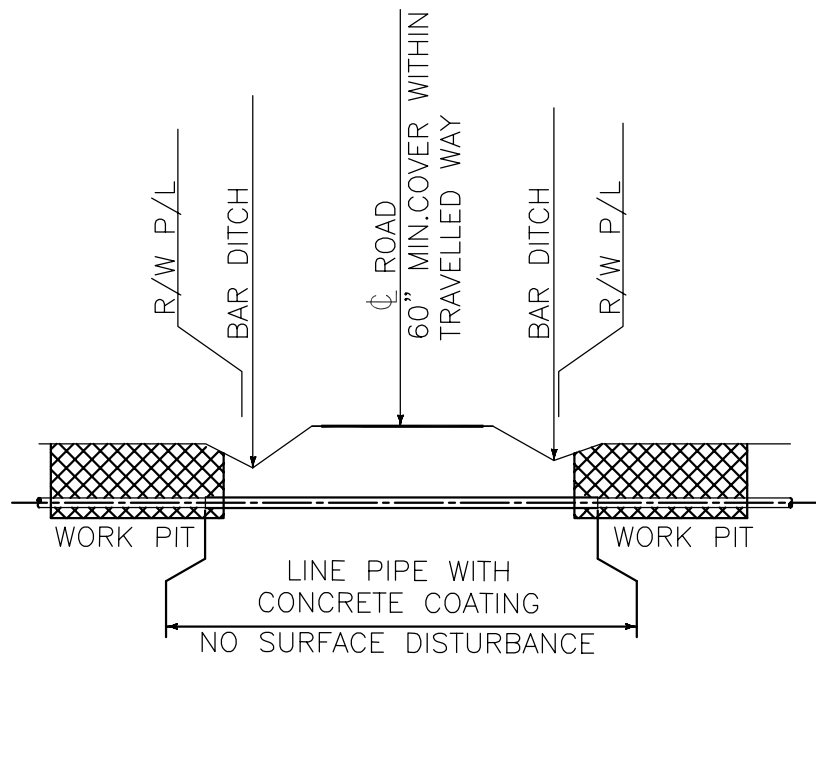

CONSTRUCTION TYPE 9
NOT TO SCALE

NOTE:


1. THIS CONFIGURATION IS FOR UNCASSED ROAD CROSSING CONSTRUCTION.
2. SEE ALIGNMENT SHEETS FOR LOCATIONS OF THIS CONFIGURATION AND MATERIAL SPECIFICATIONS.
3. SEE SITE SPECIFIC SOIL BORING DETAILS FOR ADDITIONAL INFORMATION.
4. BORE HOLE SHALL NOT EXCEED THE PIPE DIAMETER BY MORE THAN ONE AND ONE HALF (1-1/2) INCHES.

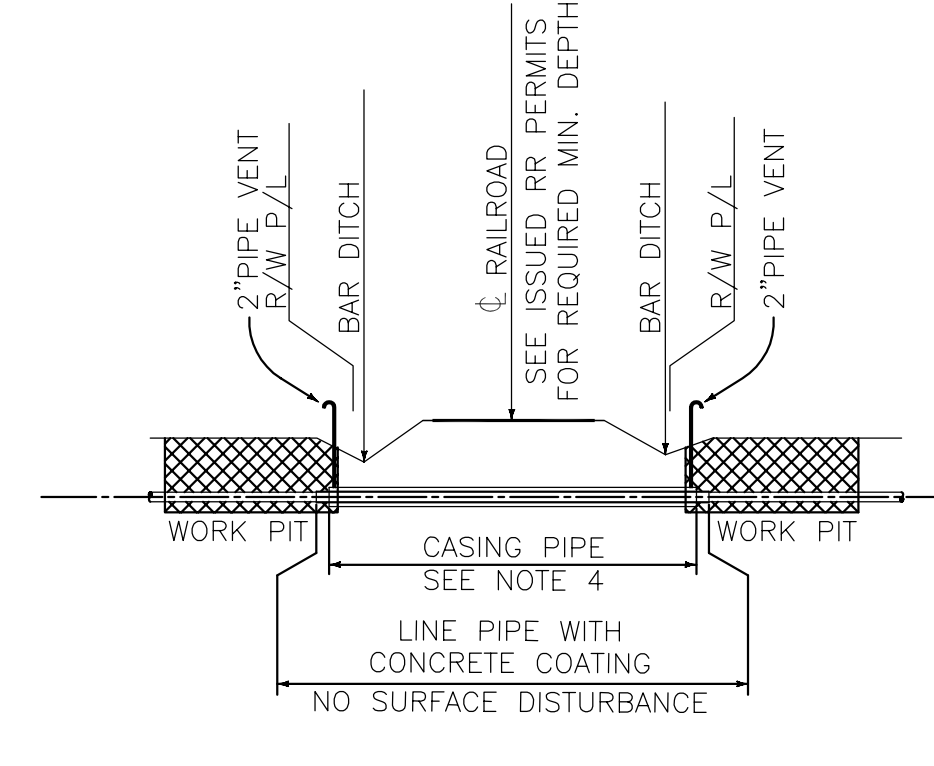

CONSTRUCTION TYPE 10
NOT TO SCALE

NOTE:

1. THIS CONFIGURATION IS FOR CASSED ROAD AND RAILROAD CROSSING CONSTRUCTION.
2. SEE ALIGNMENT SHEETS FOR LOCATIONS OF THIS CONFIGURATION AND MATERIAL SPECIFICATIONS.
3. SEE SITE SPECIFIC SOIL BORING DETAILS FOR ADDITIONAL INFORMATION.
4. ANNULUS FILLED WITH DIELECTRIC MATERIAL PER VT GAS SPECIFICATIONS FOR ABRASION RESISTANT COATED CARRYING PIPE ONLY. DIELECTRIC MATERIAL SHALL NOT FILL THE ANNULUS SPACE WHERE CONCRETE COATED CARRYING PIPE IS SPECIFIED.
5. THE BORE HOLE SHALL NOT EXCEED THE CASING DIAMETER BY MORE THAN ONE AND ONE HALF (1-1/2) INCHES.

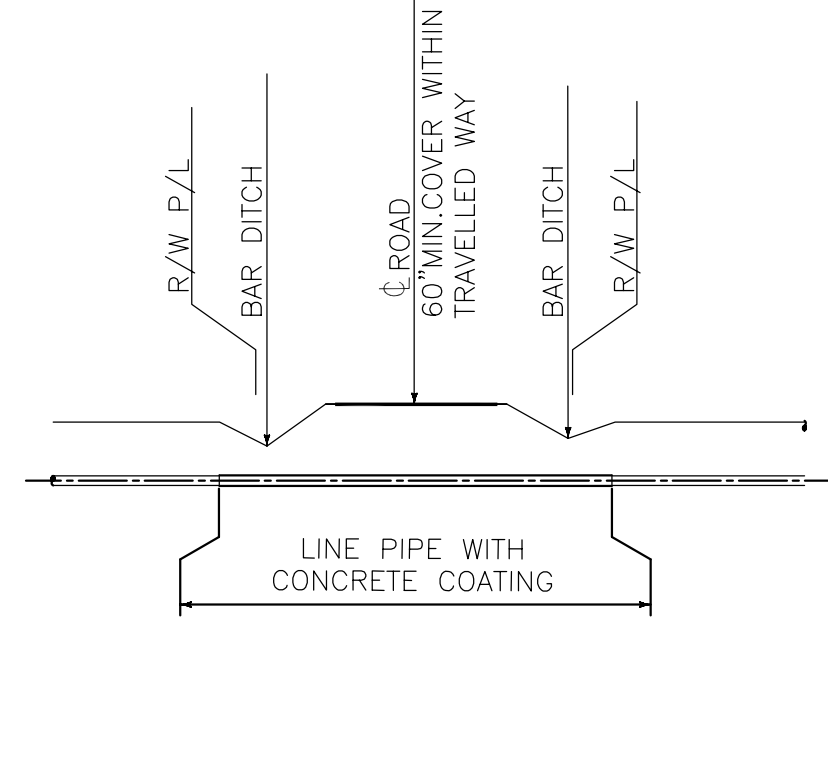

CONSTRUCTION TYPE 11
NOT TO SCALE

NOTE:

1. THIS CONFIGURATION IS FOR OPEN CUT ROAD CROSSING CONSTRUCTION.
2. SEE ALIGNMENT SHEETS FOR LOCATIONS OF THIS CONFIGURATION AND MATERIAL SPECIFICATIONS.
3. SEE SITE SPECIFIC SOIL BORING DETAILS FOR ADDITIONAL INFORMATION.
4. COMPACTION AND RESTORATION TO TOWN AND VT GAS SPECIFICATIONS.

NOTE:

1. CONSTRUCTION TYPE 5 NOT USED.

DWG. NO.	REFERENCE DWG.	REV	DSN	TDB	CK	DESCRIPTION	INITIALS	DATE	INITIALS	DATE	YEAR: 2016	W.O.	SCALE: NOTED	DWG. ANGP-T-G-006	REV. 1
						ADDED ARCH. SITES (6/08/15)									
		1	BCK	TDB											

		BID	CONSTRUCTION
ENVIRONMENTAL	JLS	06/28/13	JLS 05/2016
DRAFTING DESIGNER	GIL	06/28/13	GJM 05/2016
DRAFTING SUPERVISOR	BZD	06/28/13	BCK 05/2016
DESIGN ENGINEER	MDF	06/28/13	GEW 05/2016
DESIGN MANAGER	SAB	06/28/13	JEO 05/2016









VERMONT GAS PROPOSED 12" PIPELINE ADDISON NATURAL GAS PROJECT CONSTRUCTION CONFIGURATION DETAILS	
LOC. CHITTENDEN & ADDISON COUNTIES	
YEAR: 2016	W.O.
SCALE: NOTED	

Vermont Gas

CIA

38 Eastwood Drive, Suite 105
South Burlington, VT 05403
Main: (802) 735-0372 - www.chacompanies.com

VHB Vanasse Hangen Brustlin, Inc.

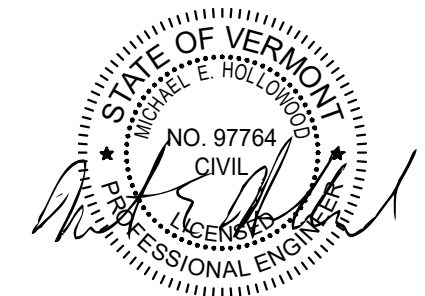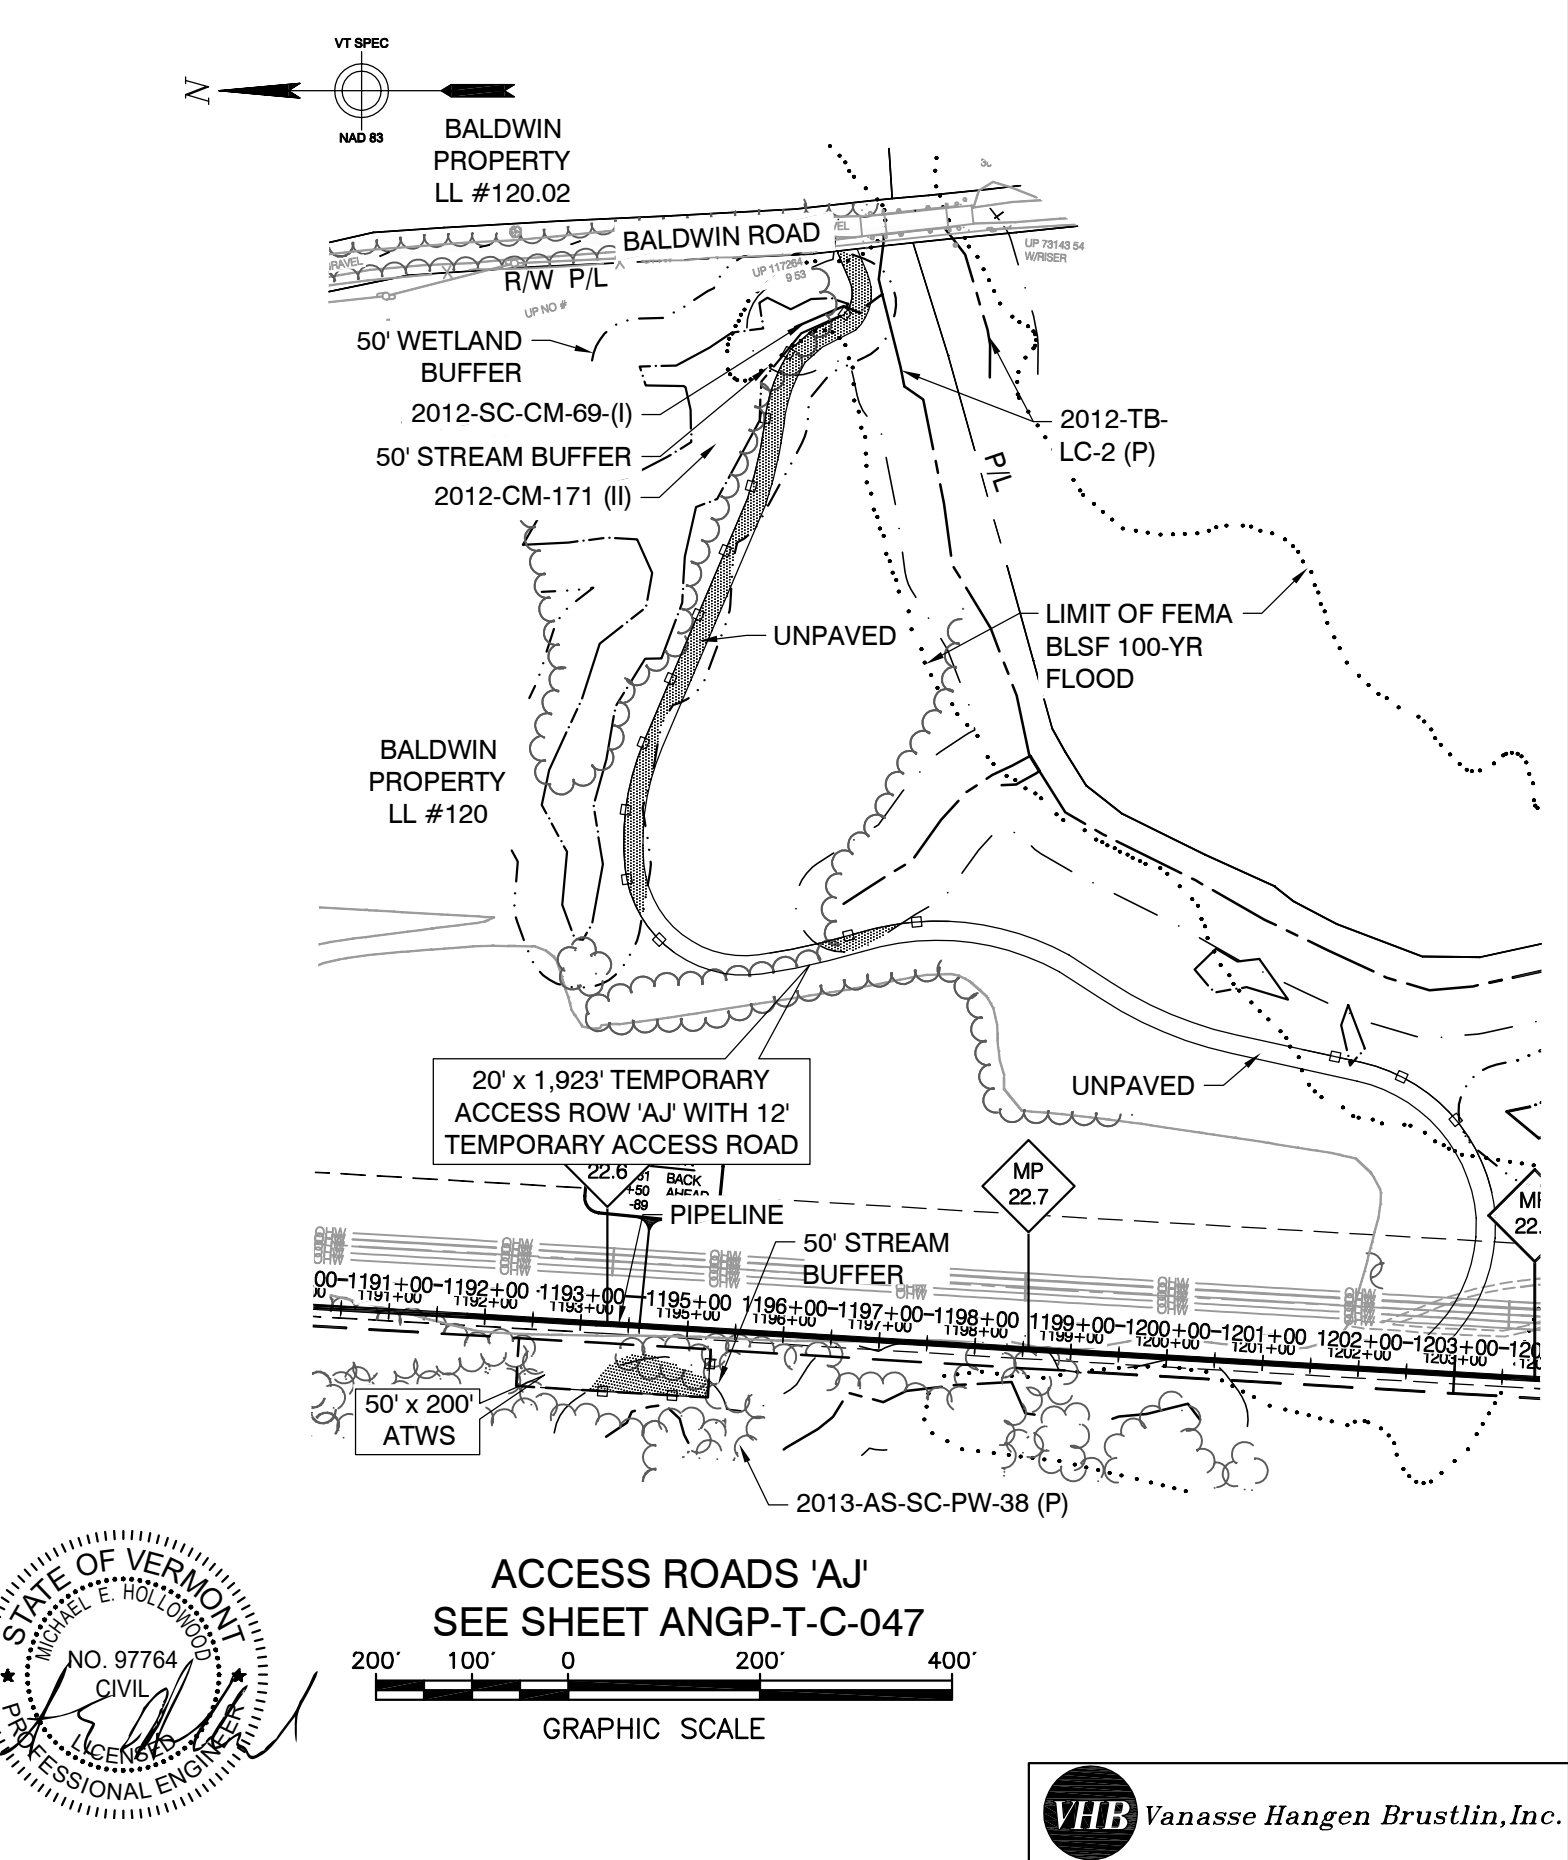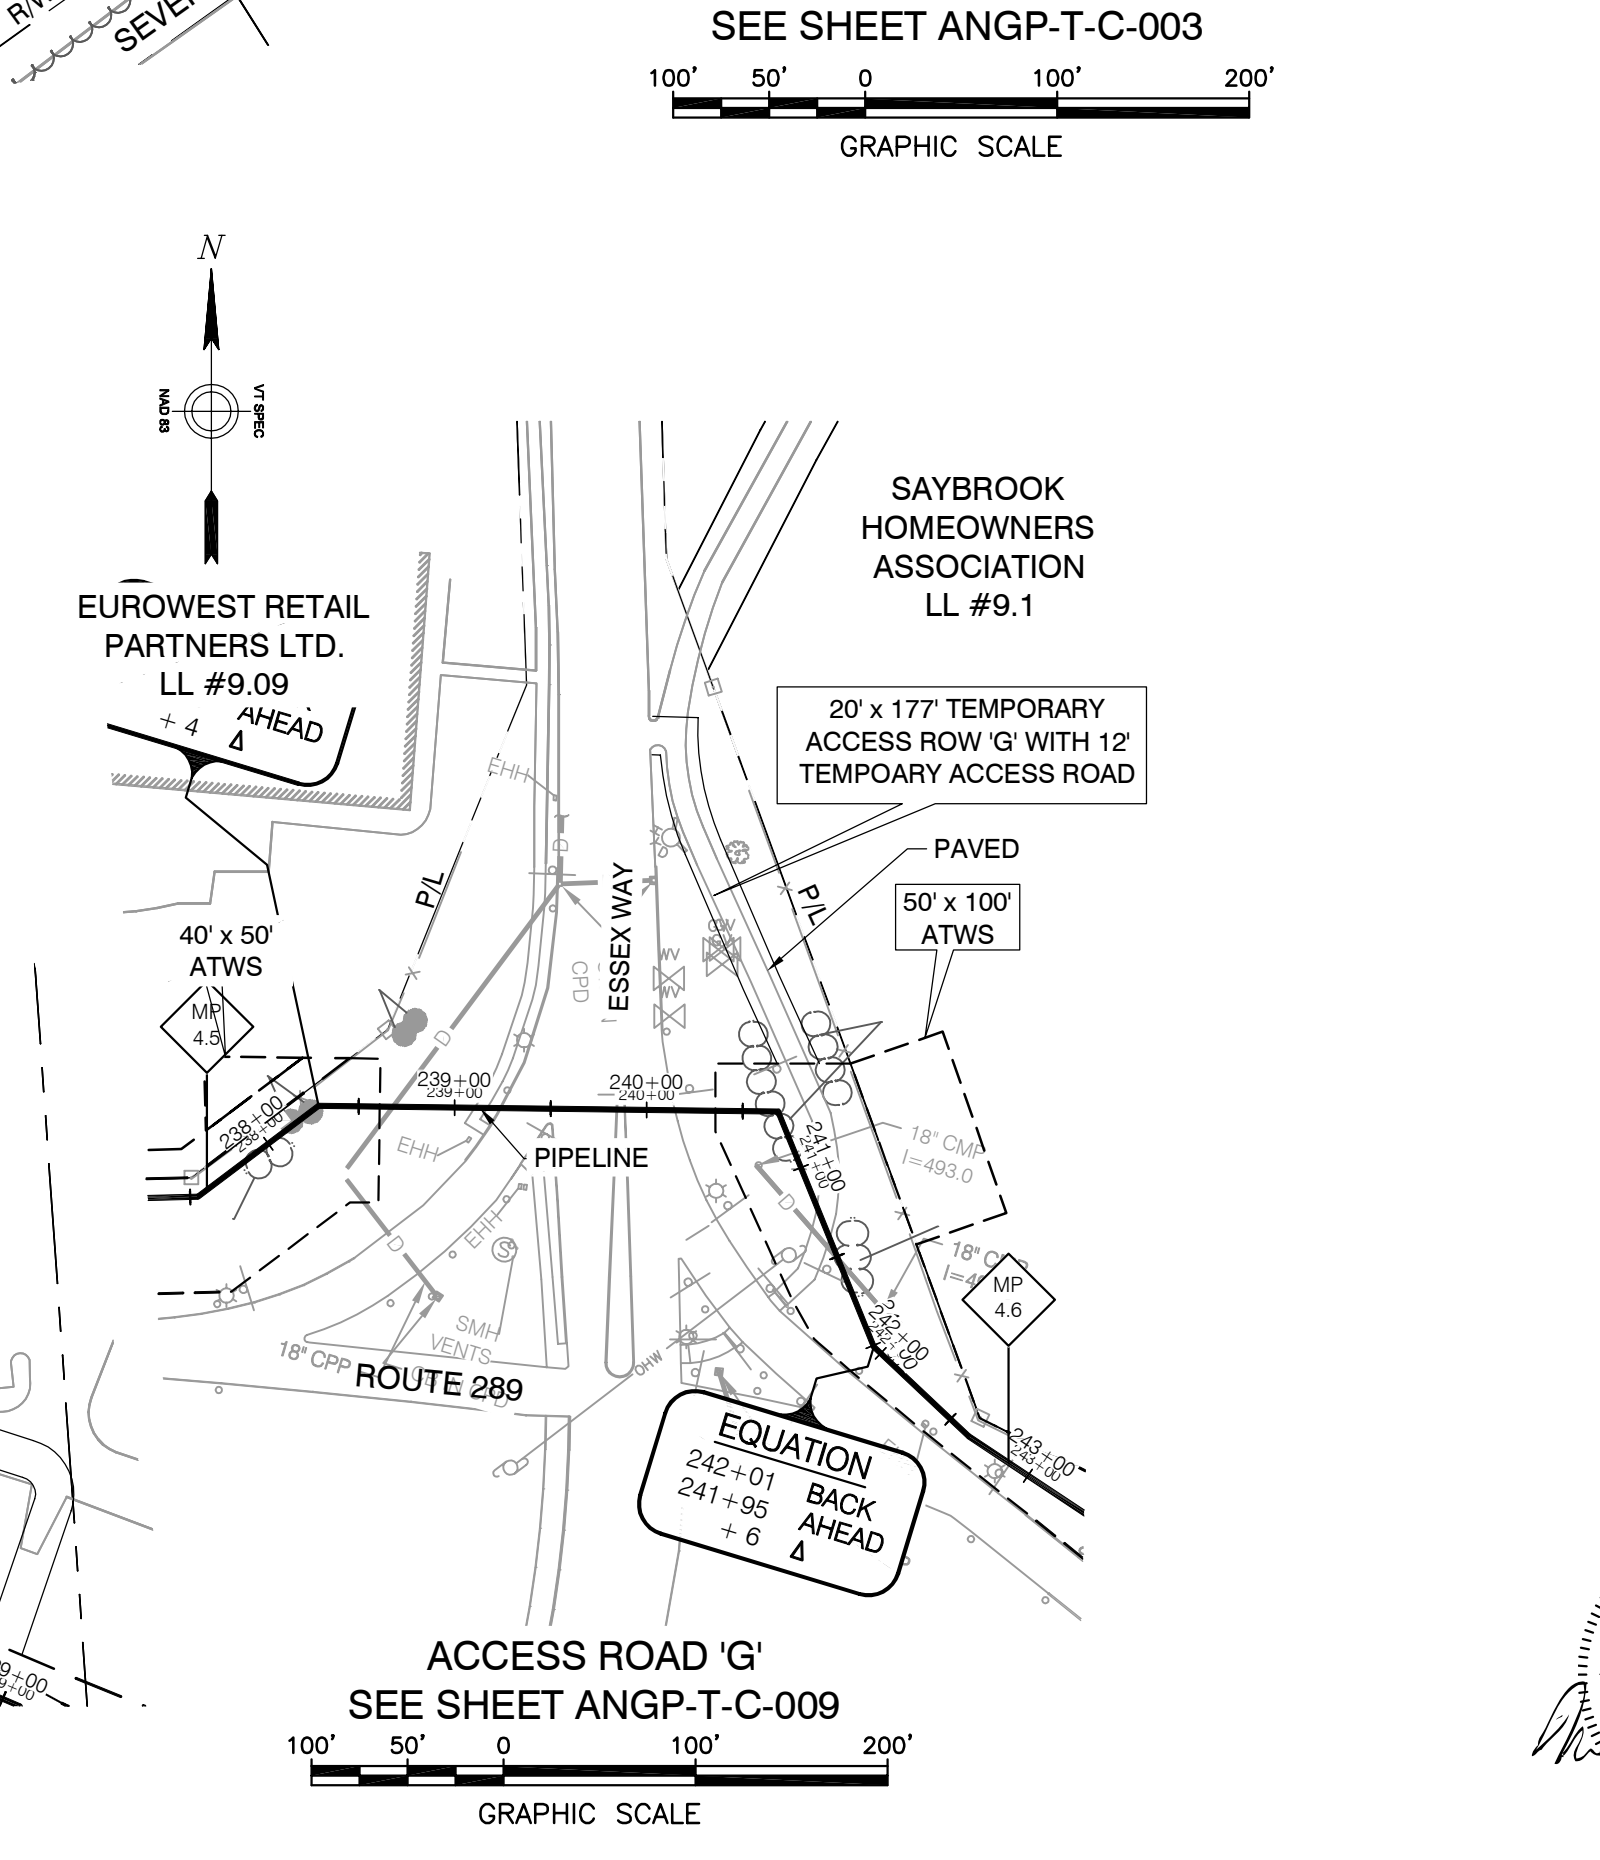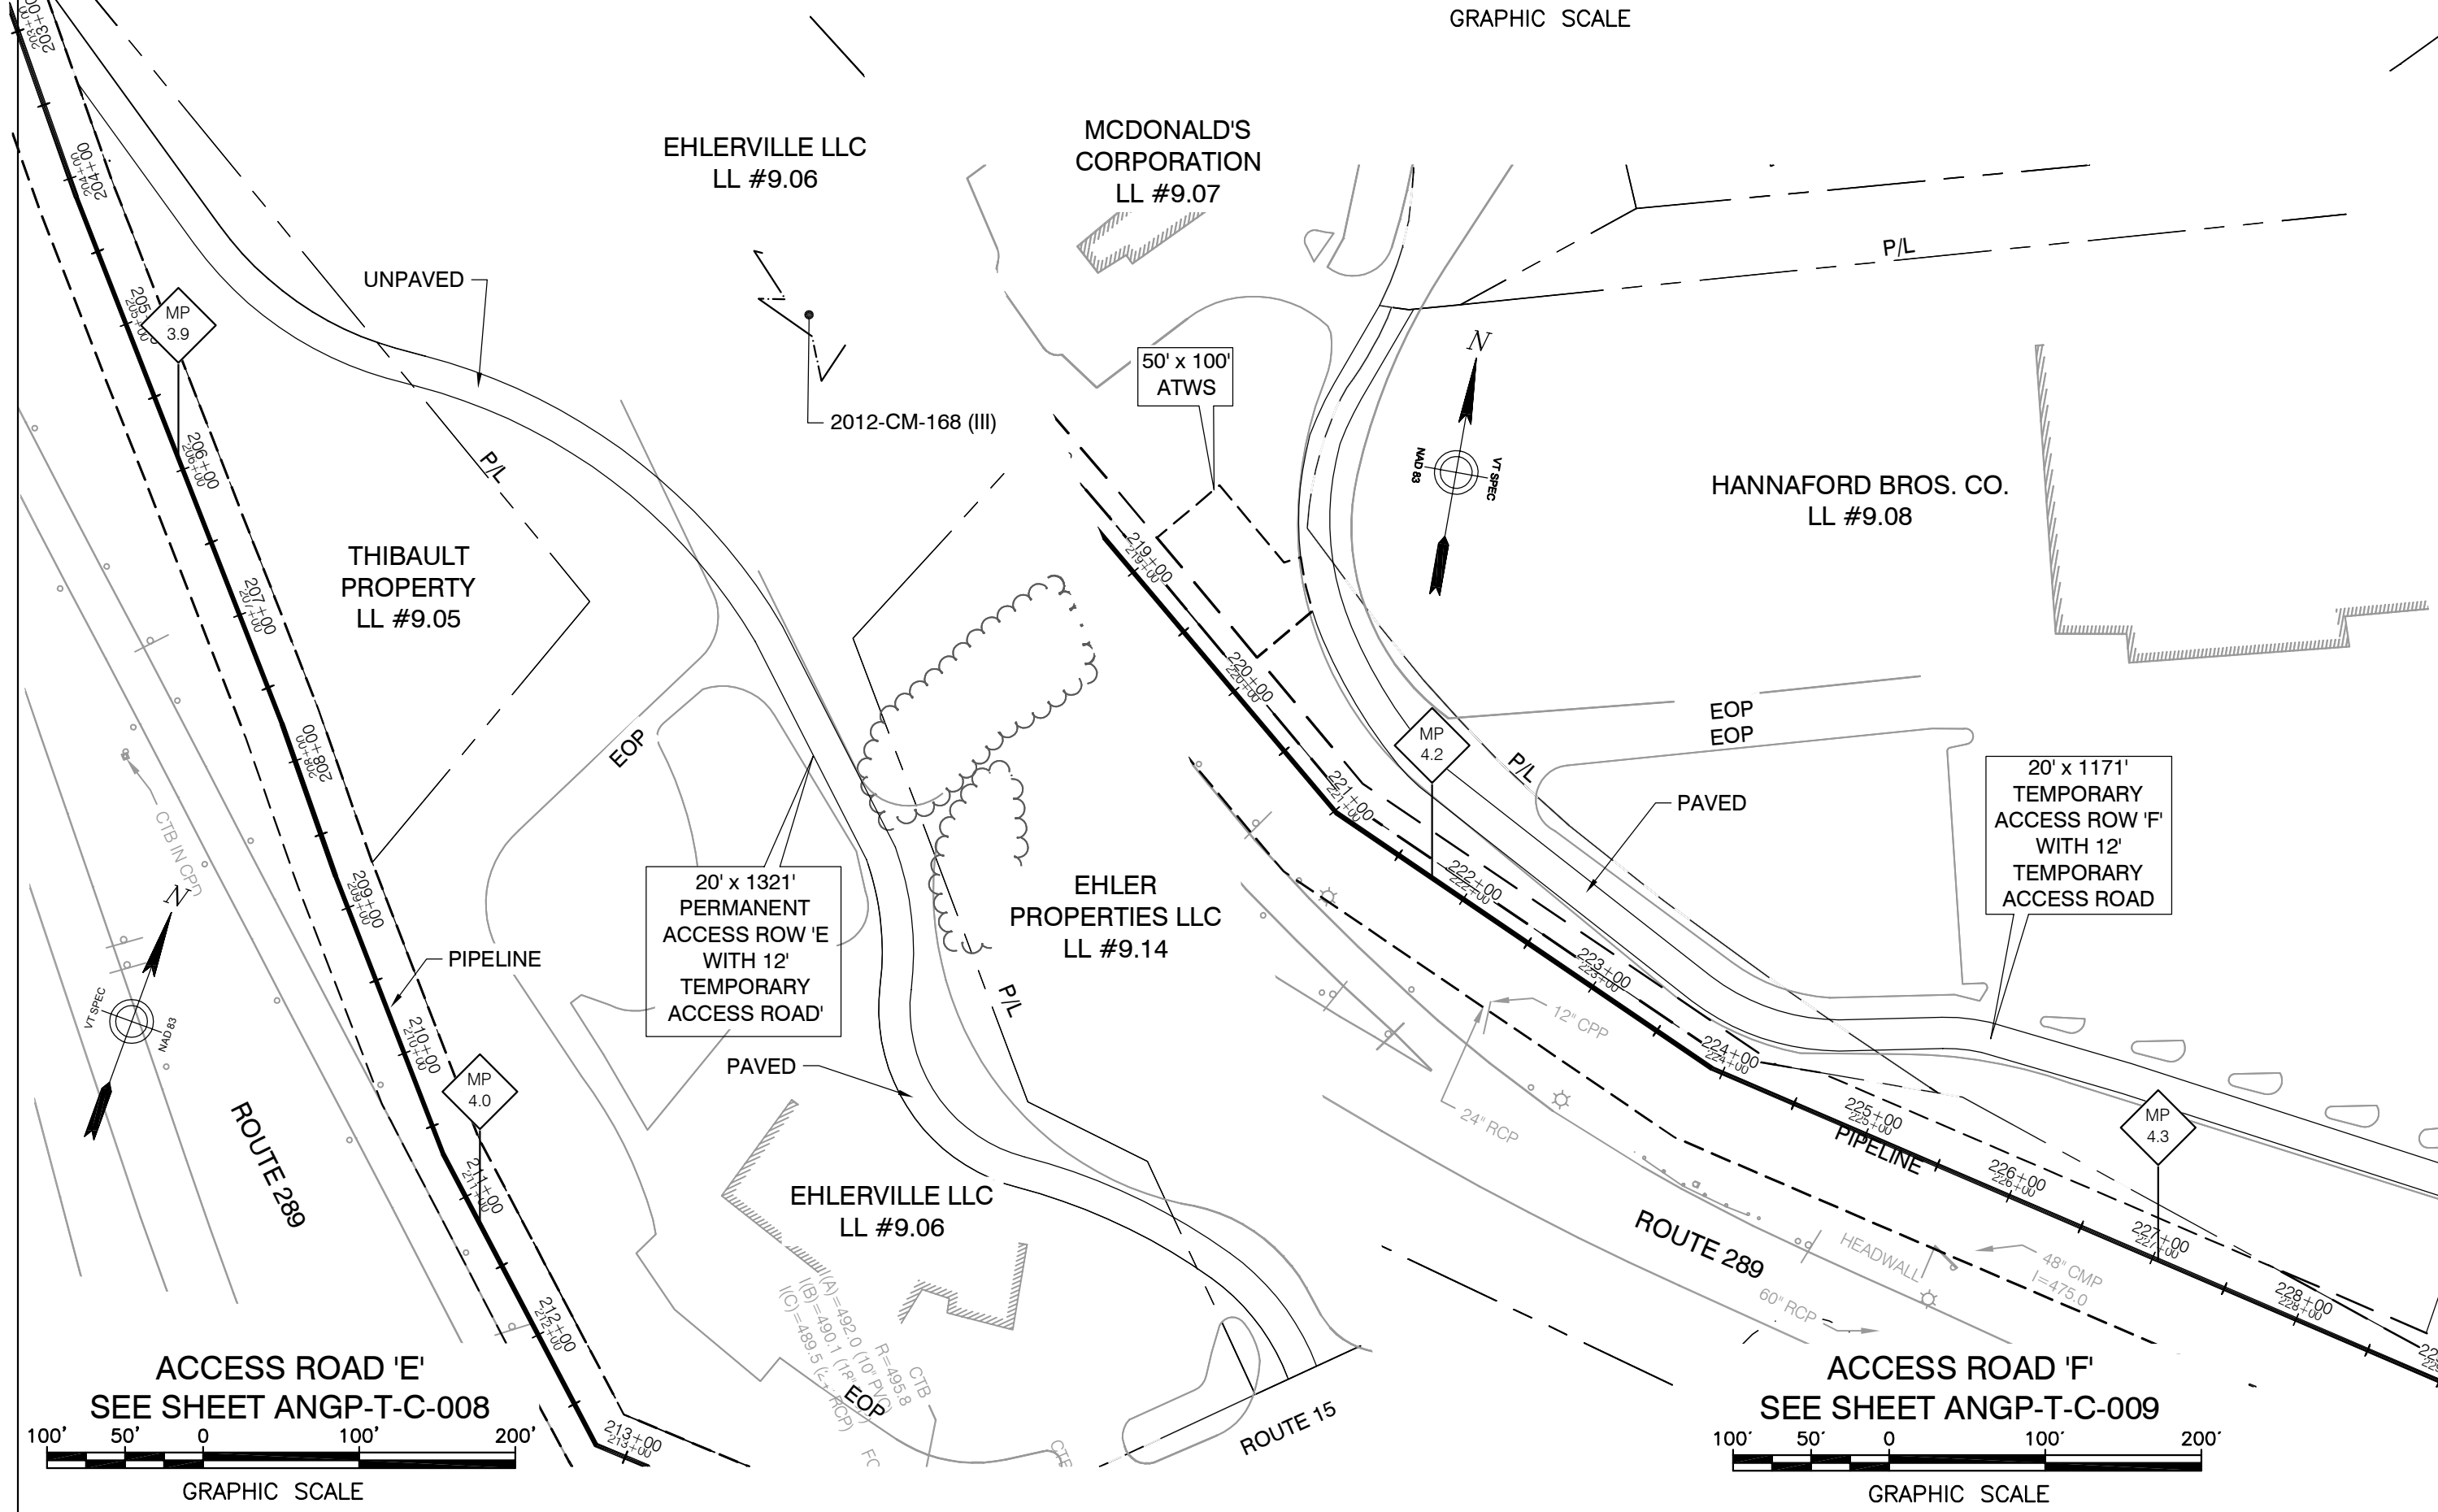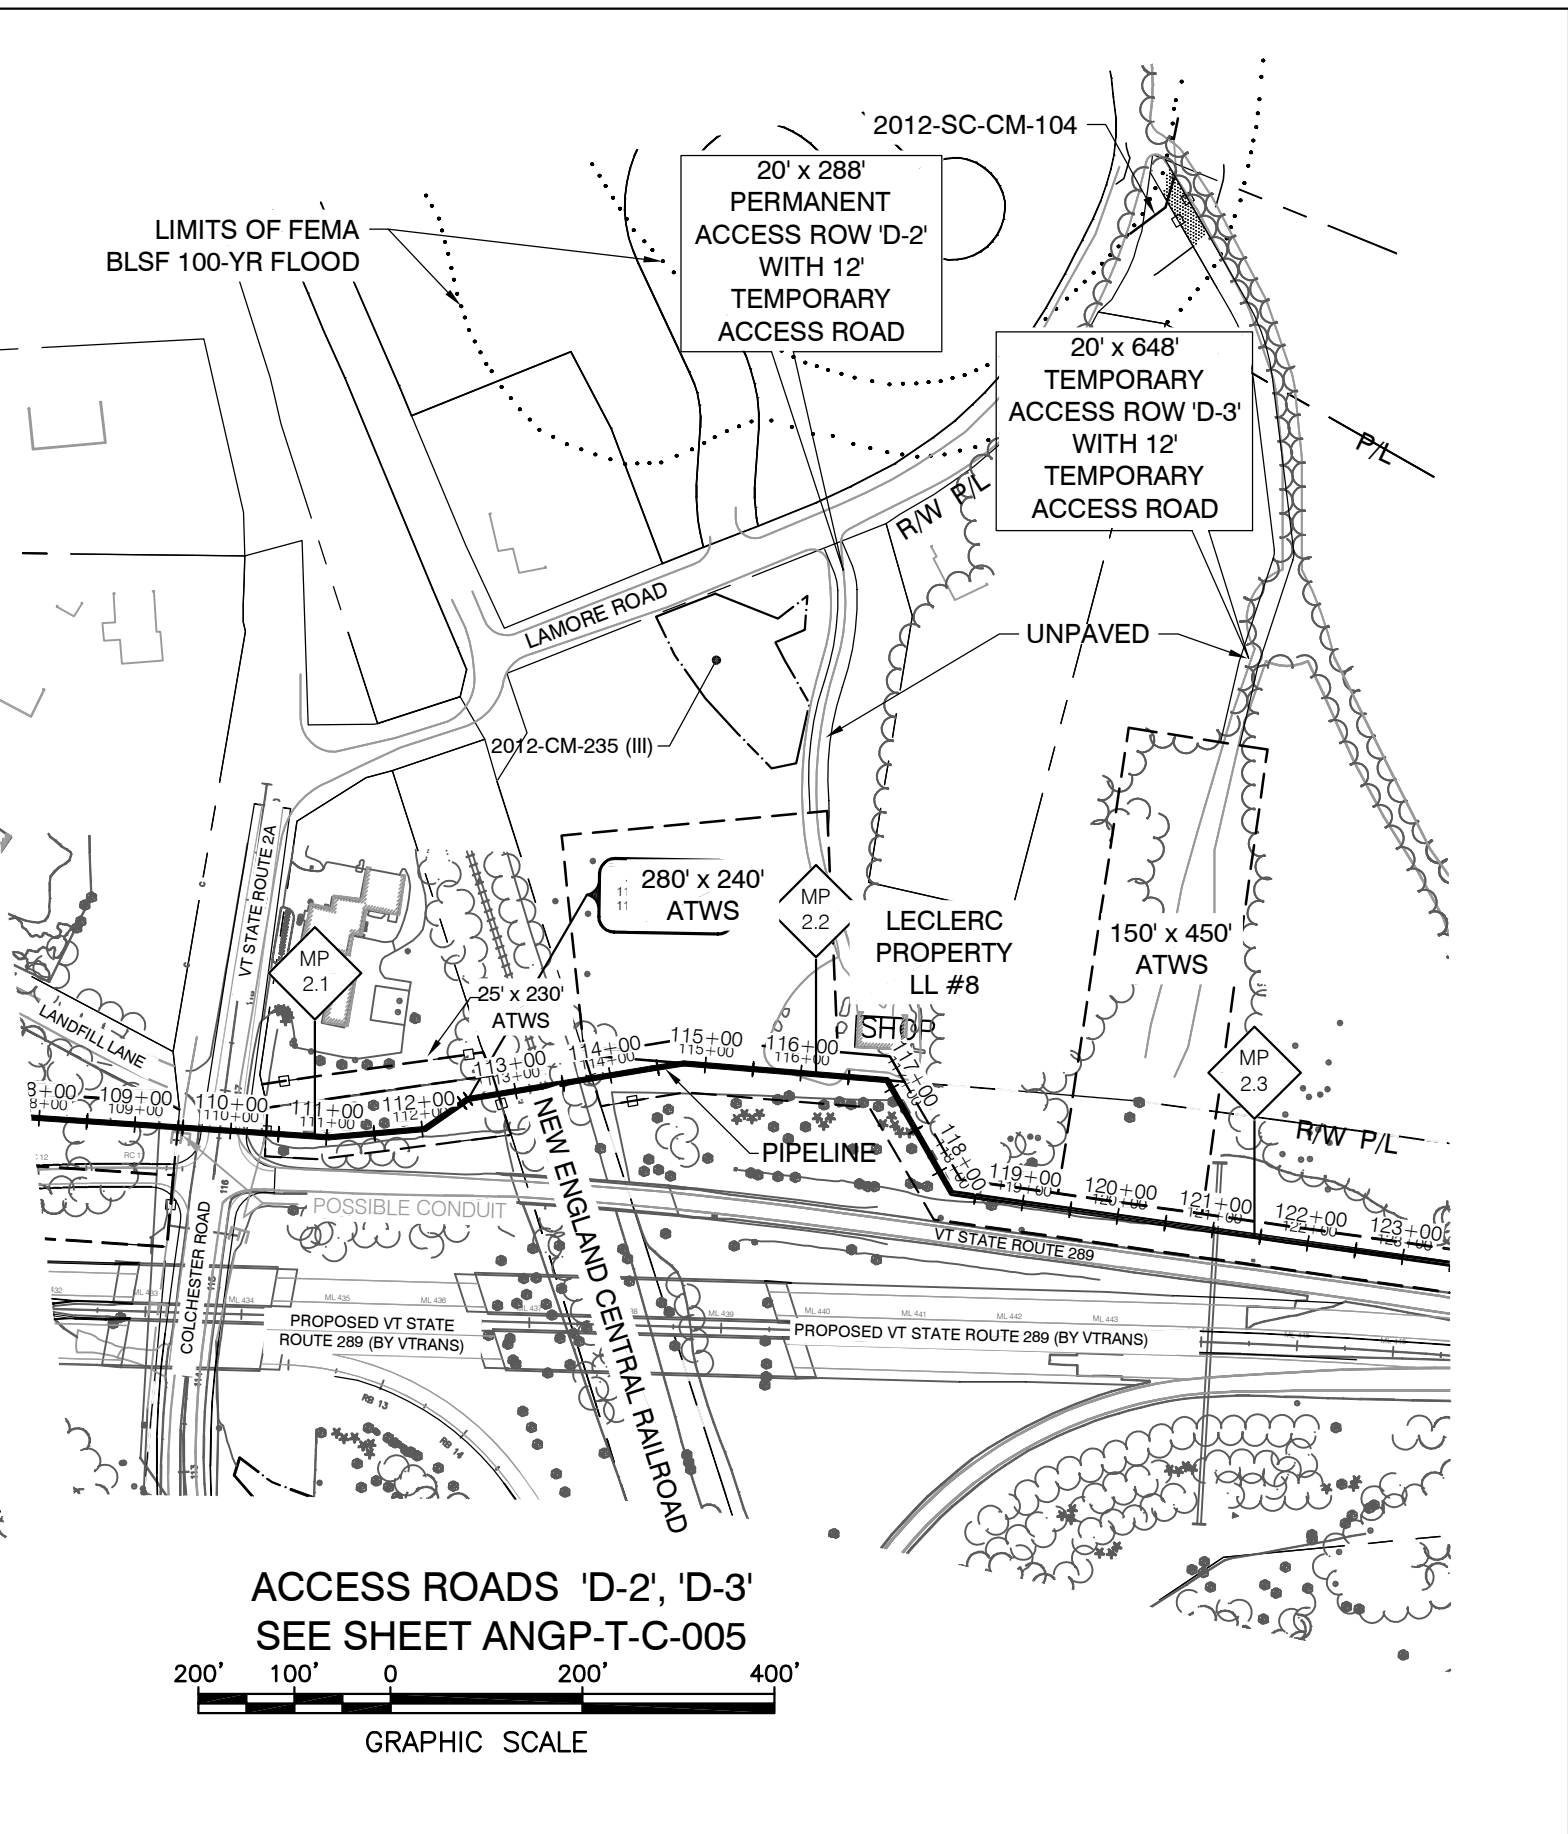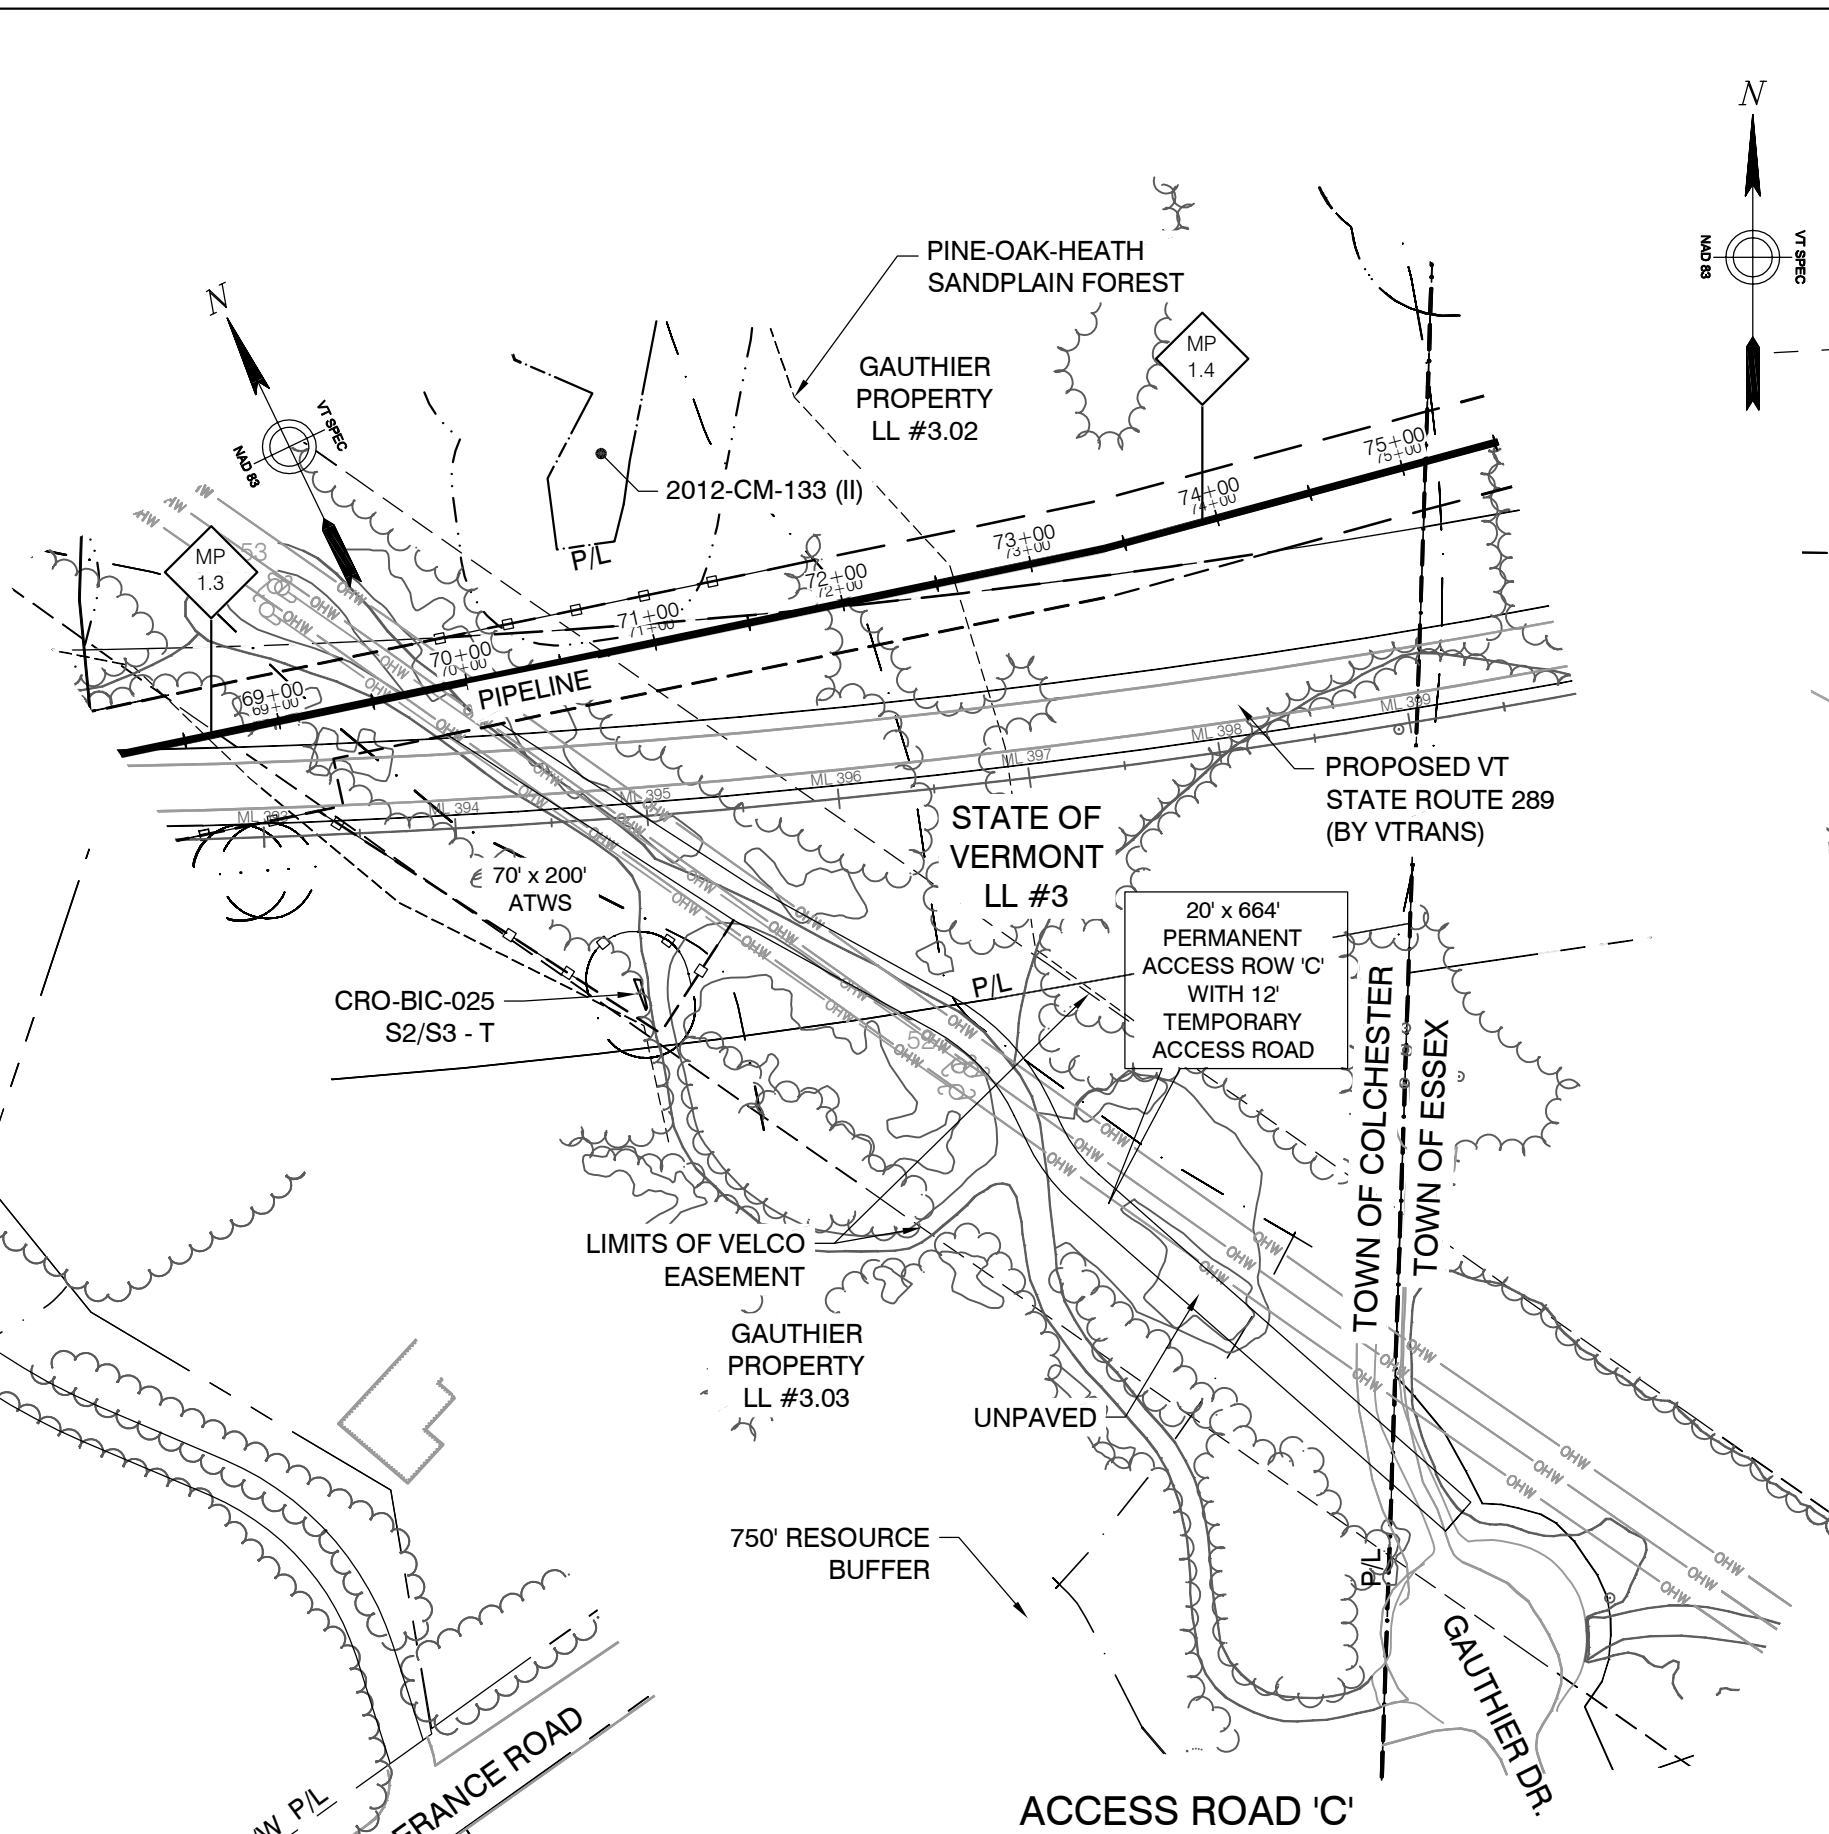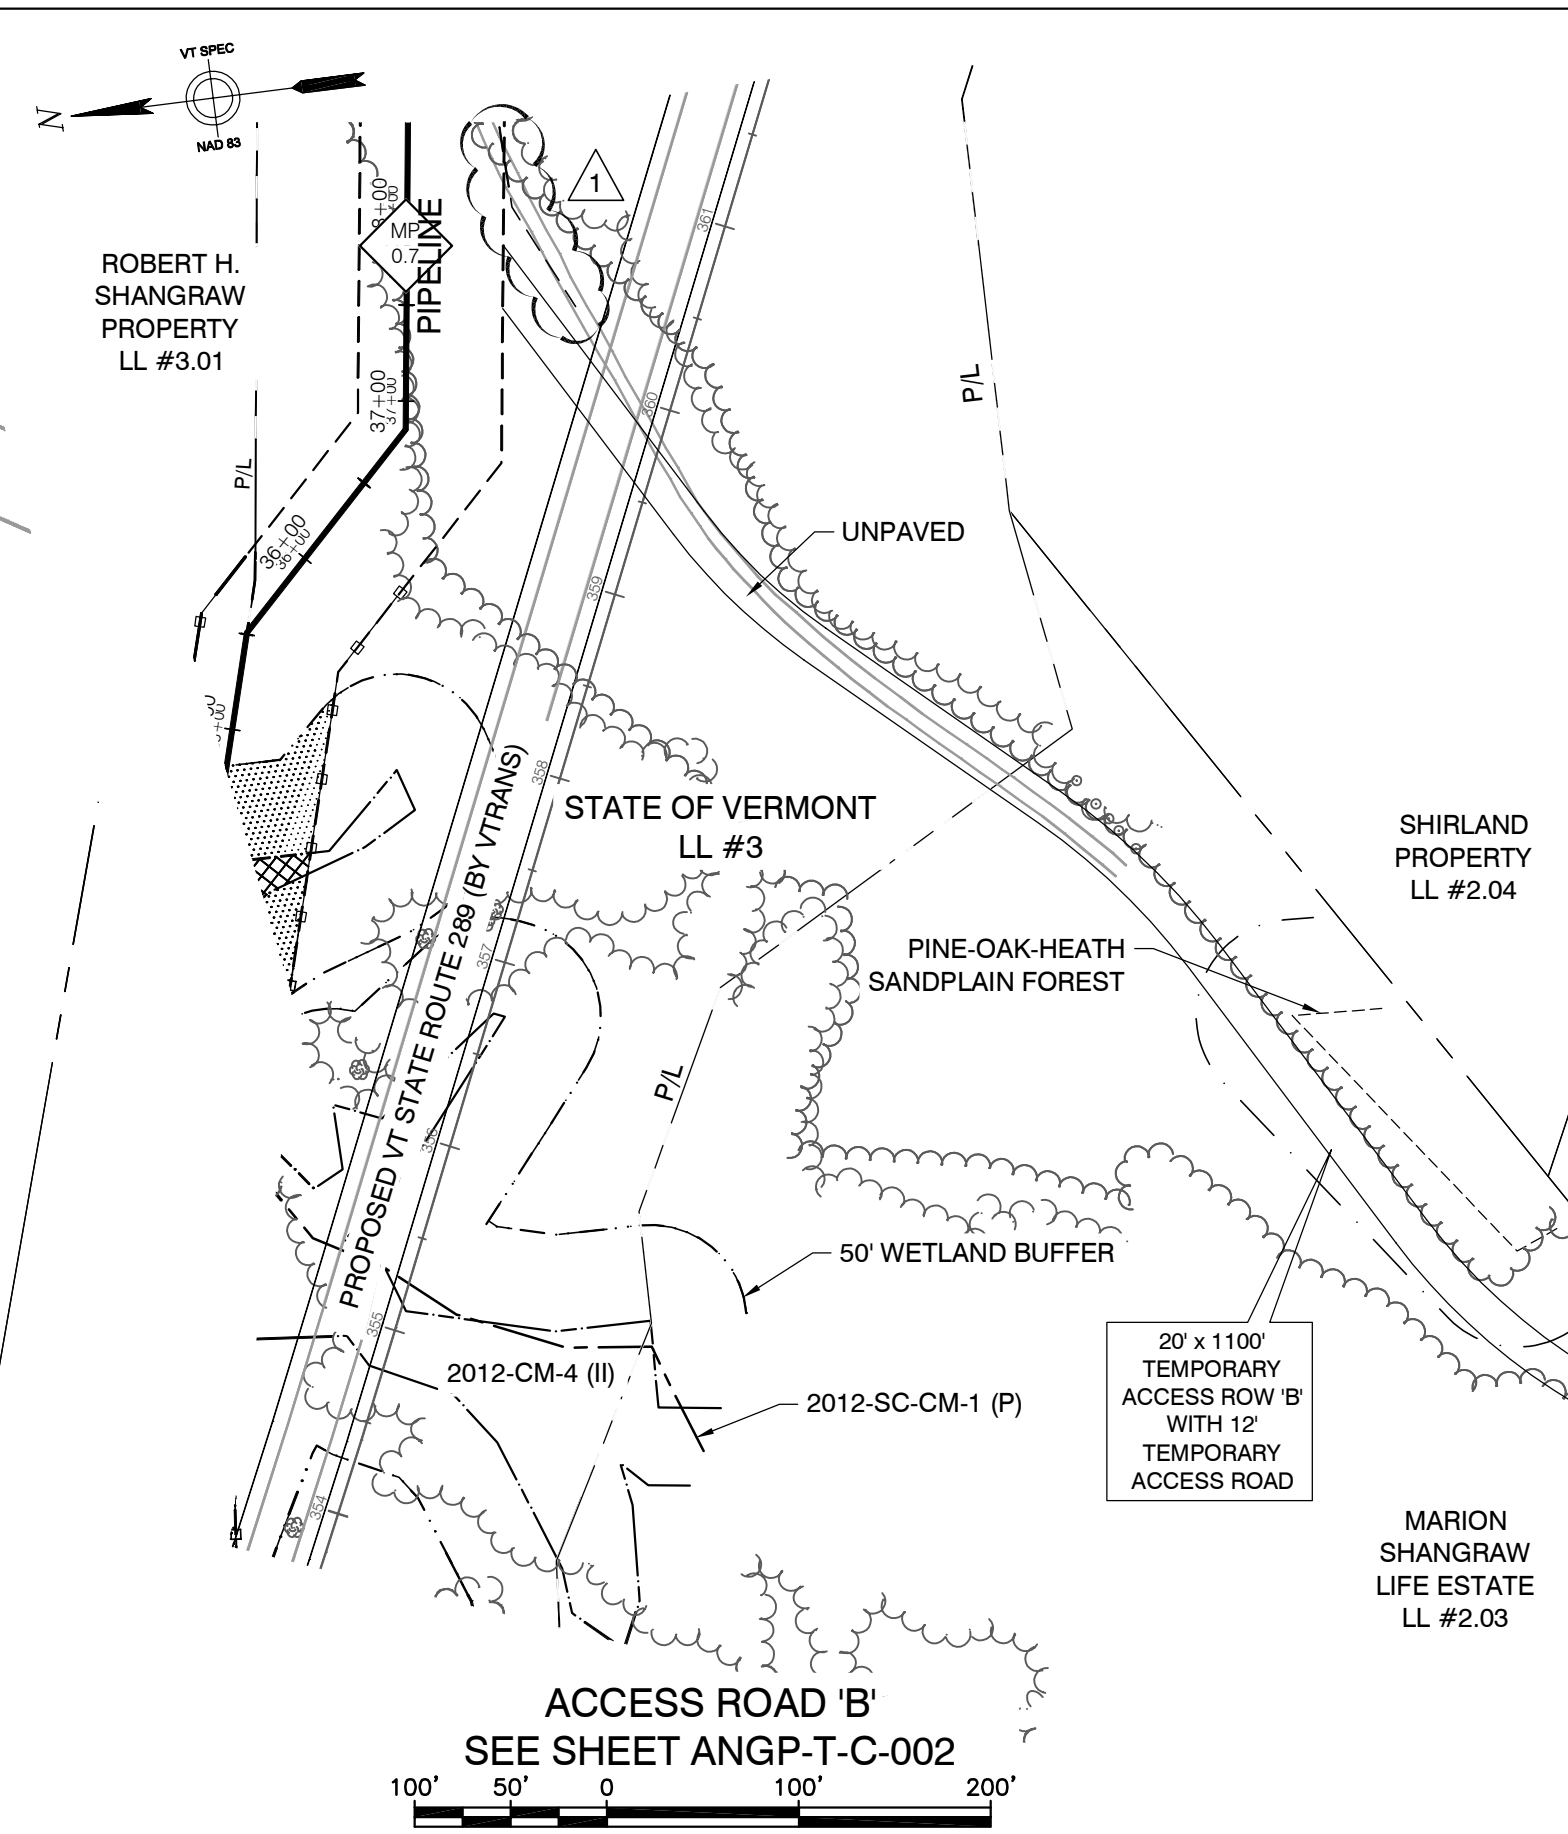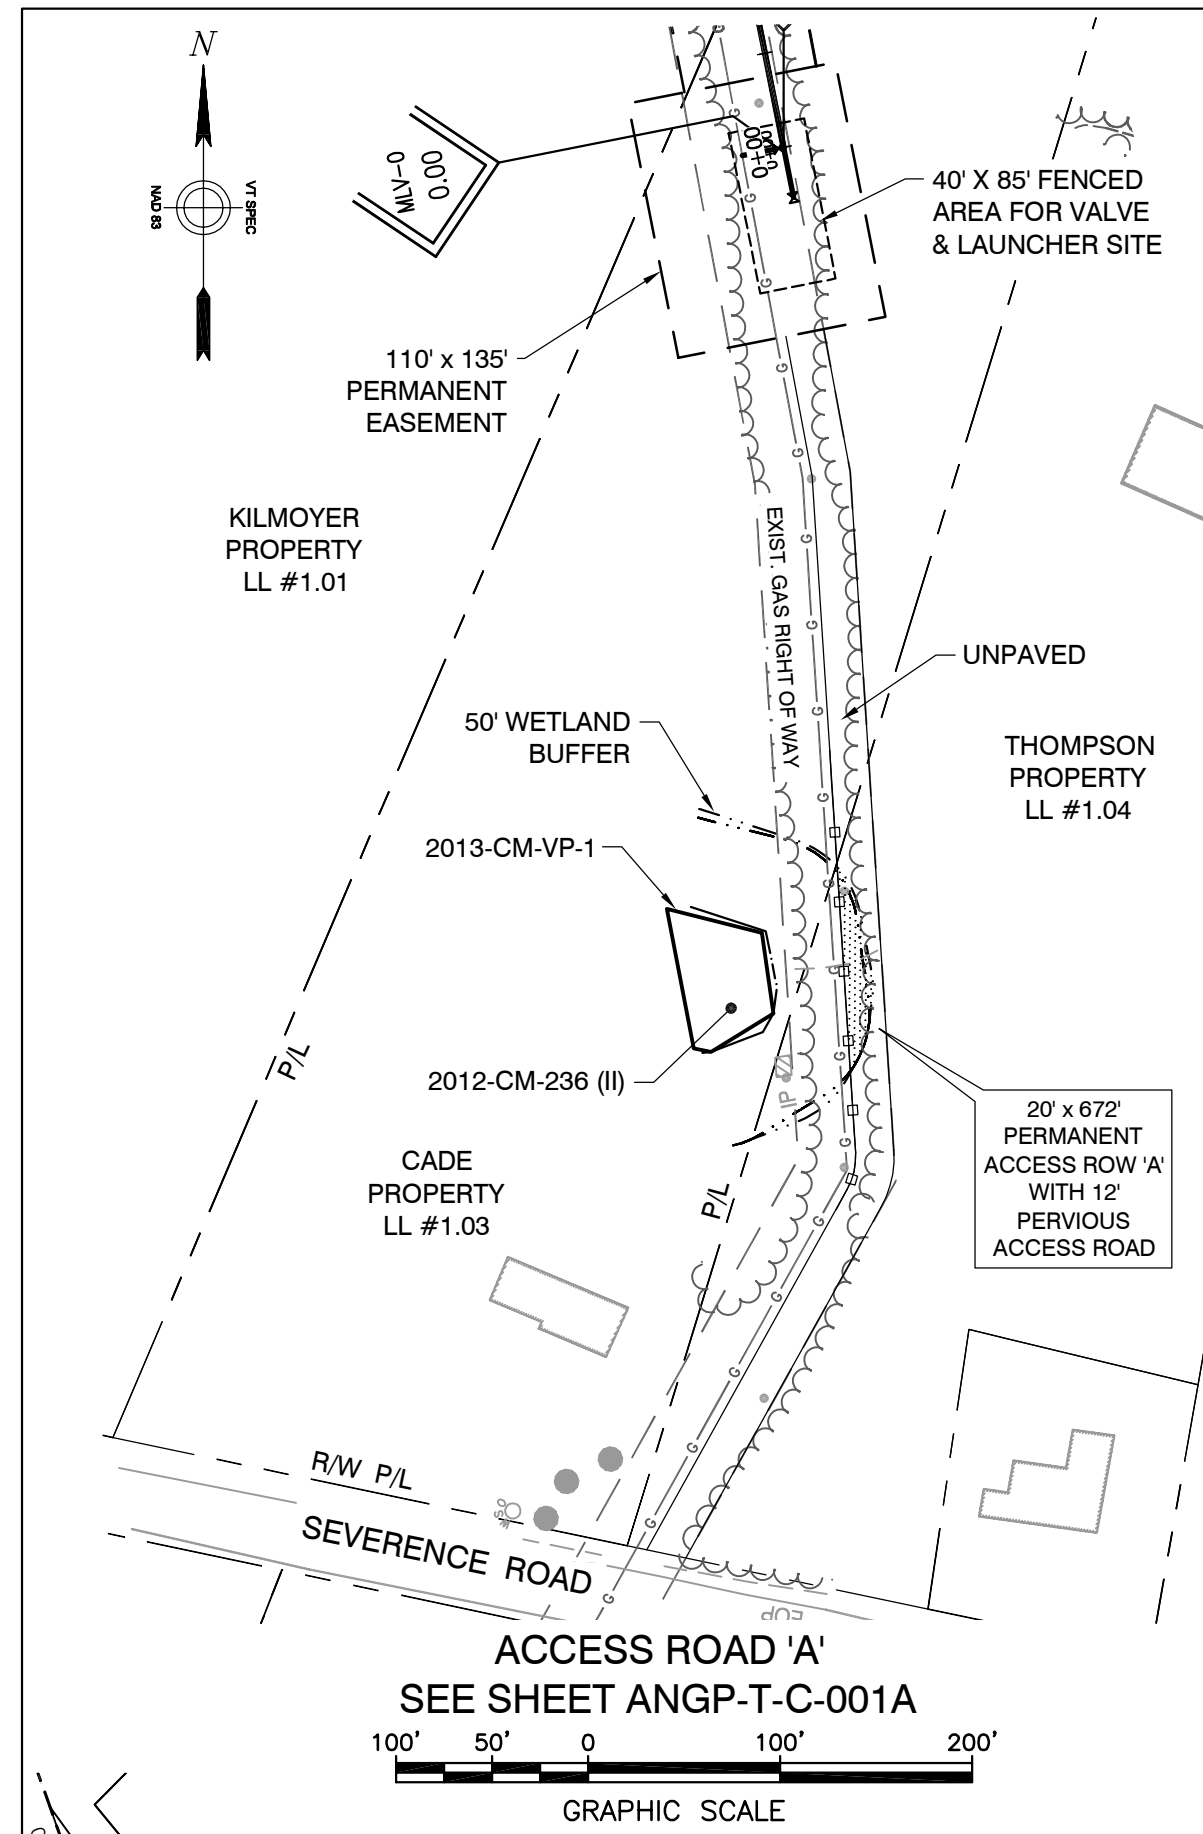

DWG. NO.	REFERENCE DWG.	REV	DSN	BCK	CK	DESCRIPTION	INITIALS	DATE	INITIALS	DATE	YEAR:	W.O.	SCALE:	DWG.	ANGP-T-G-007A	REV.	1
		1	GJM	BCK		IFC 2016 EDITS (05/2016)					2016		AS NOTED				

		BID	CONSTRUCTION
ENVIRONMENTAL	JLS	06/28/13	JLS 05/2016
DRAFTING DESIGNER	GIL	06/28/13	GJM 05/2016
DRAFTING SUPERVISOR	BZD	06/28/13	BCK 05/2016
DESIGN ENGINEER	MDF	06/28/13	GEW 05/2016
DESIGN MANAGER	SAB	06/28/13	JEO 05/2016

VERMONT GAS
PROPOSED 12" PIPELINE
ADDISON NATURAL GAS PROJECT
ACCESS ROAD DETAILS


LOC. CHITTENDEN & ADDISON COUNTIES

YEAR: 2016 W.O.

SCALE: AS NOTED

DWG. ANGP-T-G-007A

REV. 1

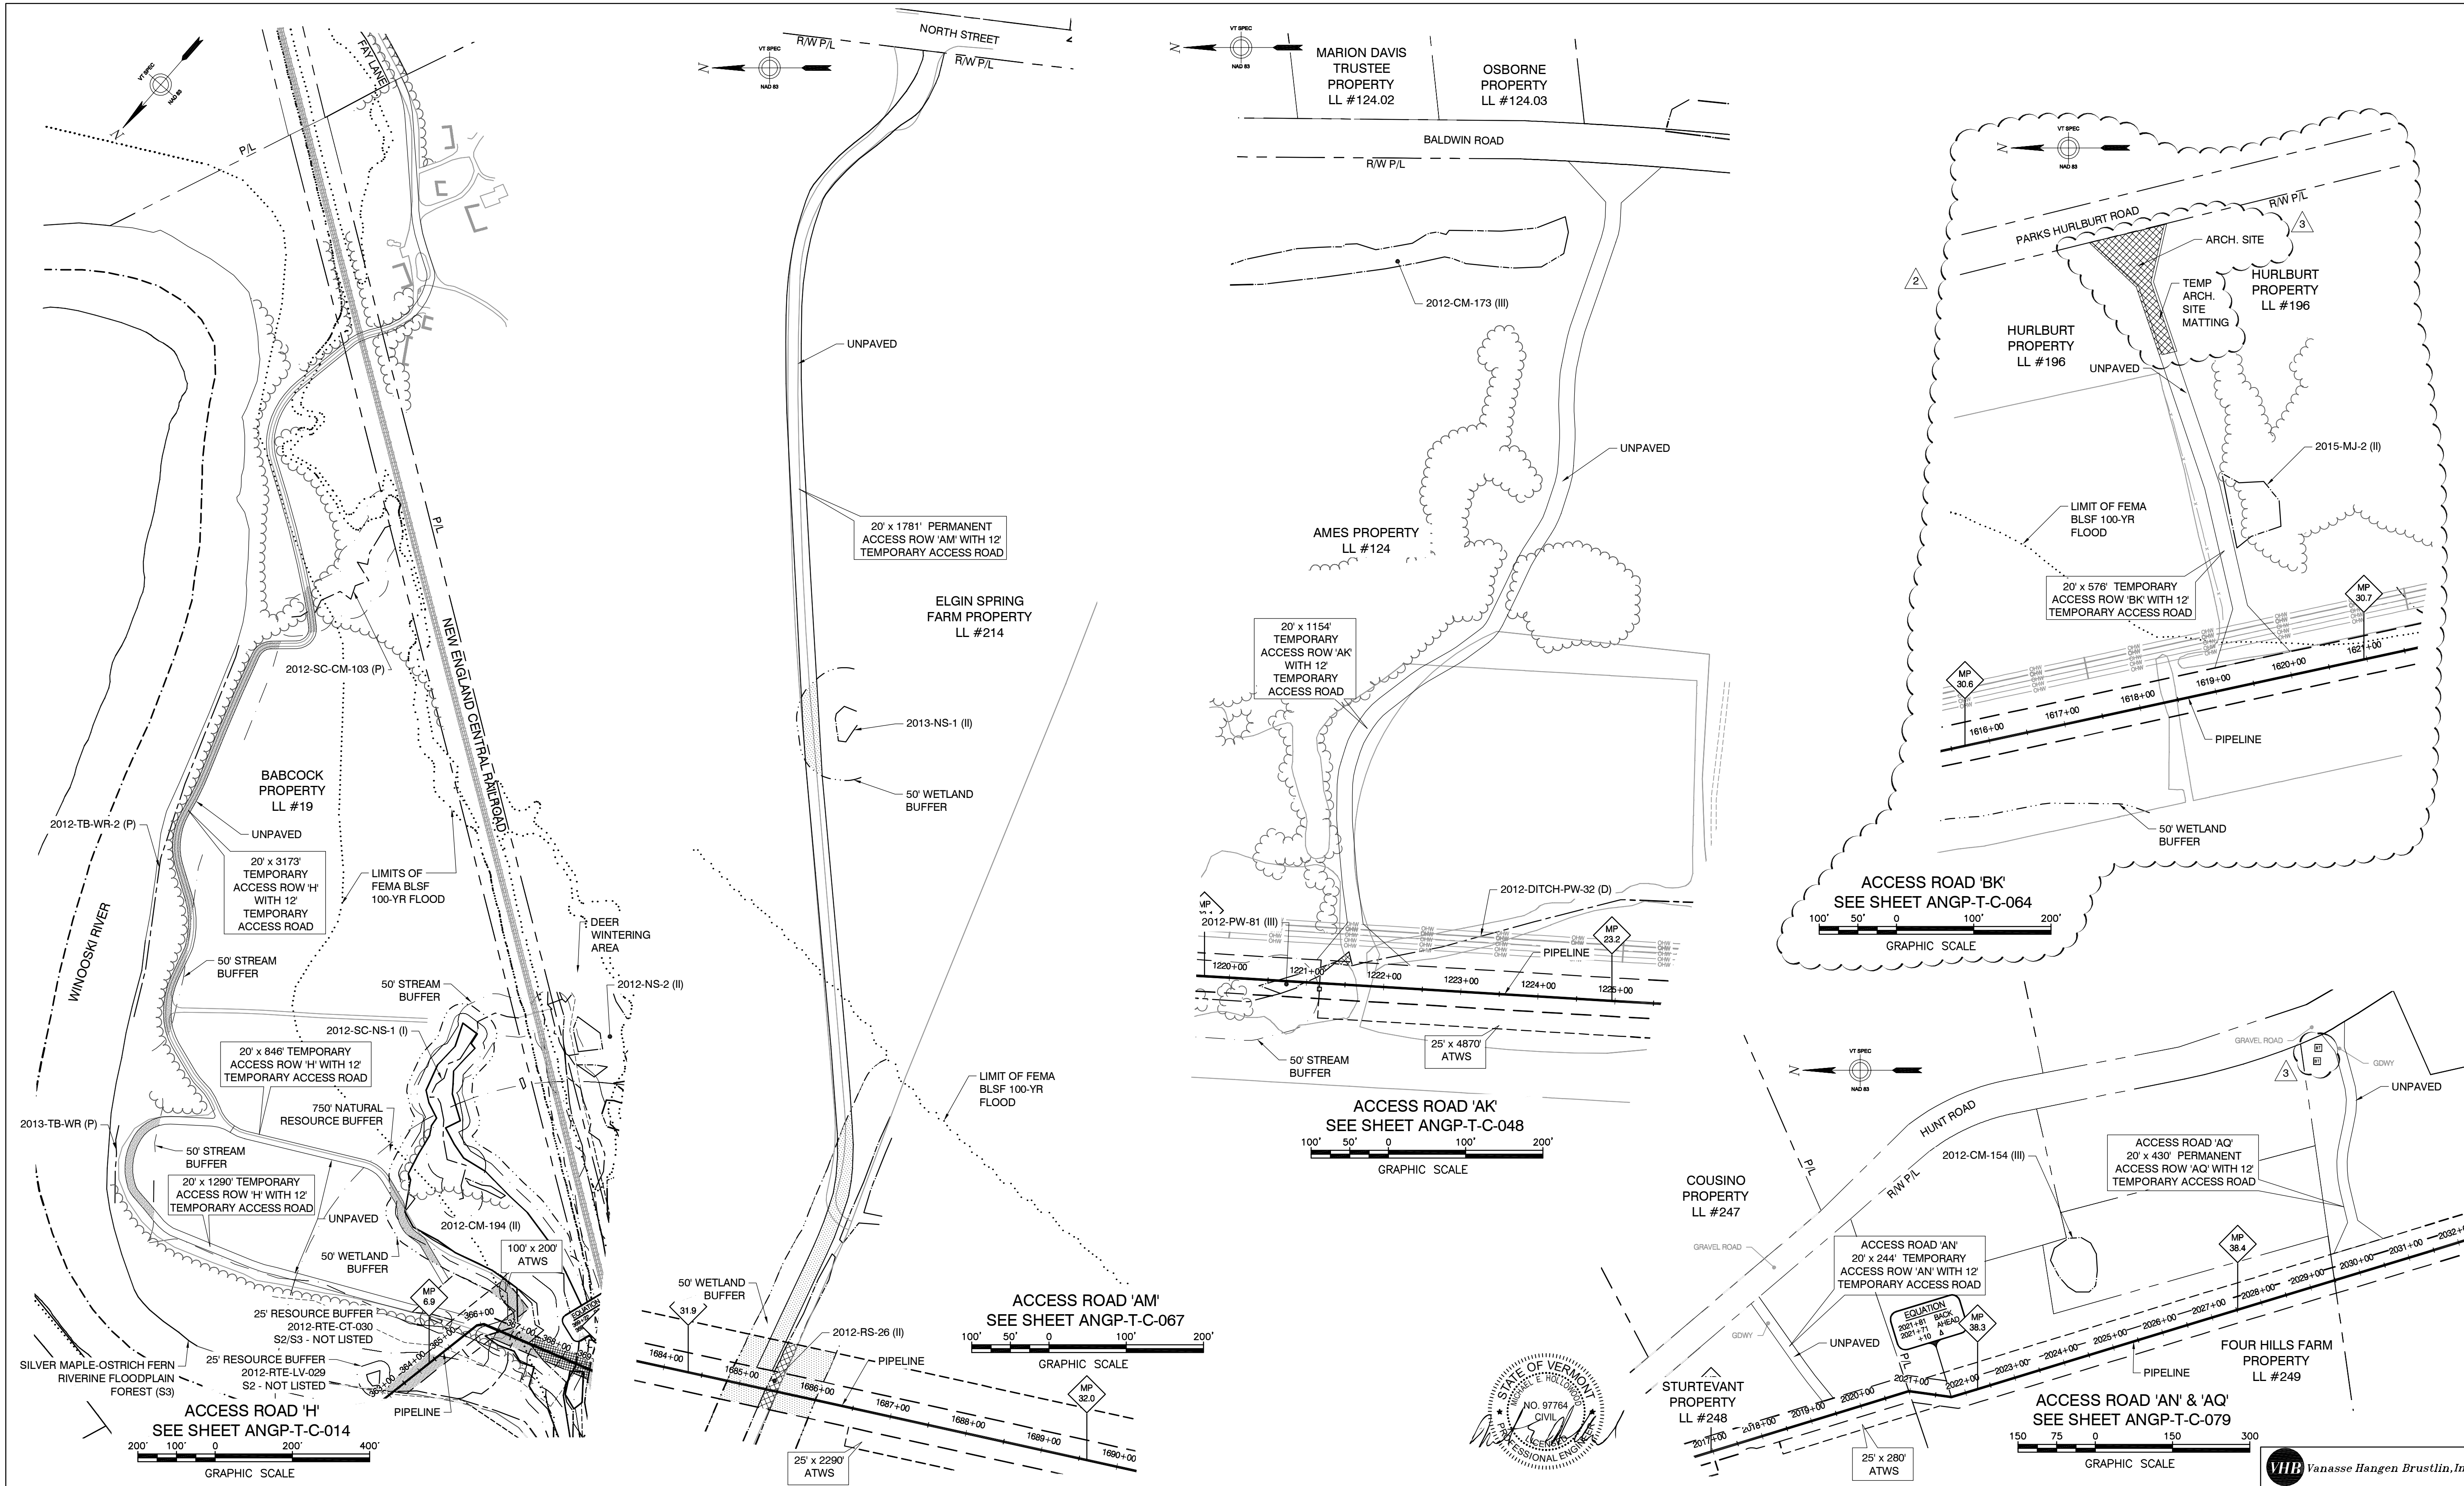

DWG. NO.	REFERENCE DWG.	REV	DSN	CK	DESCRIPTION	INITIALS	DATE	INITIALS	DATE	YEAR:	W.O.	SCALE:	DWG.	REV.
		3	GJM	BCK	IFC 2016 EDITS (05/2016)					2016		AS NOTED	ANGP-T-G-007B	3
		2	VGS	VGS	ACCESS ROAD "BK" ADDED (11/13/15)									
		1	BCK	TDB	VHB EDITS (6/09/15)									



ENVIRONMENTAL	BID	CONSTRUCTION
JLS 06/28/13	JLS 06/28/13	JLS 05/2016
GIL 06/28/13	GJM 06/28/13	GJM 05/2016
BZD 06/28/13	BCK 06/28/13	BCK 05/2016
MDF 06/28/13	GEW 06/28/13	GEW 05/2016
SAB 06/28/13	JEO 06/28/13	JEO 05/2016

VERMONT GAS	
PROPOSED 12" PIPELINE	
ADDISON NATURAL GAS PROJECT	
ACCESS ROAD DETAILS	
LOC.	CHITTENDEN & ADDISON COUNTIES
YEAR:	2016
W.O.	
SCALE:	AS NOTED


VERMONT GAS
 38 Eastwood Drive, Suite 105
 South Burlington, VT 05403
 Main: (802) 795-0372 • www.chacompanies.com










CIA
 CHITTENDEN & ADDISON COMPANIES



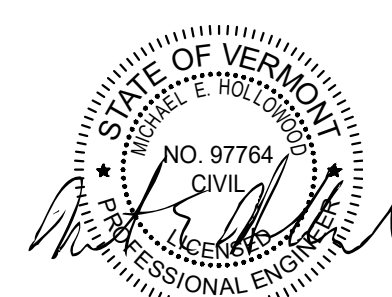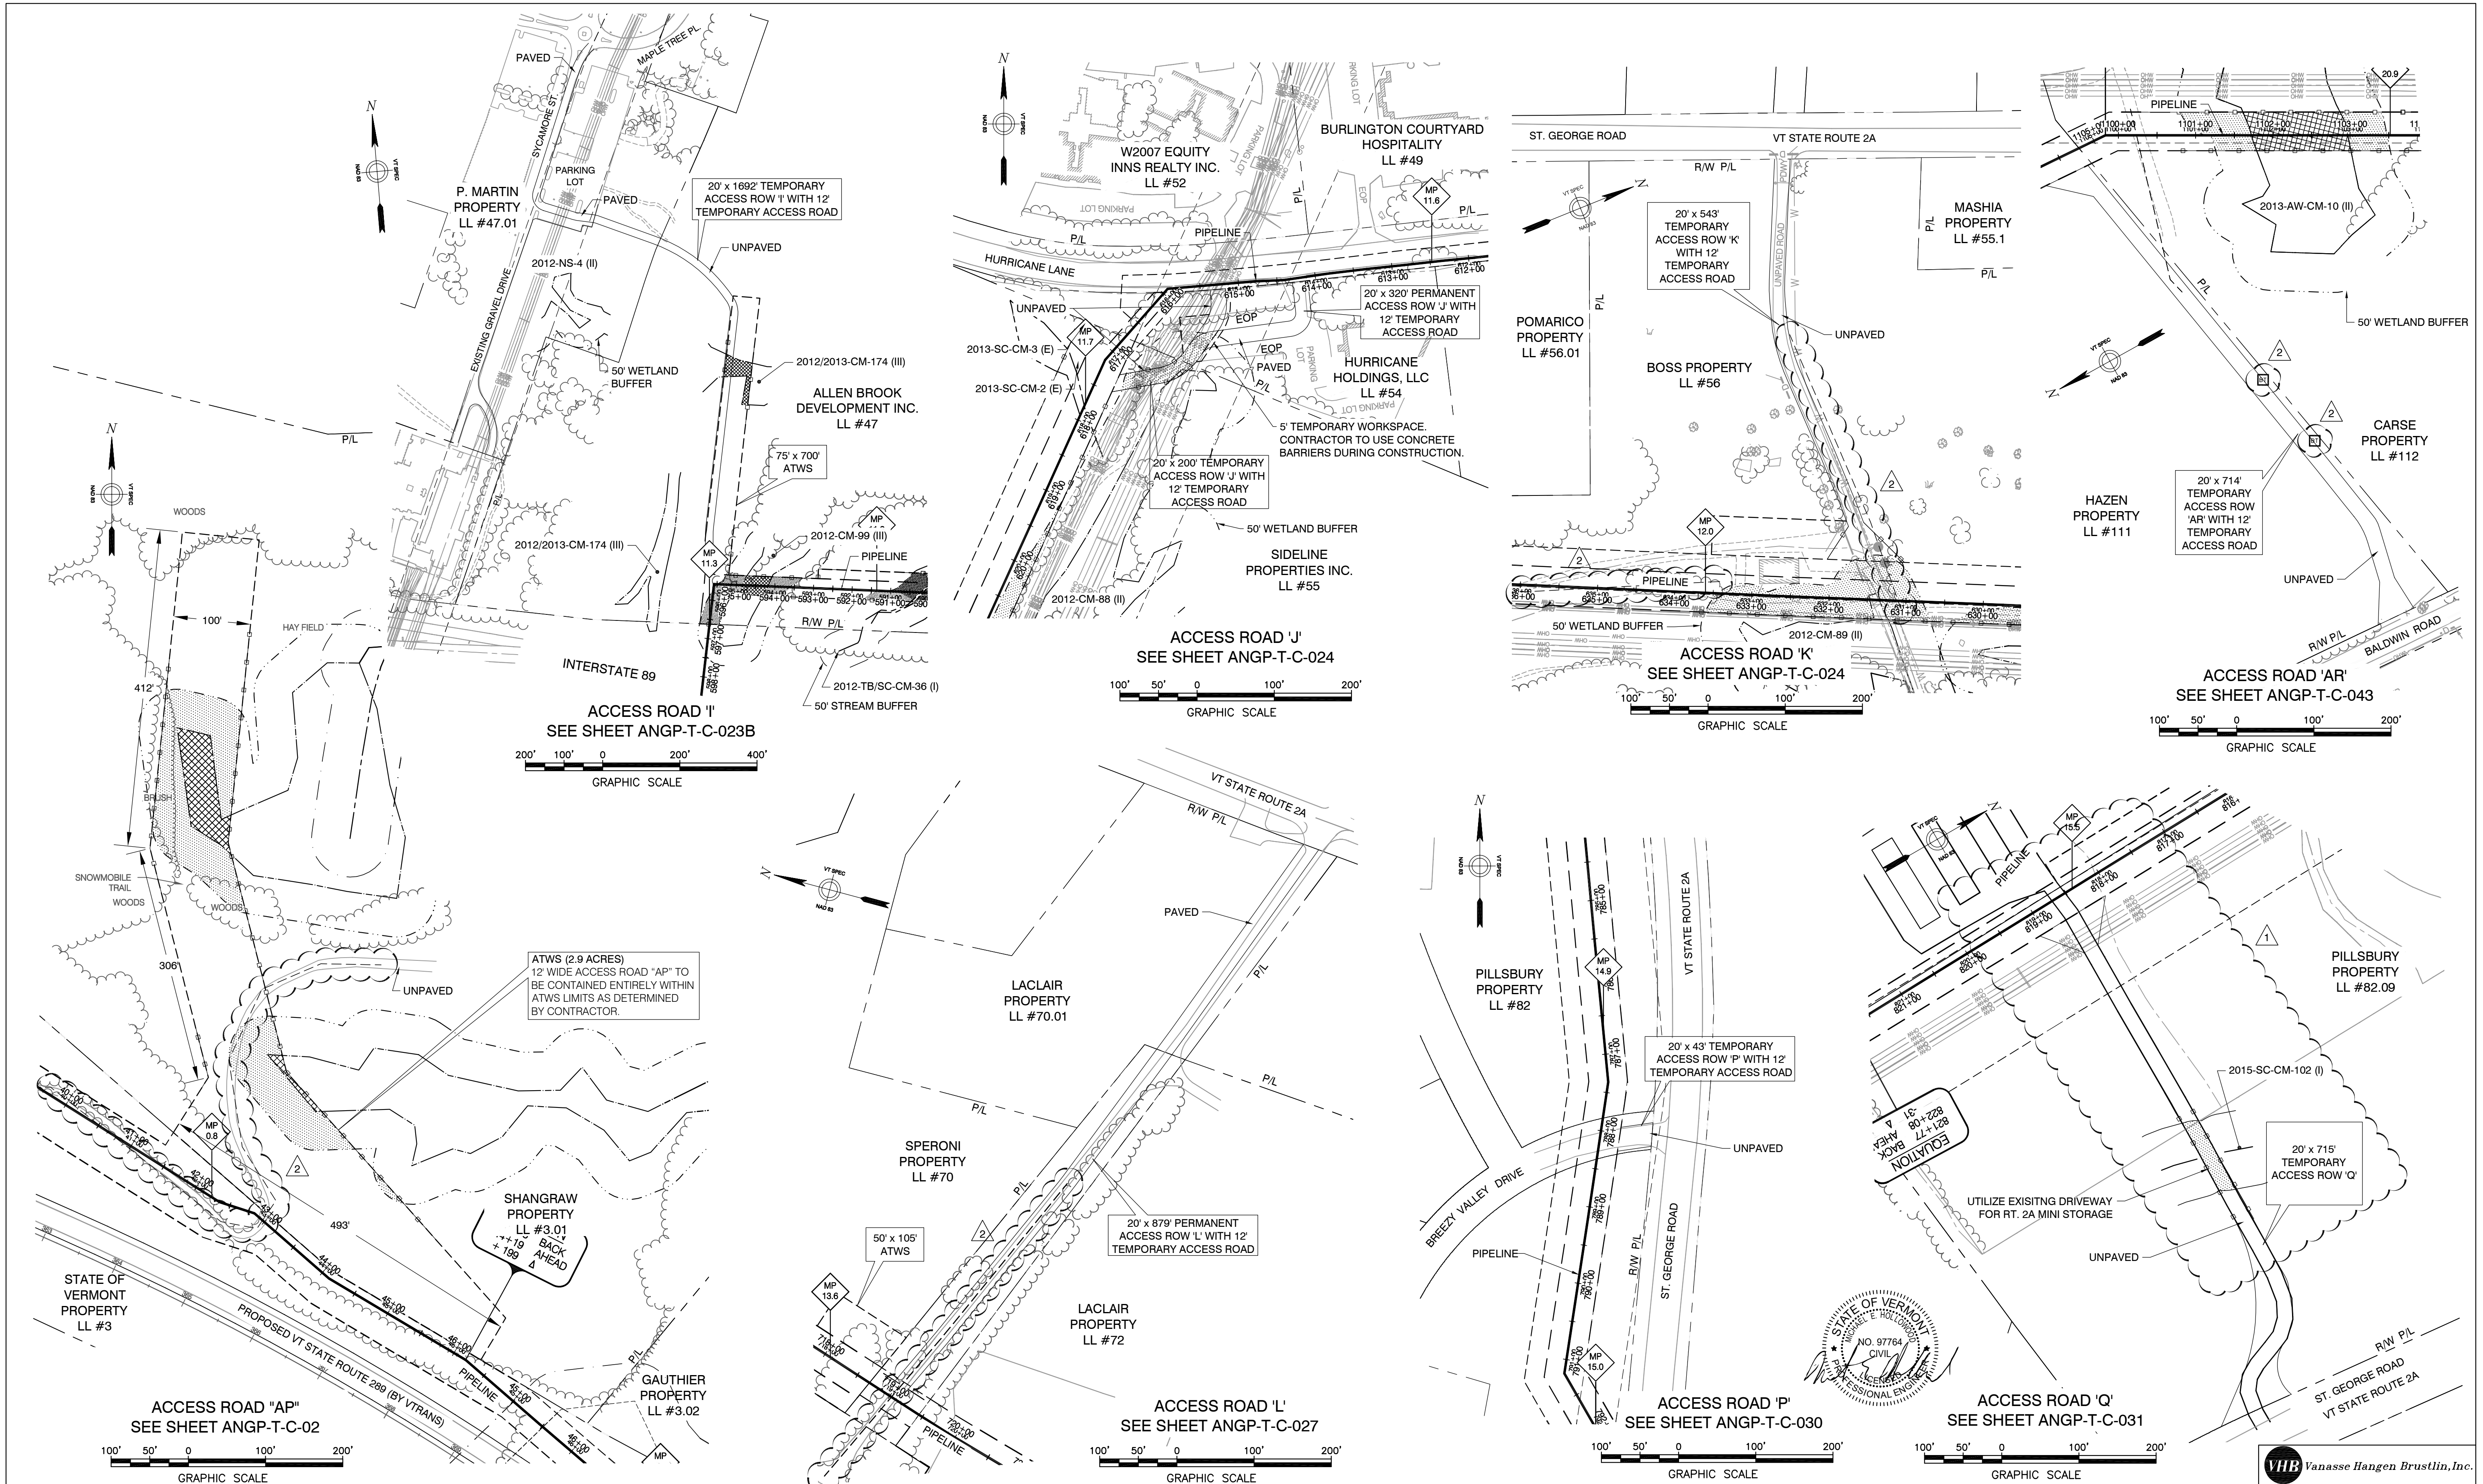

DWG. NO.	REFERENCE DWG.			REV	DSN	CK	DESCRIPTION	INITIALS	DATE	BID	CONSTRUCTION	YEAR: 2016	W.O.	SCALE: AS NOTED	DWG. ANGP-T-G-008	REV. 2
	2	GJM	BCK													
	1	BCK	TDB	PILLSBURY REROUTE AND ADDED NR DATA (6/05/15)	GIL	06/28/13	DRAFTING DESIGNER	GIL	06/28/13	GJM	05/2016	LOC. CHITTENDEN & ADDISON COUNTIES				



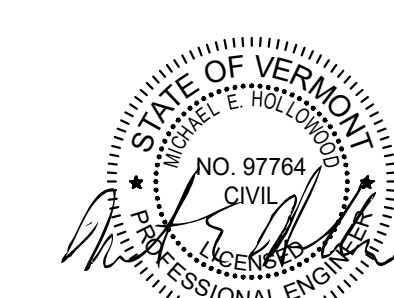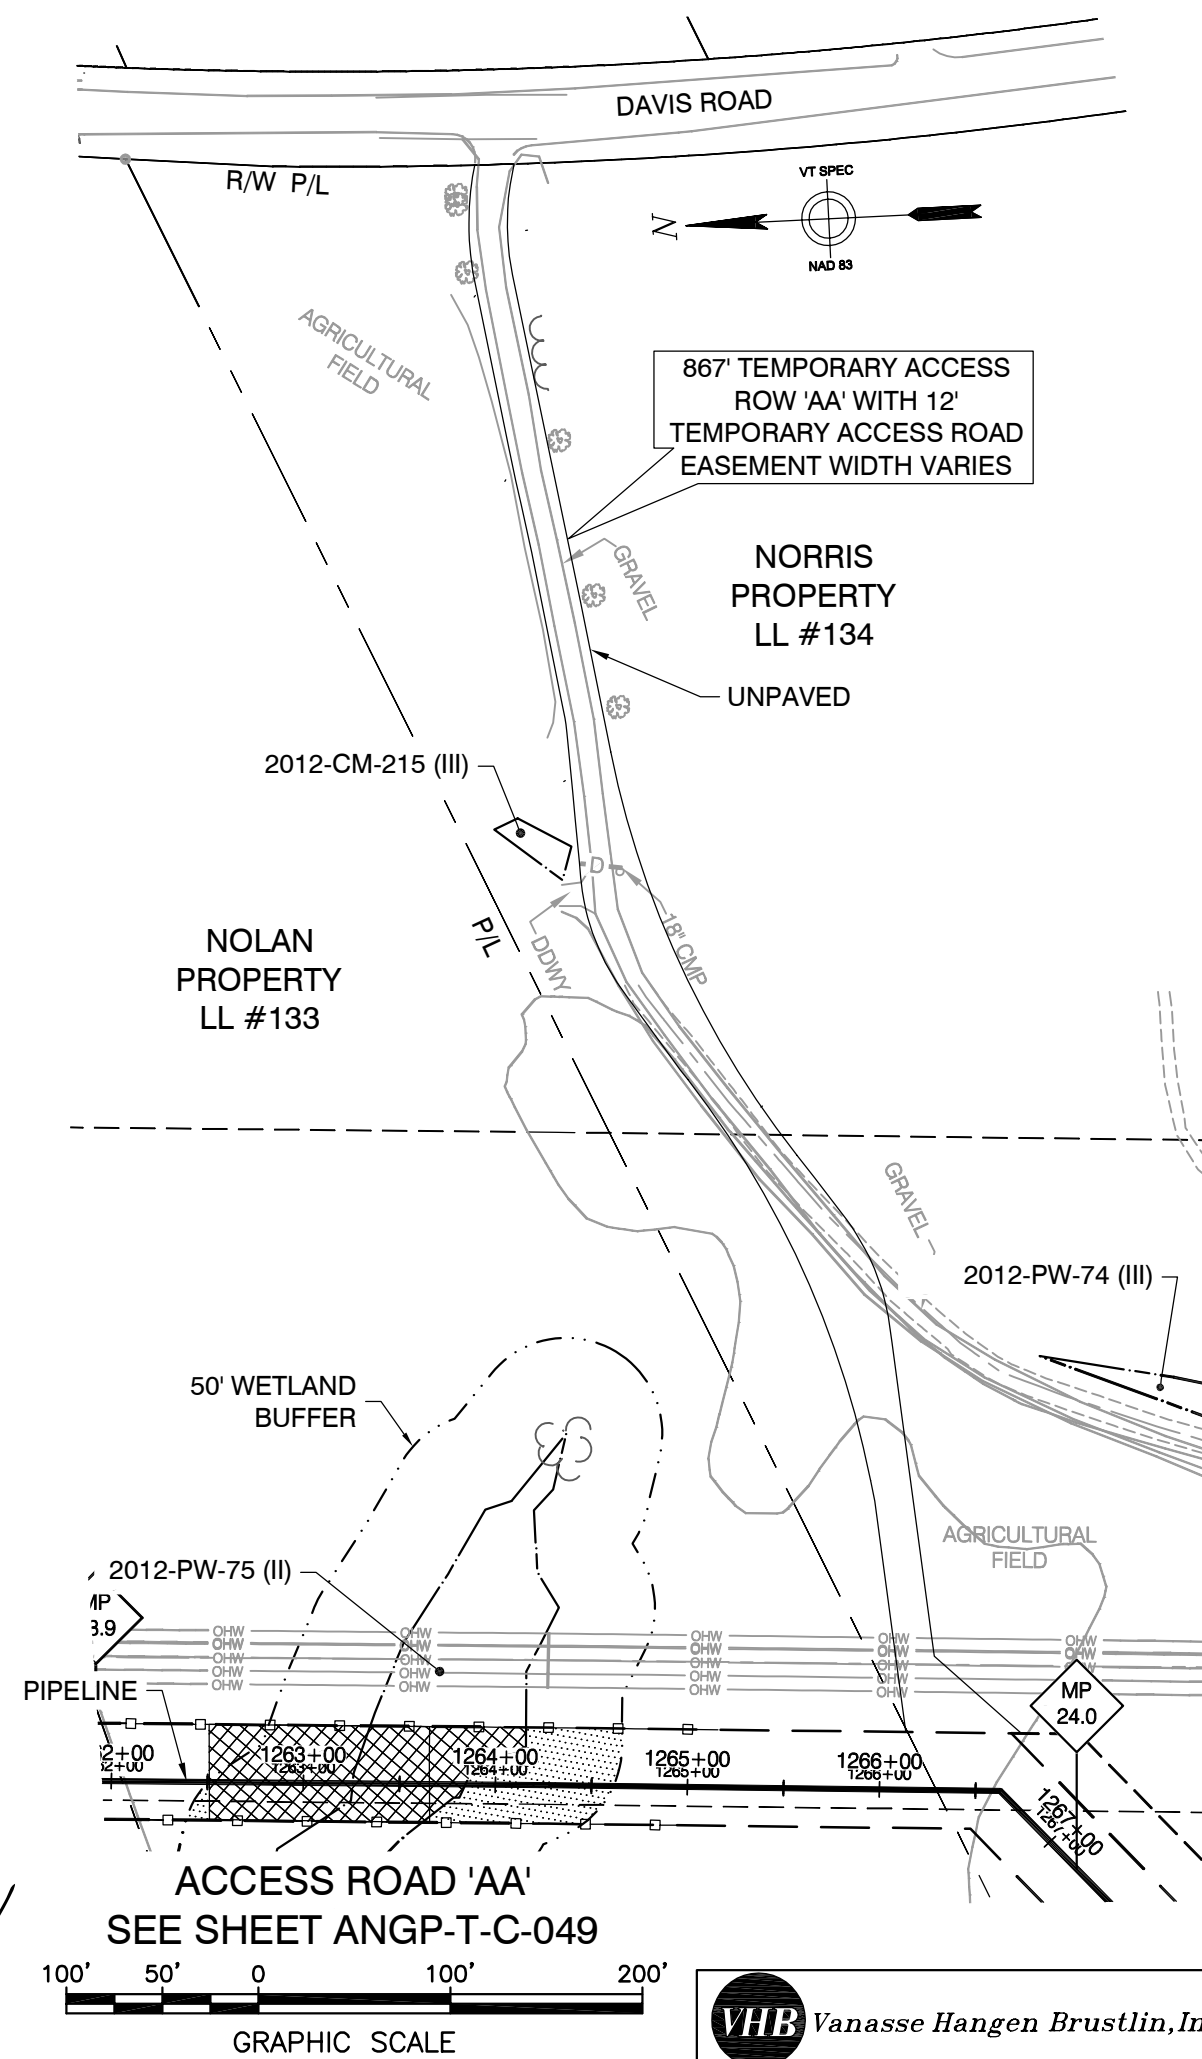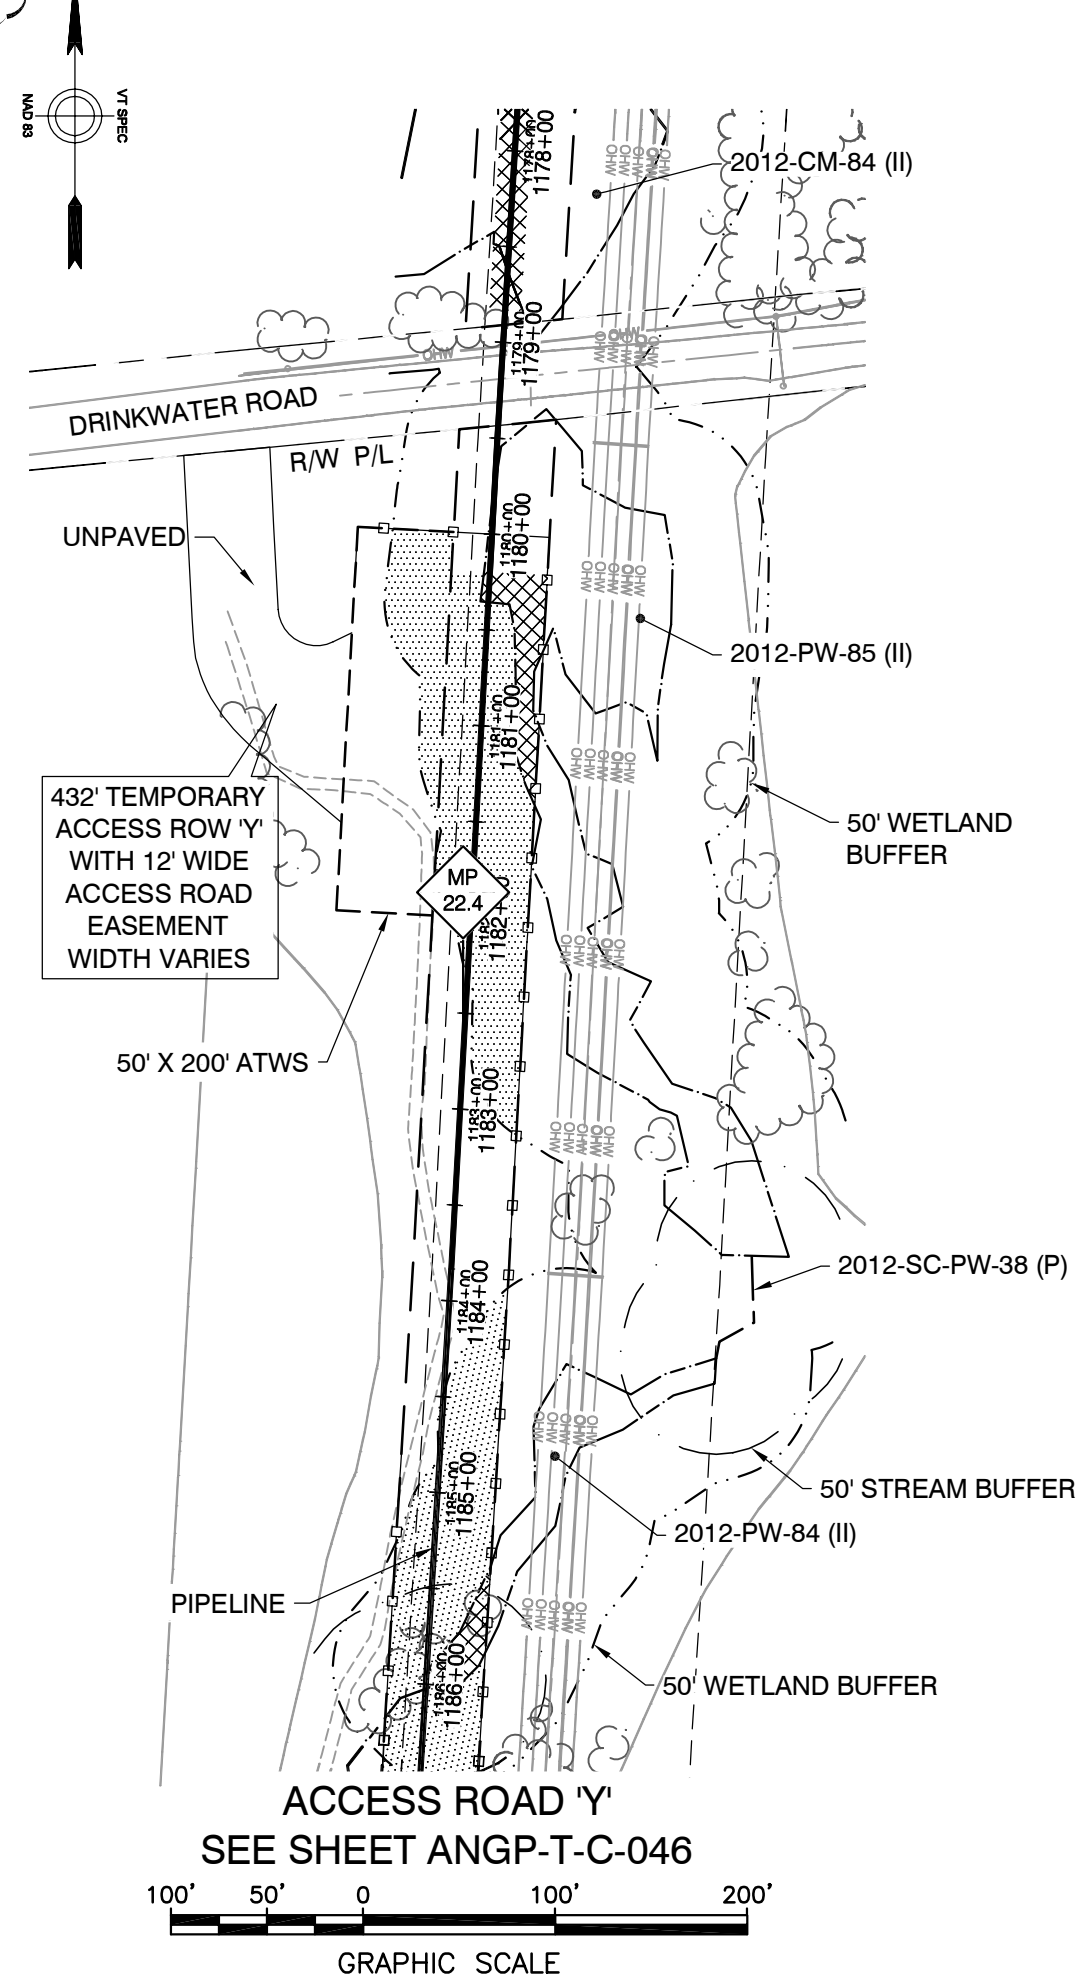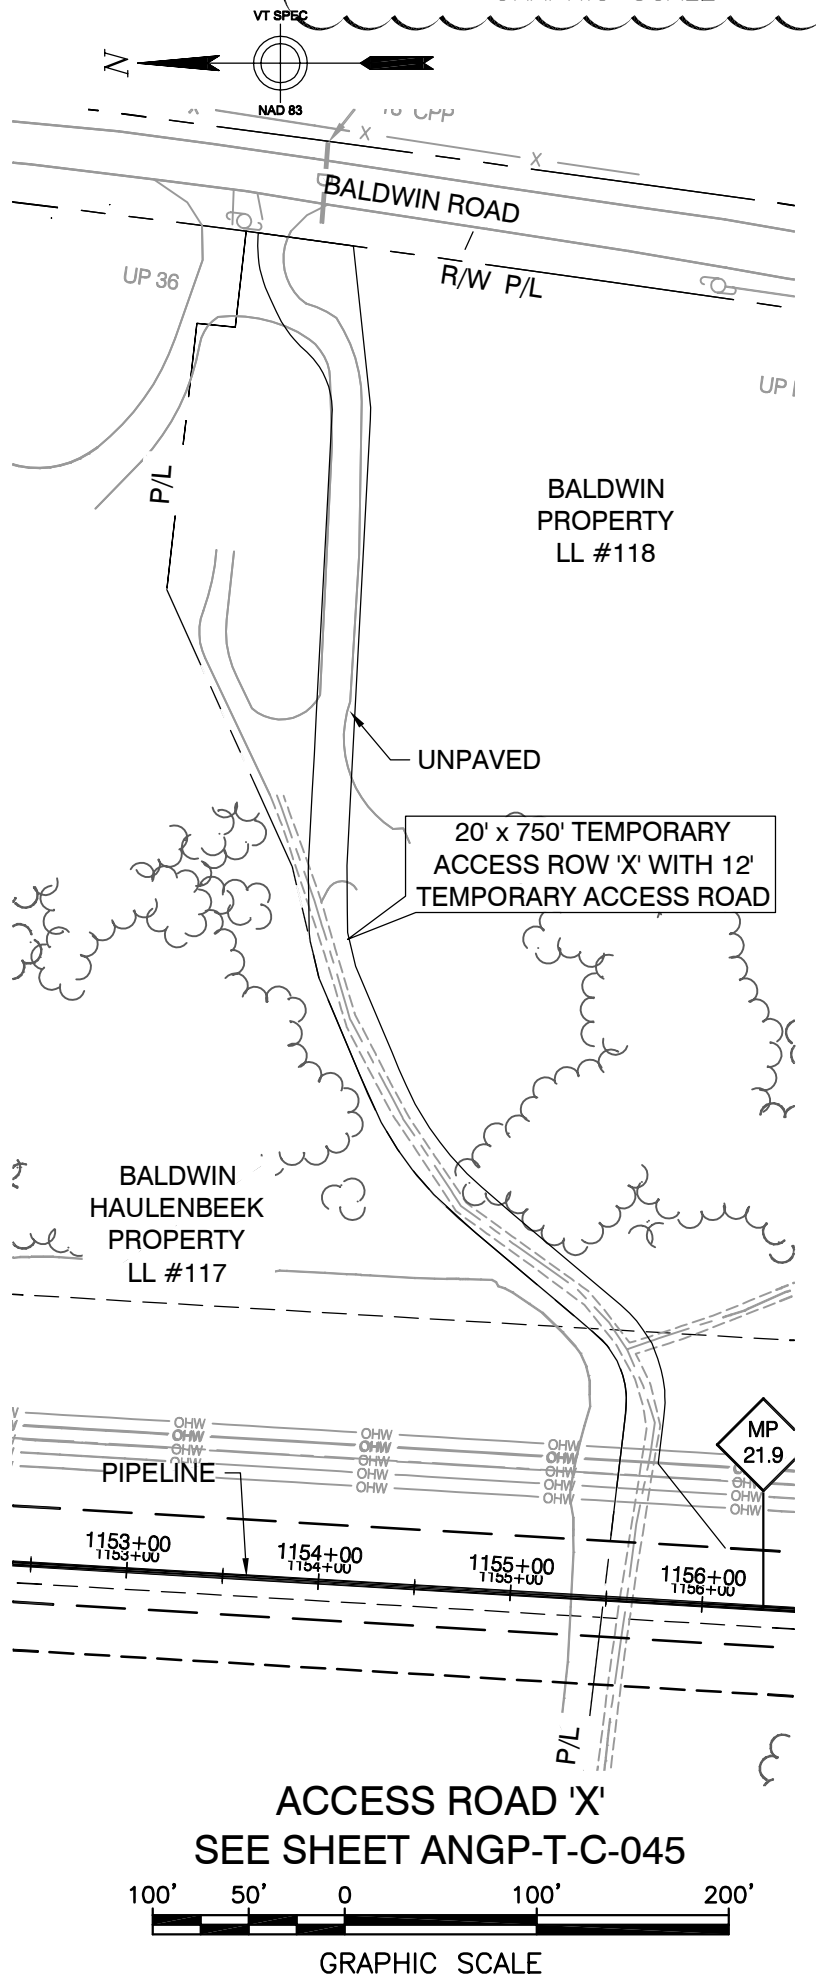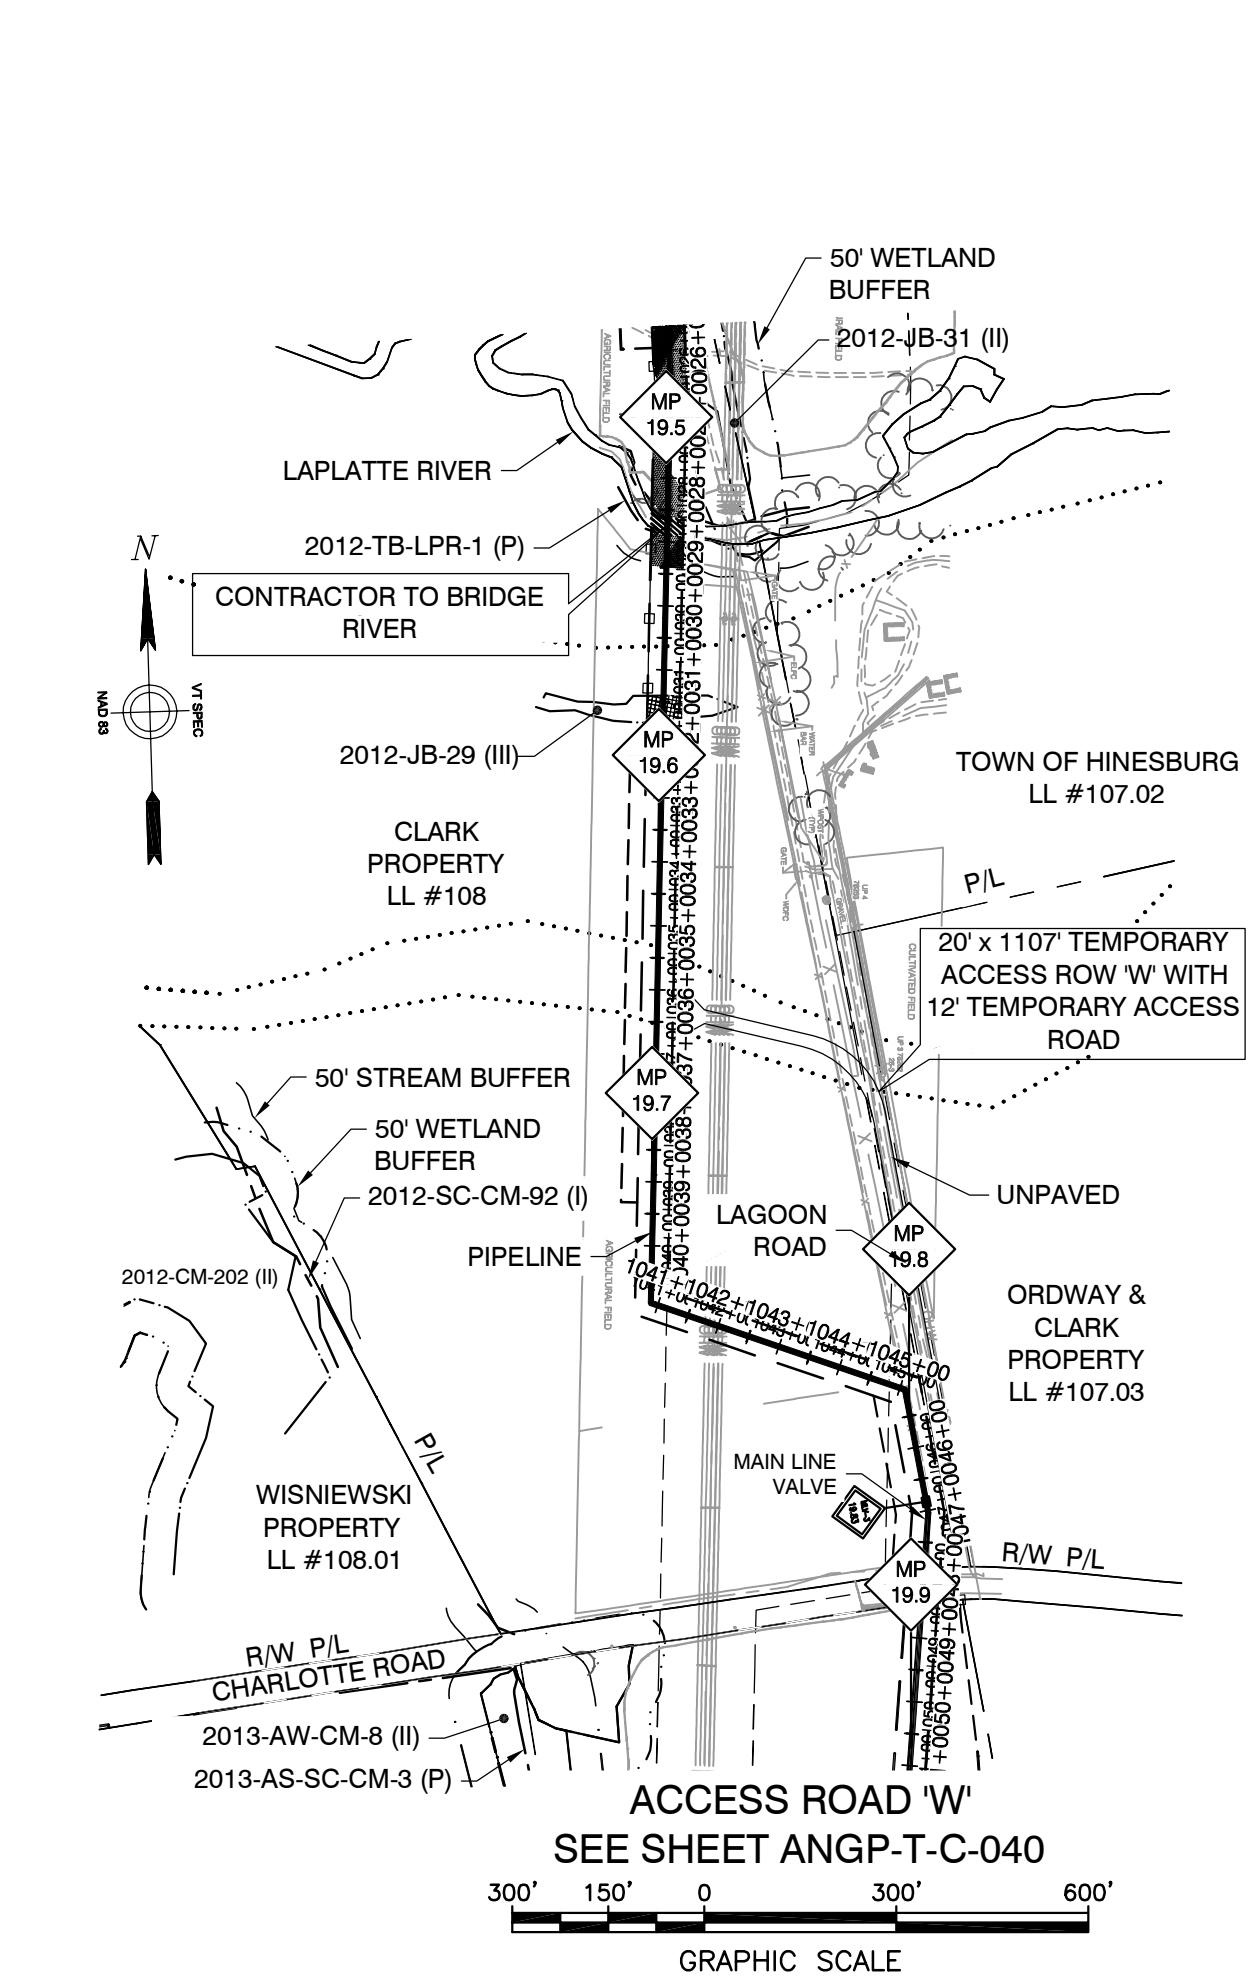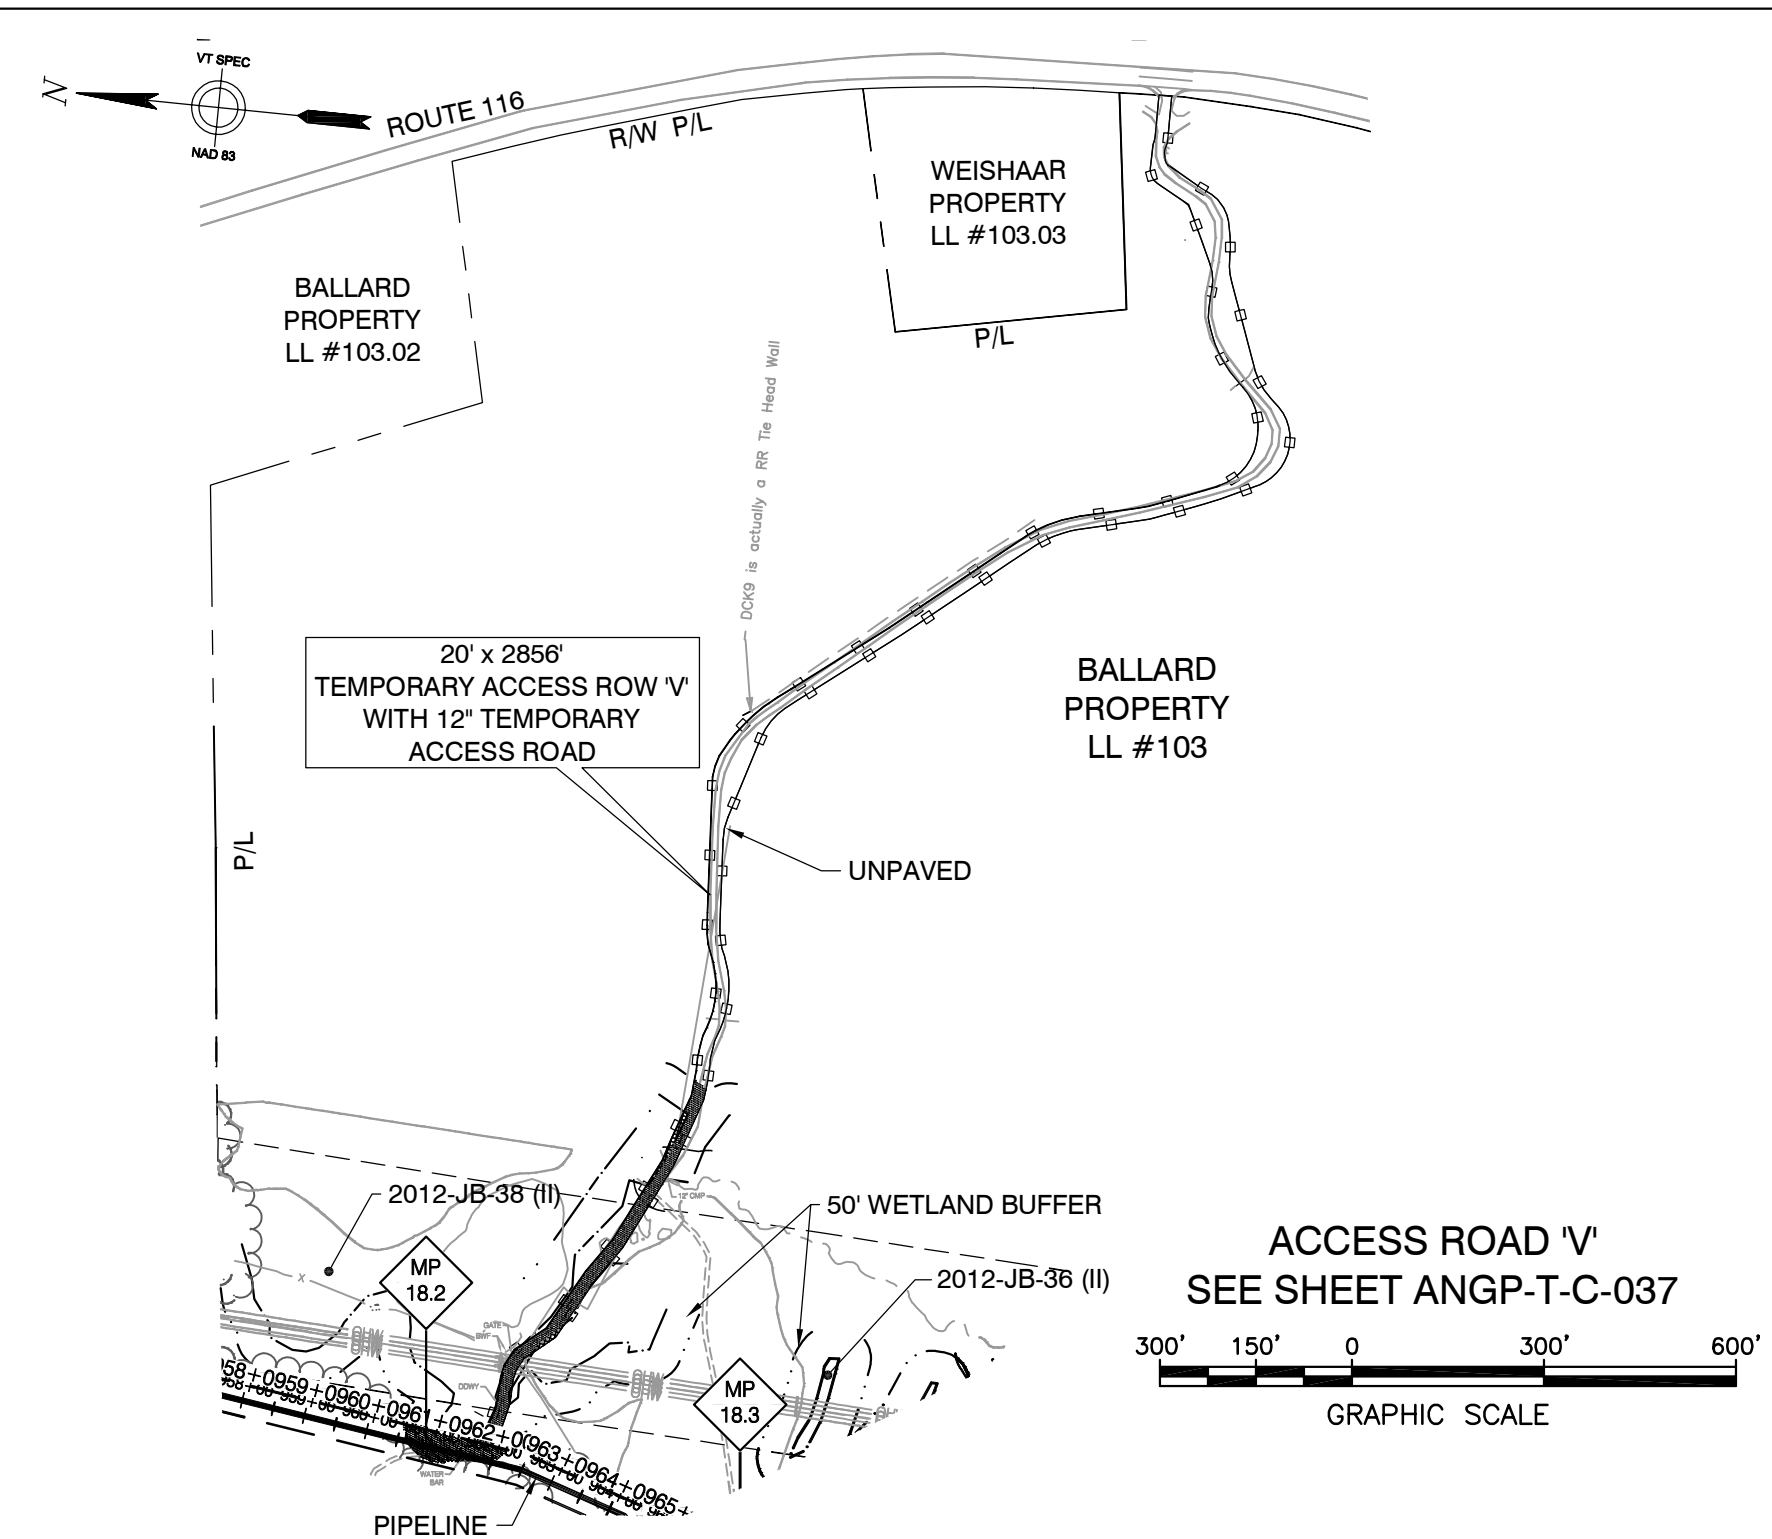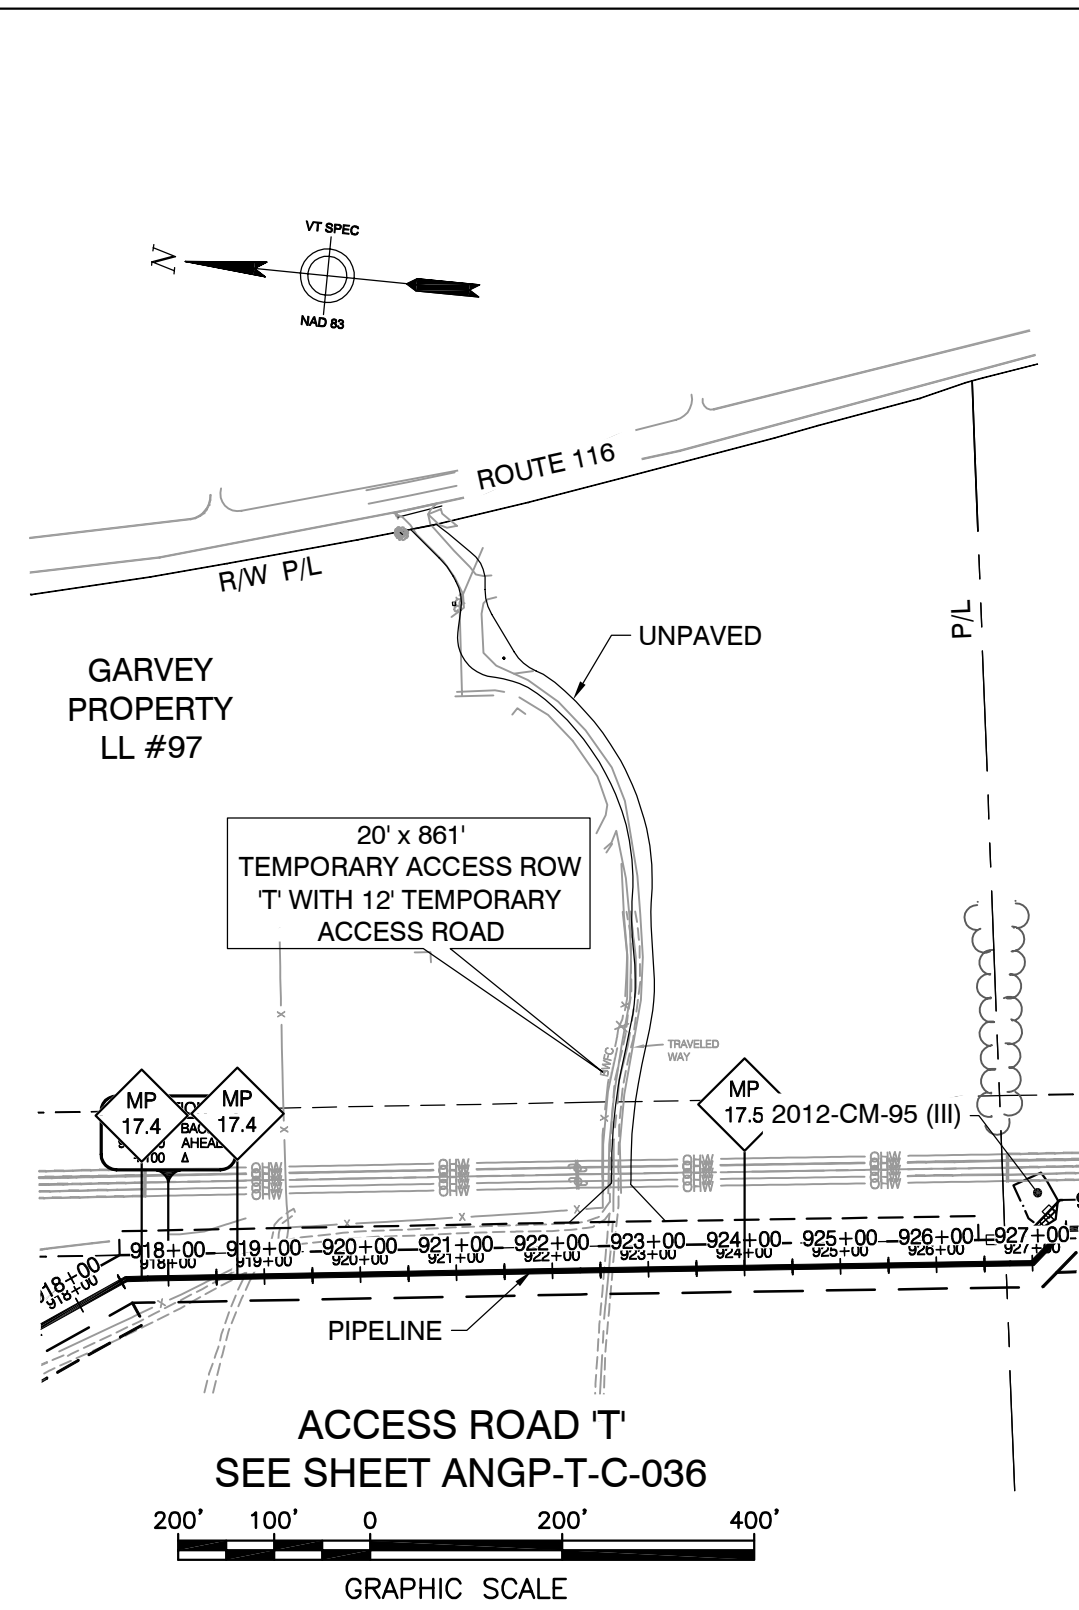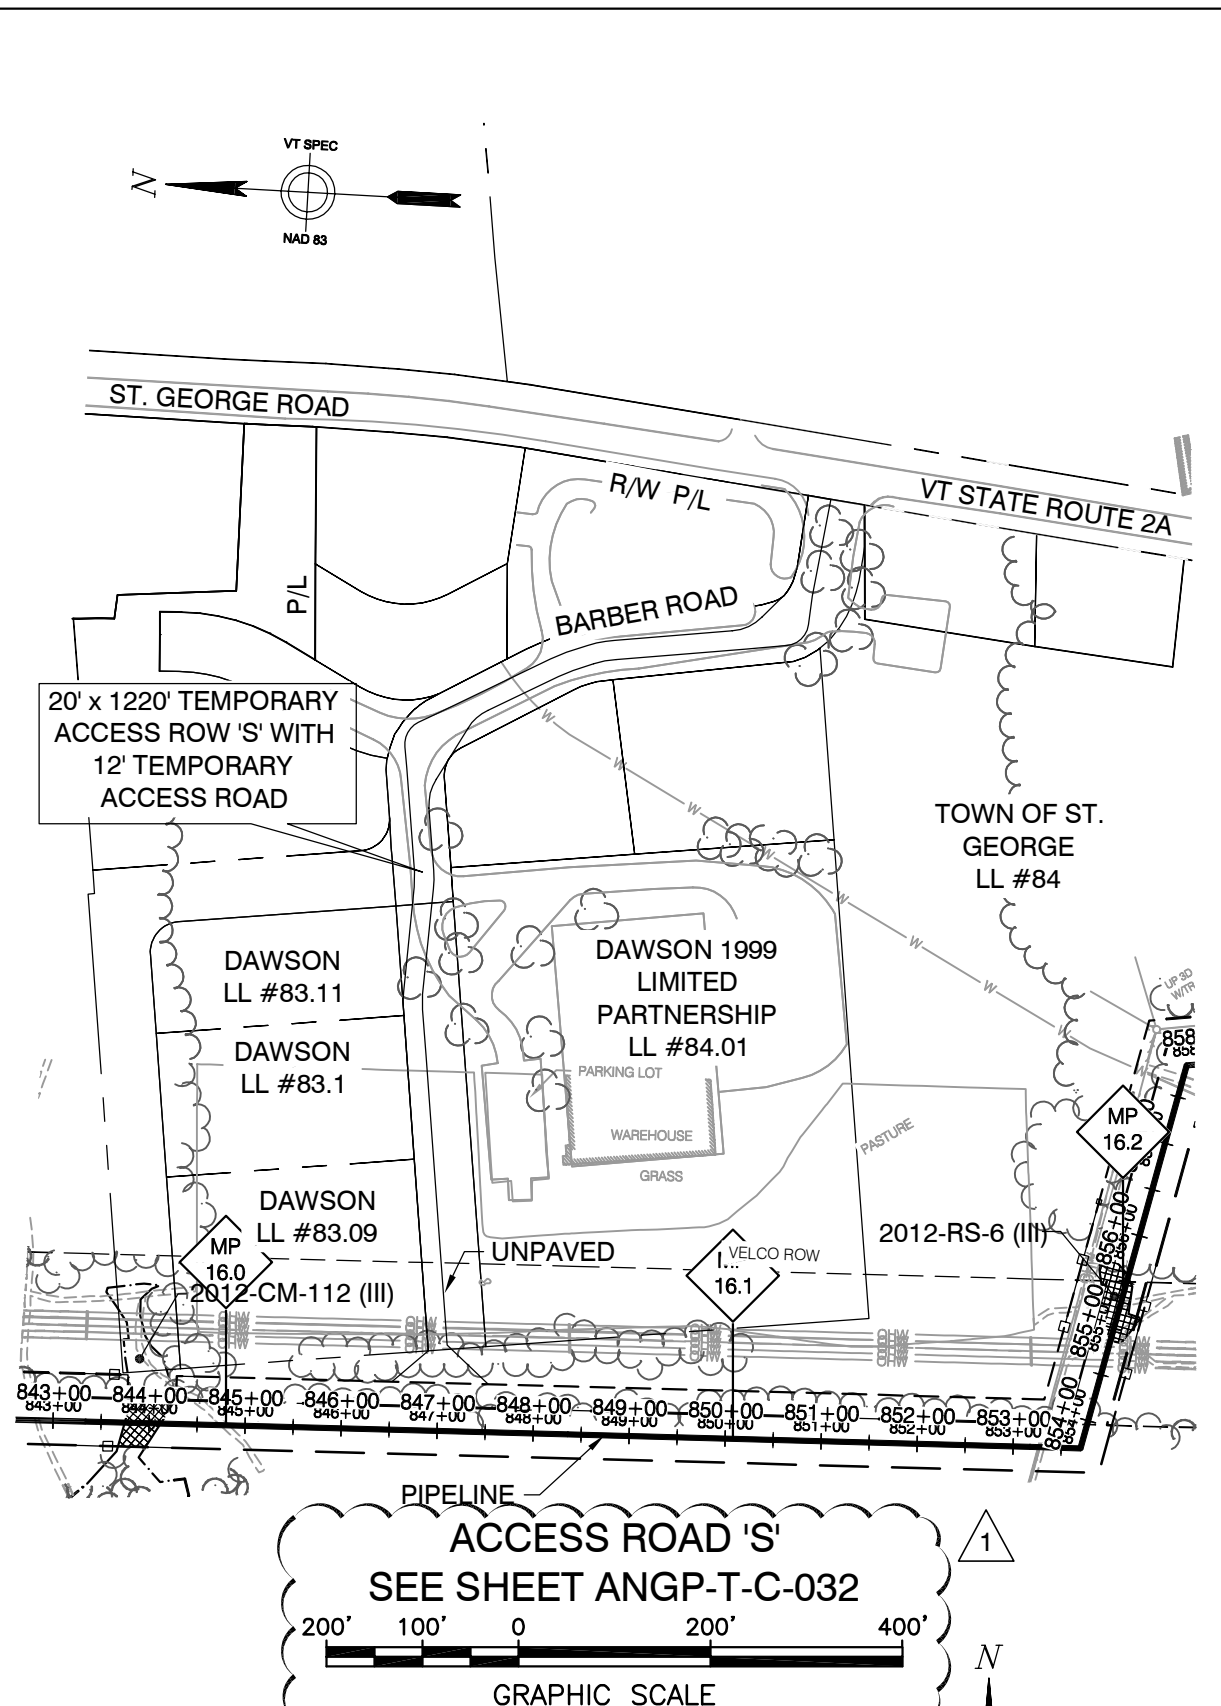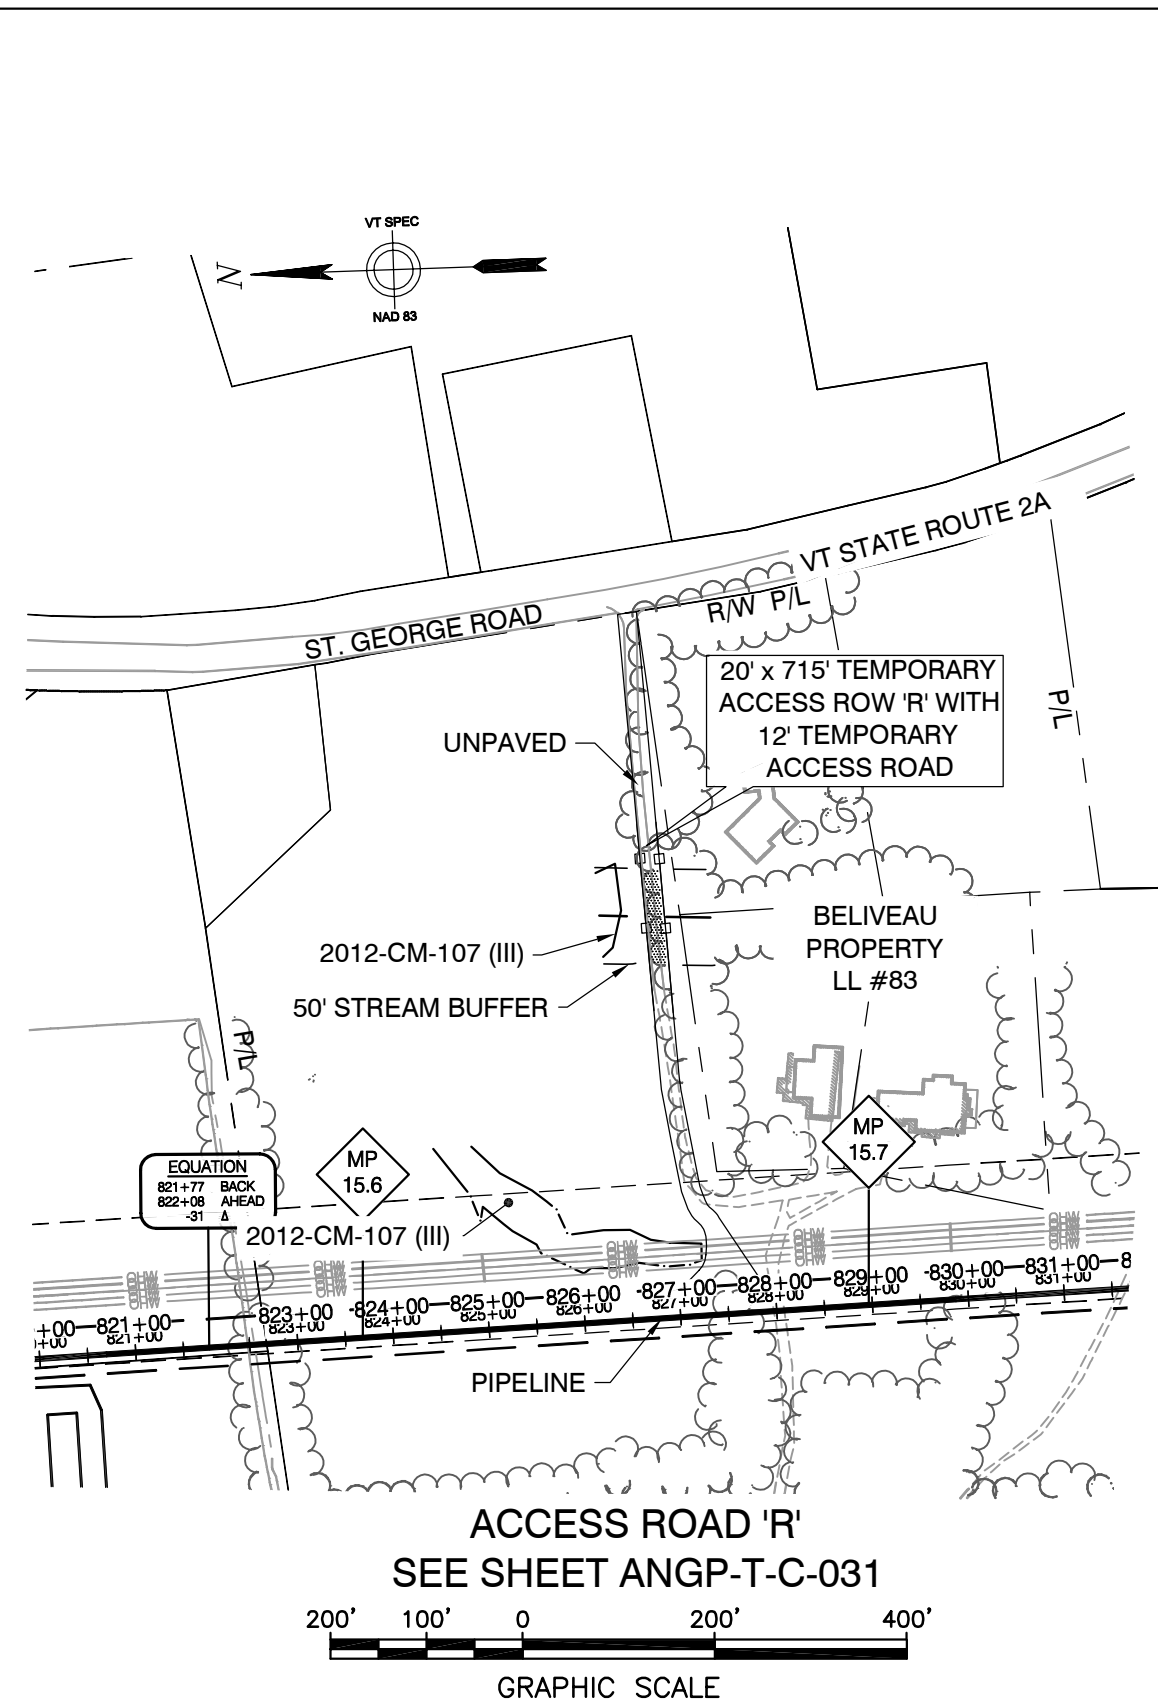

DWG. NO.	REFERENCE DWG.	REV	DSN	CK	DESCRIPTION	INITIALS	DATE	INITIALS	DATE	YEAR:	W.O.	SCALE:	DWG.	REV.
		1	BCK	TDB	VHB EDITS (6/09/15)					2016		AS NOTED	ANGP-T-G-009	1







	BID	CONSTRUCTION
ENVIRONMENTAL	JLS 06/28/13	JLS 05/2016
DRAFTING DESIGNER	GIL 06/28/13	GJM 05/2016
DRAFTING SUPERVISOR	BZD 06/28/13	BCK 05/2016
DESIGN ENGINEER	MDF 06/28/13	GEW 05/2016
DESIGN MANAGER	SAB 06/28/13	JEO 05/2016

VERMONT GAS
PROPOSED 12" PIPELINE
ADDISON NATURAL GAS PROJECT
ACCESS ROAD DETAILS

LOC. CHITTENDEN & ADDISON COUNTIES

YEAR: 2016 W.O. SCALE: AS NOTED DWG. ANGP-T-G-009 REV. 1

38 Eastwood Drive, Suite 105
South Burlington, VT 05403
Main: (802) 735-0372 • www.chacompanies.com

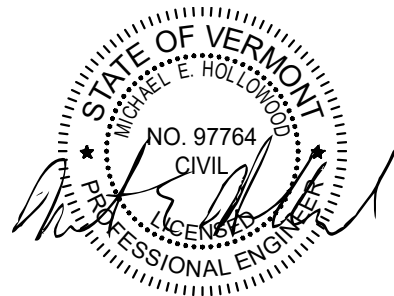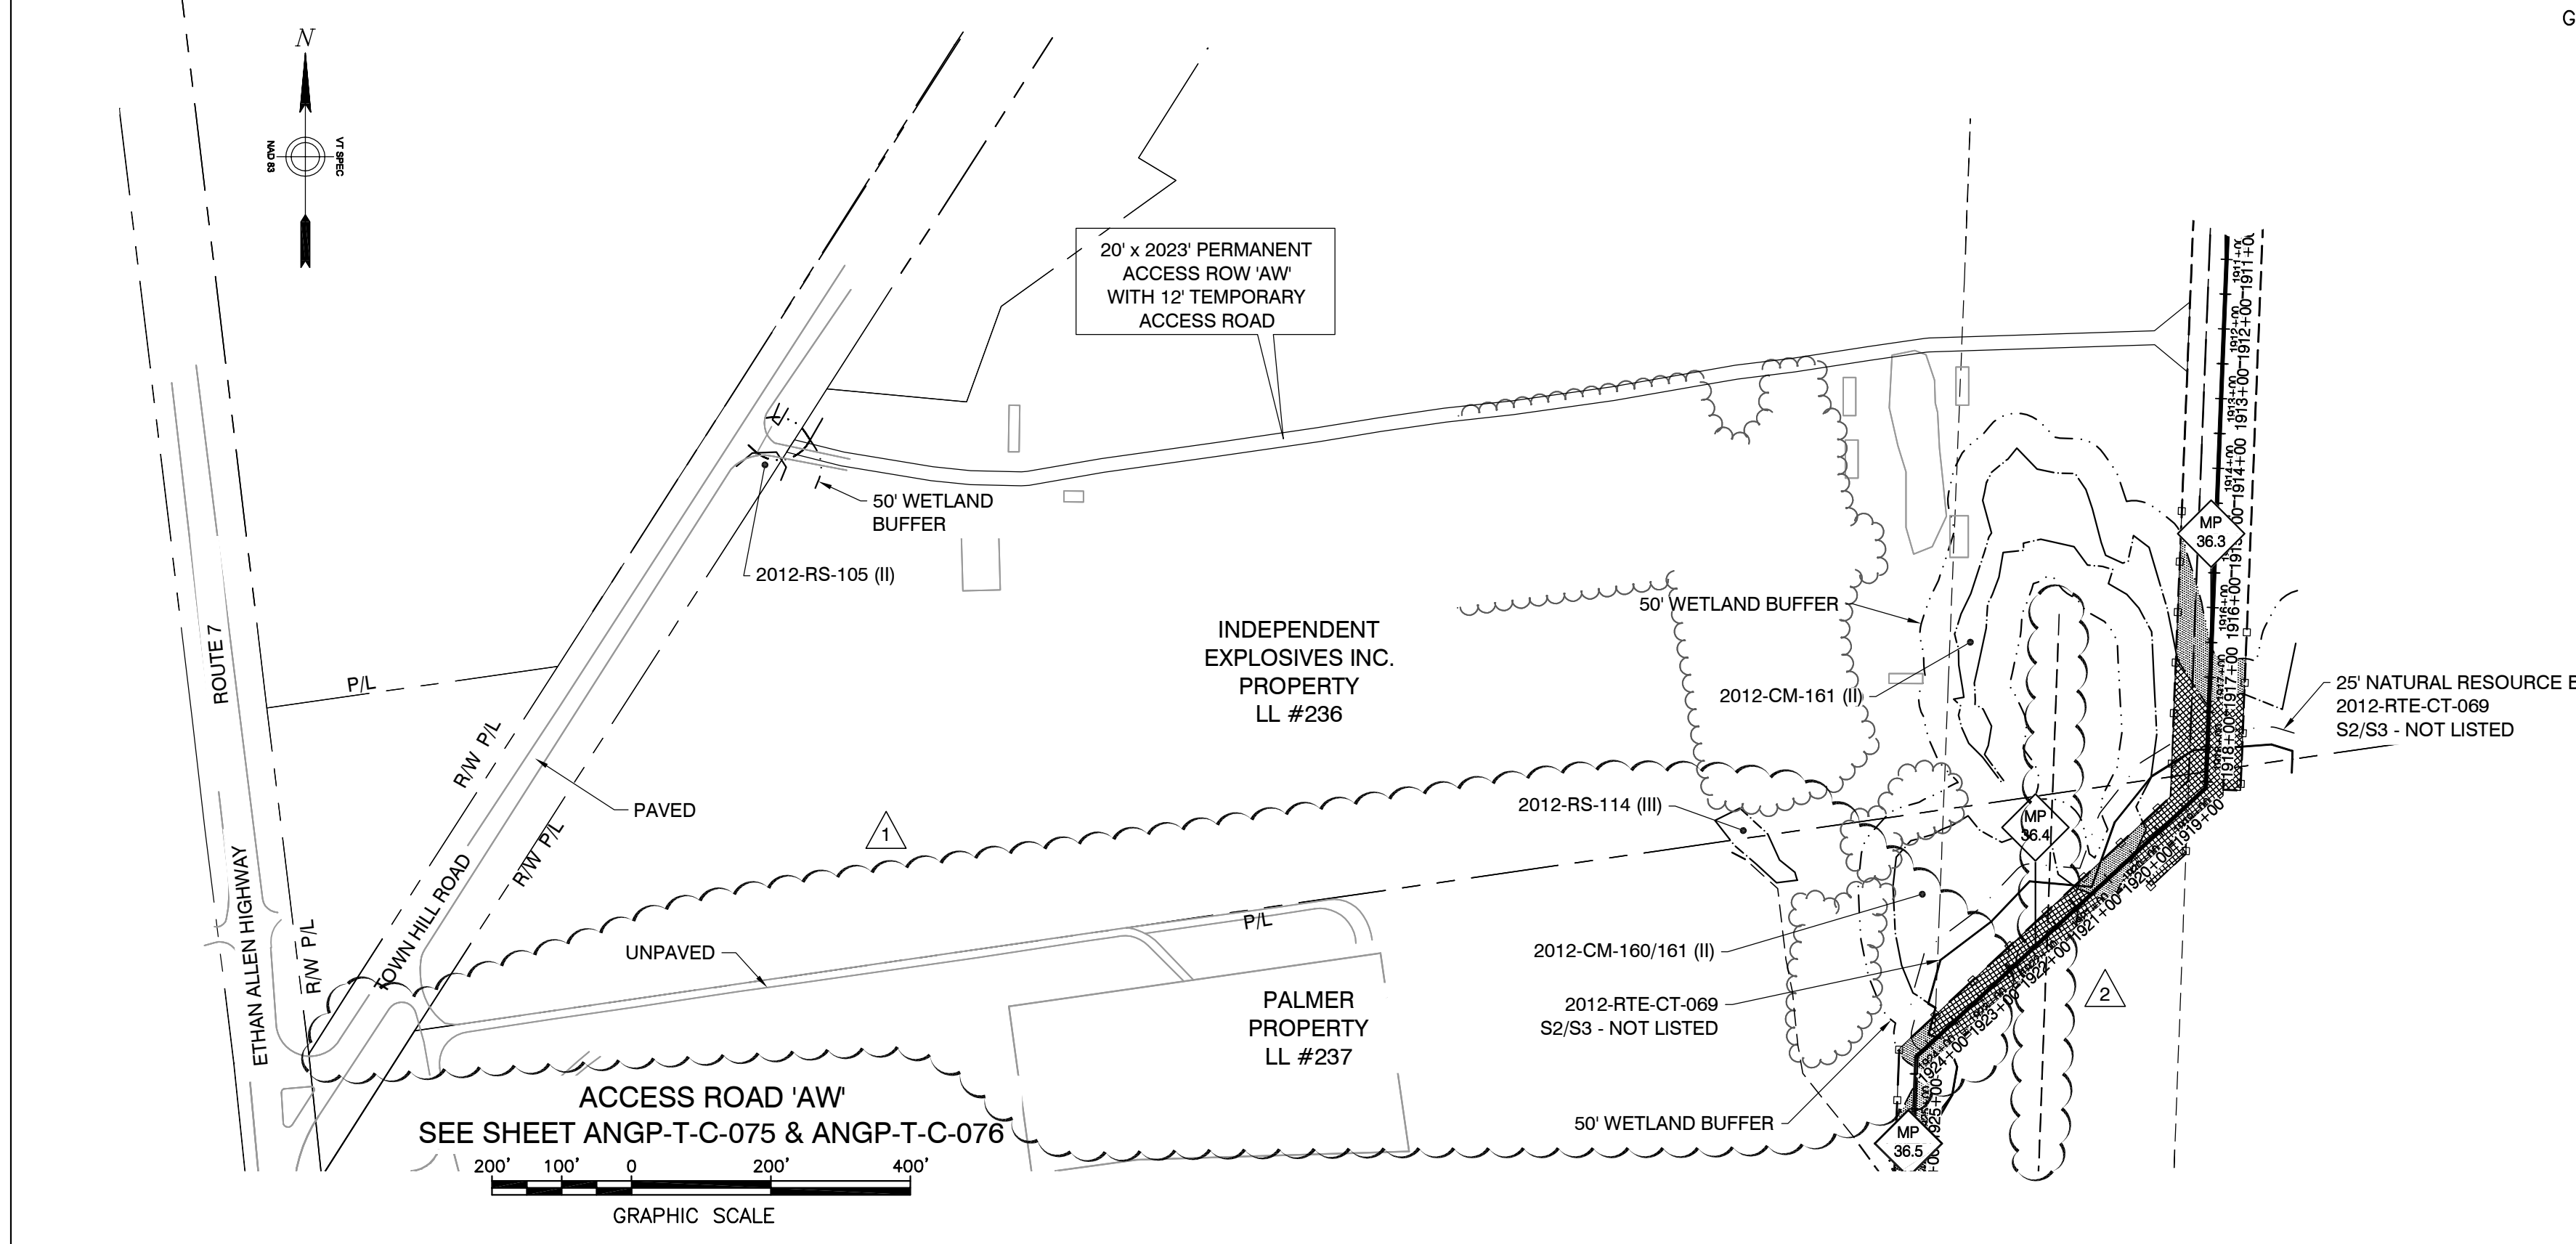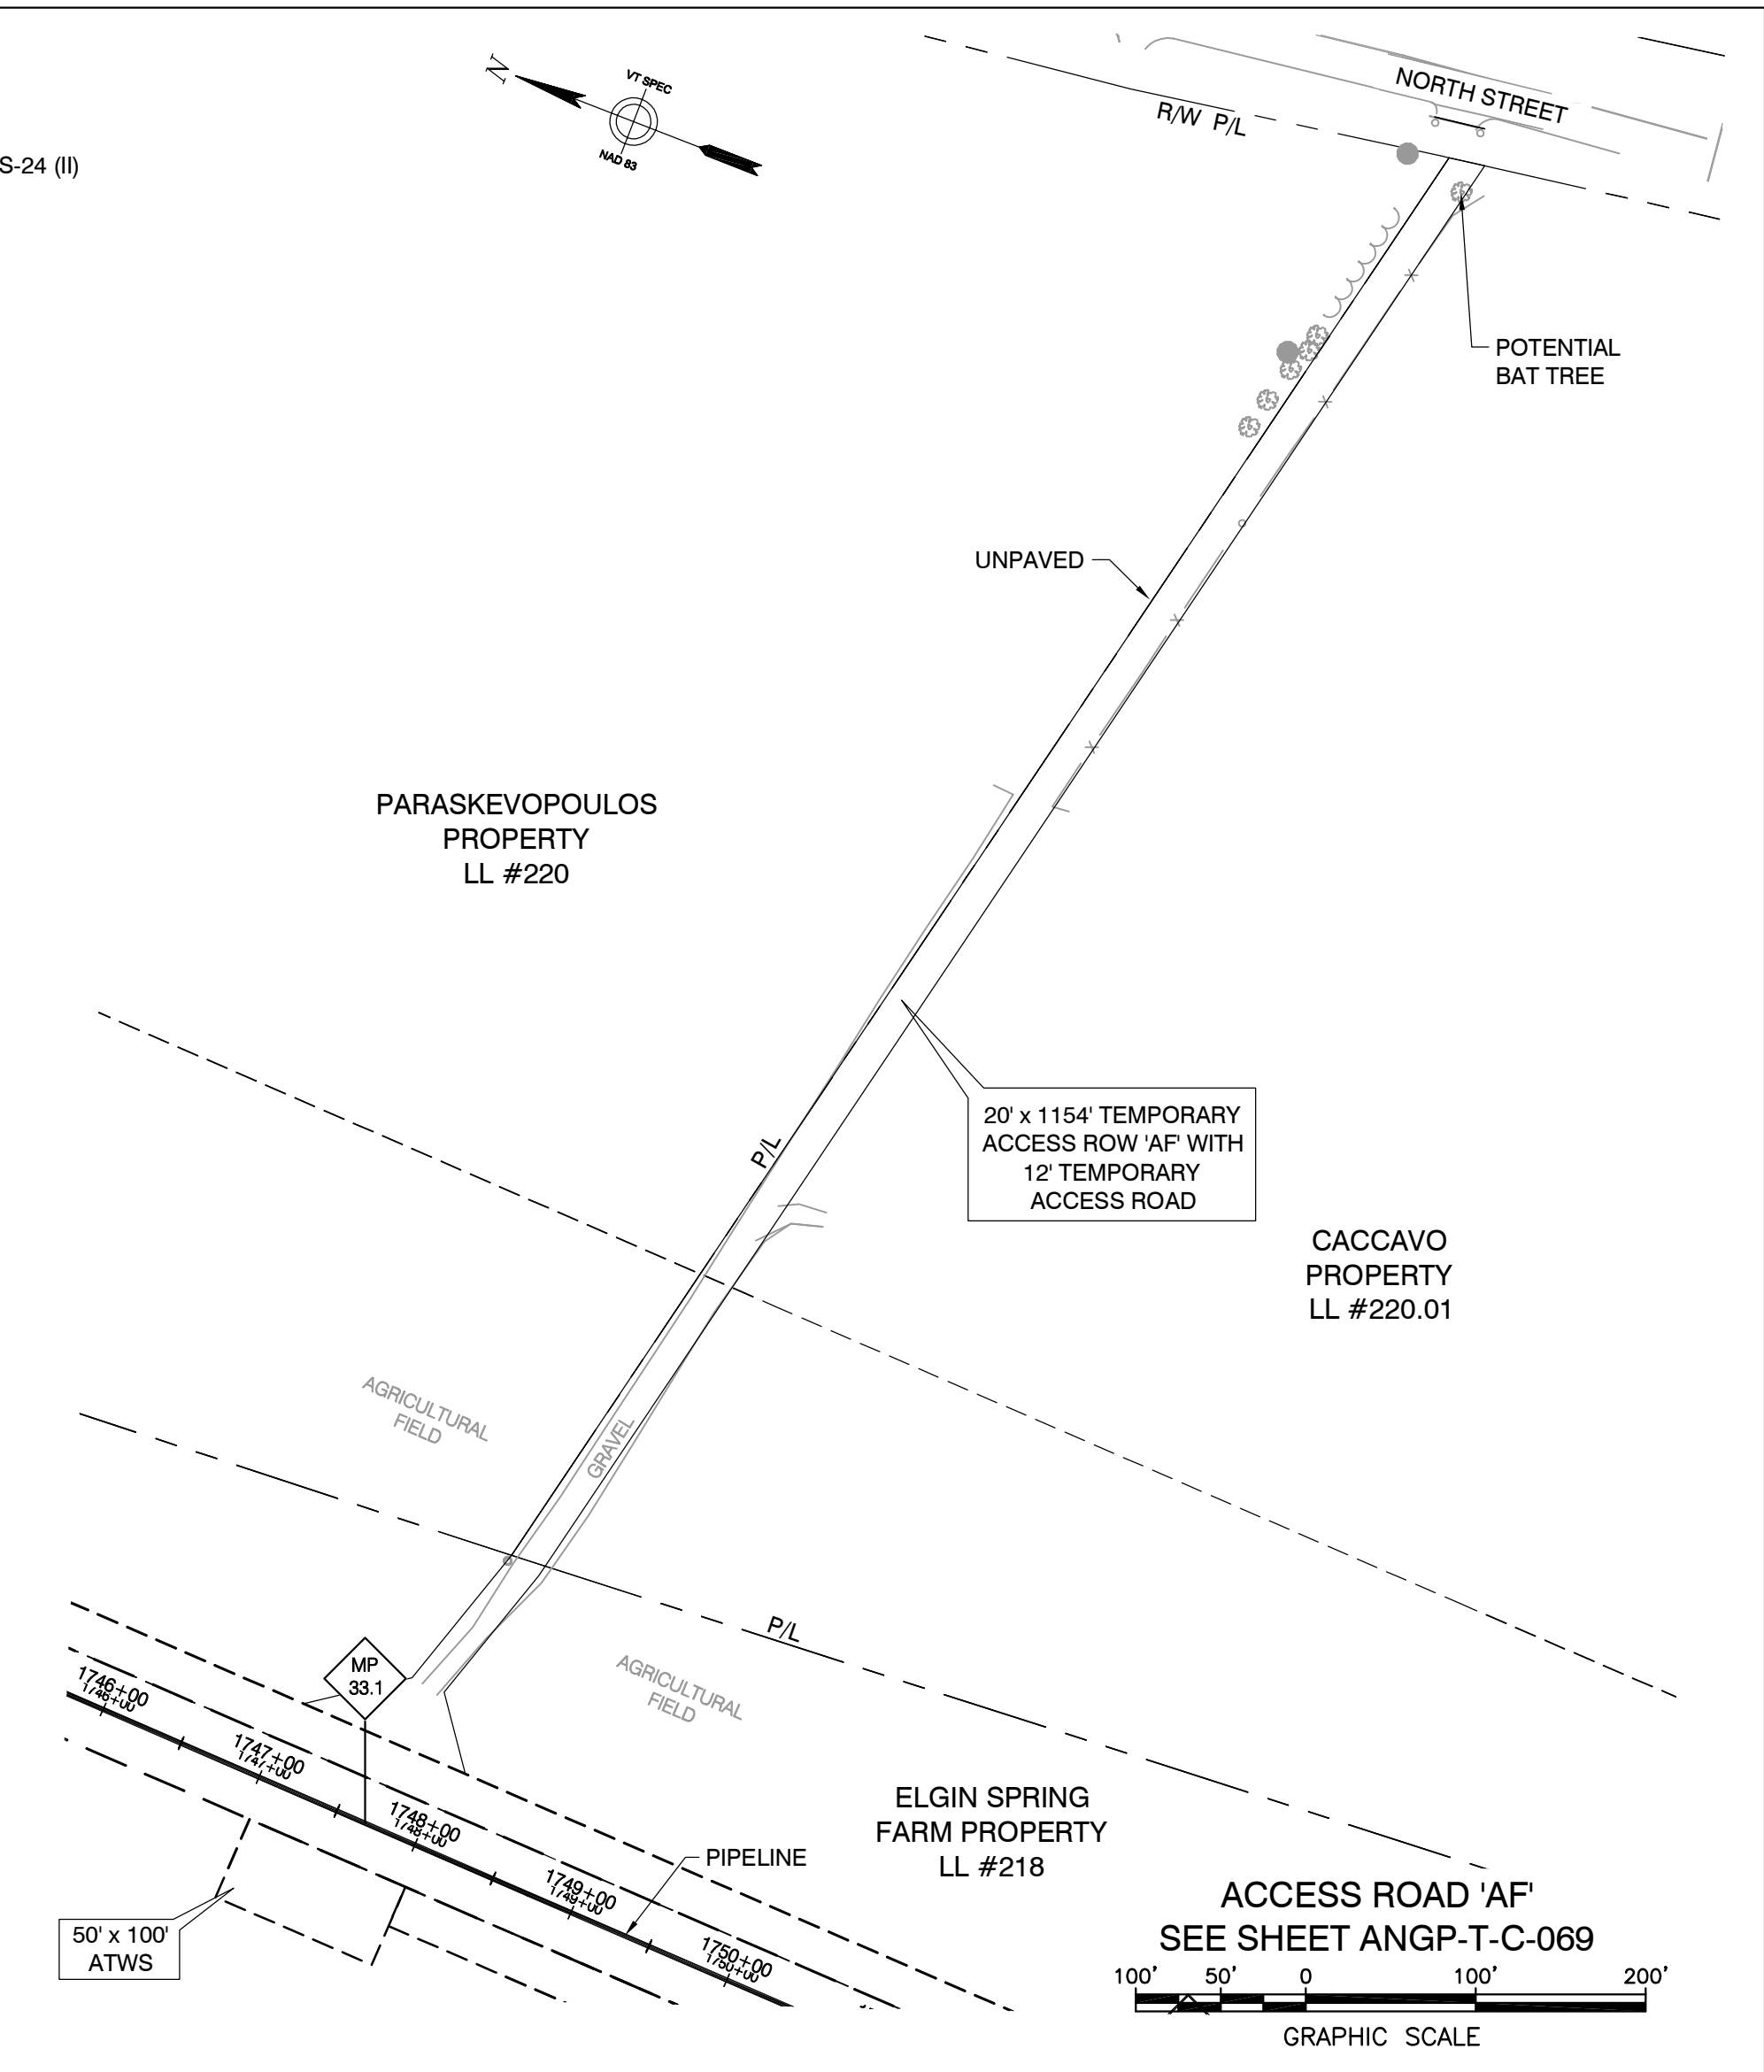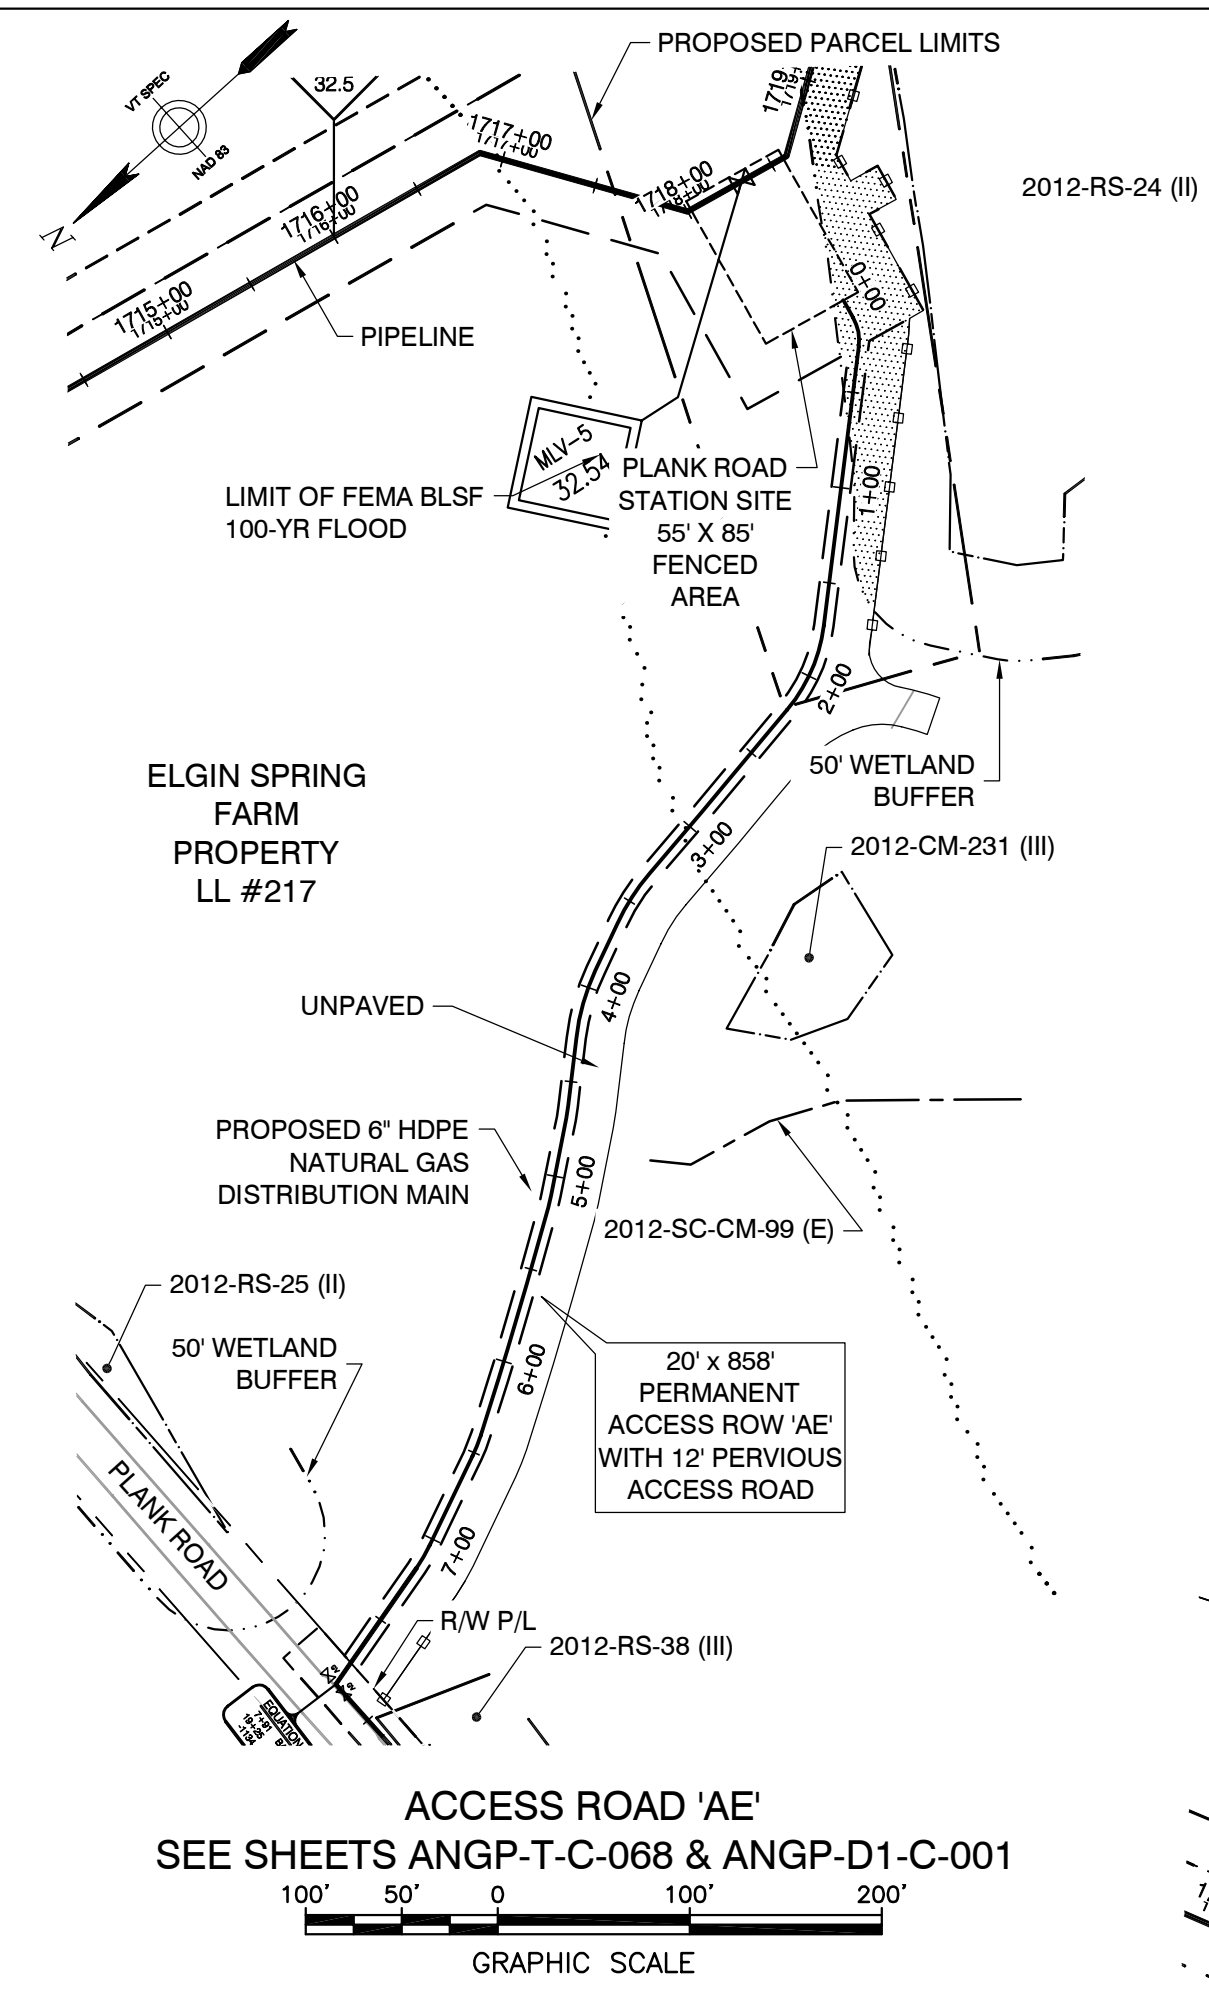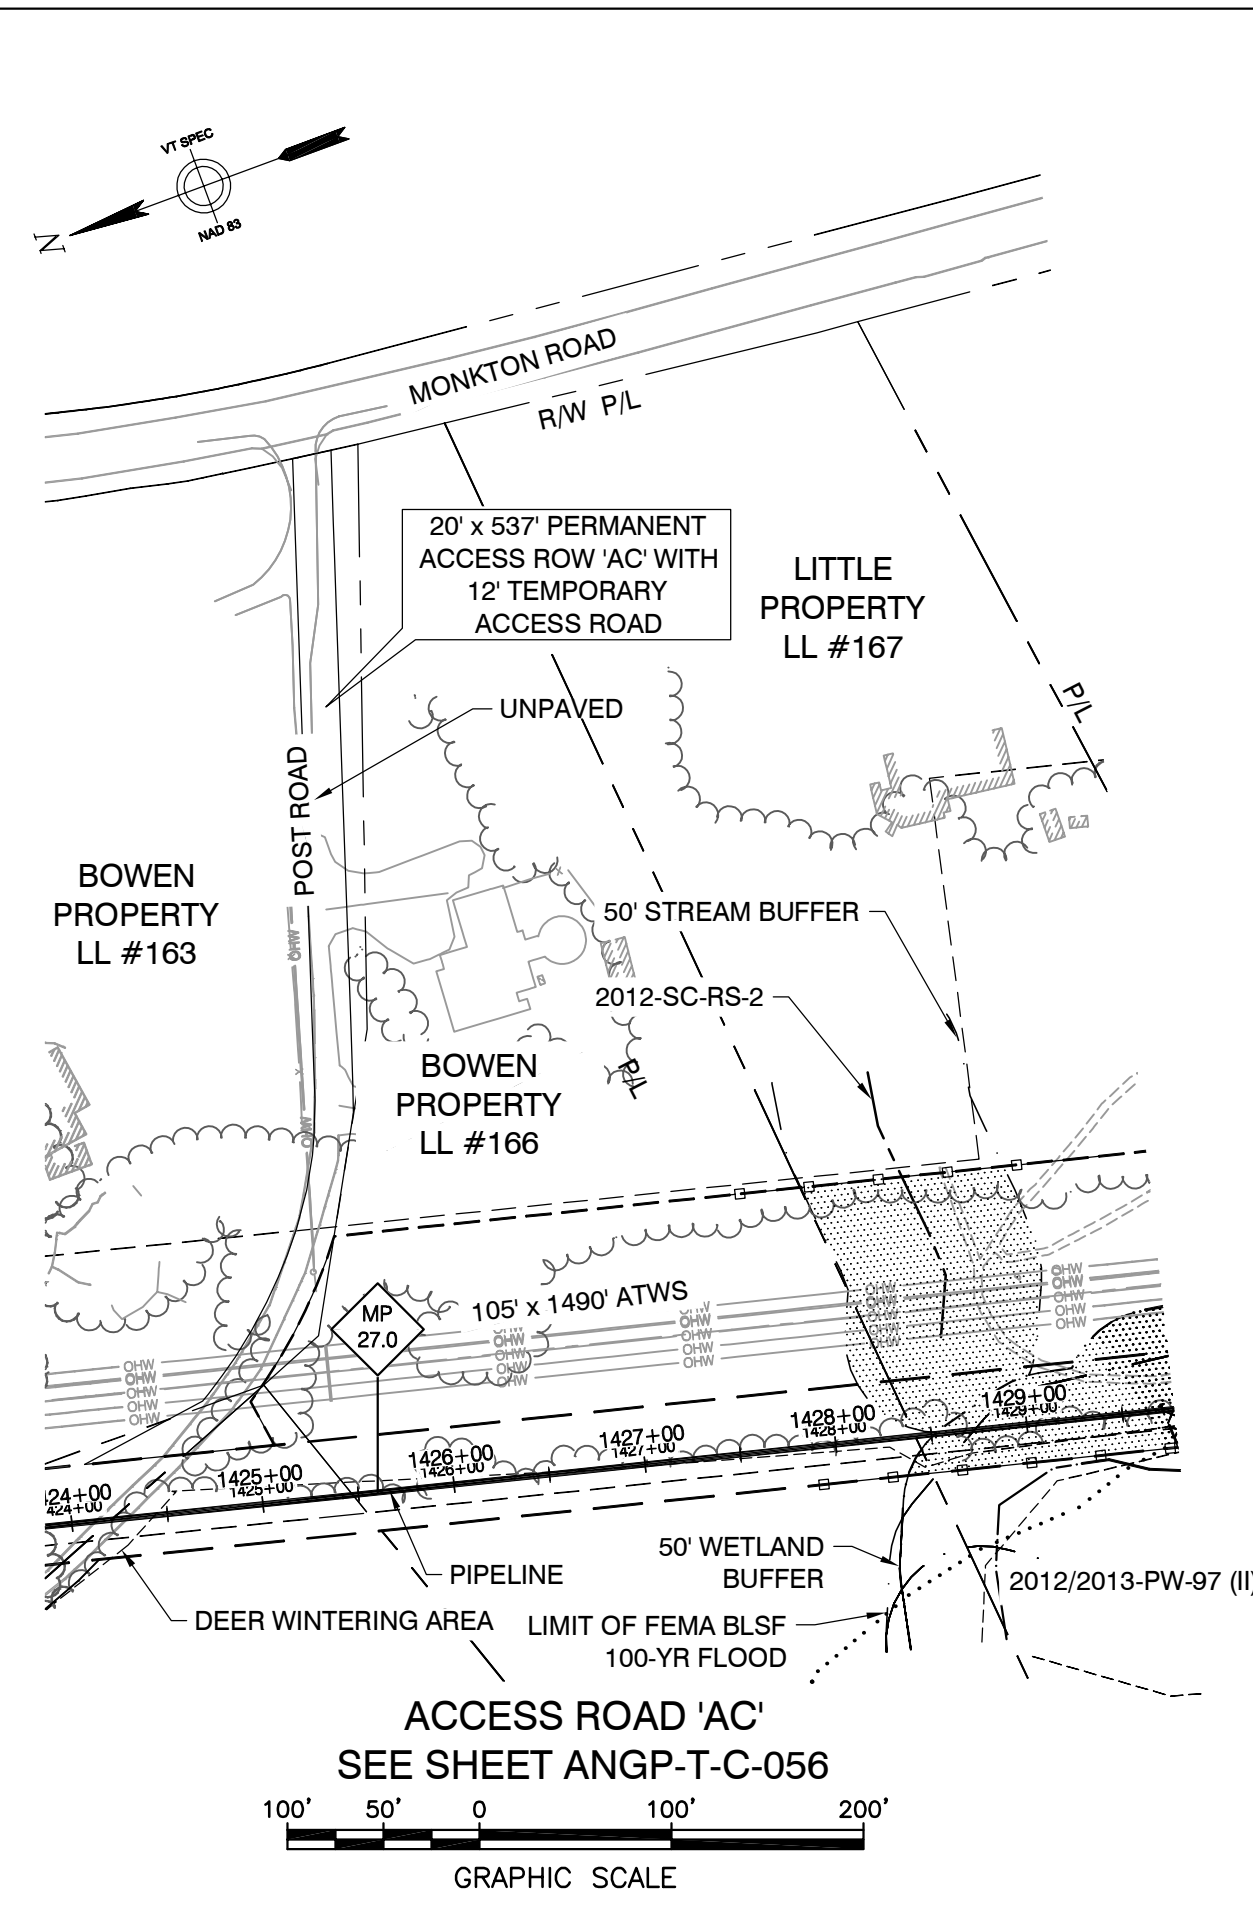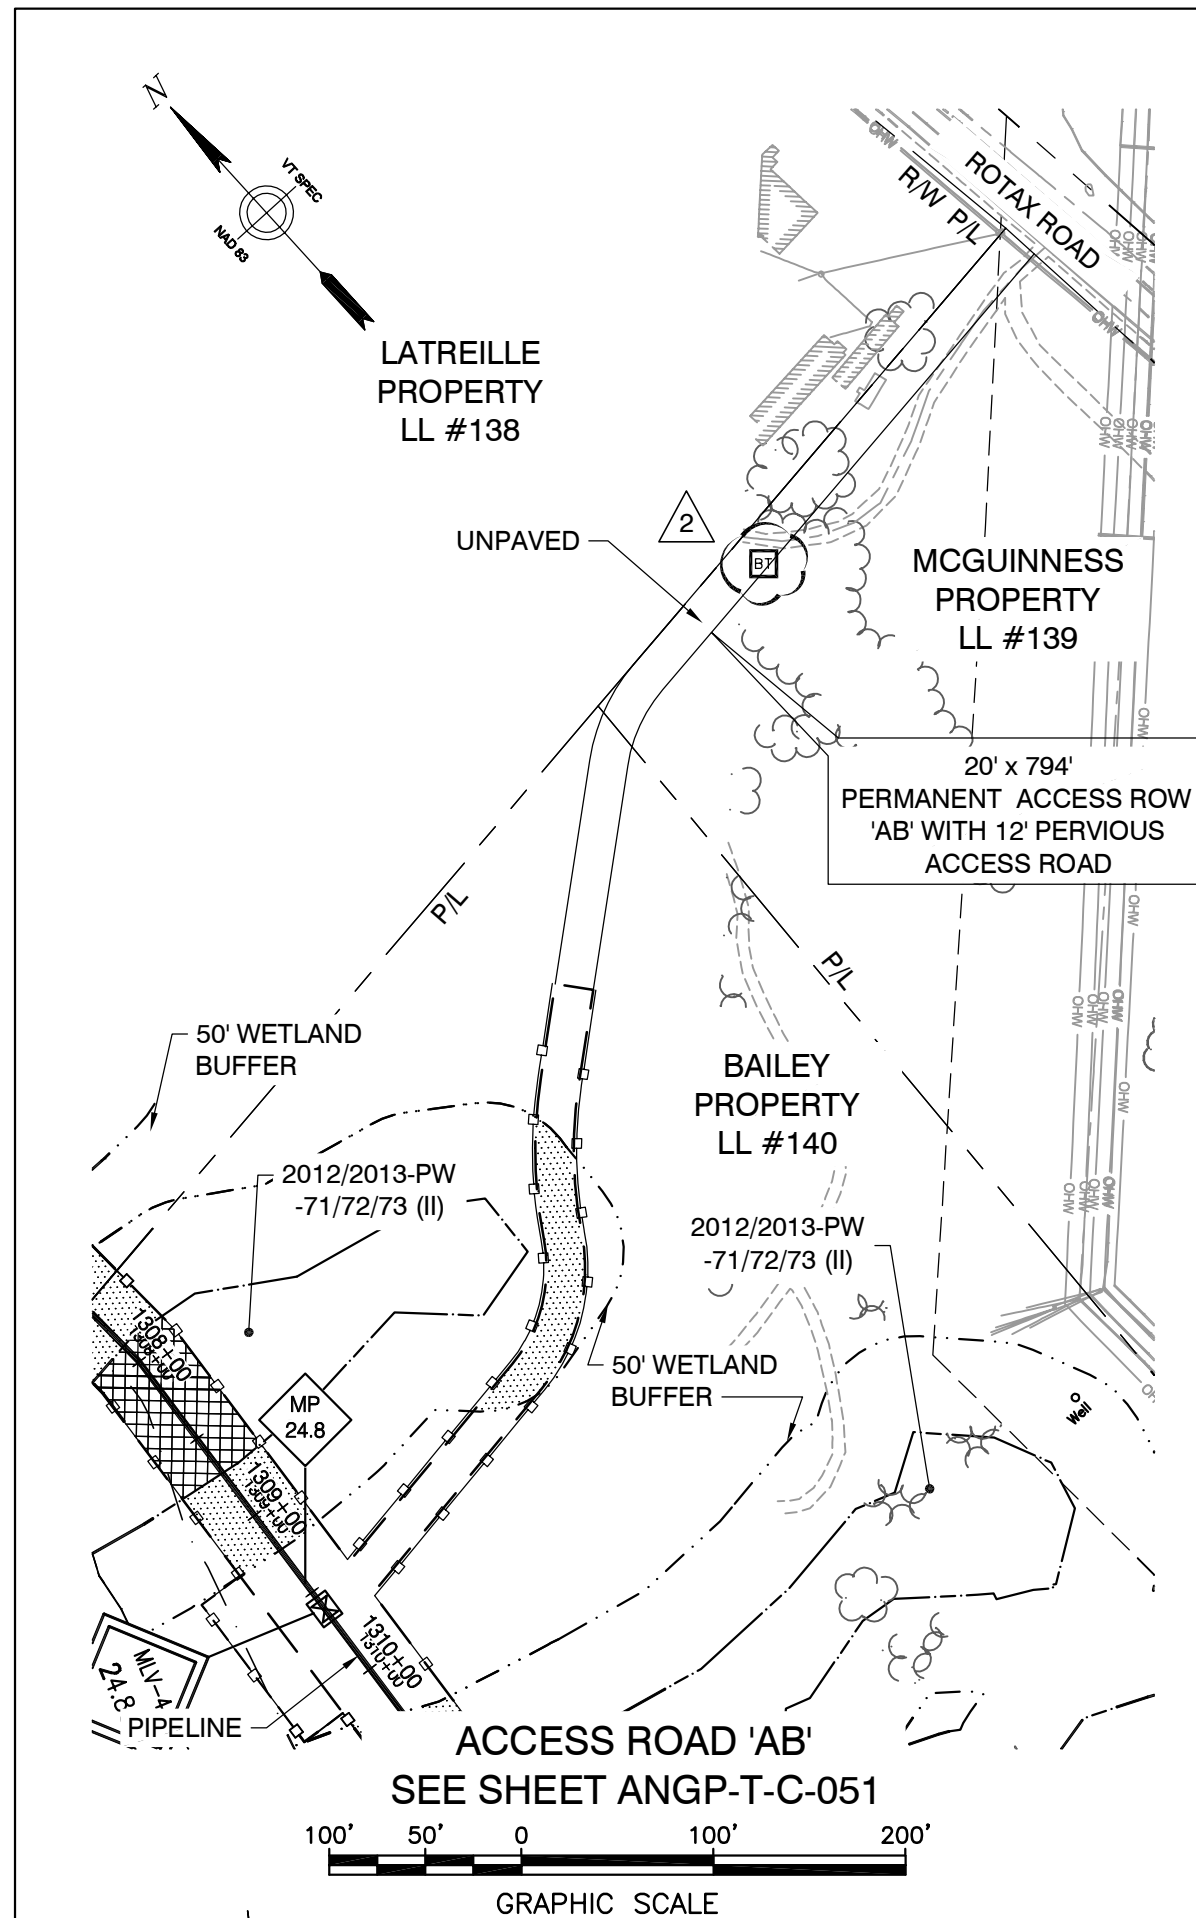

VHB Vanasse Hangen Brustlin, Inc.

DWG. NO.	REFERENCE DWG.	REV	DSN	CK	DESCRIPTION	INITIALS	DATE	INITIALS	DATE	YEAR: 2016	W.O.	SCALE: AS NOTED	DWG. ANGP-T-G-010	REV. 2
		2	GJM	BCK	IFC 2016 EDITS (05/2016)									
		1	BCK	TDB	ACCESS ROAD "AG" REMOVED (5/14/15)									

	BID	CONSTRUCTION
ENVIRONMENTAL	JLS 06/28/13	JLS 05/2016
DRAFTING DESIGNER	GIL 06/28/13	GJM 05/2016
DRAFTING SUPERVISOR	BZD 06/28/13	BCK 05/2016
DESIGN ENGINEER	MDF 06/28/13	GEW 05/2016
DESIGN MANAGER	SAB 06/28/13	JEO 05/2016

VERMONT GAS
PROPOSED 12" PIPELINE
ADDISON NATURAL GAS PROJECT
ACCESS ROAD DETAILS

LOC. CHITTENDEN & ADDISON COUNTIES

VERMONT GAS

CIA


38 Eastwood Drive, Suite 105
South Burlington, VT 05403
Main: (802) 735-0372 - www.chacompanies.com

CONSTRUCTION DEMARCATION:

- CONSTRUCTION DEMARCATION TO BE INSTALLED ALONG PERIMETER OF LIMITS OF DISTURBANCE PER THE EPSC PLAN.
- DEMARCATION IS NOT TO CROSS ACTIVE ACCESS ROUTES.
- WITHIN AT LEAST 50 FEET OF A WATER RESOURCE AREA, DEMARCATION MUST INCLUDE:
 - 2 TO 3 ROWS OF STAKED (OR STAPLED) 3 INCH ORANGE BARRIER MESH TAPE OR ROPE,
 - ORANGE CONSTRUCTION FENCE, OR
 - ORANGE SNOW FENCE.
 - OTHER INTERCHANGEABLE AND/OR DEC APPROVED MEASURE.
- GREATER THAN AT LEAST 50 FEET FROM WATER RESOURCE AREAS, DEMARCATION MAY INCLUDE:
 - ONE ROW OF STAKED (OR STAPLED) 3 INCH ORANGE BARRIER MESH TAPE OR ROPE, OR
 - ORANGE FLAGGING OR PAINT.
 - OTHER INTERCHANGEABLE AND/OR DEC APPROVED MEASURE.


PERIMETER CONTROLS:

- PERIMETER CONTROLS ARE TO BE INSTALLED ON DOWNSLOPE SIDE OF AREAS OF DISTURBANCE WHERE THERE IS POTENTIAL FOR SEDIMENT RUNOFF AND/OR SOIL EROSION.
- PERIMETER CONTROLS ARE NOT TO CROSS ACTIVE ACCESS ROUTES (E.G., ROADS) OR ACTIVE FLOW PATHS (E.G., A STREAM).
- PARTICULAR CARE IS TO BE TAKEN WHEN INSTALLING PERIMETER CONTROLS IN A WETLAND.
- WITHIN AT LEAST 50 FEET OF WATER RESOURCE AREAS, PERIMETER CONTROLS MUST INCLUDE:
 - REINFORCED SILT FENCE - TO BE REINFORCED WITH WIRE MESH, STAKED HAYBALES, STAKED FIBER ROLLS, EROSION CONTROL MIX BERMS, OR WOOD CHIP BERMS.
 - STONE BERMS
 - OTHER INTERCHANGEABLE AND/OR DEC-APPROVED MEASURE.
- GREATER THAN AT LEAST 50 FEET FROM WATER RESOURCE AREAS, PERIMETER CONTROLS MAY INCLUDE:
 - SILT FENCE (NON-REINFORCED)
 - STAKED FIBER ROLLS
 - EROSION CONTROL MIX BERMS
 - OTHER INTERCHANGEABLE AND/OR DEC-APPROVED MEASURE.

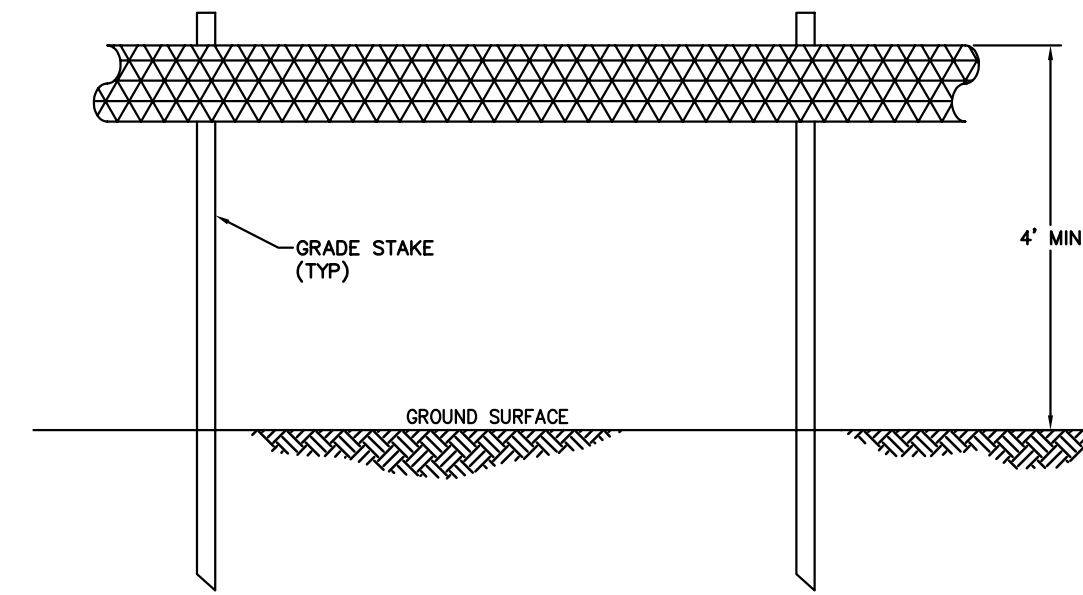

Notes:

- BARRIER MESH TAPE OR ROPE SHALL BE INSTALLED ALONG THE PERIMETER OF THE PROJECT AREA TO DEMARCAT THE LIMIT OF DISTURBANCE. NO EARTHWORK OR STORAGE OF MATERIALS SHALL BE CONDUCTED BEYOND THIS LIMIT WITHOUT PRIOR APPROVAL FROM THE OSPC.
- USE 3" ORANGE BARRIER MESH TAPE OR 1/2" YELLOW POLYPROPYLENE ROPE.
- WITHIN 50' OF WATER RESOURCE AREAS, USE 2-3 ROWS OF TAPE OR ROPE. BEYOND 50' OF WATER RESOURCE AREAS USE 1 ROW OF TAPE OR ROPE.
- TAPE OR ROPE MAY BE FASTENED TO STAKES, TREES, OR OTHER APPROPRIATE FIXED OBJECTS.
- PROJECT DEMARCATION SHALL NOT CROSS ACTIVE ACCESS ROUTES (E.G. ROADS). PROJECT DEMARCATION MAY CROSS RESOURCE AREAS WITH EXCEPTION OF LARGER WATER BODIES WHERE IT IS NOT FEASIBLE OR ADVISABLE.
- PROJECT DEMARCATION SHALL REMAIN IN PLACE AND BE MAINTAINED/REPLACED AS NEEDED UNTIL FINAL STABILIZATION IN THE AREA HAS BEEN ACHIEVED.

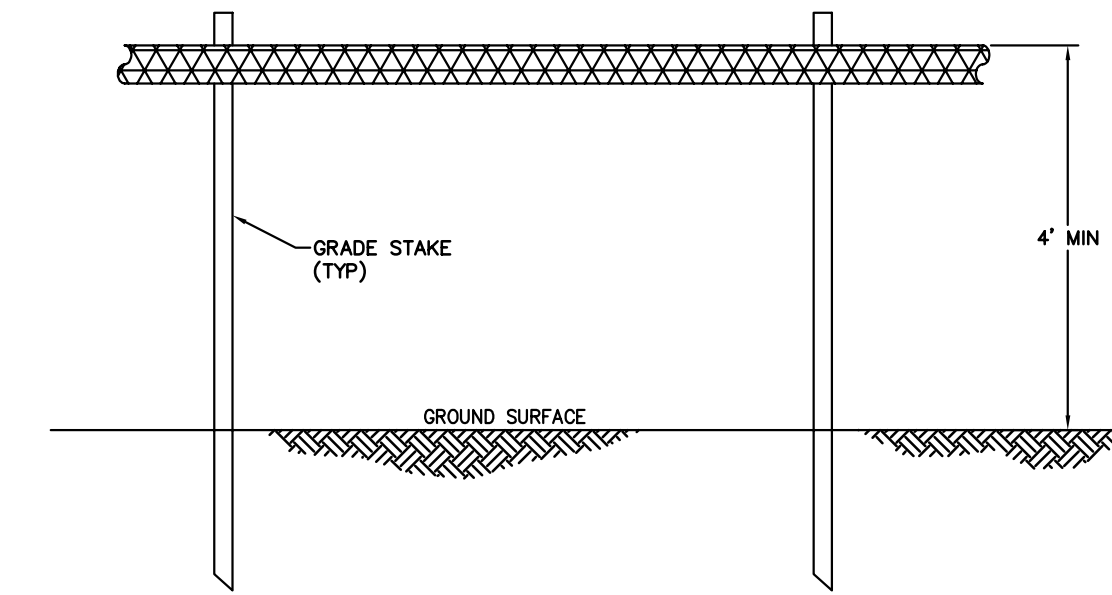

Notes:


- BARRIER FLAGGING OR PAINT SHALL BE INSTALLED ALONG THE PERIMETER OF THE PROJECT AREA TO DEMARCAT THE LIMIT OF DISTURBANCE. NO EARTHWORK OR STORAGE OF MATERIALS SHALL BE CONDUCTED BEYOND THIS LIMIT WITHOUT PRIOR APPROVAL FROM THE OSPC.
- FLAGGING OR PAINT MAY BE FASTENED TO STAKES, TREES, OR OTHER APPROPRIATE FIXED OBJECTS.
- PROJECT DEMARCATION SHALL NOT CROSS ACTIVE ACCESS ROUTES (E.G. ROADS). PROJECT DEMARCATION MAY CROSS RESOURCE AREAS WITH THE EXCEPTION OF LARGER WATER BODIES WHERE IT IS NOT FEASIBLE OR ADVISABLE.
- PROJECT DEMARCATION SHALL REMAIN IN PLACE AND BE MAINTAINED/REPLACED AS NEEDED UNTIL FINAL STABILIZATION IN THE AREA HAS BEEN ACHIEVED.

1 Construction Demarcation Table 12/12
N.T.S. Source: VHB LD_

2 Perimeter Control Table 12/12
N.T.S. Source: VHB LD_

3 Barrier Mesh Tape or Rope 12/12
N.T.S. Source: VHB LD_


4 Barrier Flagging or Paint 12/12
N.T.S. Source: VHB LD_

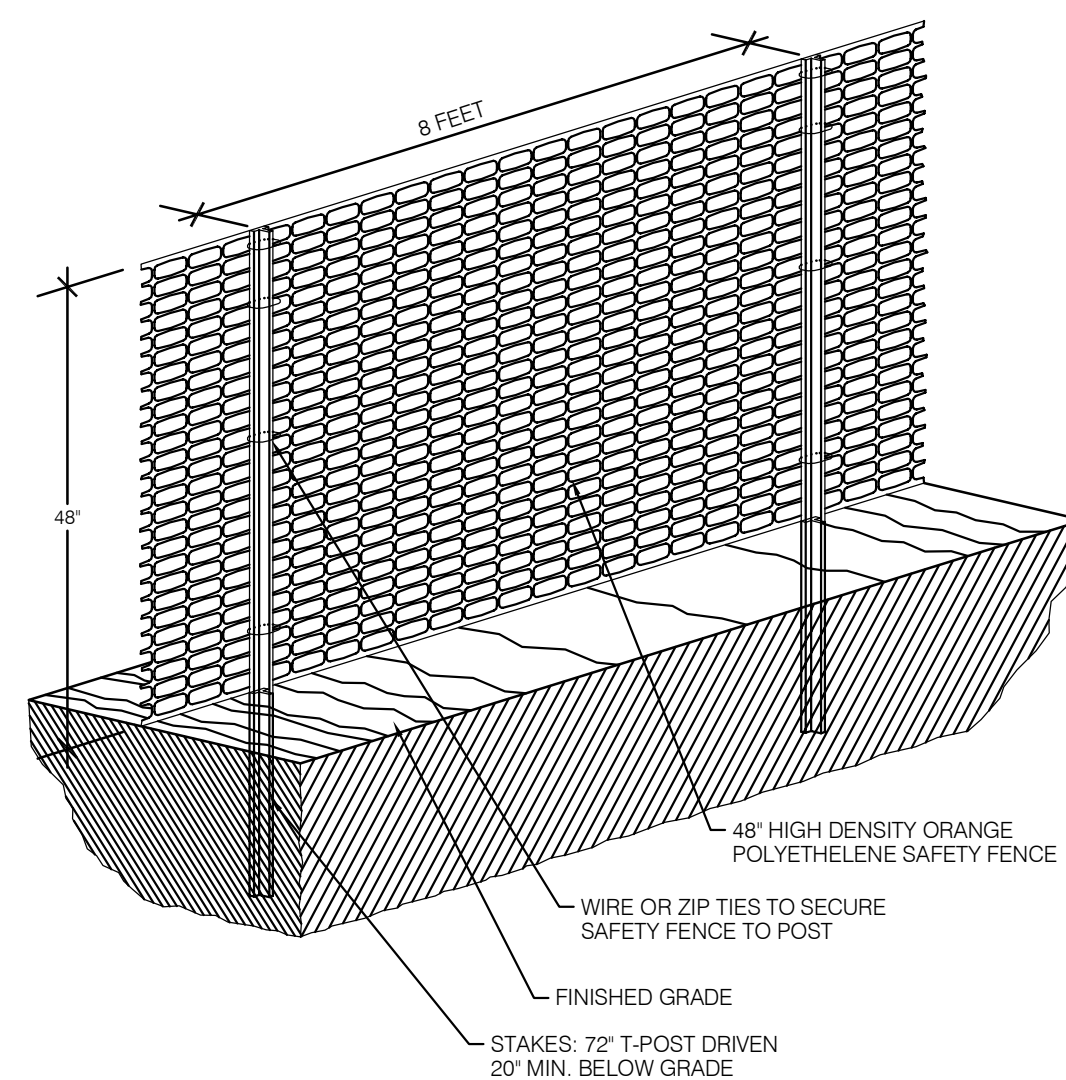

Notes:

- CONSTRUCTION/SNOW FENCE SHALL BE INSTALLED WITHIN 50' OF A WATER RESOURCE, (STREAM, BROOK, LAKE, POND, ETC.) UNLESS THE AREA IS DENSELY WOODED, IN WHICH CASE 2 TO 3 ROWS OF ORANGE BARRIER MESH TAPE OR ROPE MAY BE USED.
- CONSTRUCTION/SNOW FENCE SHALL NOT CROSS ACTIVE ACCESS ROUTES (E.G. ROADS). CONSTRUCTION/SNOW FENCE MAY CROSS RESOURCE AREAS WITH THE EXCEPTION OF LARGER WATER BODIES WHERE IT IS NOT FEASIBLE OR ADVISABLE.
- CONSTRUCTION/SNOW FENCE SHALL REMAIN IN PLACE AND BE MAINTAINED/REPLACED AS NEEDED UNTIL FINAL STABILIZATION IN THE AREA HAS BEEN ACHIEVED.


5 Construction/Snow Fence 12/12
N.T.S. Source: VHB LD_651

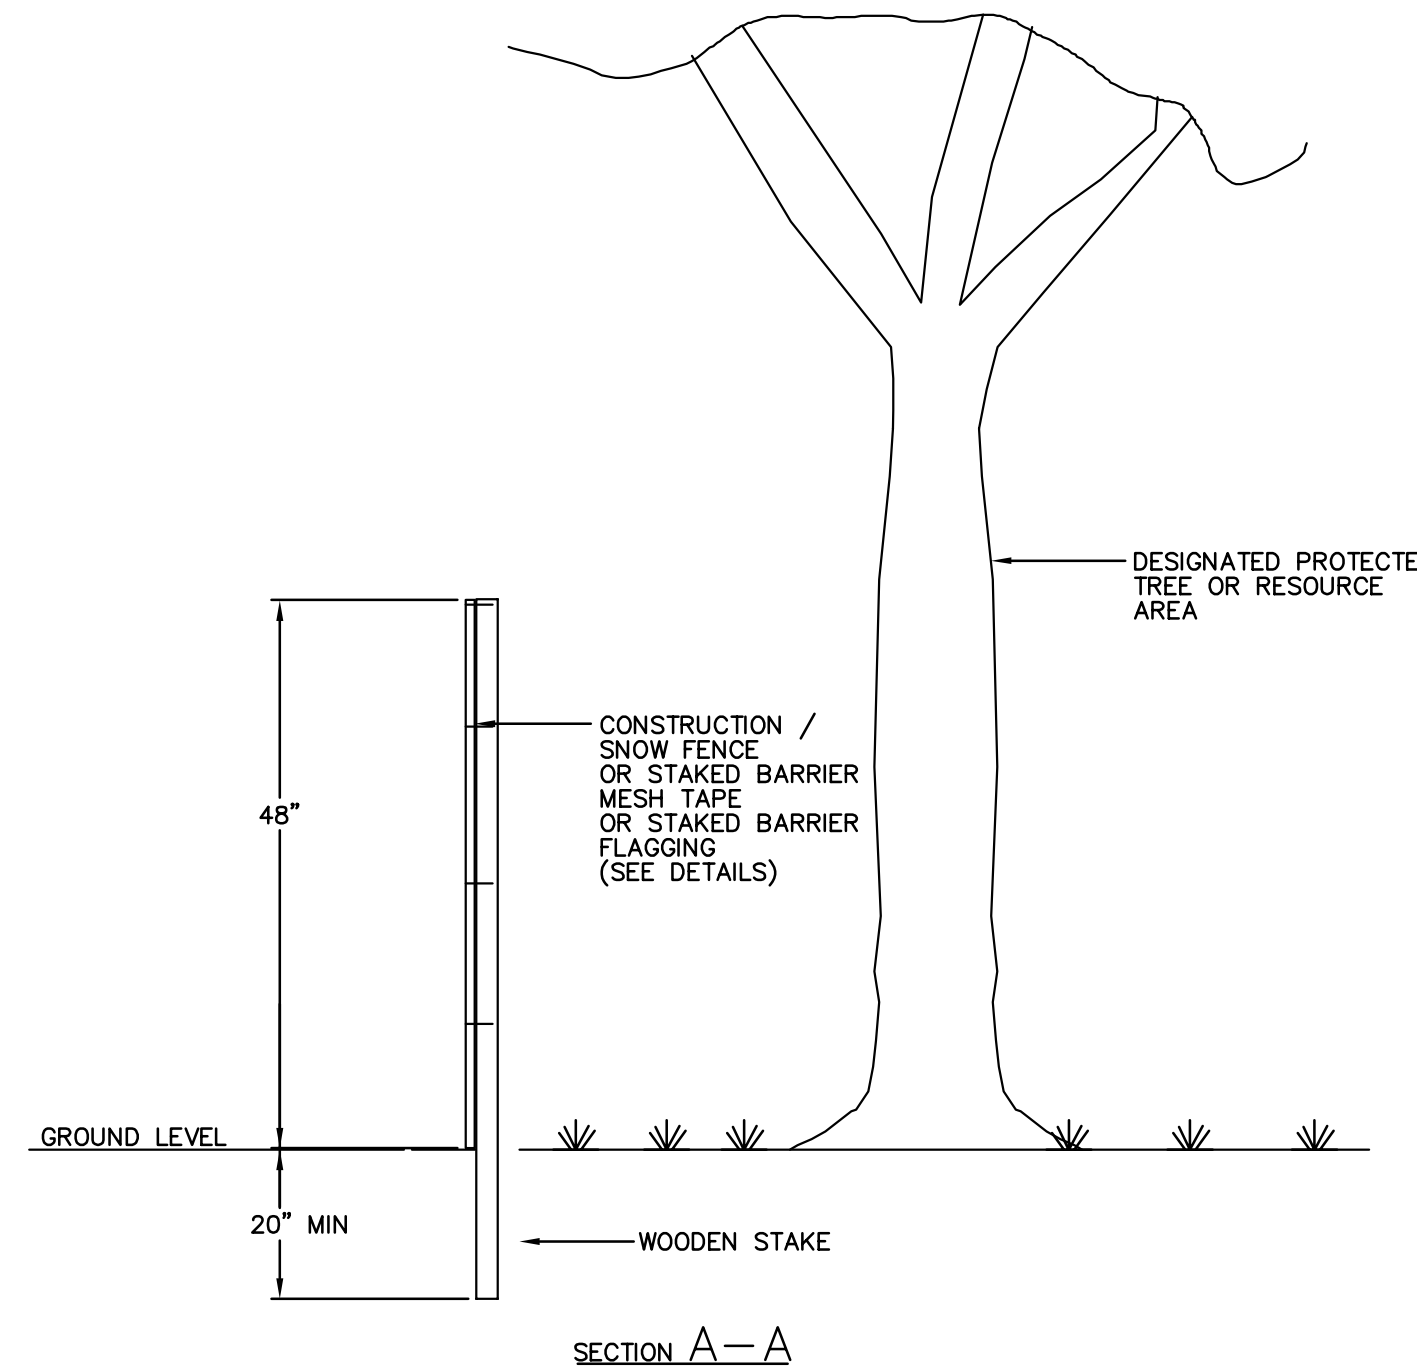


NOTES:

- MINIMUM DISTANCE BETWEEN RESOURCE AND BARRIER SHALL BE 25' UNLESS OTHERWISE DIRECTED BY OSPC.
- RESOURCES REQUIRING PROTECTION FOR ALL SIDES WILL BE BOXED WITH A MINIMUM OF 4 PANELS.
- BARRIER MAY BE CONSTRUCTION/SNOW FENCE, STAKED BARRIER MESH TAPE, OR STAKED BARRIER FLAGGING. (SEE DETAILS.)
- BARRIER TO REMAIN IN PLACE UNTIL CONSTRUCTION ACTIVITIES IN AREA ARE COMPLETE OR AS AS OTHERWISE DIRECTED BY OSPC.

6 Wetland, RTE, and Vegetation Protection Barrier 12/12
N.T.S. Source: CHA LD_

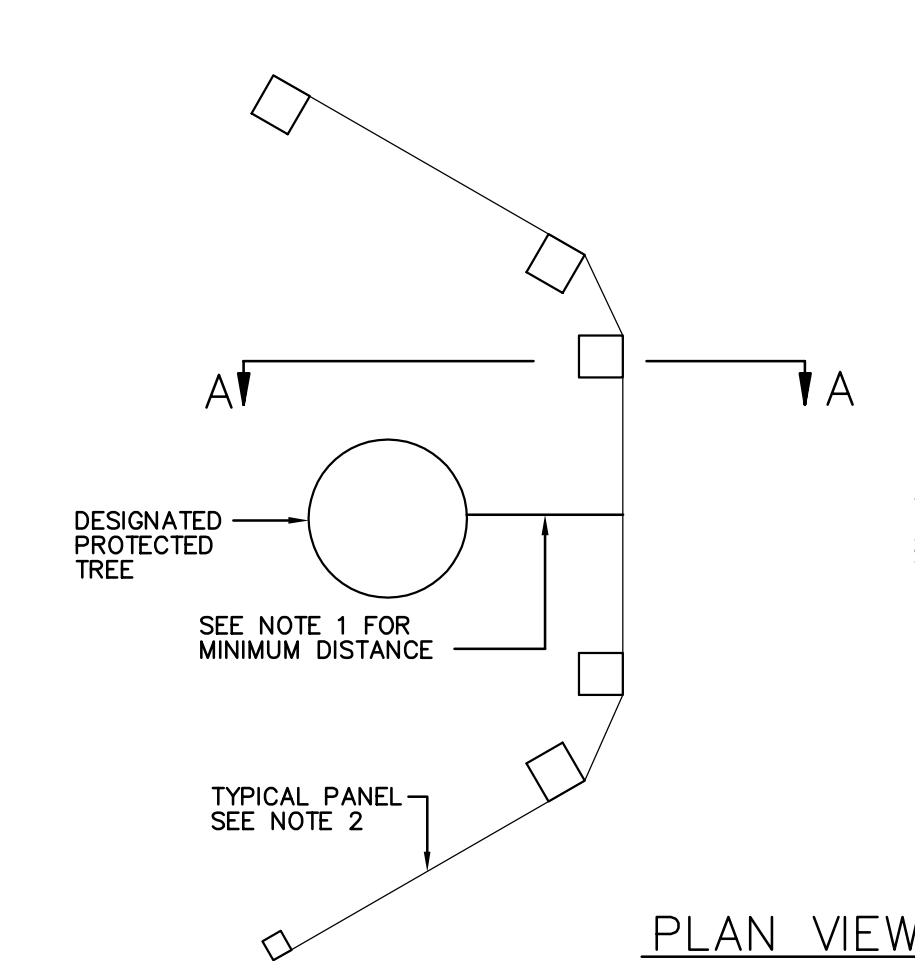

PLAN VIEW

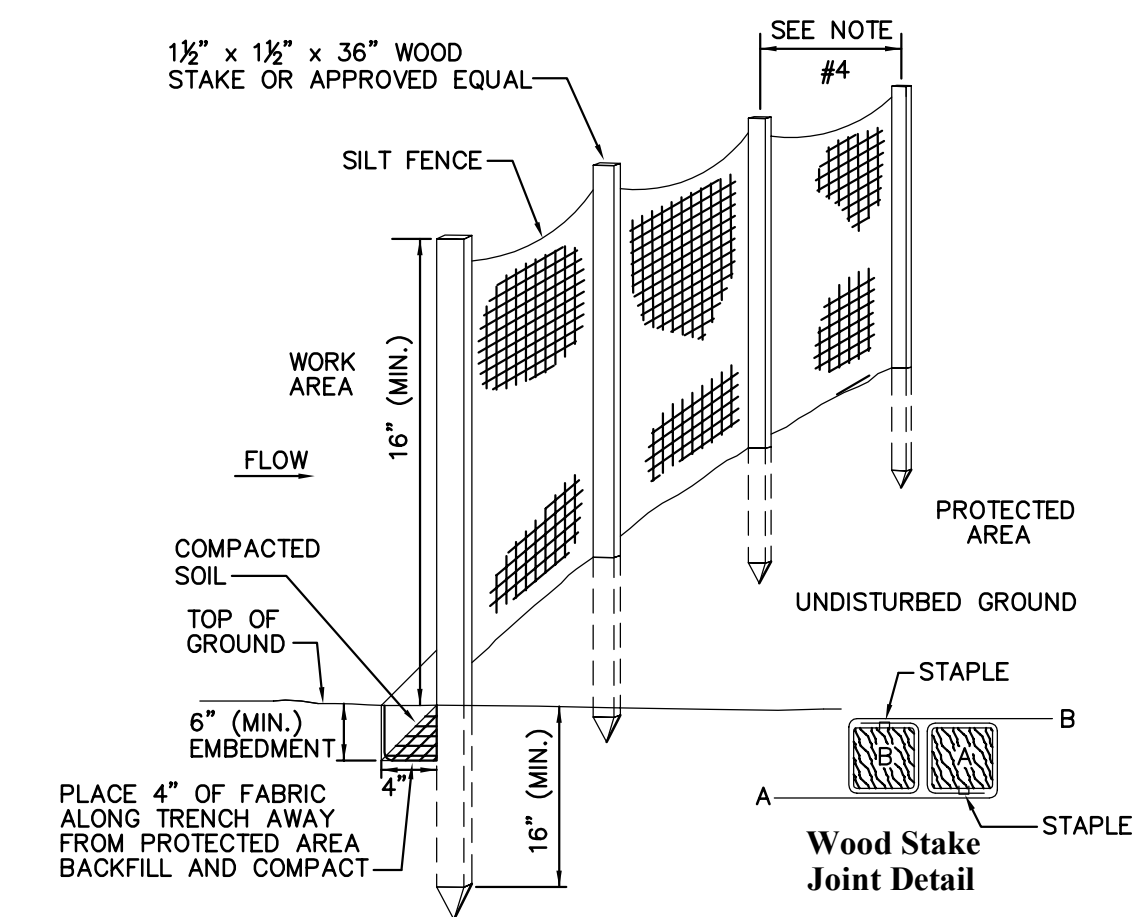

Notes:

- SEE DETAIL # 2 ON SHEET ANGP-T-G-012 FOR LIST OF APPROPRIATE PERIMETER CONTROLS TO USE.
- FILTER CLOTH SHALL BE EITHER FILTER X, MIRAFI 100X, STABILINKA T140N OR APPROVED EQUIVALENT.
- FOR FILTER CLOTH FENCE WHEN ELONGATION IS >50%, POST SPACING SHALL NOT EXCEED 4 FT. FOR FILTER CLOTH FENCE WHEN ELONGATION IS <50% POST SPACING SHALL NOT EXCEED 6 FT.
- WHEN TWO SECTIONS OF FILTER CLOTH ADJOIN EACH OTHER THEY SHALL BE OVER-LAPPED BY 6 INCHES AND FOLDED.
- PREFABRICATED UNITS SHALL BE GEOFAB, ENVIROFENCE OR APPROVED EQUIVALENT.
- MAINTENANCE SHALL BE PERFORMED AS NEEDED AND MATERIAL REMOVED WHEN SEDIMENT REACHES HALF OF FABRIC HEIGHT AND DISPOSED OF IN AN UPLAND AREA.
- PERIMETER CONTROLS SHALL NOT CROSS ACTIVE ACCESS ROUTES (E.G., ROADS) OR ACTIVE FLOW PATHS (E.G., LARGER STREAMS/RIVERS).
- PERIMETER CONTROLS SHALL REMAIN IN PLACE AND BE MAINTAINED/REPLACED AS NEEDED UNTIL FINAL STABILIZATION IN THE AREA HAS BEEN ACHIEVED.

7 Silt Fence 12/12
N.T.S. Source: VHB LD_650VT





VHB Vanasse Hangen Brustlin, Inc.

DWG. NO.	REFERENCE DWG.	REV	DSN	CK	DESCRIPTION	INITIALS	DATE	INITIALS	DATE	YEAR: 2016	W.O.	SCALE: NOTED	DWG. ANGP-T-G-012	REV. 0

	BID	CONSTRUCTION
ENVIRONMENTAL	JLS 06/28/13	JLS 05/2016
DRAFTING DESIGNER	GIL 06/28/13	GJM 05/2016
DRAFTING SUPERVISOR	BZD 06/28/13	BCK 05/2016
DESIGN ENGINEER	MDF 06/28/13	GEW 05/2016
DESIGN MANAGER	SAB 06/28/13	JEO 05/2016

VERMONT GAS
PROPOSED 12" PIPELINE
ADDISON NATURAL GAS PROJECT
CONSTRUCTION DETAILS
LOC. CHITTENDEN & ADDISON COUNTIES

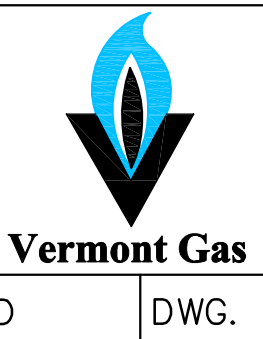


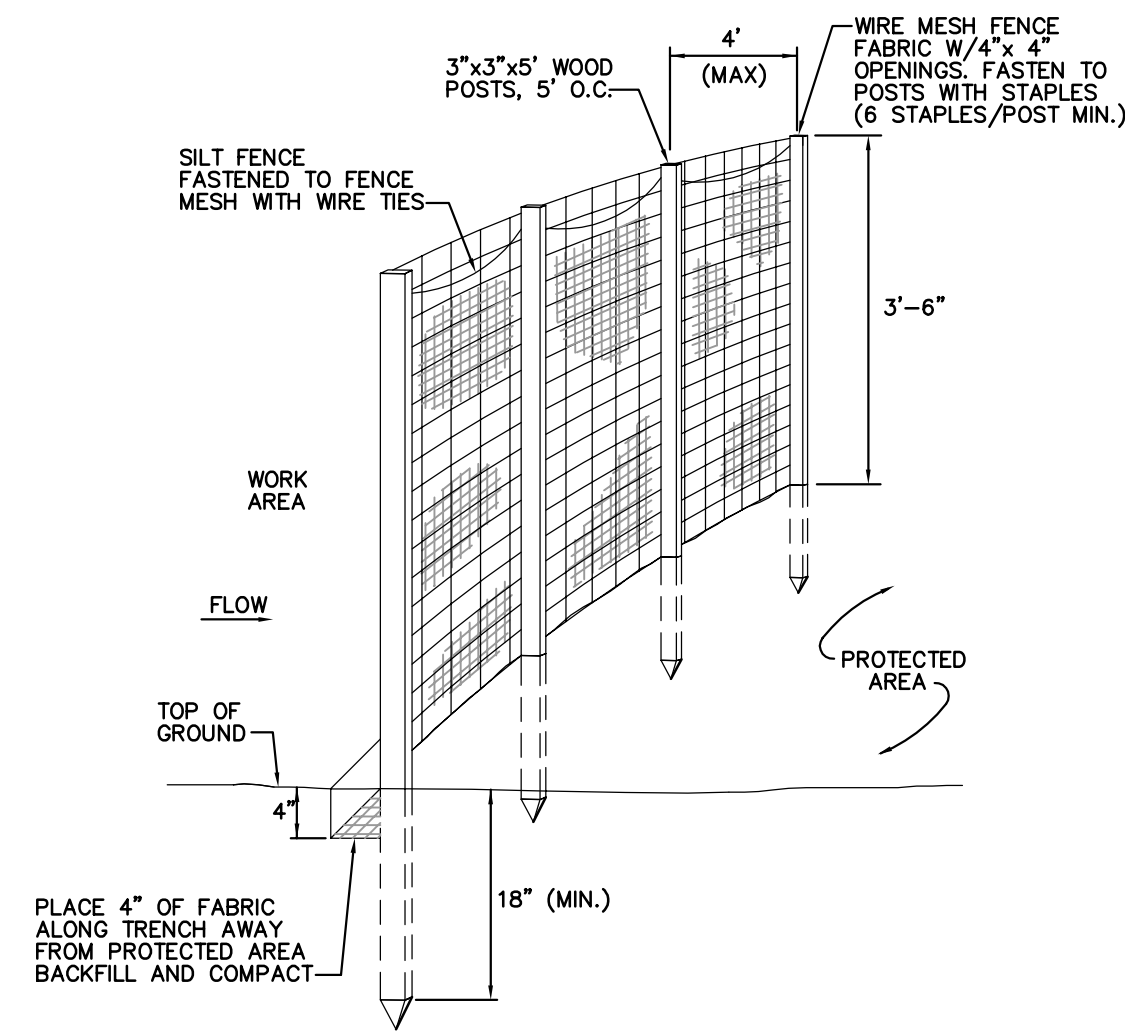

Notes:

- SEE DETAIL #2 ON SHEET ANGP-T-G-012 FOR LIST OF APPROPRIATE PERIMETER CONTROLS TO USE
- FILTER CLOTH SHALL BE EITHER FILTER X, MIRAFI 100X, STABILINKA T140N OR APPROVED EQUIVALENT.
- FOR FILTER CLOTH FENCE WHEN ELONGATION IS >50%, POST SPACING SHALL NOT EXCEED 4 FT. FOR FILTER CLOTH FENCE WHEN ELONGATION IS <50%, POST SPACING SHALL NOT EXCEED 6 FT.
- WHEN TWO SECTIONS OF FILTER CLOTH ADJOIN EACH OTHER THEY SHALL BE OVER-LAPPED BY 6 INCHES AND FOLDED.
- PREFABRICATED UNITS SHALL BE GEOFAB, ENVIROFENCE OR APPROVED EQUIVALENT.
- MAINTENANCE SHALL BE PERFORMED AS NEEDED AND MATERIAL REMOVED WHEN SEDIMENT REACHES HALF OF FABRIC HEIGHT AND DISPOSED OF IN AN UPLAND AREA.
- PERIMETER CONTROLS SHALL NOT CROSS ACTIVE ACCESS ROUTES (E.G., ROADS) OR ACTIVE FLOW PATHS (E.G., LARGER STREAMS/RIVERS).
- PERIMETER CONTROLS SHALL REMAIN IN PLACE AND BE MAINTAINED/REPLACED AS NEEDED UNTIL FINAL STABILIZATION IN THE AREA HAS BEEN ACHIEVED.


1 Reinforced Silt Fence with Wire Mesh 12/12
N.T.S. Source: VHB LD_651

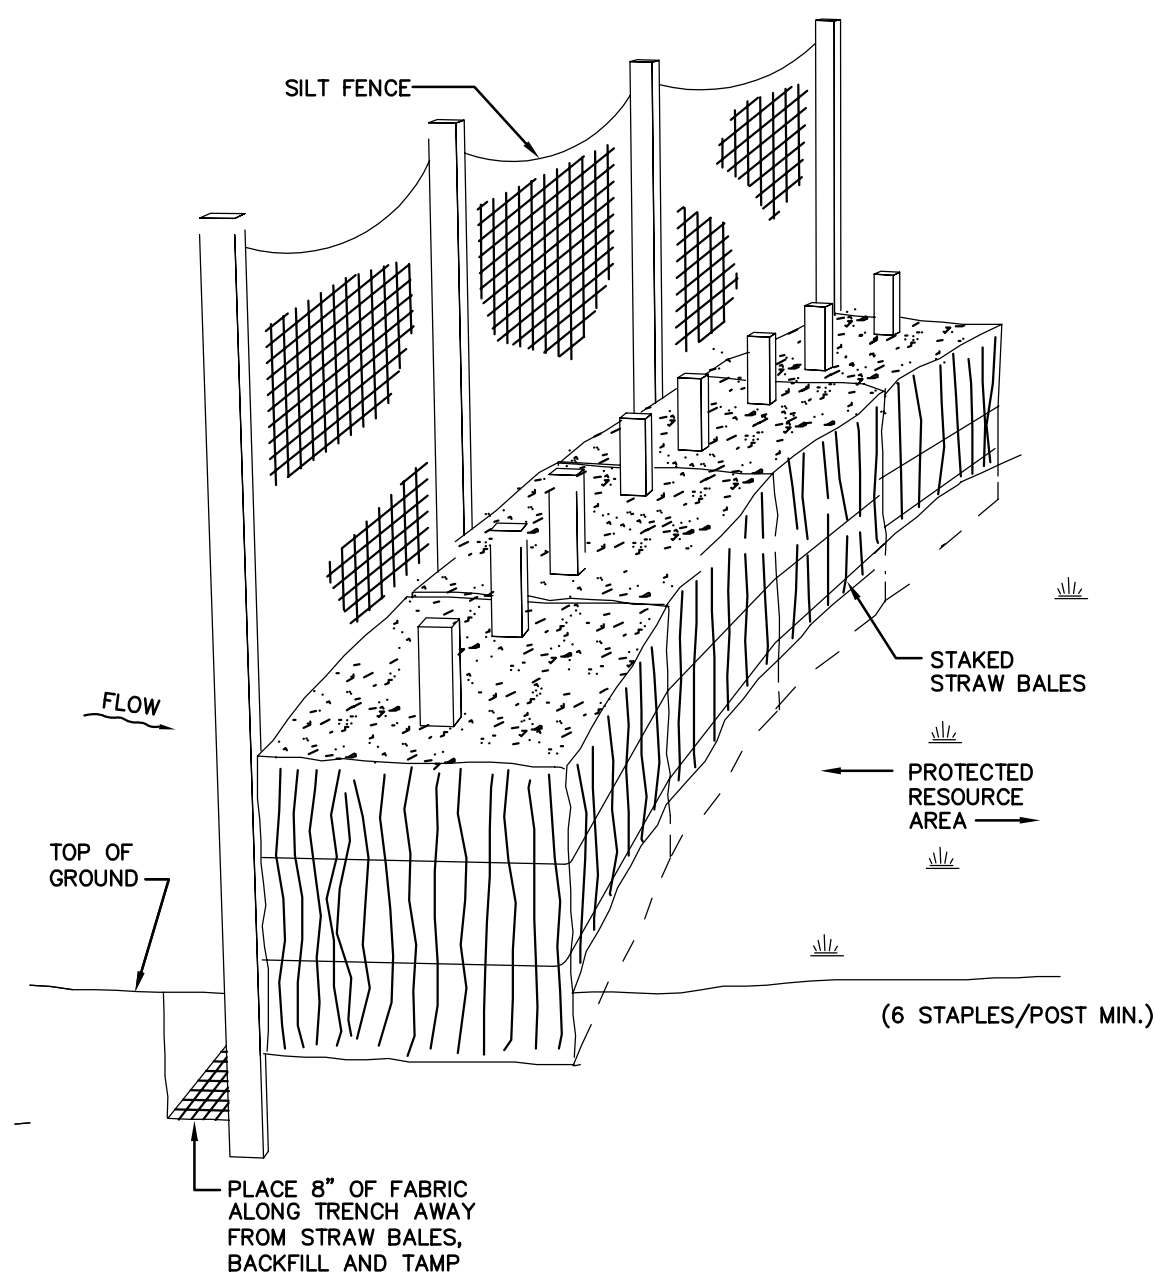

Notes:

- SEE DETAIL # 2 ON SHEET ANGP-T-G-012 FOR LIST OF APPROPRIATE PERIMETER CONTROLS TO USE
- SEE SILT FENCE DETAIL AND NOTES FOR INSTALLATION SPECIFICATIONS FOR SILT FENCE.
- SEE STAKED HAY BALE DETAIL AND NOTES FOR INSTALLATION SPECIFICATIONS FOR STAKED STRAW BALES. SEEDLESS STRAW BALES ARE TO BE USED IN RESOURCE AREAS AND THEIR BUFFERS; DO NOT USE HAY BALES.
- STAKED STRAW BALES MAY BE INTERCHANGED WITH STAKED FIBER ROLLS.
- PERIMETER CONTROLS SHALL NOT CROSS ACTIVE ACCESS ROUTES (E.G., ROADS) OR ACTIVE FLOW PATHS (E.G., LARGER STREAMS/RIVERS).
- PERIMETER CONTROLS SHALL REMAIN IN PLACE AND BE MAINTAINED/REPLACED AS NEEDED UNTIL FINAL STABILIZATION IN AREA HAS BEEN ACHIEVED.


2 Reinforced Silt Fence with Staked Straw Bales 12/12
N.T.S. Source: VHB LD_

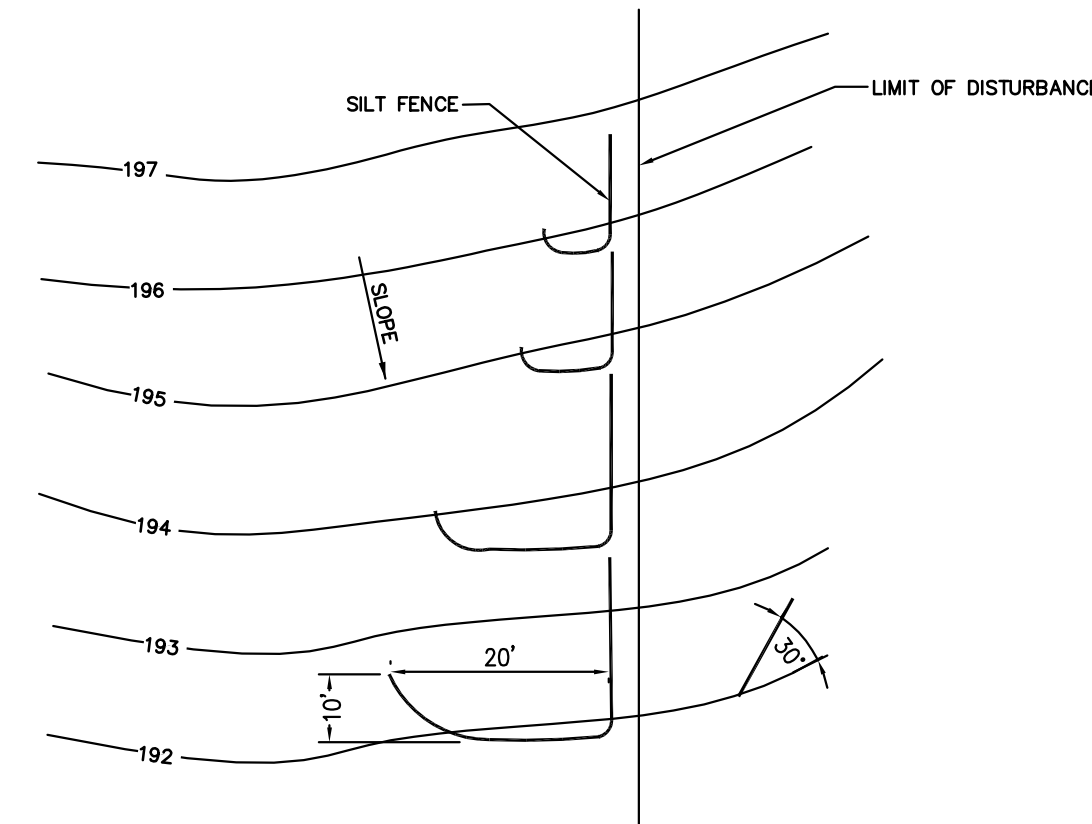

Notes:

- SILT FENCE SHALL BE INSTALLED IN SHORTER RUNS WITH "J-HOOKS" TO AVOID CONCENTRATION OF FLOWS AT ONE LOCATION BY TRAPPING RUNOFF AT MULTIPLE POINTS ALONG A SLOPE.
- MINIMUM WIDTH OF J-HOOK RECOMMENDED AT 20 FT WITH A DEPTH OF 10 FT. WHERE SPACE IS LIMITED (E.G., ALONG NARROW RIGHTS OF WAY), NARROWER HOOKS CAN BE USED WITH A HIGHER SPACING FREQUENCY.
- START DOWN-GRADIENT SILT FENCE LINE AS CLOSE AS POSSIBLE TO UP-GRADIENT J-HOOK.
- SEE SILT FENCE NOTES FOR INSTALLATION SPECIFICATIONS.


3 Silt Fence "J-Hooks" 12/12
N.T.S. Source: VHB LD_

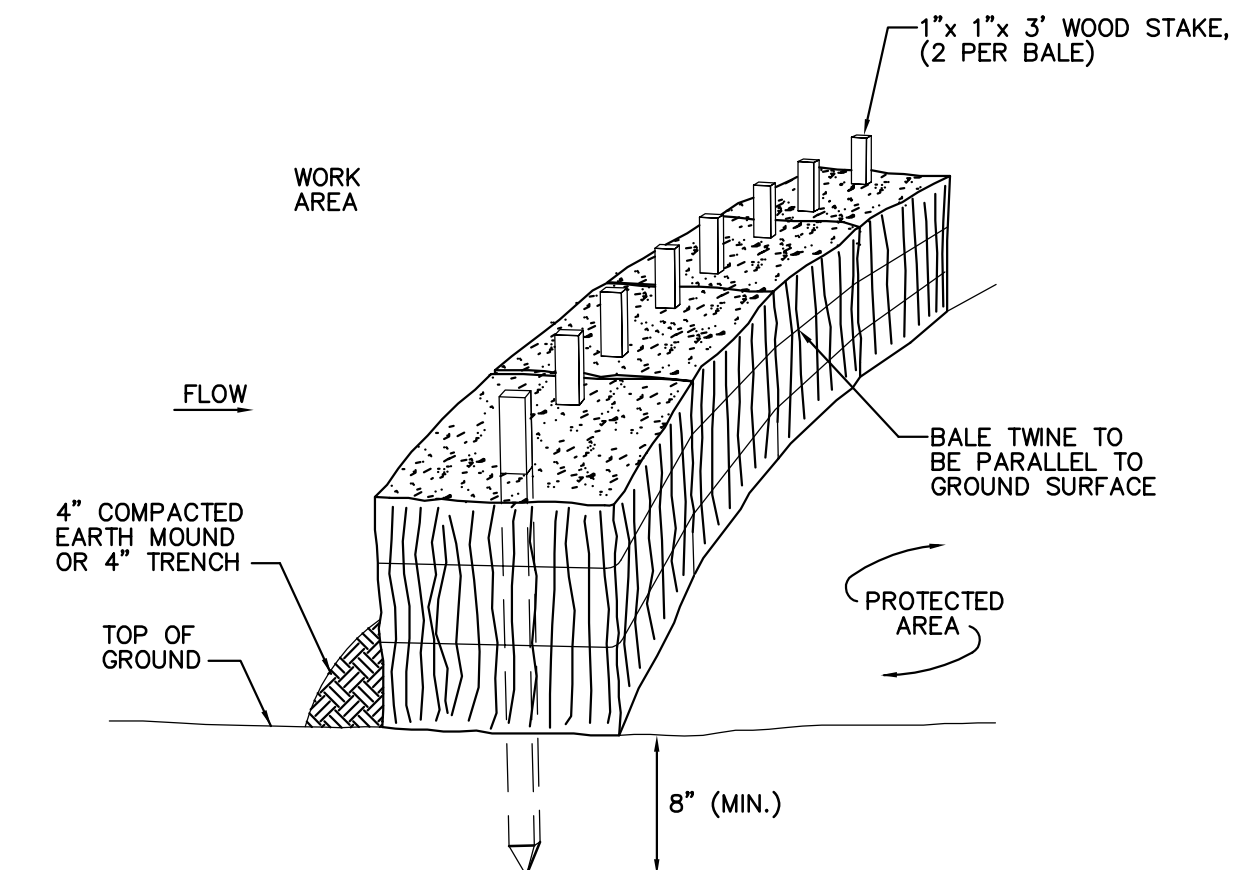

Notes:

- ENSURE BALES ARE TRENCHED INTO THE GROUND (4" MIN) OR A 4" COMPACTED EARTH MOUND IS PRESENT ON UP GRADIENT SIDE OF BARRIER.
- ENSURE BALES ARE INSTALLED SO ROPE RUNS PARALLEL TO GROUND.
- ENSURE STAKES ARE PROPERLY HAMMERED IN, LEAVING ~ 4" OF EXPOSURE ABOVE THE BALE.
- REMOVE ACCUMULATED SEDIMENT WHEN IT REACHES 1/2 OF THE OVERALL HEIGHT. DISPOSE OF IN AN UPLAND AREA AWAY FROM WATER FLOW.
- MAINTAIN AND REPLACE HAY BALES AS NEEDED.


4 Staked Hay Bales 12/12
N.T.S. Source: VHB LD_653

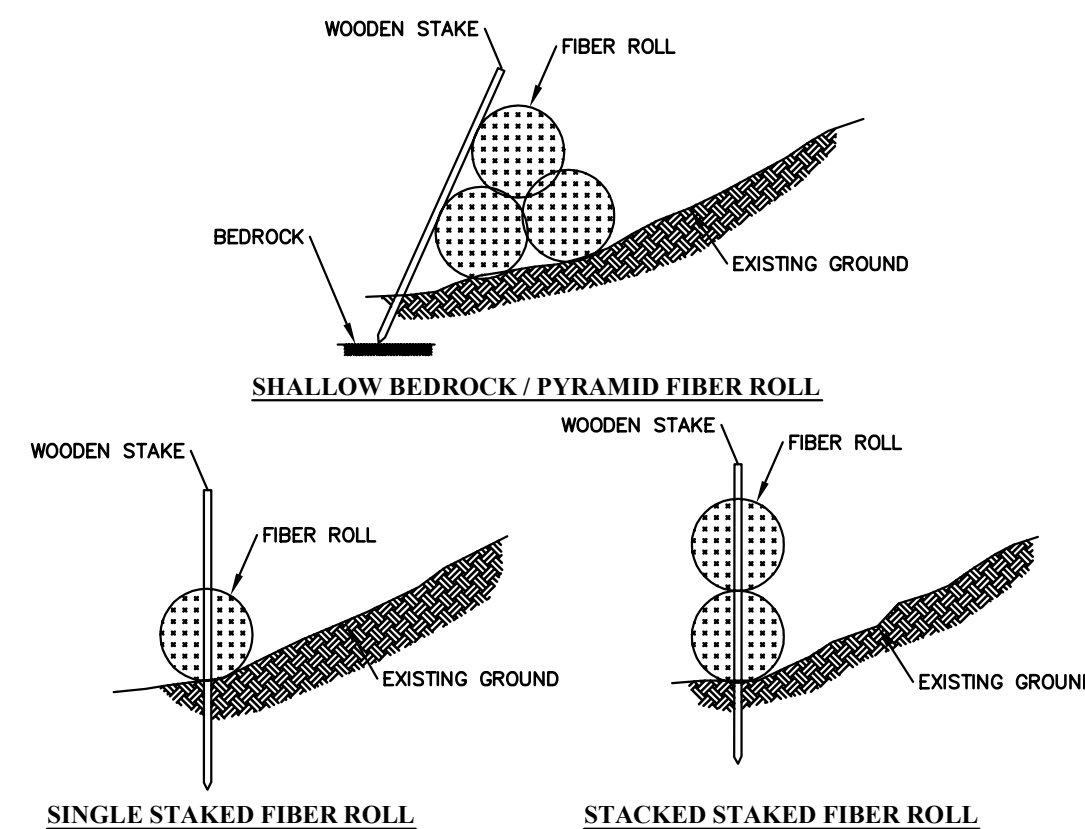

Notes:

- SEE DETAIL # 2 ON SHEET ANGP-T-G-012 FOR LIST OF APPROPRIATE PERIMETER CONTROLS TO USE.
- FIBER ROLL SHALL BE PLACED IN SHALLOW TRENCH UP TO 4", WHERE FEASIBLE, PLACING SOIL REMOVED FROM TRENCH BEHIND THE ROLL.
- FIBER ROLLS SHALL BE ANCHORED WITH 2" BY 2" WOODEN STAKES (36" LONG), OR SIMILAR, WHERE FEASIBLE, EITHER INSTALLED THROUGH CENTER OF ROLL (AS SHOWN) OR PLACED ON BOTH SIDES OF ROLL.
- STAKES TO BE PLACED 4 FT APART, MINIMUM.
- SINGLE OR DOUBLE STACKED STAKED FIBER ROLLS TO BE INSTALLED WHERE SOIL DEPTH ALLOWS. WHERE SHALLOW TO BEDROCK, PYRAMID FIBER ROLLS TO BE UTILIZED WITH STAKES, AS FEASIBLE.
- FIBER ROLLS TO BE REPLACED OR REPLENISHED AS NEEDED DURING ACTIVE EARTH WORK.
- PERIMETER CONTROLS SHALL NOT CROSS ACTIVE ACCESS ROUTES (E.G., ROADS) OR ACTIVE FLOW PATHS (E.G., STREAMS/RIVERS).
- PERIMETER CONTROLS SHALL REMAIN IN PLACE AND BE MAINTAINED/REPLACED AS NEEDED UNTIL FINAL STABILIZATION IN AREA HAS BEEN ACHIEVED.

5 Staked Fiber Roll 12/12
N.T.S. Source: VHB LD_

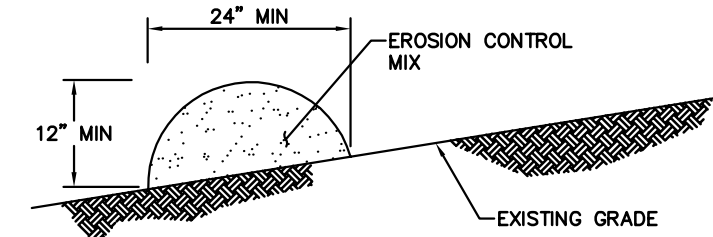


Notes:

COMPOSITION
EROSION CONTROL MIX BERM SHALL CONSIST PRIMARILY OF ORGANIC MATERIAL AND MAY INCLUDE: SHREDDED BARK, STUMP GRINDINGS, COMPOSTED BARK AND/OR ACCEPTABLE MANUFACTURED PRODUCTS. WOOD AND BARK CHIPS, GROUND CONSTRUCTION DEBRIS, OR REPROCESSED WOOD PRODUCTS ARE NOT ACCEPTABLE AS THE ORGANIC COMPONENT OF THE MIX.

INSTALLATION

- SEE DETAILS # 2 ON SHEET ANGP-T-G-012 FOR LIST OF APPROPRIATE PERIMETER CONTROLS TO USE.
- THE BERM SHALL BE PLACED ALONG A RELATIVELY LEVEL CONTOUR.
- EXISTING GROUND SHALL BE PREPARED AS NEEDED SUCH THAT THE BERM LIES NEARLY FLAT ALONG THE GROUND TO AVOID THE CREATION OF VOIDS AND BRIDGES IN ORDER TO MINIMIZE THE POTENTIAL OF WASH OUTS UNDER THE BERM.
- ON SLOPES < 5% OR AT THE BOTTOM OF STEEPER SLOPES (<2:1) UP TO 20' LONG, THE BERM MUST BE A MINIMUM OF 12" HIGH, AS MEASURED ON THE UPHILL SIDE OF THE BERM, AND A MINIMUM OF 2 FT. WIDE ON LONGER OR STEEPER SLOPES, THE BERM SHALL BE WIDER TO ACCOMMODATE ADDITIONAL FLOW.
- BERM MAY BE INSTALLED IN PLACE OF SILT FENCE EXCEPT IN, BUT NOT LIMITED TO, THE FOLLOWING AREAS: WETLAND AREAS, AT POINTS OF CONCENTRATED FLOW, BELOW STORMWATER OUTFALLS, AROUND CATCH BASINS AND CLOSED STORM SYSTEMS AND AT THE BOTTOM OF STEEP SLOPES THAT ARE MORE THAN 50 FEET FROM TOP TO BOTTOM. BERM MAY BE USED IN WETLAND BUFFER AREAS BUT MAY NOT BE USED IN WETLANDS AREA.
- PERIMETER CONTROLS SHALL NOT CROSS ACTIVE ACCESS ROUTES (E.G., ROADS) OR ACTIVE FLOW PATHS (E.G., LARGER STREAMS/RIVERS).
- PERIMETER CONTROLS SHALL REMAIN IN PLACE AND BE MAINTAINED/REPLACED AS NEEDED UNTIL FINAL STABILIZATION IN AREA HAS BEEN ACHIEVED.


6 Erosion Control Mix Berm 12/12
N.T.S. Source: VHB LD_

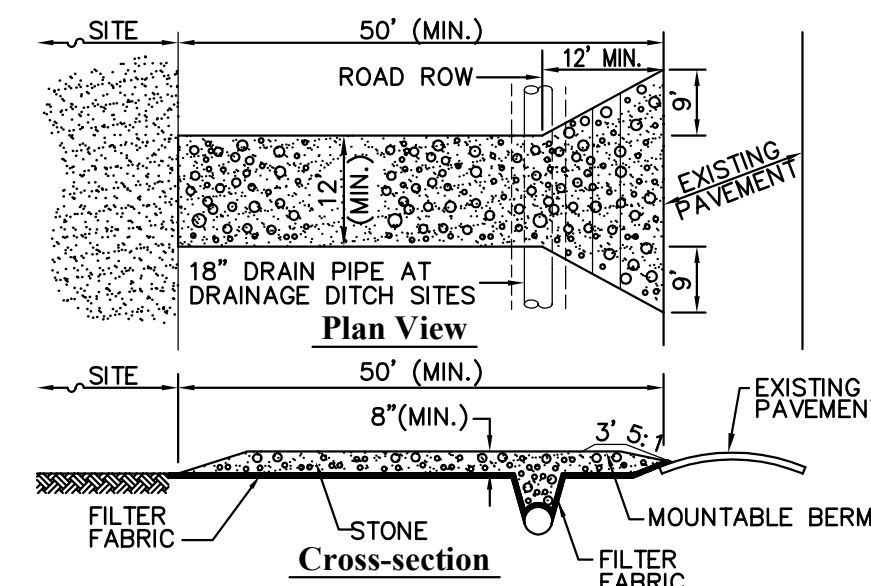

Notes:

- STONE SIZE: USE 1 TO 4 INCH DIAMETER STONE, OR RECLAIMED OR RECYCLED CONCRETE EQUIVALENT.
- LENGTH: NOT LESS THAN 50 FEET.
- THICKNESS: NOT LESS THAN 8 INCHES.
- WIDTH: EXIT WIDTH SHALL BE A TWELVE (12) FOOT MINIMUM, BUT NOT LESS THAN THE FULL WIDTH AT POINTS WHERE INGRESS OR EGRESS OCCURS.
- GEOTEXTILE: MUST BE PLACED OVER THE ENTIRE AREA PRIOR TO PLACING STONE.
- SURFACE WATER: ALL SURFACE WATER FLOWING OR DIVERTED TOWARD CONSTRUCTION EXITS SHALL BE PIPED BENEATH THE EXIT. IF PIPING IS IMPRACTICAL, A MOUNTABLE BERM WITH 5:1 SLOPES WILL BE PERMITTED.
- MAINTENANCE: THE EXIT SHALL BE MAINTAINED IN A CONDITION WHICH WILL PREVENT TRACKING OR FLOWING OF SEDIMENT ONTO PUBLIC RIGHTS-OF-WAY. ALL SEDIMENT SPILLED, DROPPED, WASHED OR TRACKED ONTO PUBLIC RIGHTS-OF-WAY MUST BE REMOVED IMMEDIATELY. MAINTENANCE MAY REQUIRE TOP DRESSING W/ADDITIONAL AGGREGATE.
- WHEN WHEEL/EQUIPMENT WASHING IS REQUIRED IT SHALL BE DONE ON AN AREA STABILIZED WITH STONE AND WHICH DRAINS INTO AN APPROVED SEDIMENT TRAPPING DEVICE.
- PERIODIC INSPECTION AND NEEDED MAINTENANCE SHALL BE PROVIDED ACCORDING TO PERMIT REQUIREMENTS.
- STABILIZED CONSTRUCTION EXIT SHALL BE REMOVED PRIOR TO FINAL FINISH MATERIALS BEING INSTALLED.

7 Stabilized Construction Exit 12/12
N.T.S. Source: VHB LD_

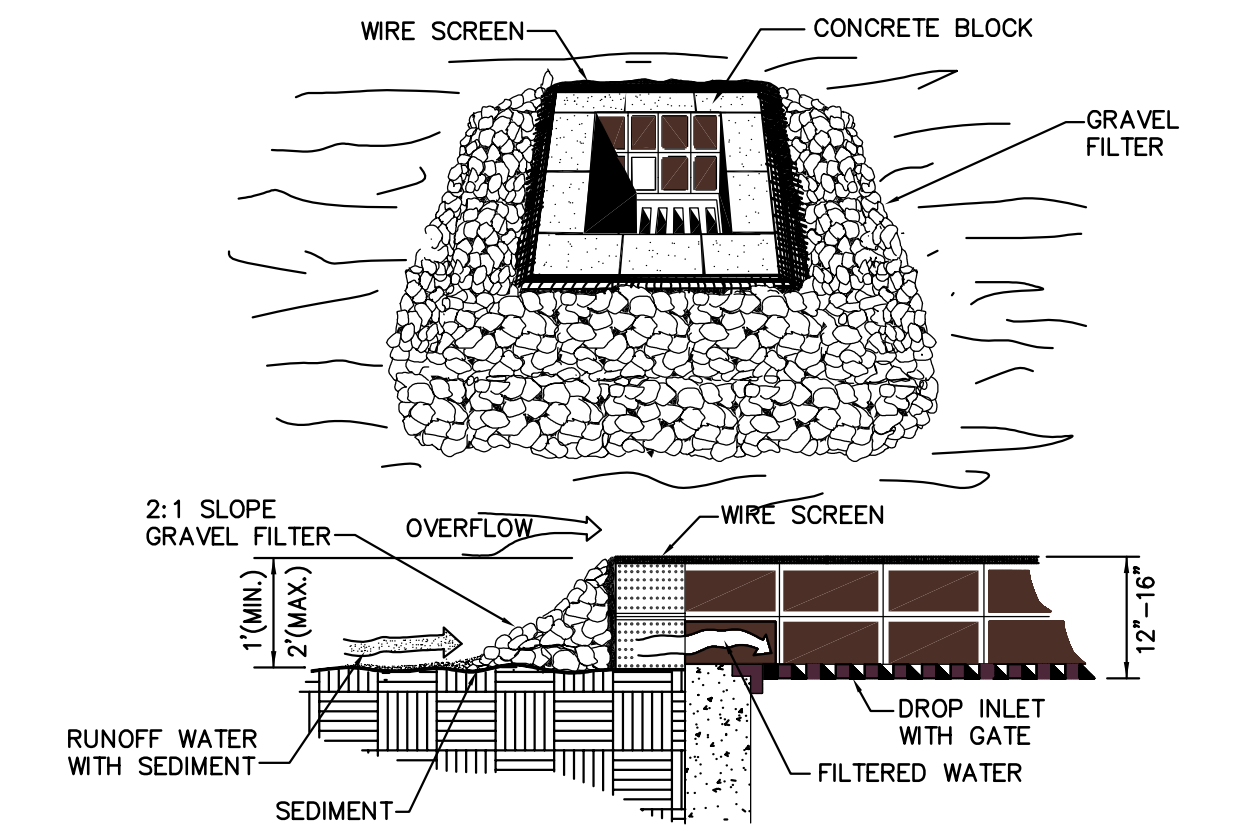

Notes:

- LAY ONE BLOCK ON EACH SIDE OF THE STRUCTURE ON ITS SIDE FOR DEWATERING. FOUNDATION SHALL BE 2" MINIMUM BELOW THE REST OF THE INLET AND BLOCKS SHALL BE PLACED AGAINST THE INLET FOR SUPPORT.
- CONCRETE BLOCKS SHOULD BE PLACED LENGTHWISE ON THEIR SIDES IN A SINGLE ROW AROUND THE PERIMETER OF THE INLET. THE ENDS OF EACH BLOCK SHOULD BE ABUTTING. THE HEIGHT OF THE BARRIER CAN BE VARIED DEPENDING ON THE DESIGN BY STACKING VARIOUS COMBINATIONS OF DIFFERENT SIZED BLOCKS. THE BARRIER SHOULD BE A MINIMUM OF 12 INCHES HIGH AND A MAXIMUM OF 16 INCHES HIGH.
- HARDWARE CLOTH OR 1/2" WIRE MESH SHOULD BE PLACED OVER THE OPENINGS OF THE CONCRETE BLOCKS AND EXTENDED AT LEAST 12 INCHES AROUND THE OPENING TO PREVENT AGGREGATE FROM BEING TRANSPORTED THROUGH THE OPENINGS IN THE BLOCK.
- USE CLEAN STONE OR GRAVEL 1/2" TO 3/4" IN DIAMETER PLACED 2" BELOW TOP OF THE BLOCK ON A 2H:1V SLOPE OR FLATTER.
- A 1 FOOT THICK LAYER OF FILTER STONE WILL BE PLACED AGAINST THE 3" STONE.
- MAXIMUM DRAINAGE AREA PER SEDIMENT TRAP IS 1 ACRE.
- BLOCK AND GRAVEL DROP INLET SEDIMENT FILTER SHALL BE CONSTRUCTED IN PAVED AREAS.

8 Block and Gravel Drop Inlet Sediment Filter (Paved Areas) 10/13
N.T.S. Source: VHB LD_





DWG. NO.	REFERENCE DWG.	REV	DSN	CK	DESCRIPTION	INITIALS	DATE	INITIALS	DATE	YEAR:	W.O.	SCALE:	DWG.	ANGP-T-G-013	REV.
										2016		NOTED			0

ENVIRONMENTAL		DRAFTING DESIGNER		DRAFTING SUPERVISOR		DESIGN ENGINEER		DESIGN MANAGER	
JLS	06/28/13	GIL	06/28/13	BZD	06/28/13	MDF	06/28/13	SAB	06/28/13

CONSTRUCTION		VERMONT GAS	
JLS	05/2016	PROPOSED 12" PIPELINE	
GJM	05/2016	ADDISON NATURAL GAS PROJECT	
BCK	05/2016	CONSTRUCTION DETAILS	
GEW	05/2016	LOC. CHITTENDEN & ADDISON COUNTIES	
JEO	05/2016	YEAR: 2016 W.O. SCALE: NOTED DWG. ANGP-T-G-013 REV. 0	





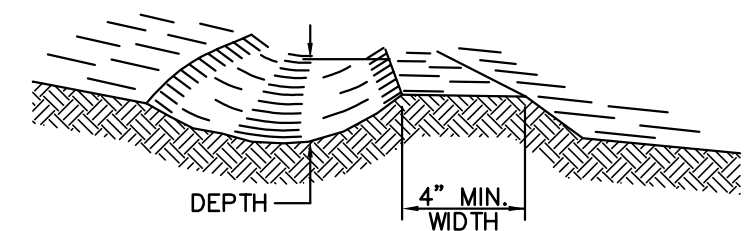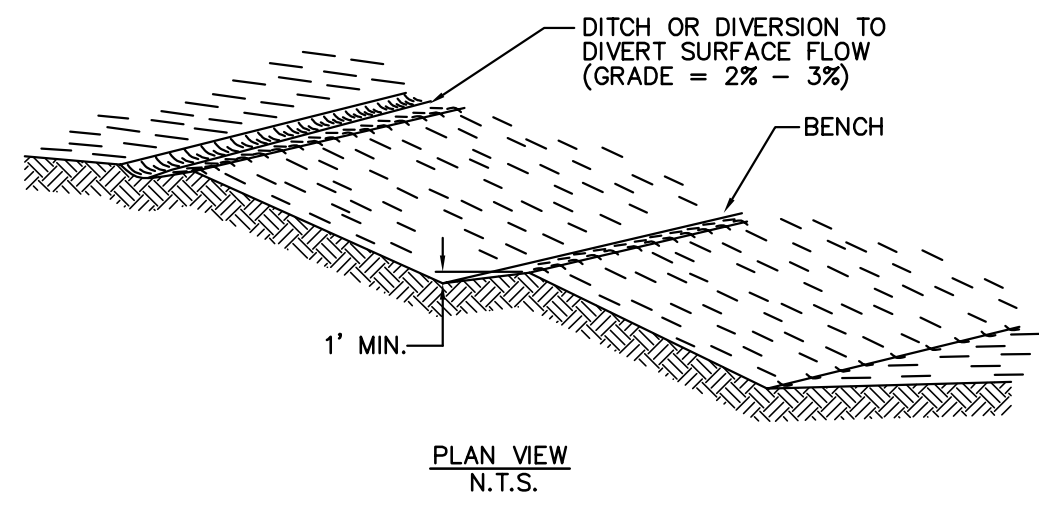

Notes:


1. ALL TREES, BRUSH, STUMPS, OBSTRUCTIONS, AND OTHER OBJECTIONABLE MATERIAL SHALL BE REMOVED AND DISPOSED OF SO AS NOT TO INTERFERE WITH THE PROPER FUNCTIONING OF THE DIVERSION.
2. THE DIVERSION SHALL BE EXCAVATED OR SHAPED TO LINE, GRADE, AND CROSS SECTION AS REQUIRED TO MEET CRITERIA SPECIFIED HEREIN, AND BE FREE OF BANK PROJECTIONS OR OTHER IRREGULARITIES WHICH WILL IMPEDE NORMAL FLOW.
3. FILLS SHALL BE COMPACTED AS NEEDED TO PREVENT UNEQUAL SETTLEMENT THAT WOULD CAUSE DAMAGE IN THE COMPLETED DIVERSION.
4. ALL GRADED AREAS SHALL BE PERMANENTLY STABILIZED FOLLOWING FINISHED GRADING.
5. SILT FENCE OR HAY BALES SHALL BE PLACED AT THE OUTLET OF EACH STRUCTURE.

1 Diversion Swale and Bench 12/12
N.T.S. Source: VHB LD_

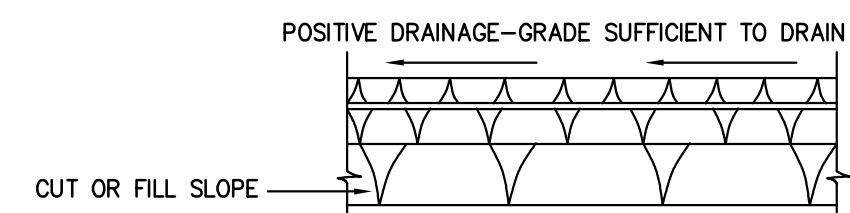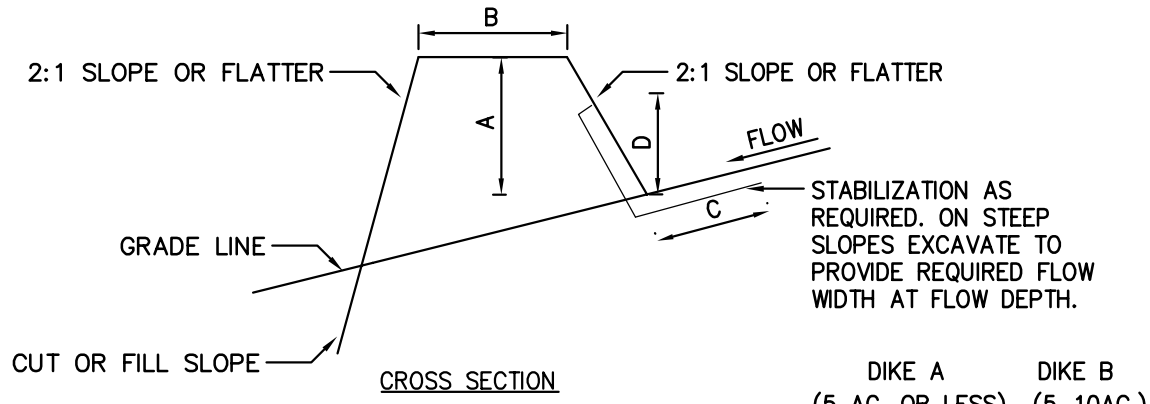

- CONSTRUCTION SPECIFICATIONS**
1. ALL DIKES SHALL BE COMPACTED BY EARTH-MOVING EQUIPMENT.
 2. ALL DIKES SHALL HAVE POSITIVE DRAINAGE TO AN OUTLET.
 3. TOP WIDTH MAY BE WIDER AND SIDE SLOPES BE FLATTER IF DESIRED TO FACILITATE CONSTRUCTION TRAFFIC.
 4. FIELD LOCATION SHOULD BE ADJUSTED AS NEEDED TO UTILIZE A STABILIZED SAFE OUTLET.
 5. EARTH DIKES SHALL HAVE AN OUTLET THAT FUNCTIONS WITH A MINIMUM OF EROSION. RUNOFF SHALL BE CONVEYED TO A SEDIMENT TRAPPING DEVICE SUCH AS A SEDIMENT TRAP OR SEDIMENT BASIN WHERE EITHER THE DIKE CHANNEL OR THE DRAINAGE AREA ABOVE THE DIKE ARE NOT ADEQUATELY STABILIZED.
 6. STABILIZATION SHALL BE: (A) IN ACCORDANCE WITH STANDARD SPECIFICATIONS FOR MULCH IF NOT IN SEEDING SEASON, (B) PER THE FOLLOWING CHART
- | TYPE OF TREATMENT | CHANNEL GRADE | A (5 AC OR LESS) | B (5 AC - 10 AC) |
|-------------------|---------------|--------------------------|---------------------------------------|
| 1 | 0.5%-3.0% | SEED AND STRAW MULCH | SEED AND STRAW MULCH |
| 2 | 3.1%-5.0% | SEED AND STRAW MULCH | SEED AND COVER USING RECP |
| 3 | 5.1%-8.0% | SEED AND COVER WITH RECP | LINED WITH 4-8" RIP-RAP OR GEOTEXTILE |
| 4 | 8.1%-20.0% | LINED WITH 4-8" RIP-RAP | ENGINEERED DESIGN |


2 Earth Dike 12/12
N.T.S. Source: VHB / VT S+S EPSC LD_

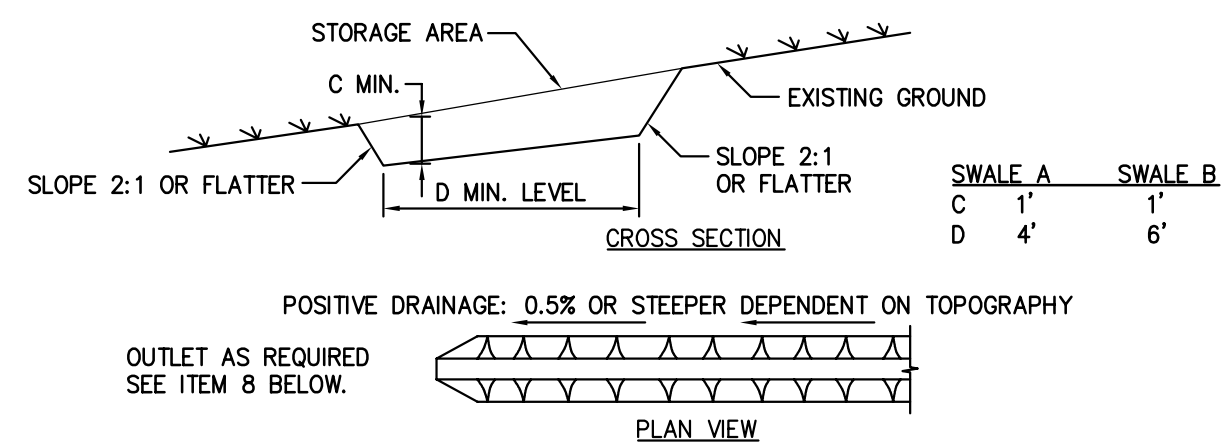

- CONSTRUCTION SPECIFICATIONS**
1. ALL TEMPORARY SWALES SHALL HAVE UNINTERRUPTED POSITIVE GRADE TO AN OUTLET.
 2. DIVERTED RUNOFF FROM A DISTURBED AREA SHALL BE CONVEYED TO A SEDIMENT TRAPPING DEVICE.
 3. DIVERTED RUNOFF FROM AN UNDISTURBED AREA SHALL OUTLET DIRECTLY INTO AN UNDISTURBED STABILIZED AREA AT NON-EROSIVE VELOCITY.
 4. ALL TREES, BRUSH, STUMPS, OBSTRUCTIONS, AND OTHER OBJECTIONABLE MATERIAL SHALL BE REMOVED AND DISPOSED OF SO AS NOT TO INTERFERE WITH THE PROPER FUNCTIONING OF THE SWALE.
 5. THE SWALE SHALL BE EXCAVATED OR SHAPED TO LINE, GRADE, AND CROSS SECTION AS REQUIRED TO MEET THE CRITERIA SPECIFIED HEREIN AND BE FREE OF BANK PROJECTIONS OR OTHER IRREGULARITIES WHICH WILL IMPEDE NORMAL FLOW.
 6. FILLS SHALL BE COMPACTED BY EARTH MOVING EQUIPMENT.
 7. ALL EARTH REMOVED AND NOT NEEDED FOR CONSTRUCTION SHALL BE PLACED SO THAT IT WILL NOT INTERFERE WITH THE FUNCTIONING OF THE SWALE.
 8. STABILIZATION SHALL BE AS PER THE FLOW CHANNEL STABILIZATION CHART BELOW:


TYPE OF TREATMENT	CHANNEL GRADE	A (5 AC OR LESS)	B (5 AC - 10 AC)
1	0.5%-3.0%	SEED AND STRAW MULCH	SEED AND STRAW MULCH
2	3.1%-5.0%	SEED AND STRAW MULCH	SEED AND COVER USING RECP
3	5.1%-8.0%	SEED AND COVER WITH RECP	LINED WITH 4-8" RIP-RAP OR GEOTEXTILE
4	8.1%-20.0%	LINED WITH 4-8" RIP-RAP	ENGINEERED DESIGN

3 Temporary Swale 12/12
N.T.S. Source: VHB / VT S+S EPSC LD_

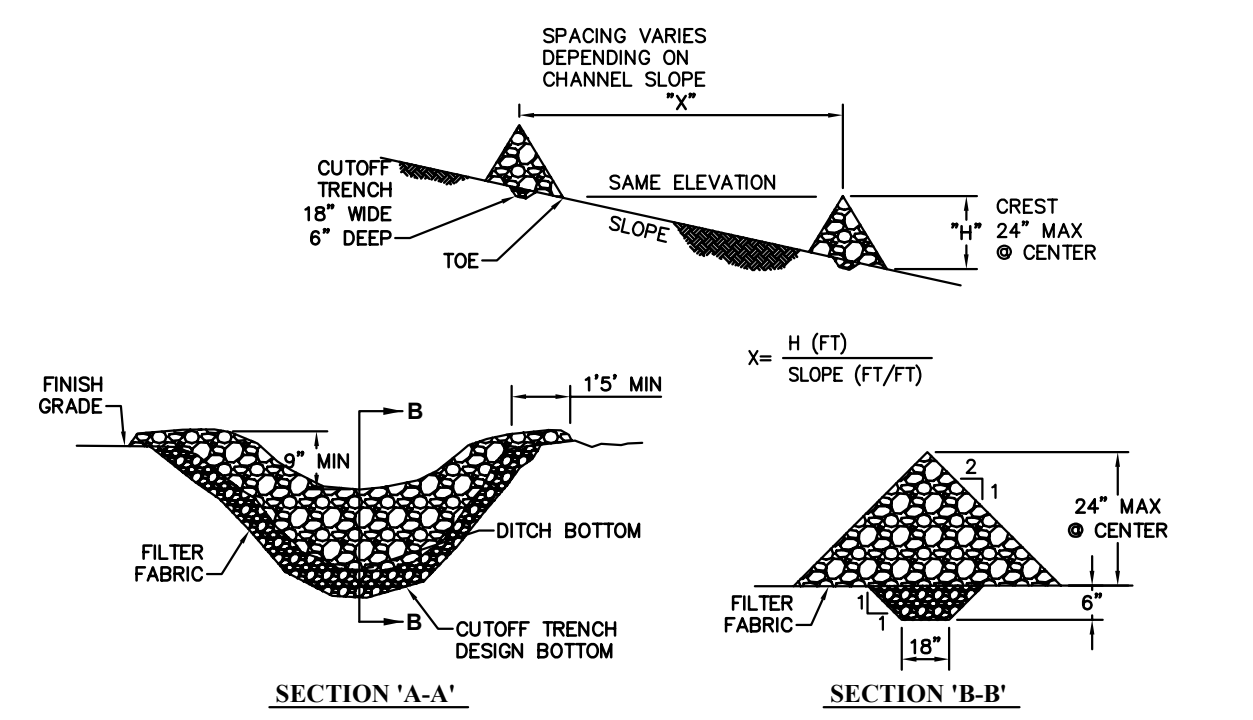

- Notes:**
1. STONE WILL BE PLACED ON A FILTER FABRIC FOUNDATION TO THE LINES, GRADES AND LOCATIONS SHOWN IN THE PLAN USING A WELL GRADED STONE MATRIX 2 TO 9 INCHES IN SIZE.
 2. SET SPACING OF CHECK DAMS TO ASSUME THAT THE ELEVATIONS OF THE CREST OF THE DOWNSTREAM DAM IS AT THE SAME ELEVATION OF THE TOE OF THE UPSTREAM DAM.
 3. EXTEND THE STONE A MINIMUM OF 1.5 FEET BEYOND THE DITCH BANKS TO PREVENT CUTTING AROUND THE DAM.
 4. PROTECT THE CHANNEL DOWNSTREAM OF THE LOWEST CHECK DAM FROM SCOUR AND EROSION WITH STONE OR LINER AS APPROPRIATE.
 5. ENSURE THAT CHANNEL APPURTENANCES SUCH AS CULVERT ENTRANCES BELOW CHECK DAMS ARE NOT SUBJECT TO DAMAGE OR BLOCKAGE FROM DISPLACED STONE.
 6. MAXIMUM DRAINAGE AREA ABOVE CHECK DAM SHALL NOT EXCEED 2 AC.


4 Stone Check Dam 12/12
N.T.S. Source: VHB / VT S+S EPSC LD_

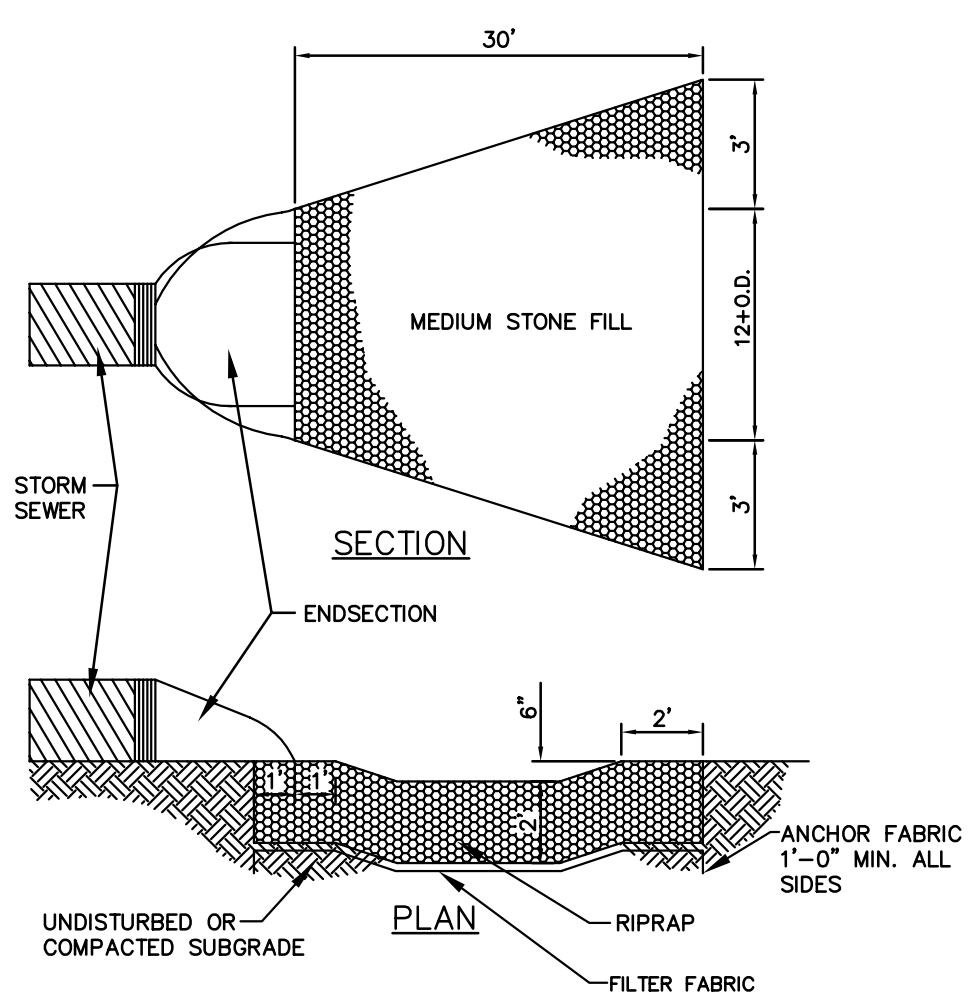

Notes:


1. OUTLET PROTECTION MAY BE DONE BY USING ROCK RIP-RAP, GROUTED RIP-RAP, OR GABIONS.
2. STONE SIZE SHALL BE A WELL GRADED MIXTURE SO THAT 50% OF THE STONE SIZE, BY WEIGHT, SHALL BE LARGER THAN THE #50 SIZE DETERMINED USING THE CHARTS.

5 Outlet Protection 12/12
N.T.S. Source: CHA LD_

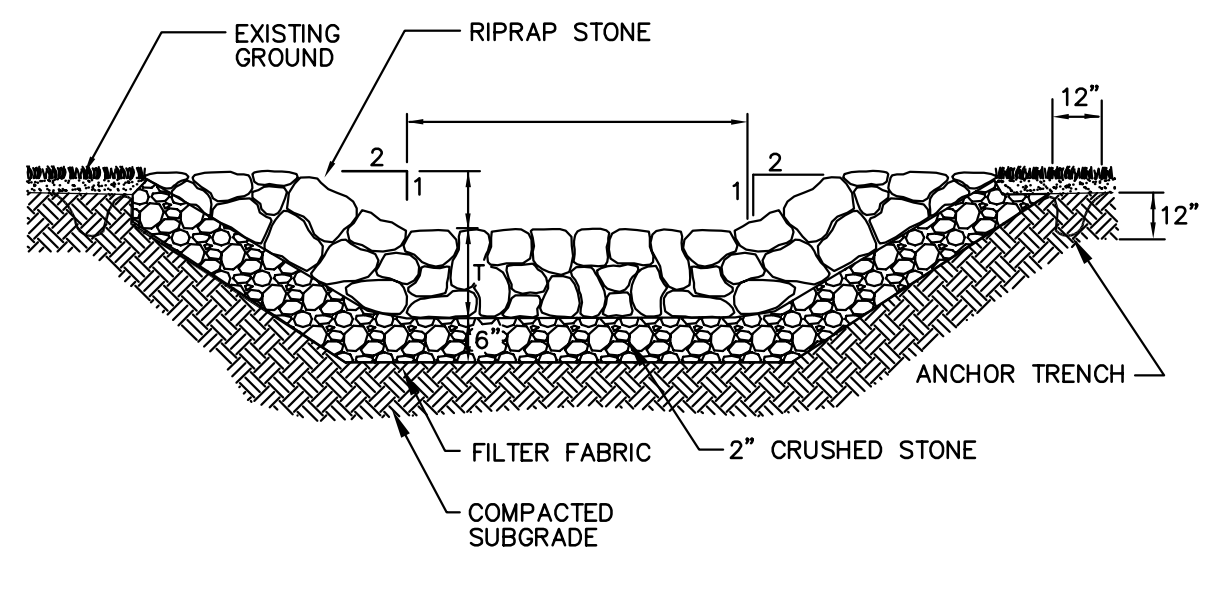


- Notes:**
1. MIN. CAPACITY SHALL CARRY PEAK FLOW RATE DURING 10-YR, 24-HR STORM EVENT.
 2. MAX SIZE OF RIPRAP STONE SHALL BE:
- | VEL. (FPS) | D MAX (IN.) |
|------------|-------------|
| 5.0 | 6 |
| 8.5 | 12 |
| 10 | 18 |
| 12 | 24 |
| 15 | 36 |
3. FOUNDATION AREA SHALL BE CLEARED OF TREES, STUMPS, ROOTS, SOD, LOOSE ROCK, OR OTHER OBJECTIONABLE MATERIAL.
 4. OUTLET STABILIZATION MAY BE NEEDED TO PREVENT EROSION.

6 Stone-lined Swale 12/12
N.T.S. Source: VHB LD_358

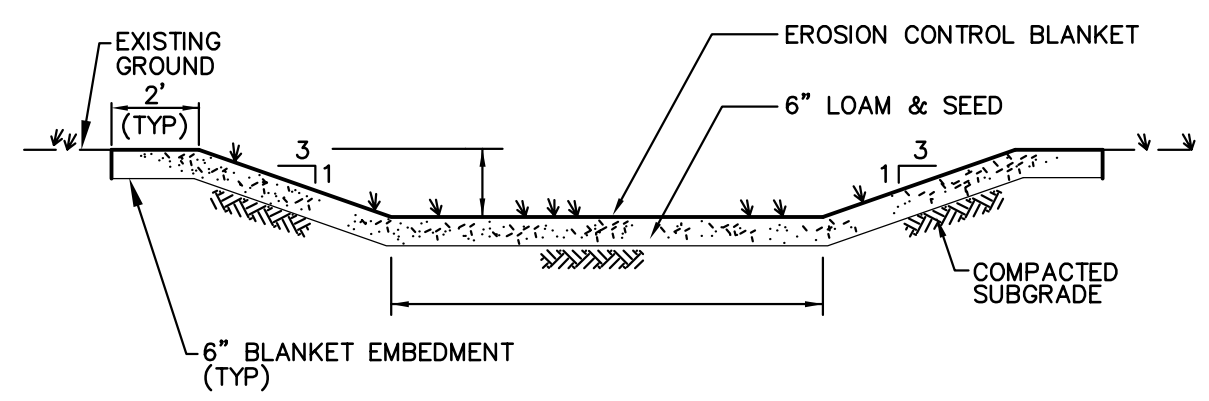

- Notes:**
1. NOT TO BE USED IN AREAS WHERE FLOW VOLUME AND RATES MAY CAUSE EROSION AND SHOULD OTHERWISE BE CONVEYED VIA STONE-LINED SWALE.
 2. FOUNDATION AREA SHALL BE CLEARED OF TREES, STUMPS, ROOTS, SOD, LOOSE ROCK, OR OTHER OBJECTIONABLE MATERIAL.
 3. INSTALL TEMPORARY COVER (E.G., MULCH) TO PROTECT AREA WHILE SEED IS GERMINATING.
 4. SEE SEEDING SPECIFICATIONS FOR SEED TYPES AND SEED APPLICATION RATES.

7 Grassed Swale 12/12
N.T.S. Source: VHB LD_171

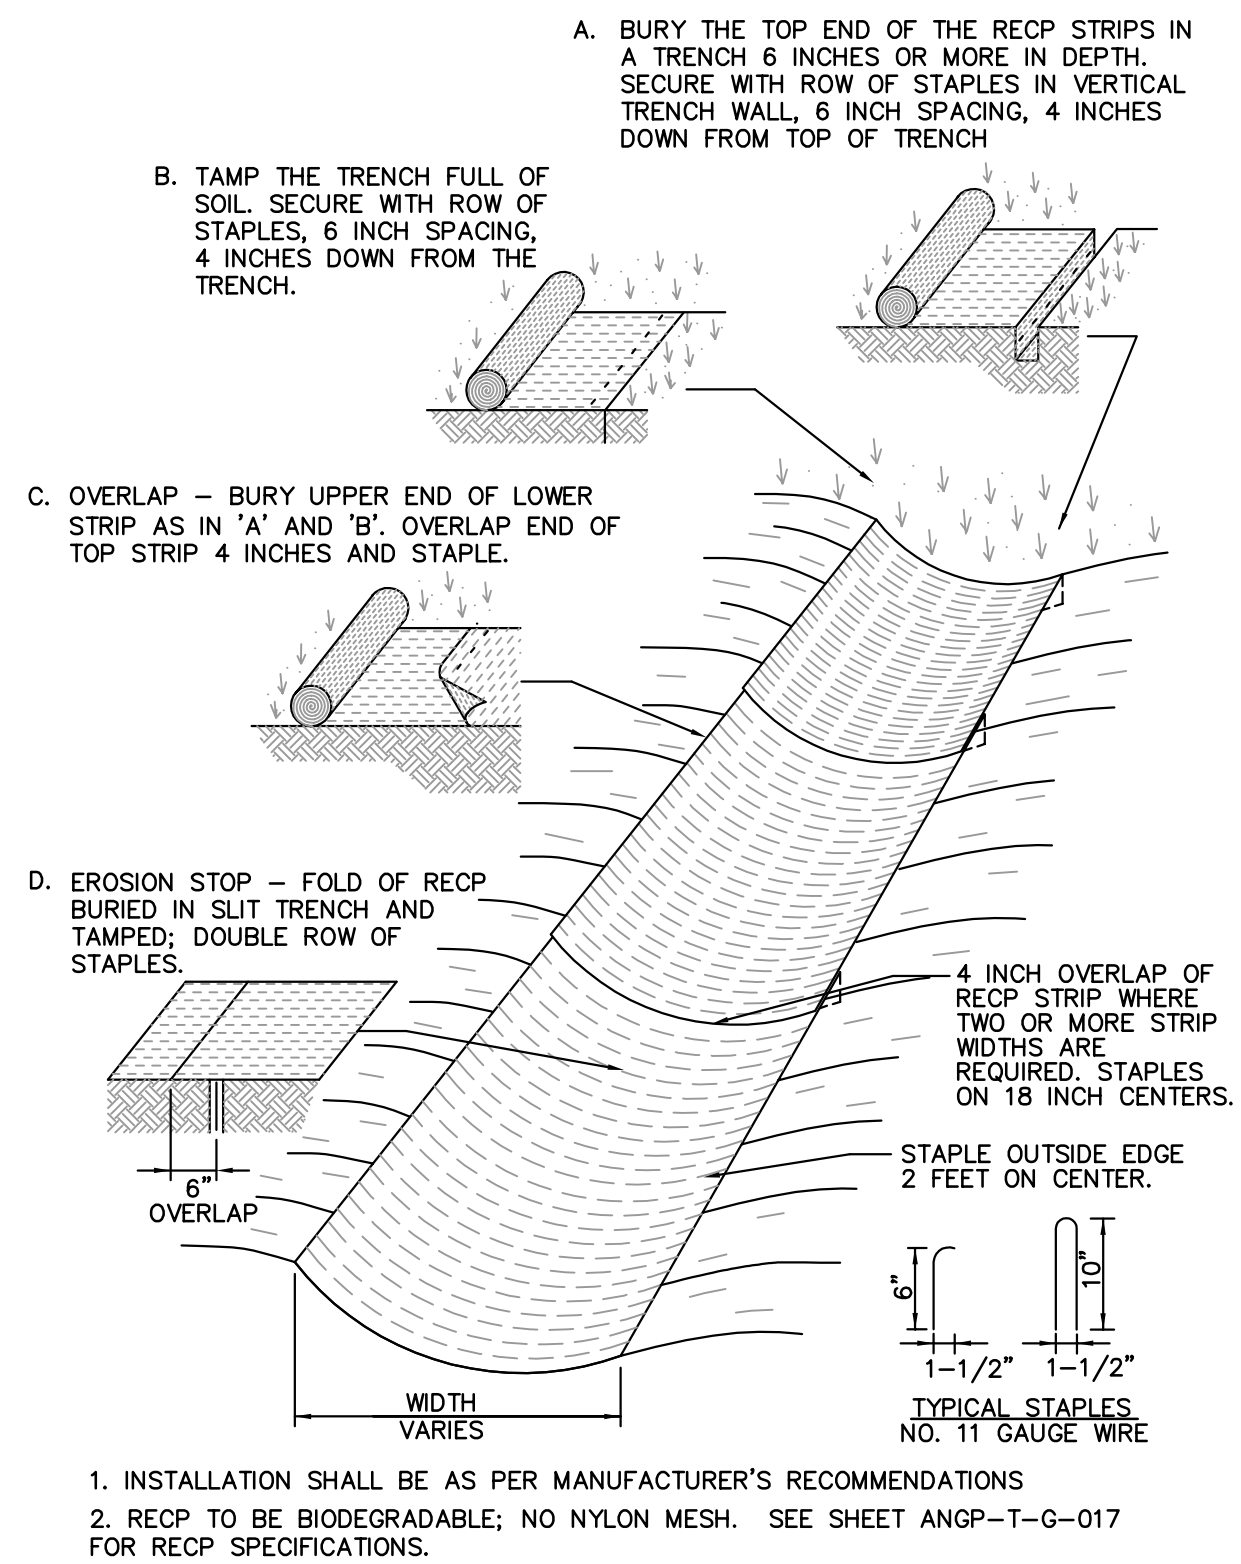

8 Rolled Erosion Control Blanket (RECP) - Swale Installation 12/12
N.T.S. Source: VHB



VHB Vanasse Hangen Brustlin, Inc.

DWG. NO.	REFERENCE DWG.	REV	DSN	CK	DESCRIPTION	INITIALS	DATE	INITIALS	DATE	YEAR: 2016	W.O.	SCALE: NOTED	DWG. ANGP-T-G-014	REV. 0


	BID	CONSTRUCTION
ENVIRONMENTAL	JLS 06/28/13	JLS 05/2016
DRAFTING DESIGNER	GIL 06/28/13	GJM 05/2016
DRAFTING SUPERVISOR	BZD 06/28/13	BCK 05/2016
DESIGN ENGINEER	MDF 06/28/13	GEW 05/2016
DESIGN MANAGER	SAB 06/28/13	JEO 05/2016

VERMONT GAS
PROPOSED 12" PIPELINE
ADDISON NATURAL GAS PROJECT
CONSTRUCTION DETAILS

LOC. CHITTENDEN & ADDISON COUNTIES

YEAR: 2016 W.O. SCALE: NOTED DWG. ANGP-T-G-014 REV. 0

38 Eastwood Drive, Suite 105
South Burlington, VT 05403
Main: (802) 795-0372 - www.chacompanies.com

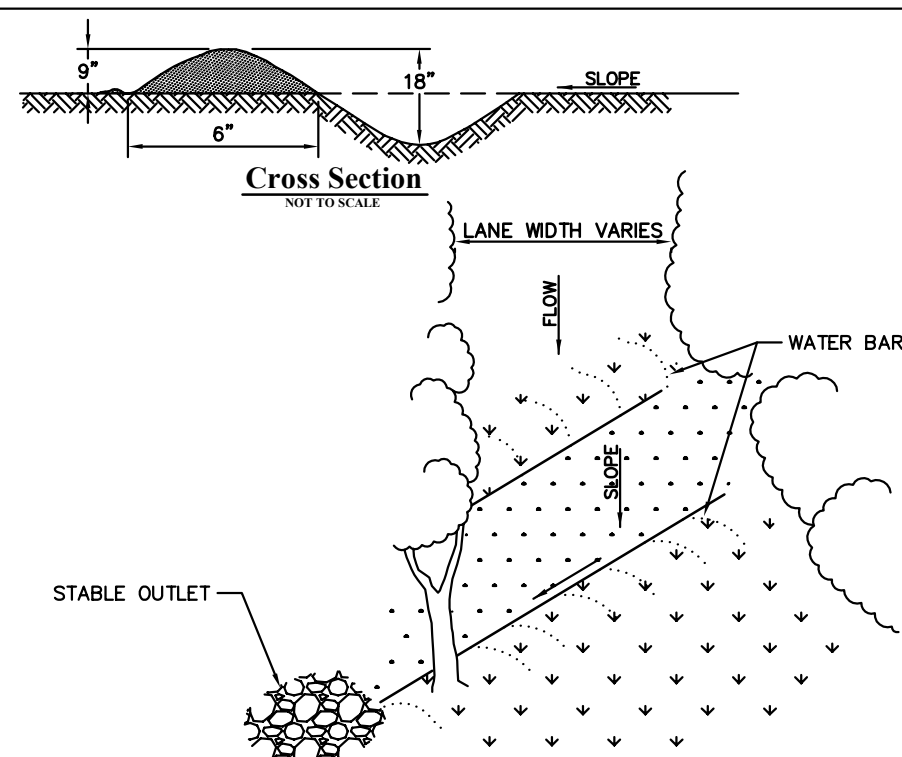


Construction Specifications

- INSTALL THE WATER BAR AS SOON AS THE RIGHT OF WAY IS CLEARED AND GRADED.
- DISK OR STRIP THE SOIL FROM THE BASE FOR THE CONSTRUCTED RIDGE BEFORE PLACING FILL.
- TRACK THE RIDGE TO COMPACT IT TO THE DESIGN CROSS SECTION.
- THE OUTLET SHALL BE LOCATED ON AN UNDISTURBED AREA. FIELD SPACING WILL BE ADJUSTED TO USE THE MOST STABLE OUTLET AREAS. OUTLET PROTECTION WILL BE PROVIDED WHEN NATURAL AREAS ARE NOT ADEQUATE.
- FOR PERMANENT WATER BARS, VEHICLE CROSSING SHALL BE STABILIZED WITH GRAVEL. EXPOSED AREAS SHALL BE SEED AND MULCHED. FOR TEMPORARY WATER BARS, VEHICLE CROSSING SHALL BE COMPACTED AND MAINTAINED PER THESE SPECIFICATIONS. FOLLOWING THEIR USE, WATER BARS SHALL BE REGRADED TO MATCH PRE-CONSTRUCTION CONDITIONS. TOPSOIL SHALL BE RE-APPLIED THEN ALL AREAS OF EXPOSED SOIL SHALL BE FULLY STABILIZED PER THE EPSC PLAN.
- INSPECT WATER BARS FOR EROSION DAMAGE AND SEDIMENT. CHECK OUTLET AREAS AND MAKE REPAIRS AS NEEDED TO RESTORE OPERATION.

SPACING:	SLOPE (%)	SPACING (FT)
	<5	125
	5-10	100
	10-20	75
	20-35	50
	>35	25

1 Water Bars

N.T.S. Source: Vermont Standards and Specs for EPSC 2006 LD_

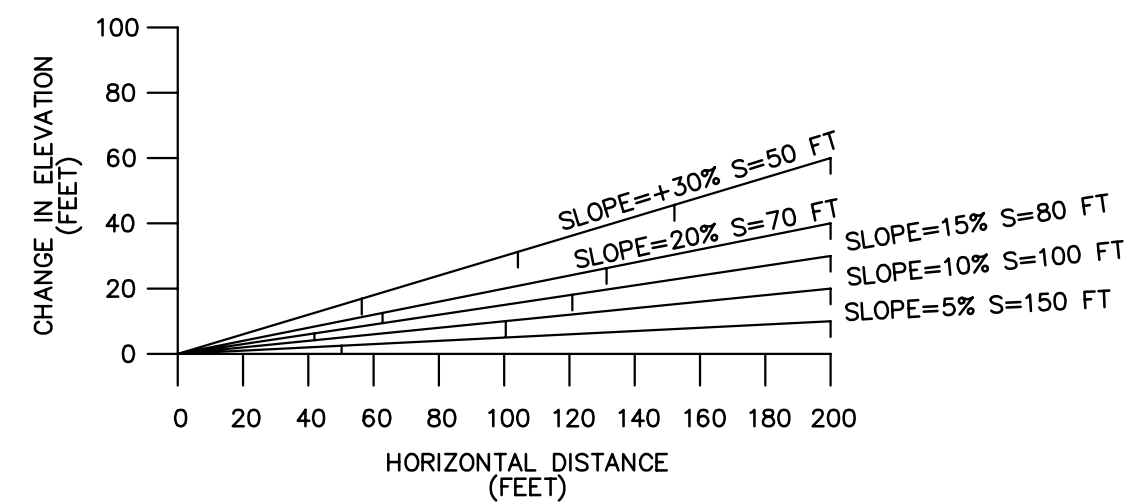


NOTE: S = TRENCH BREAKER SPACING

NOTES:

- PERMANENT TRENCH BREAKER SANDBAGS SHALL NOT BE FILLED WITH TOPSOIL.
- SPACINGS SHOWN ARE RECOMMENDED MINIMUM GUIDELINES. OSPC REPRESENTATIVE MAY ADJUST SPACING IN THE FIELD WITH PRIOR WRITTEN APPROVAL OF OWNER.
- ONE TRENCH BREAKER IS REQUIRED AT ALL STREAM BANKS AND AT WETLAND BOUNDARIES.
- REFER TO SHEETS ANGP-T-G-020B AND 020C FOR APPROXIMATE TRENCH BREAKER LOCATIONS.

2 Permanent Trench Break Spacing Guideline

N.T.S. Source: CHA LD_

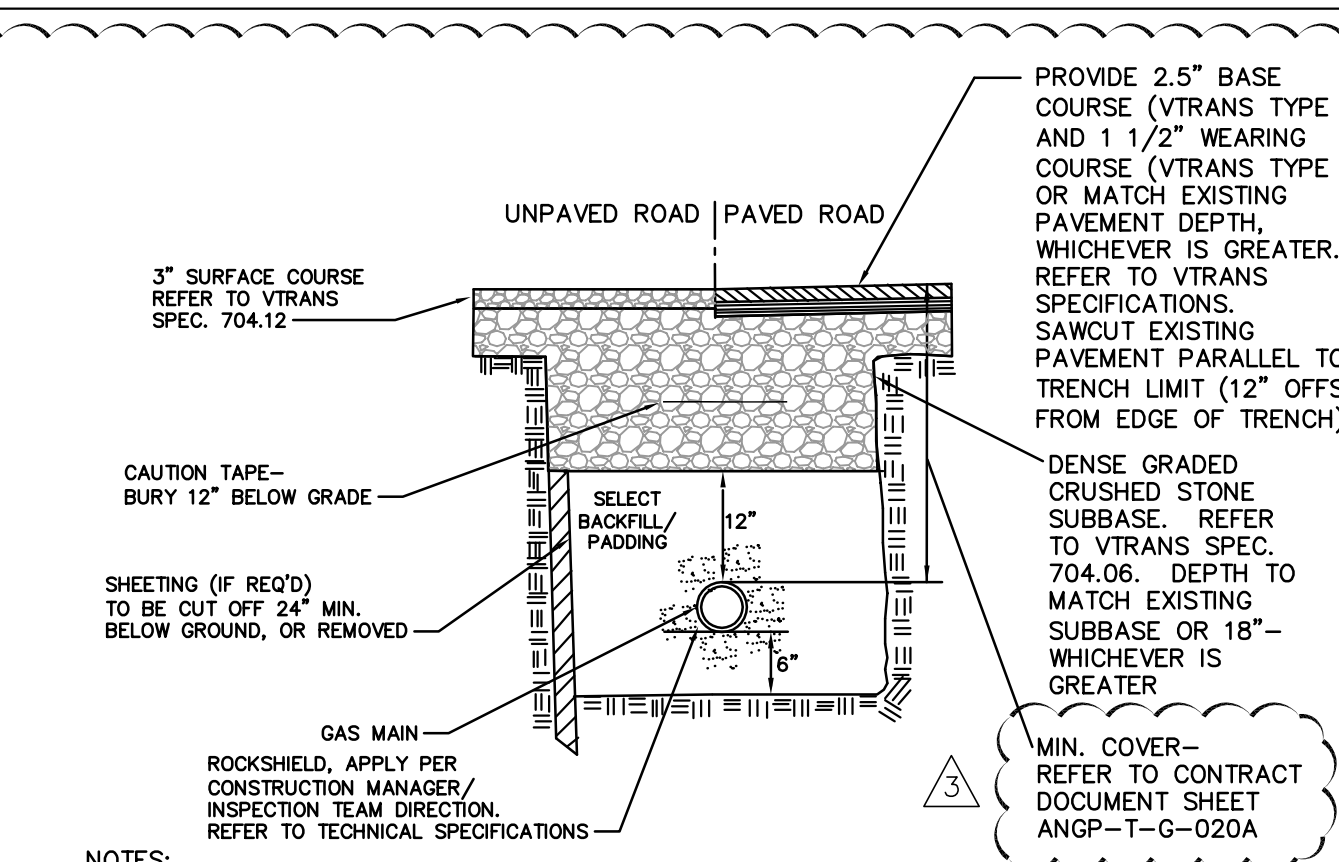

NOTES:

- REFER TO TECHNICAL SPECIFICATIONS FOR BOTH GENERAL AND SELECT/PADDING BACKFILL REQUIREMENTS.
- IN RESOURCE AREAS (E.G. WETLANDS AND PAS AREAS) GENERAL BACKFILL SHALL BE NATIVE MATERIAL TO MATCH PROFILE DEPTH OF ADJACENT NATIVE, UNDISTURBED SUBSOIL/SURFACE SOIL INTERFACE. EXCESS SUBSOIL TO BE PROPERLY DISPOSED OF AND STABILIZED.
- THE OWNER SHALL PROVIDE TESTING SERVICES TO INSURE THAT THE IN-PLACE DENSITY OF THE BACKFILL MEETS REQUIREMENTS DETERMINED IN THE SPECIFICATIONS.
- ALL TRENCH CONSTRUCTION SHALL CONFORM TO APPLICABLE FEDERAL, STATE AND LOCAL REGULATIONS.
- FOR PIPE SUPPORT METHODS AND OTHER PIPE-IN-TRENCH REQUIREMENTS, REFER TO TECHNICAL SPECIFICATIONS.

3 Typical Trench Detail-Roadways and Driveways

N.T.S. Source: CHA LD_


CHA PLAN SHEET #	TOWN	PROJECT COMPONENT	PLANT ID CODE	STATE RANK	MATTING LOCATIONS (STATION)
ANGP-EPSC-014	WILLISTON	TRANSMISSION (ACCESS ROAD)	2012-RTE-CT-03 1	S2/S3	366+50 TO 368+75 AND ON ACCESS ROAD
ANGP-EPSC-022	WILLISTON	TRANSMISSION	2012-RTE-CT-08 4	S2/S3	562+50 TO 563+75
ANGP-EPSC-039	HINESBURG	TRANSMISSION	2012-RTE-CT-08 0	S2/S3	892+80 TO 893+50
ANGP-EPSC-039	HINESBURG	TRANSMISSION	2012-RTE-CT-08 1	S2/S3	1001+20 TO 1002+20
ANGP-EPSC-039	HINESBURG	TRANSMISSION	2012-RTE-CT-08 2	S2/S3	1003+50 TO 1005+80
ANGP-EPSC-040	HINESBURG	TRANSMISSION	2012-RTE-CT-04 1	S2/S3	1021+20 TO 1023+00
ANGP-EPSC-051	MONKTON	TRANSMISSION	2012-RTE-ACT-0 83	S2/S3	1302+10 TO 1307+90
ANGP-EPSC-066	NEW HAVEN	TRANSMISSION	2012-RTE-CT-05 1	S2/S3	1649+50 TO 1652+00
ANGP-EPSC-066	NEW HAVEN	TRANSMISSION	2012-RTE-CT-06 1	S2/S3	1665+50
ANGP-EPSC-066	NEW HAVEN	TRANSMISSION	2012-RTE-AT-05 3	S1	1659+60
ANGP-EPSC-066	NEW HAVEN	TRANSMISSION	2012-RTE-LV-05 4	S2	1659+60
ANGP-EPSC-066	NEW HAVEN	TRANSMISSION	2012-RTE-AT-06 3	S1	1669+70 TO 1670+50
ANGP-EPSC-075, 079, 077	NEW HAVEN	TRANSMISSION	2012-RTE-CT-06 9	S2/S3	1918+00 TO 1966+50
ANGP-EPSC-V011	FERRISBURGH	DISTRIBUTION MAIN	2012-RTE-CT-06 8	S2/S3	118+80 TO 119+10

Notes:


- INSTALL CONSTRUCTION MATS ON STATION LOCATIONS LISTED IN TABLE TO PROTECT RARE PLANT SPECIES.
- LIMIT DURATION OF MATTING DURING GROWING SEASON TO EXTENT PRACTICABLE.
- REMOVE MATTING IMMEDIATELY FOLLOWING THEIR USE. FOR EXAMPLE, WHERE MATTING IS USED FOR TEMPORARY STOCKPILING OF SOIL FROM TRENCHING OPERATIONS, REMOVE MATTING IMMEDIATELY FOLLOWING BACKFILL OPERATIONS.
- AT A MINIMUM, MATTING IS NOT TO BE LEFT IN PLACE FOR MORE THAN 28 DAYS WHERE FEASIBLE.
- REFER TO ADDITIONAL ENVIRONMENTAL NOTE 12 ON SHEET ANGP-T-G-011

4 RTE Matting Table

N.T.S. Source: VHB 09/13

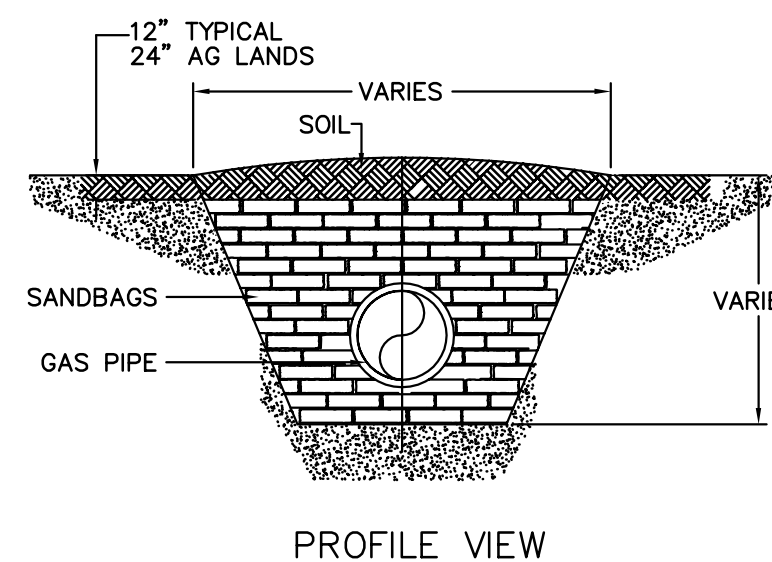


PROFILE VIEW

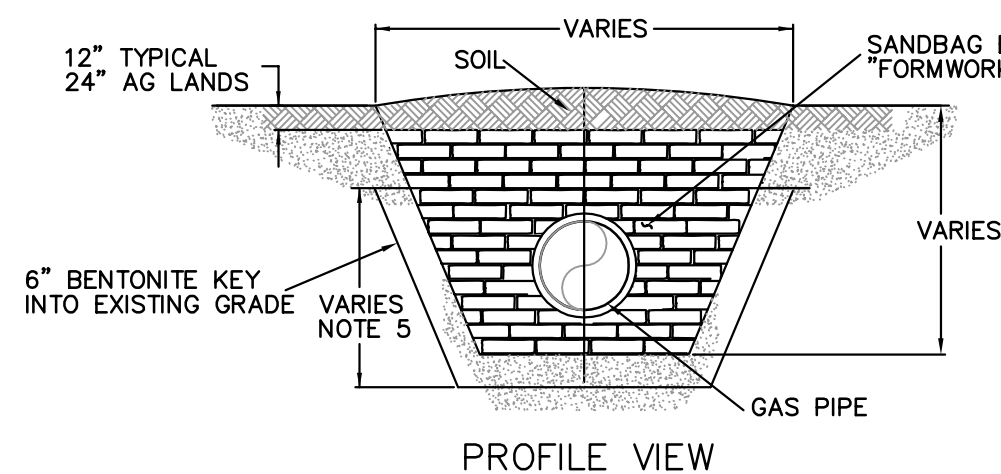


PROFILE VIEW

NOTES:

- PERMANENT TRENCH BREAKER WITH BENTONITE SEAL IS INTENDED TO PROHIBIT WATER FLOW THROUGH THE BREAKER.
- PERMANENT TRENCH BREAKER WITH BENTONITE SEAL TO BE INSTALLED AT EDGE OF WETLANDS AND STREAMS.
- SAND BAG BARRIER WIDTH SHALL BE MINIMUM 1 BAG WIDE AND/OR AS FIELD DETERMINED TO PROVIDE STABILITY.
- BENTONITE IS TO BE INSTALLED IN THE VOID SPACE BETWEEN THE SANDBAG BARRIER "FORMWORK" IN SUCH A MANNER TO COMPLETELY SURROUND THE PIPE AND FILL THE VOID FROM THE BOTTOM OF THE TRENCH TO A HEIGHT 6" ABOVE THE LEVEL OF IMPORTED PADDING MATERIAL WHICH IS INSTALLED ON THE EXTERIOR SIDE OF THE SANDBAG BARRIER IN THE WETLAND ZONE.
- AFTER BENTONITE PLACEMENT, INSTALL SAND BAGS ON TOP OF THE PERMANENT TRENCH BREAKER AND BENTONITE SEAL TO THE REQUIRED HEIGHT PER DETAIL 2 AND BACKFILL EXTERIOR SIDES OF SAND BAG BARRIERS.

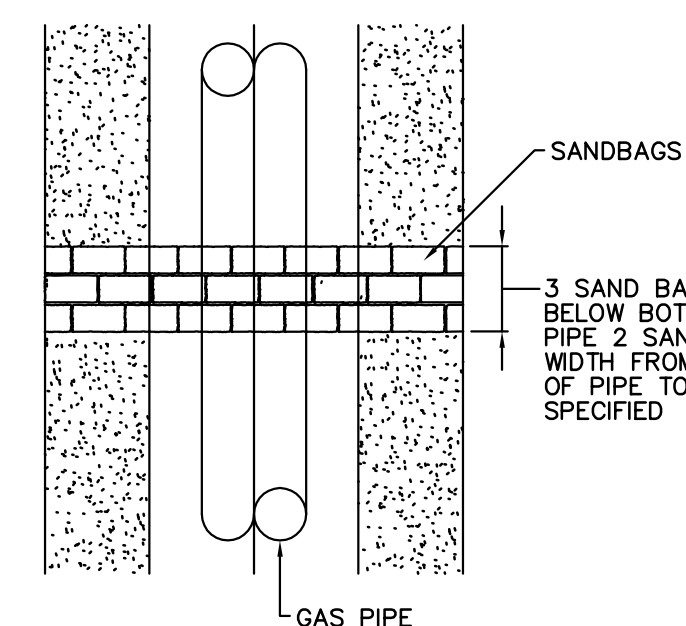

PLAN VIEW SAND BAG TRENCH BREAKER

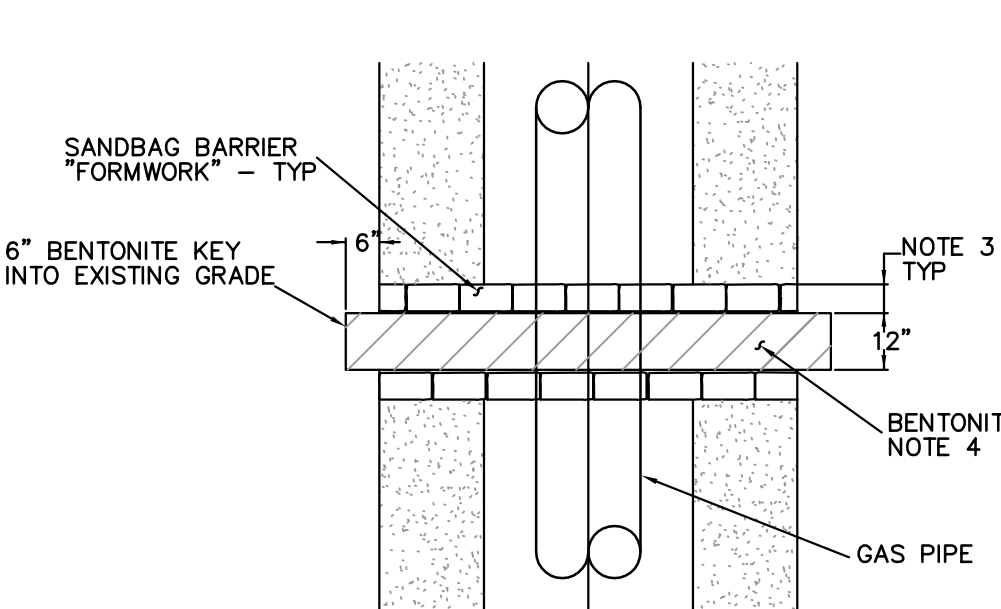

PLAN VIEW TRENCH BREAKER WITH BENTONITE


5 Permanent Trench Break or Sandbags

N.T.S. Source: CHA LD_

6 Typical Trench Detail-Cross Country

N.T.S. Source: CHA LD_

DWG. NO.	REFERENCE DWG.	REV	DSN	CK	DESCRIPTION	INITIALS	DATE	INITIALS	DATE	YEAR:	W.O.	SCALE:	DWG.	REV.
		3	GJM	BCK	IFC 2016 EDITS (05/2016)					2016		NOTED	ANGP-T-G-015	3
		2	BCK	TDB	TRENCH DETAIL UPDATE (1/6/16)									
		1	BCK	TDB	DEPTH OF COVER UPDATE (6/11/15)									

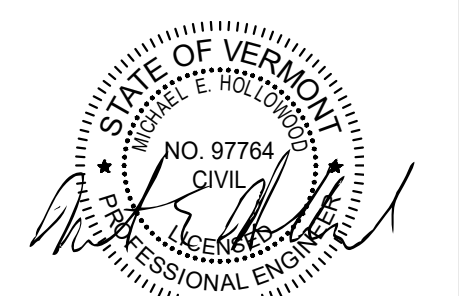

VHB Vanasse Hangen Brustlin, Inc.





ENVIRONMENTAL		DRAFTING DESIGNER		DRAFTING SUPERVISOR		DESIGN ENGINEER		DESIGN MANAGER	
JLS	06/28/13	GIL	06/28/13	BZD	06/28/13	MDF	06/28/13	SAB	06/28/13
JLS	05/2016	GJM	05/2016	BCK	05/2016	GEW	05/2016	JEO	05/2016

VERMONT GAS
PROPOSED 12" PIPELINE
ADDISON NATURAL GAS PROJECT
CONSTRUCTION DETAILS
LOC. CHITTENDEN & ADDISON COUNTIES


CONSTRUCTION SPECIFICATIONS

- AREA UNDER EMBANKMENT SHALL BE CLEARED, GRUBBED AND STRIPPED OF ANY VEGETATION AND ROOT MAT. THE POOL AREA SHALL BE CLEARED.
- THE FILL MATERIAL FOR THE EMBANKMENT SHALL BE FREE OF ROOTS OR OTHER WOODY VEGETATION AS WELL AS OVER-SIZED STONES, ROCKS, ORGANIC MATERIAL, OR OTHER OBJECTIONABLE MATERIAL. THE EMBANKMENT SHALL BE COMPACTED BY TRAVERSING WITH EQUIPMENT WHILE IT IS BEING CONSTRUCTED.
- VOLUME OF SEDIMENT STORAGE SHALL BE 3600 CUBIC FEET PER ACRE OF CONTRIBUTORY DRAINAGE.
- SEDIMENT SHALL BE REMOVED AND TRAP RESTORED TO ITS ORIGINAL DIMENSIONS WHEN THE SEDIMENT HAS ACCUMULATED TO 1/2 THE DESIGN DEPTH OF THE TRAP. REMOVED SEDIMENT SHALL BE DEPOSITED IN A SUITABLE AREA AND STABILIZED.
- THE STRUCTURE SHALL BE INSPECTED AFTER EACH RAIN AND REPAIRS MADE AS NEEDED.
- CONSTRUCTION OPERATIONS SHALL BE CARRIED OUT IN SUCH A MANNER THAT EROSION AND SEDIMENT ARE CONTROLLED.
- THE STRUCTURE SHALL BE REMOVED AND AREA STABILIZED WHEN THE DRAINAGE AREA HAS BEEN PROPERLY STABILIZED.
- ALL CUT SLOPES SHALL BE 2:1 OR FLATTER; CUT SLOPES 1:1 OR FLATTER.
- ALL PIPE CONNECTIONS SHALL BE WATERTIGHT.
- THE TOP 2/3 OF THE RISER SHALL BE PERFORATED WITH ONE (1) INCH DIAMETER HOLES OR SLITS SPACED SIX (6) INCHES VERTICALLY AND HORIZONTALLY AND PLACED IN THE CONCAVE PORTION OF PIPE. NO HOLES WILL BE ALLOWED WITHIN SIX (6) INCHES OF THE HORIZONTAL BARREL.
- THE RISER SHALL BE WRAPPED WITH 1/4 TO 1/2 INCH HARDWARE CLOTH WIRE THEN WRAPPED WITH FILTER CLOTH (HAVING AN EQUIVALENT SIEVE SIZE OF 40-80). THE FILTER CLOTH SHALL EXTEND SIX (6) INCHES ABOVE THE HIGHEST HOLE AND SIX (6) INCHES BELOW THE LOWEST HOLE. WHERE ENDS OF THE FILTER CLOTH COME TOGETHER, THEY SHALL BE OVER-LAPPED, FOLDED AND STAPLED TO PREVENT BYPASS.
- STRAPS OR CONNECTING BANDS SHALL BE USED TO HOLD THE FILTER CLOTH AND WIRE FABRIC IN PLACE. THEY SHALL BE PLACED AT THE TOP AND BOTTOM OF THE CLOTH.
- FILL MATERIAL AROUND THE PIPE SPILLWAY SHALL BE HAND COMPACTED IN FOUR (4) INCH LAYERS. A MINIMUM OF TWO (2) FEET OF HAND COMPACTED BACKFILL SHALL BE PLACED OVER THE PIPE SPILLWAY BEFORE CROSSING IT WITH CONSTRUCTION EQUIPMENT.
- THE RISER SHALL BE ANCHORED WITH EITHER A CONCRETE BASE OR STEEL PLATE BASE TO PREVENT FLOTATION. FOR CONCRETE BASE THE DEPTH SHALL BE TWELVE (12) INCHES WITH THE RISER EMBEDDED NINE (9) INCHES. A 1/4 INCH MINIMUM THICKNESS STEEL PLATE SHALL BE ATTACHED TO THE RISER BY A CONTINUOUS WELD AROUND THE BOTTOM TO FORM A WATERTIGHT CONNECTION AND THEN PLACE TWO (2) FEET OF STONE, GRAVEL, OR TAMPED EARTH ON THE PLATE.

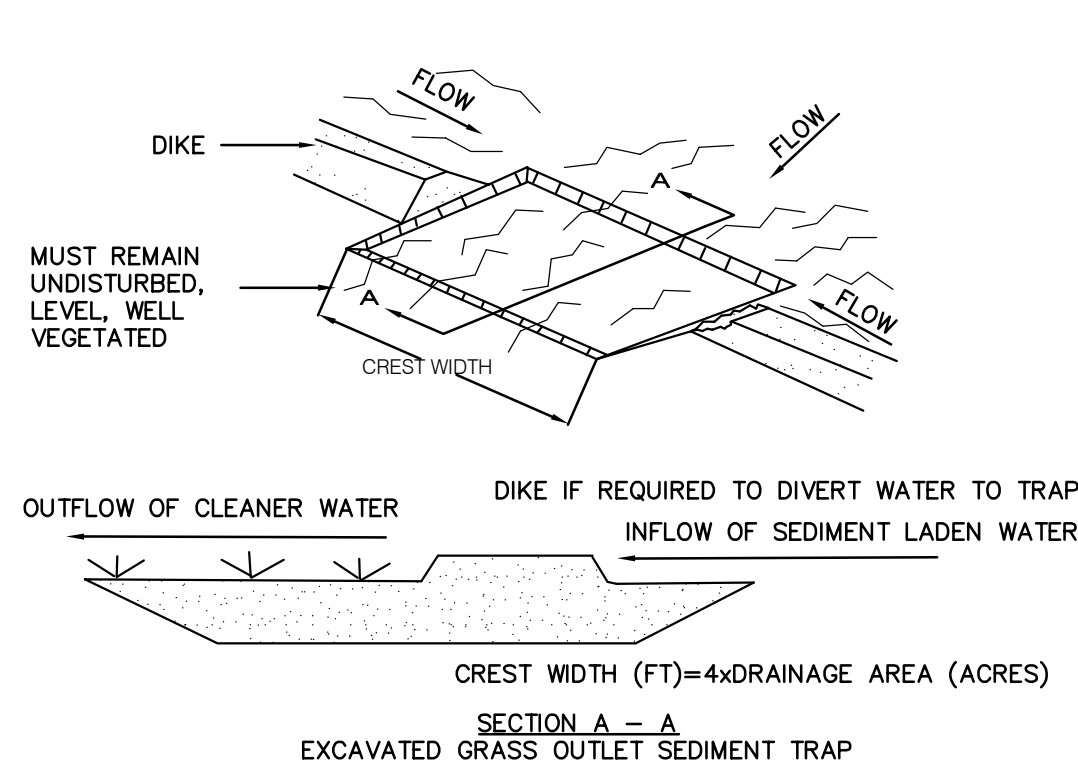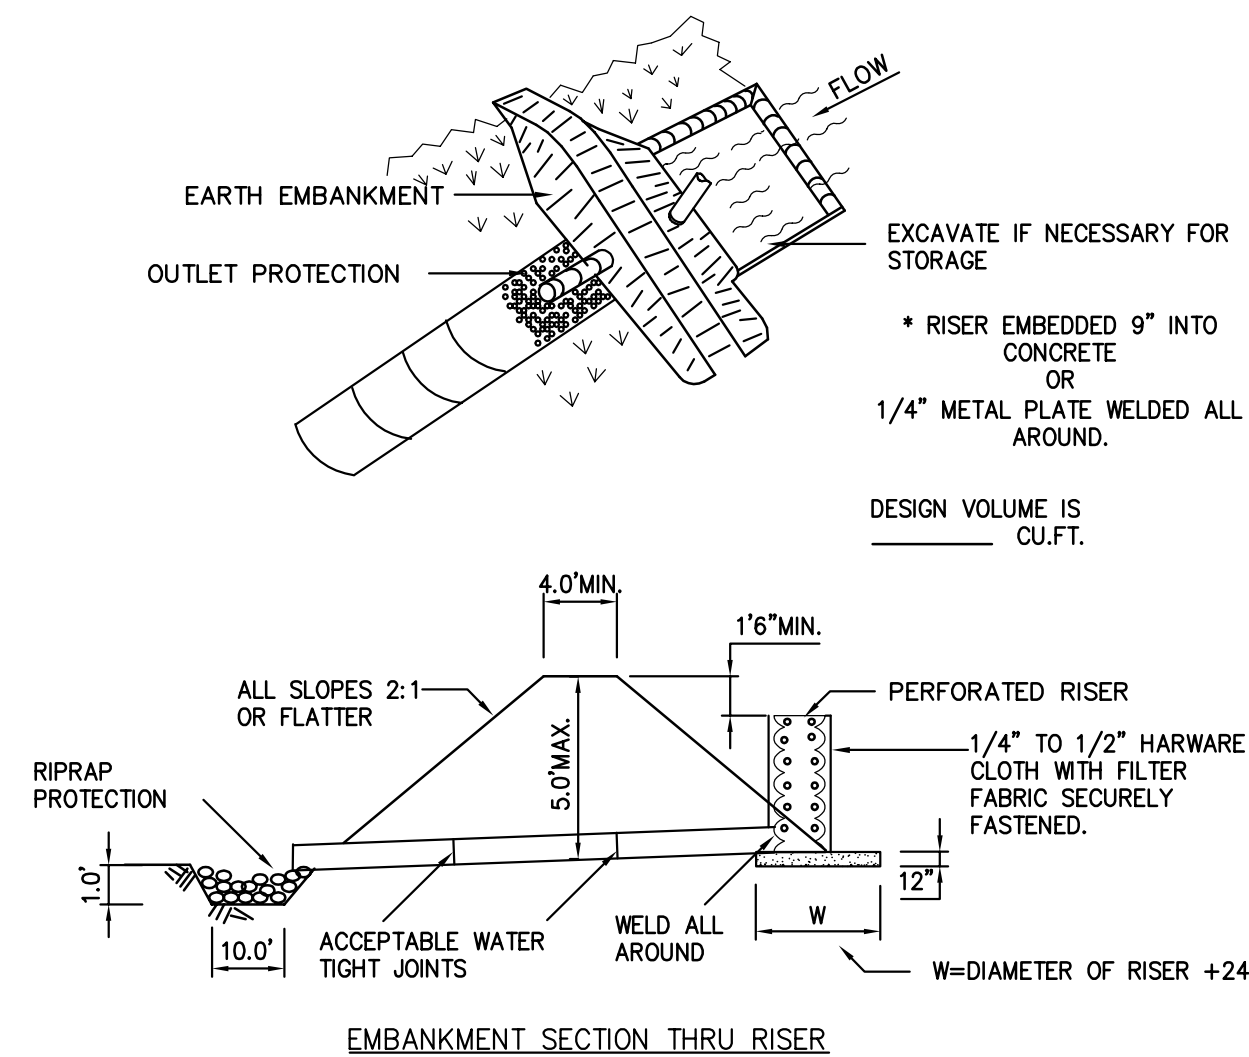

CONSTRUCTION SPECIFICATIONS

- VOLUME OF SEDIMENT STORAGE SHALL BE 1800 CUBIC FEET PER ACRE OF CONTRIBUTORY DRAINAGE AREA.
- MINIMUM CREST WIDTH SHALL BE 4 x DRAINAGE AREA
- SEDIMENT SHALL BE REMOVED AND TRAP RESTORED TO ITS ORIGINAL DIMENSIONS WHEN THE SEDIMENT HAS ACCUMULATED TO 1/2 THE DESIGN DEPTH OF THE TRAP. REMOVED SEDIMENT SHALL BE DEPOSITED IN A SUITABLE AREA AND IN SUCH A MANNER THAT IT WILL NOT ERODE.
- THE STRUCTURE SHALL BE INSPECTED AFTER EACH RAIN AND REPAIRS MADE AS NEEDED.
- CONSTRUCTION OPERATIONS SHALL BE CARRIED OUT IN SUCH A MANNER THAT EROSION AND WATER POLLUTION SHALL BE MINIMIZED.
- THE SEDIMENT TRAP SHALL BE REMOVED AND AREA STABILIZED WHEN THE REMAINING DRAINAGE AREA HAS BEEN PROPERLY STABILIZED.
- ALL CUT SLOPES SHALL BE 1:1 OR FLATTER.
MAXIMUM DRAINAGE AREA: 5 ACRES

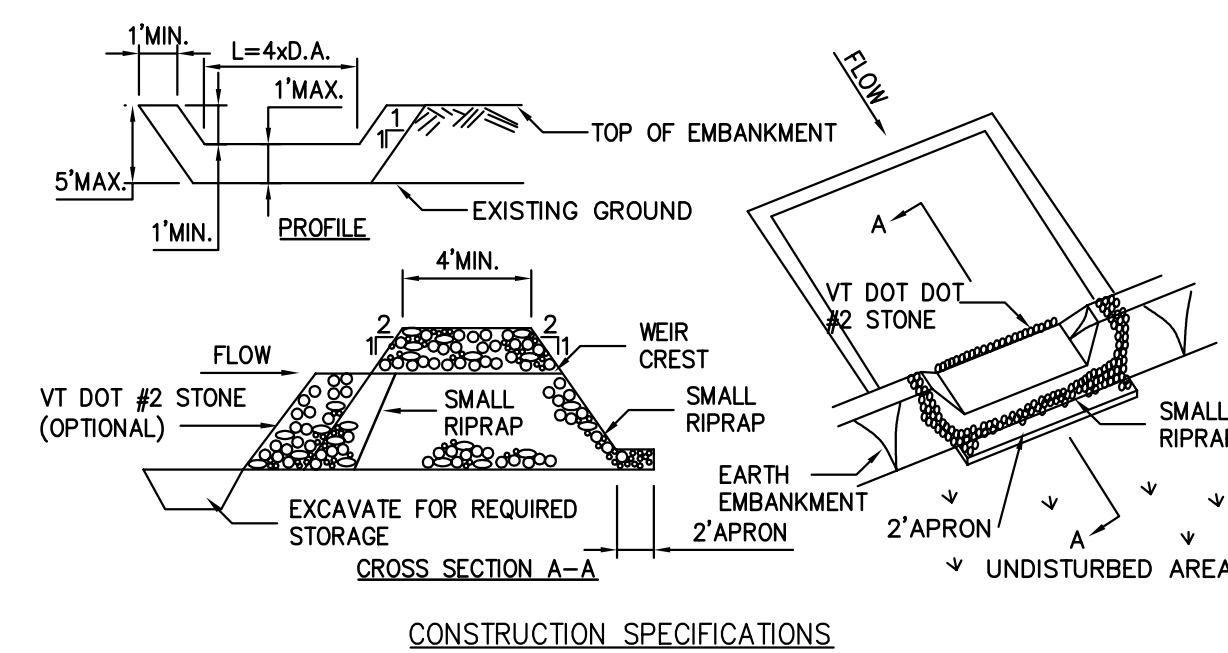

CONSTRUCTION SPECIFICATIONS

- AREA UNDER EMBANKMENT SHALL BE CLEARED, GRUBBED AND STRIPPED OF ANY VEGETATION AND ROOT MAT. THE POOL AREA SHALL BE CLEARED.
- THE FILL MATERIAL FOR THE EMBANKMENT SHALL BE FREE OF ROOTS AND OTHER WOODY VEGETATION AS WELL AS OVER-SIZED STONES, ROCKS, ORGANIC MATERIAL OR OTHER OBJECTIONABLE MATERIAL. THE EMBANKMENT SHALL BE COMPACTED BY TRAVERSING WITH EQUIPMENT WHILE IT IS BEING CONSTRUCTED.
- ALL CUT AND FILL SLOPES SHALL BE 2:1 OR FLATTER.
- THE STONE USED IN THE OUTLET SHALL BE SMALL RIPRAP 4'-8" ALONG WITH A 1" THICKNESS OF 2" AGGREGATE PLACED ON THE UP-GRADE SIDE ON THE SMALL RIPRAP OR EMBEDDED FILTER CLOTH IN THE RIPRAP.
- SEDIMENT SHALL BE REMOVED AND TRAP RESTORED TO ITS ORIGINAL DIMENSIONS WHEN THE SEDIMENT HAS ACCUMULATED TO 1/2 THE DESIGN DEPTH OF THE TRAP.
- THE STRUCTURE SHALL BE INSPECTED AFTER EACH RAIN AND AS REQUIRED BY THE PERMIT.
- CONSTRUCTION OPERATIONS SHALL BE CARRIED OUT IN SUCH A MANNER THAT EROSION AND WATER POLLUTION IS MINIMIZED.
- THE STRUCTURE SHALL BE REMOVED AND THE AREA STABILIZED WHEN THE DRAINAGE AREA HAS BEEN PROPERLY STABILIZED.
MAXIMUM DRAINAGE AREA 5 ACRES

1 Pipe Outlet Sediment Trap


N.T.S. Source: VHB / VT S+S EPSC 12/12 LD...

2 Grass Outlet Sediment Trap

N.T.S. Source: VHB / VT S+S EPSC 12/12 LD...


3 Stone Outlet Sediment Trap

N.T.S. Source: VHB / VT S+S EPSC 12/12 LD...

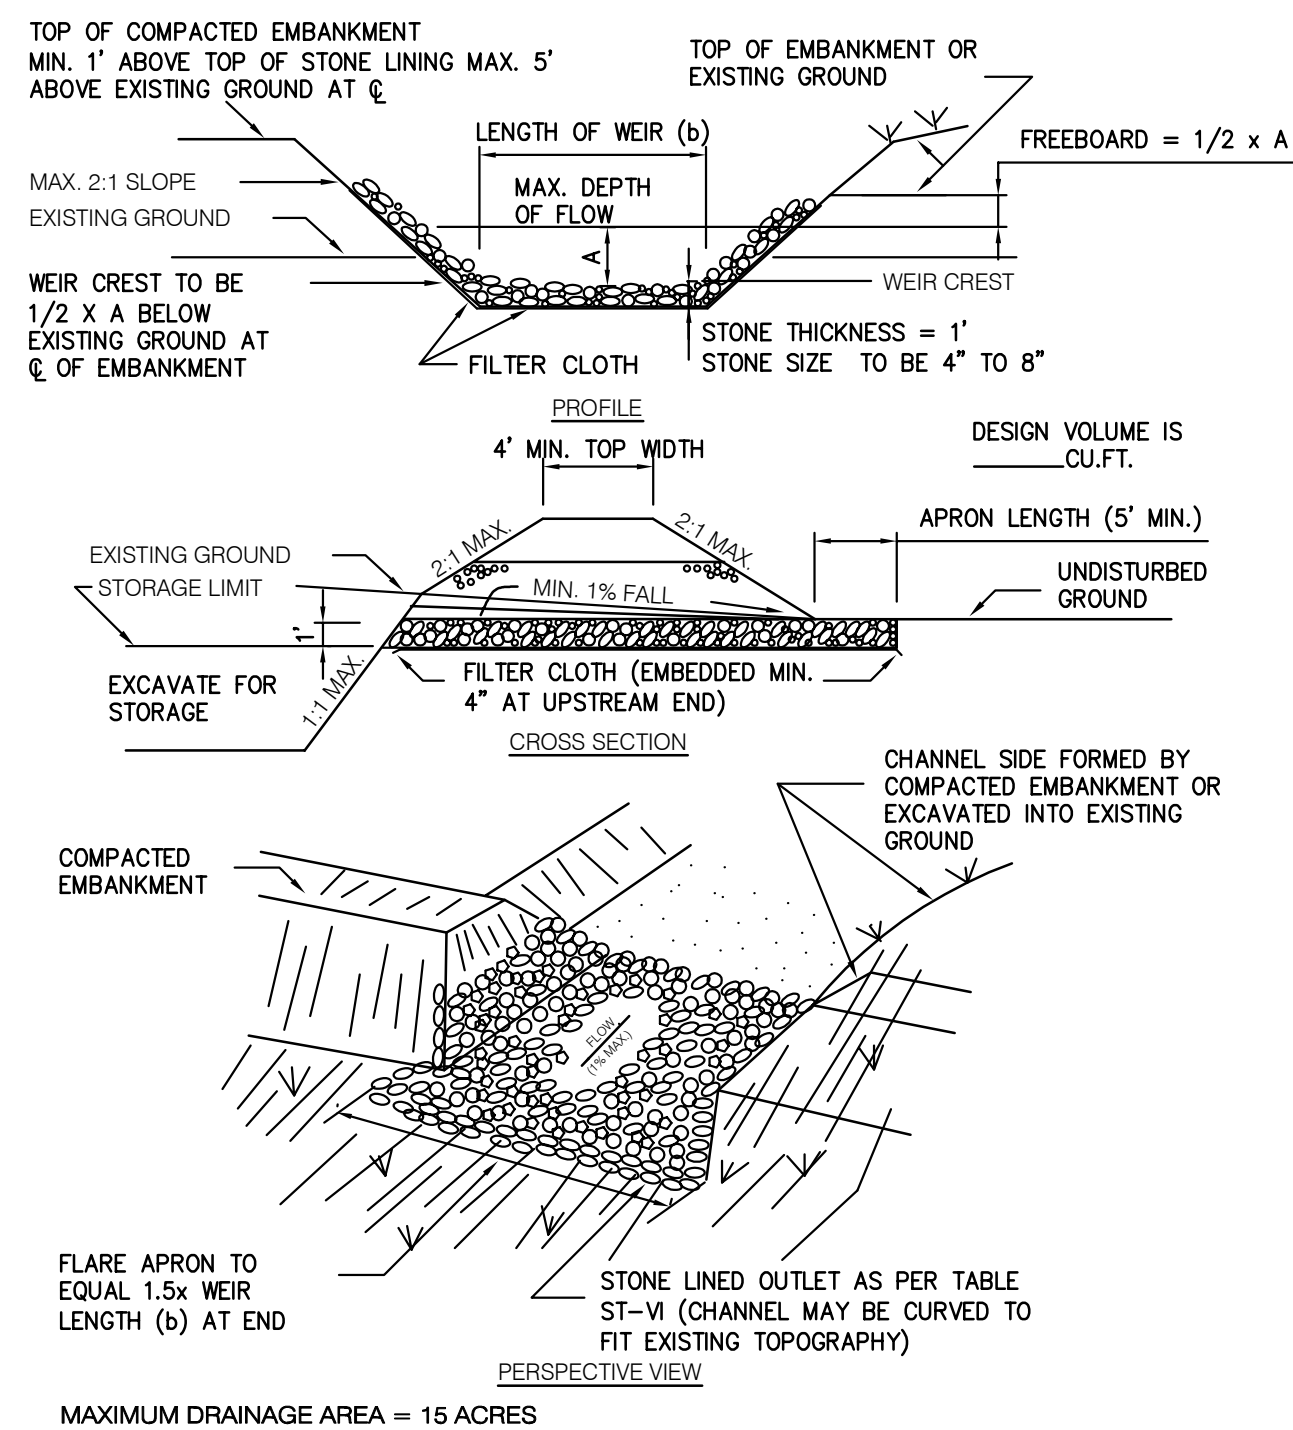


CONSTRUCTION SPECIFICATIONS

- THE AREA UNDER EMBANKMENT SHALL BE CLEARED, GRUBBED AND STRIPPED OF ANY VEGETATION AND ROOT MAT. THE POOL AREA SHALL BE CLEARED.
- THE FILL MATERIAL FOR THE EMBANKMENT SHALL BE FREE OF ROOTS OR OTHER WOODY VEGETATION AS WELL AS OVER-SIZED STONES, ROCKS, ORGANIC MATERIAL OR OTHER OBJECTIONABLE MATERIAL. THE EMBANKMENT SHALL BE COMPACTED BY TRAVERSING WITH EQUIPMENT WHILE IT IS BEING CONSTRUCTED. MAXIMUM HEIGHT OF EMBANKMENT SHALL BE FIVE (5) FEET, MEASURED AT CENTERLINE OF EMBANKMENT.
- ALL FILL SLOPES SHALL BE 2:1 OR FLATTER, CUT SLOPES 1:1 OR FLATTER.
- ELEVATION OF THE TOP OF ANY DIKE DIRECTING WATER INTO TRAP MUST EQUAL OR EXCEED THE HEIGHT OF EMBANKMENT.
- STORAGE AREA PROVIDED SHALL BE FIGURED BY COMPUTING THE VOLUME AVAILABLE BEHIND THE OUTLET CHANNEL UP TO AN ELEVATION OF ONE (1) FOOT BELOW THE LEVEL WEIR CREST.
- FILTER CLOTH SHALL BE PLACED OVER THE BOTTOM AND SIDES OF THE OUTLET CHANNEL PRIOR TO PLACEMENT OF STONE. SECTIONS OF FABRIC MUST OVERLAP AT LEAST ONE (1) FOOT WITH SECTION NEAREST THE ENTRANCE PLACED ON TOP. FABRIC SHALL BE EMBEDDED AT LEAST SIX (6) INCHES INTO EXISTING GROUND AT ENTRANCE OUTLET CHANNEL.
- STONE USED IN THE OUTLET CHANNEL SHALL BE FOUR (4) TO EIGHT (8) INCH RIPRAP. TO PROVIDE A FILTERING EFFECT, A LAYER OF FILTER CLOTH SHALL BE EMBEDDED ONE (1) FOOT WITH SECTION NEAREST ENTRANCE PLACED ON TOP. FABRIC SHALL BE EMBEDDED AT LEAST SIX (6) INCHES INTO EXISTING GROUND AT ENTRANCE OF OUTLET CHANNEL.
- SEDIMENT SHALL BE REMOVED AND TRAP RESTORED TO ITS ORIGINAL DIMENSIONS WHEN SEDIMENT HAS ACCUMULATED TO 1/2 THE DESIGN DEPTH OF THE TRAP. REMOVED SEDIMENT SHALL BE DEPOSITED IN A SUITABLE AREA AND IN SUCH A MANNER THAT IT WILL NOT ERODE.
- THE STRUCTURE SHALL BE INSPECTED AFTER EACH RAIN AND REPAIRED AS NEEDED.
- CONSTRUCTION OPERATIONS SHALL BE CARRIED OUT IN SUCH A MANNER THAT EROSION AND SEDIMENT ARE CONTROLLED.
- THE STRUCTURE SHALL BE REMOVED AND THE AREA STABILIZED WHEN DRAINAGE AREA HAS BEEN PROPERLY STABILIZED.
- DRAINAGE AREA FOR THIS PRACTICE IS LIMITED TO 15 ACRES OR LESS.

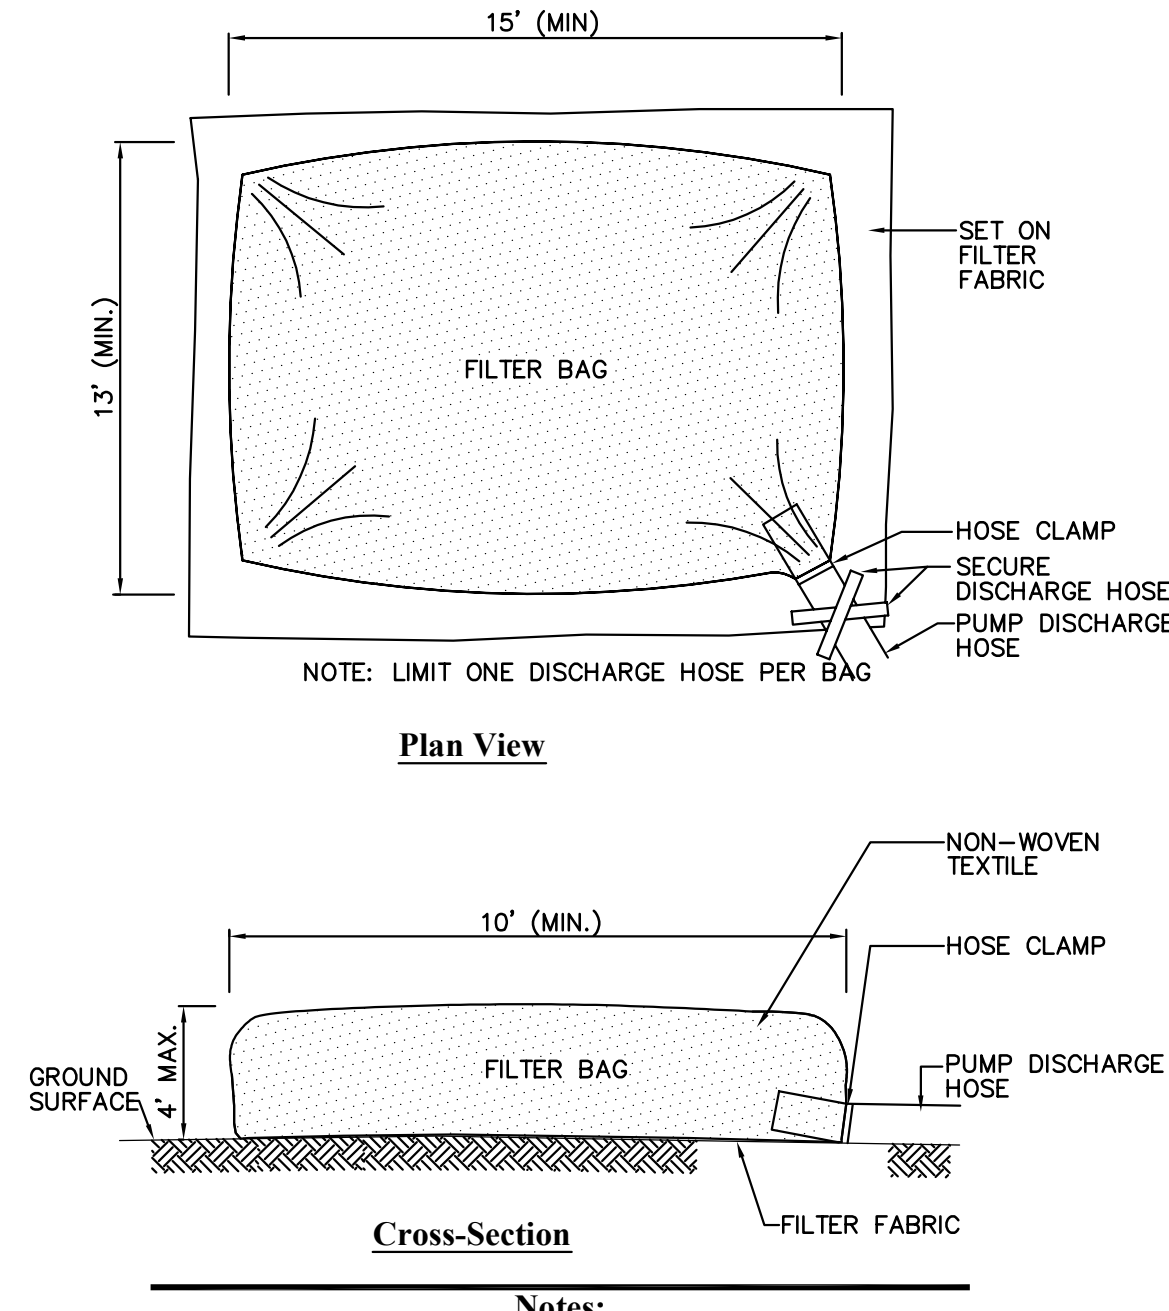

- Notes:
- BAG TO BE USED IN ACCORDANCE WITH MANUFACTURERS RECOMMENDATIONS.
 - MUST BE PLACED MIN. OF 50' FROM WETLAND OR STREAM ON STONE PAD. INSTALL DOWNGRADIENT OF BMPs INCLUDING SILT FENCE OR COMPOST LOGS AS NECESSARY.
 - INSPECT AND MAINTAIN BAG AS NECESSARY. EXPOSE OF ACCUMULATED SEDIMENT IN AN UPLAND AREA > 50' FROM WETLAND OR STREAM. STABILIZE, SEED, AND MULCH IMMEDIATELY.

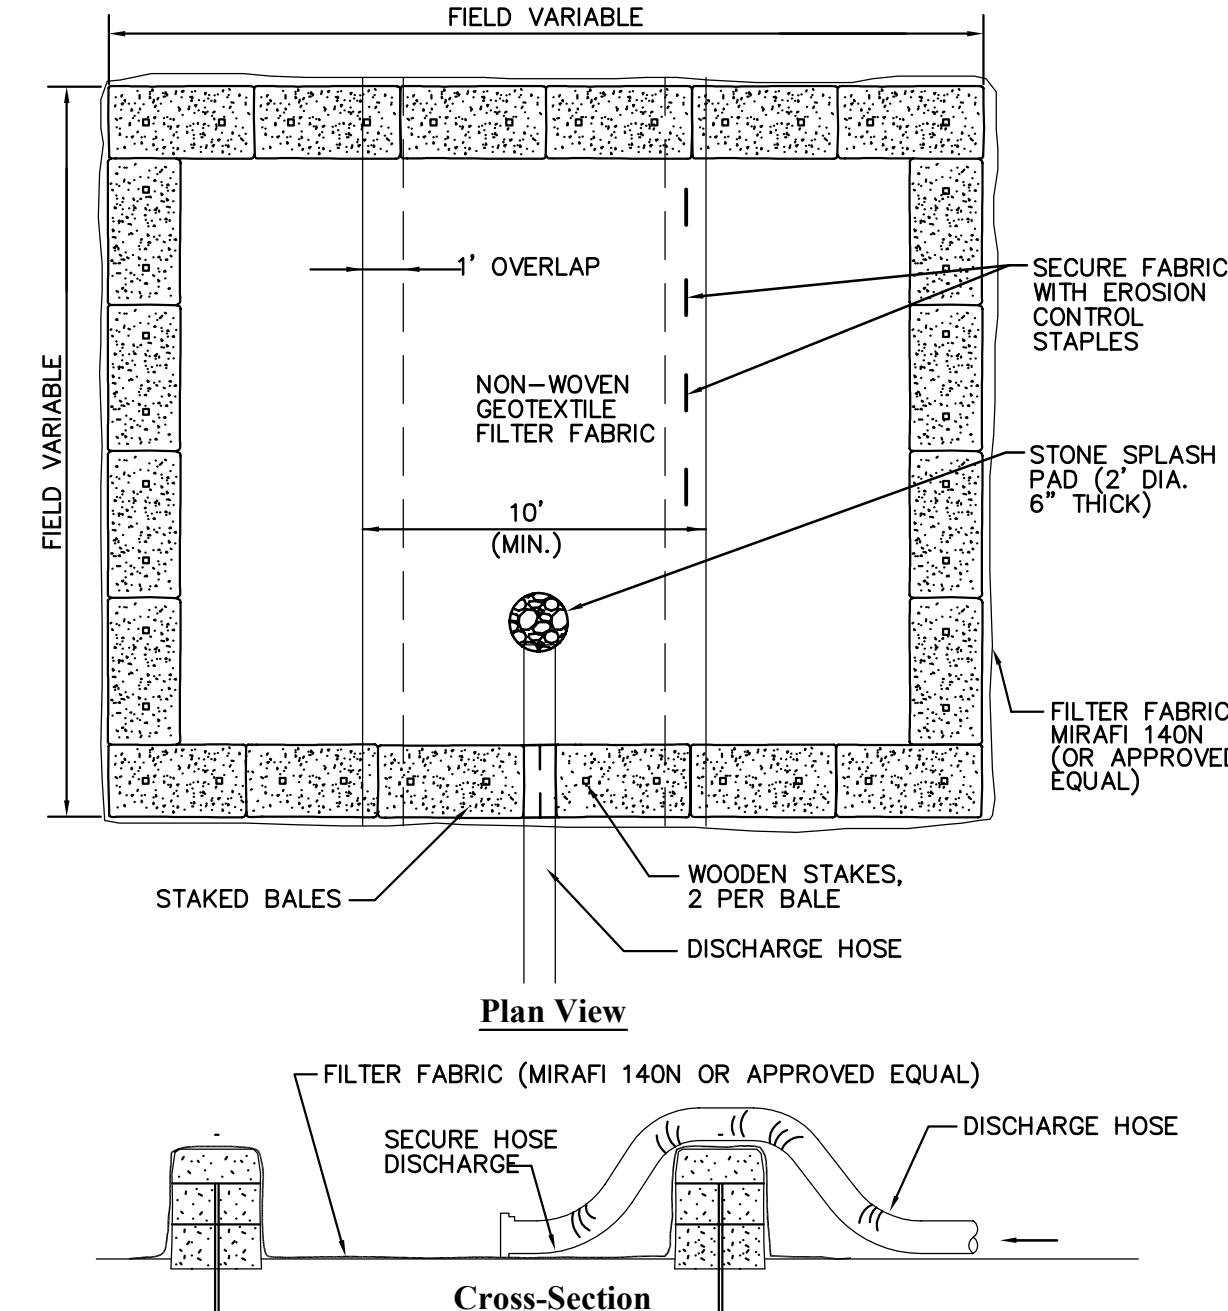

- Notes:
- NUMBERS OF BALES MAY VARY DEPENDING ON SITE CONDITIONS.
 - BASIN TO BE SIZED TO PREVENT DISCHARGE WATER FROM OVERTOPPING BASIN.
 - MUST BE PLACED MIN OF 50' FROM WETLAND OR STREAM, PREFERABLY IN A VEGETATED AREA.

4 Riprap Outlet Sediment Trap

N.T.S. Source: VHB / VT S+S EPSC 12/12 LD...


5 Dewatering Filter Bag

N.T.S. Source: VHB 12/12 LD...

6 Dewatering Straw Bale Basin


N.T.S. Source: VHB 12/12 LD...

DWG. NO.	REFERENCE DWG.	REV	DSN	CK	DESCRIPTION	INITIALS	DATE	INITIALS	DATE	YEAR: 2016	W.O.	SCALE: NOTED	DWG. ANGP-T-G-016	REV. 0

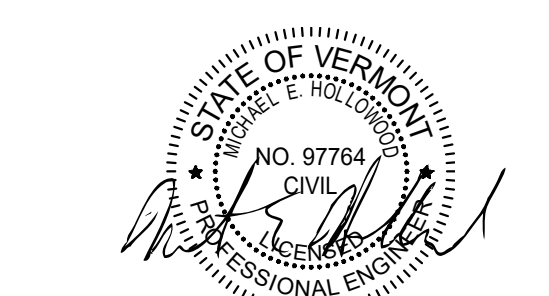


Vermont Gas
PROPOSED 12" PIPELINE
ADDISON NATURAL GAS PROJECT
CONSTRUCTION DETAILS
LOC. CHITTENDEN & ADDISON COUNTIES

38 Eastwood Drive, Suite 105
South Burlington, VT 05403
Main: (802) 795-0372 • www.chocompanies.com

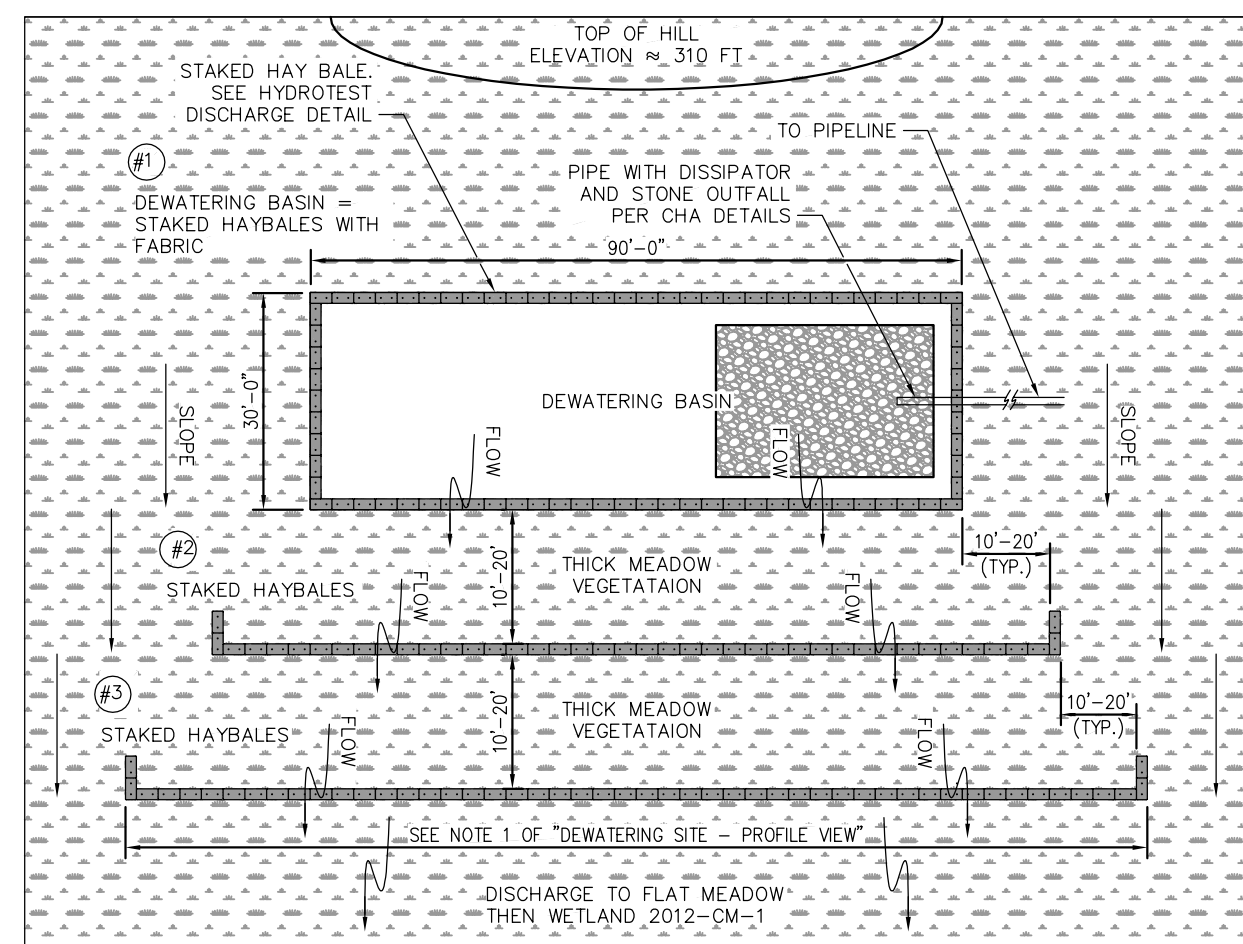


1 Dewatering Site - Plan View 09/13
N.T.S. Source: VHB

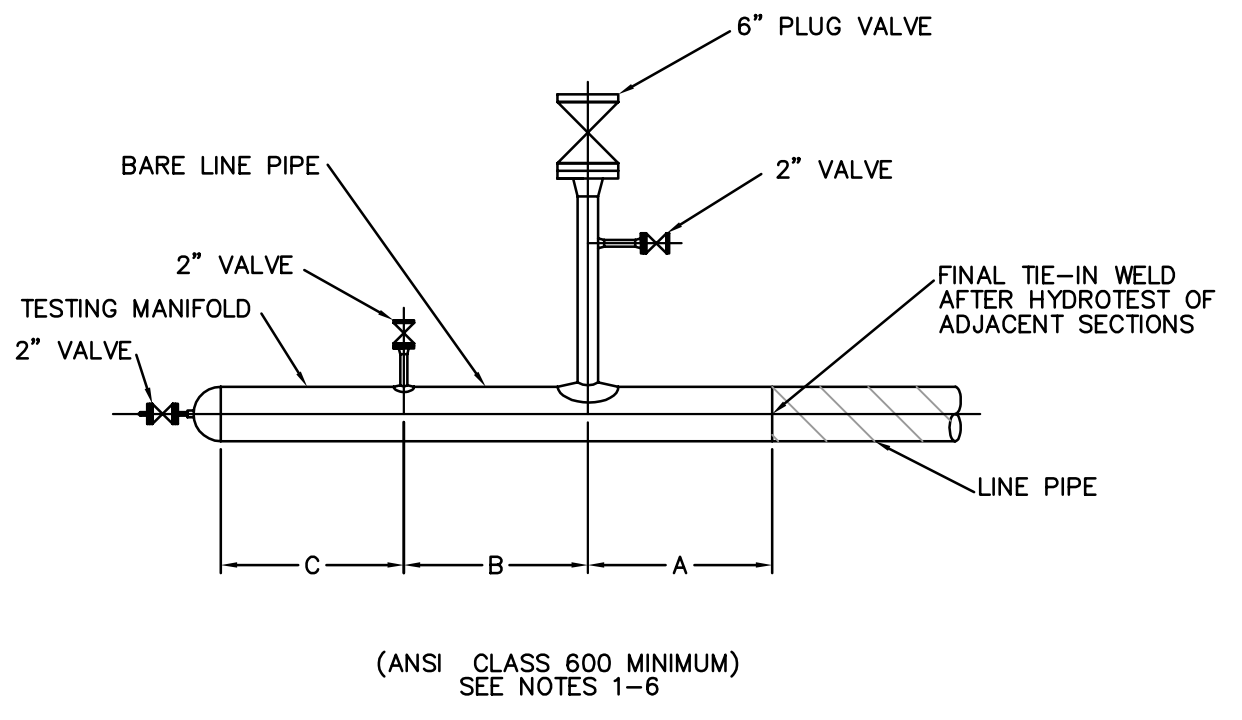

- (ANSI CLASS 600 MINIMUM)
SEE NOTES 1-6
- NOTES:**
- DIMENSIONS A, B & C ARE DEPENDENT ON PIPE DIAMETER & PIG LENGTH AND ARE TO BE DETERMINED BY CONTRACTOR.
 - FOR MANIFOLD TEST LOCATIONS & DISCHARGE LOCATIONS REFER TO EM&CP DRAWINGS.
 - TEST WATER SHALL BE TRANSFERRED BY PUMPING FROM ONE TEST SECTION TO THE NEXT ADJACENT TEST SECTION THROUGH THE 6" PIPE BRANCH AND MAKE-UP PIPING BETWEEN TEST SECTIONS. USE OF "HARD PIPING" & UNIONS IS RECOMMENDED.
 - FINAL TIE-IN WELD(S) BETWEEN TEST SECTIONS TO BE 100% RADIOGRAPHED.
 - TAP AND BRANCH SIZES AND VALVES FOR MANIFOLD ARE CONCEPTUAL AND SHALL BE DESIGNED BY CONTRACTOR TO BE COMPATIBLE WITH TEST EQUIPMENT AND PIPING.

2 Typical Hydrastatic Test Manifold 12/12
N.T.S. Source: CHA

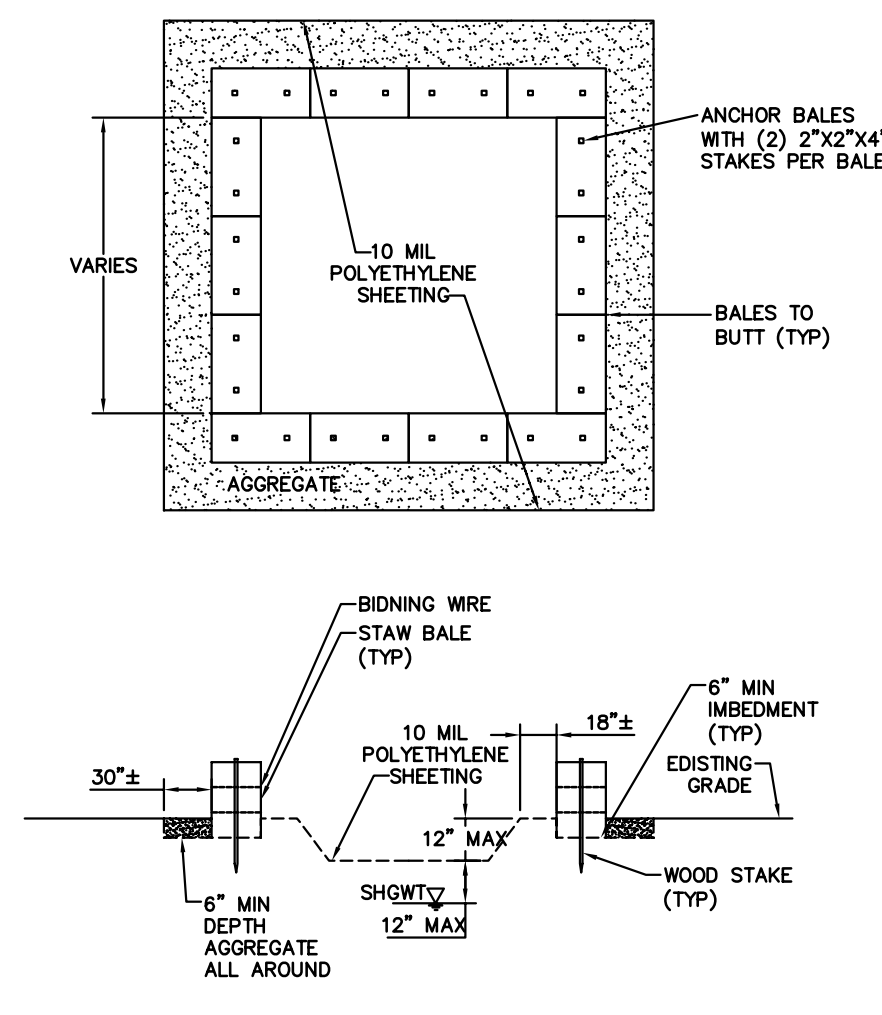


- Notes:**
- CONTAINMENT MUST BE STRUCTURALLY SOUND AND LEAK FREE AND CONTAIN ALL LIQUID WASTES.
 - CONTAINMENT DEVICES MUST BE SUFFICIENT QUANTITY OR VOLUME TO COMPLETELY CONTAIN THE LIQUID WASTES GENERATED.
 - WASHOUT MUST BE CLEANED OR NEW FACILITIES CONSTRUCTED AND READY TO USE ONCE WASHOUT IS 75% FULL.
 - WASHOUT AREA(S) SHALL BE INSTALLED IN A LOCATION EASILY ACCESSIBLE BY CONCRETE TRUCKS.
 - ONE OR MORE AREAS MAY BE INSTALLED ON THE CONSTRUCTION SITE AND MAY BE RELOCATED AS CONSTRUCTION PROGRESSES.
 - AT LEAST WEEKLY REMOVE ACCUMULATION OF SAND AND AGGREGATE AND DISPOSE OF PROPERLY.
 - PLACE 50' FROM RIVER OR STREAM.

3 Concrete Washout Area 12/12
N.T.S. Source: VHB


MILEPOST	STREAM NAME	CHANNEL WIDTH (A)	FEH WIDTH (B)	HDD LENGTH (C)	CHANNEL ELEV. (D)	ELEV. BELOW CHANNEL (E)	ENTRY ELEV. (F)	EXIT ELEV. (G)
0.99	INDIAN BROOK	4	100	2,339	208 ¹	< 198	< 208	< 208
1.52	INDIAN BROOK	15	125	1,530	188 ²	< 178	< 188	< 188
6.75	WNOOSKI RIVER (SECTION 10 WATERS)	320	N/A (1,195)	900	263 ³	< 238	< 275	< 275
19.47	LAPLATTE RIVER	30	360	640	317 ²	< 307	< 317	< 317
22.86	LEWIS CREEK	80	435	2,500	310 ¹	< 300	< 310	< 310
32.30	LITTLE OTTER CREEK	35	240	1,680	267 ¹	< 260	< 267	< 267
35.85	UNNAMED TRIB. TO LITTLE OTTER CREEK	4	640	1,010	303 ²	< 293	< 303	< 303
39.30	NEW HAVEN RIVER	120	785	530	245 ²	< 235	< 245	< 245
DISTRIBUTION MAIN 30+00	UNNAMED TRIB TO LITTLE OTTER CREEK	8	N/A (108)	300	261 ¹	< 254	< 261	< 261

1. CHANNEL ELEVATION BASED ON CONTOURS SHOWN ON EPSC PLAN PROVIDED BY CHA, INC. DATED 02/28/2013 AND NOT ASSESSED IN THE FIELD BY VHB.
2. CHANNEL ELEVATION BASED ON CONTOURS SHOWN ON EPSC PLAN PROVIDED BY CHA, INC. DATED 02/28/2013 AND MOOFED BASED ON FIELD ASSESSMENT BY VHB.
3. CHANNEL ELEVATION BASED ON BATHYMETRIC SURVEY PROVIDED BY COLE & COLANTONIO DATED 12/12/2012 AND NOT ASSESSED IN THE FIELD BY VHB.

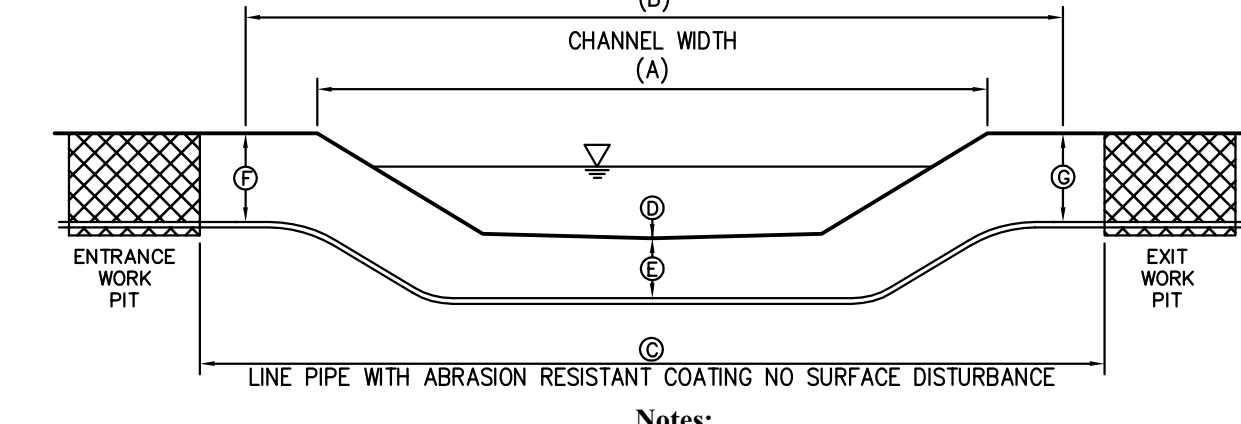

- Notes:**
- THIS CONFIGURATION IS FOR HORIZONTAL DIRECTIONAL DRILL OF STREAM CROSSINGS AS SHOWN ON PROJECT PLANS. SEE ALIGNMENT SHEETS FOR LOCATIONS OF THIS CONFIGURATION.
 - TOP OF PIPELINE MUST BE AT LEAST AS DEEP AS THE CHANNEL BOTTOM (DIMENSION D) THROUGHOUT THE FLUVIAL EROSION HAZARD (FEH) CORRIDOR.
 - MINIMUM SEPARATION BETWEEN THE TOP OF PIPELINE AND THE CHANNEL BOTTOM (DIMENSION E) MUST BE AT LEAST 7 FEET.
 - ELEVATIONS PROVIDED ARE BASED ON APPROXIMATE NAVD 88 DATUM AND MUST BE FIELD VERIFIED PRIOR TO INSTALLATION OF PIPELINE.
 - FEH CORRIDOR IS LISTED AS NOT APPLICABLE (N/A) WHERE THE STREAM CROSSES OR IS ADJACENT TO AN EXISTING ROADWAY OR OTHER INFRASTRUCTURE THAT RESULTS IN RIVER MANAGEMENT CONSTRAINTS AT THAT LOCATION. FEH CORRIDOR WIDTHS AT THESE LOCATIONS ARE SHOWN FOR INFORMATION PURPOSES ONLY.

4 Horizontal Directional Drill (HDD) Stream Crossing - Typical Section 4/13
N.T.S. SOURCE

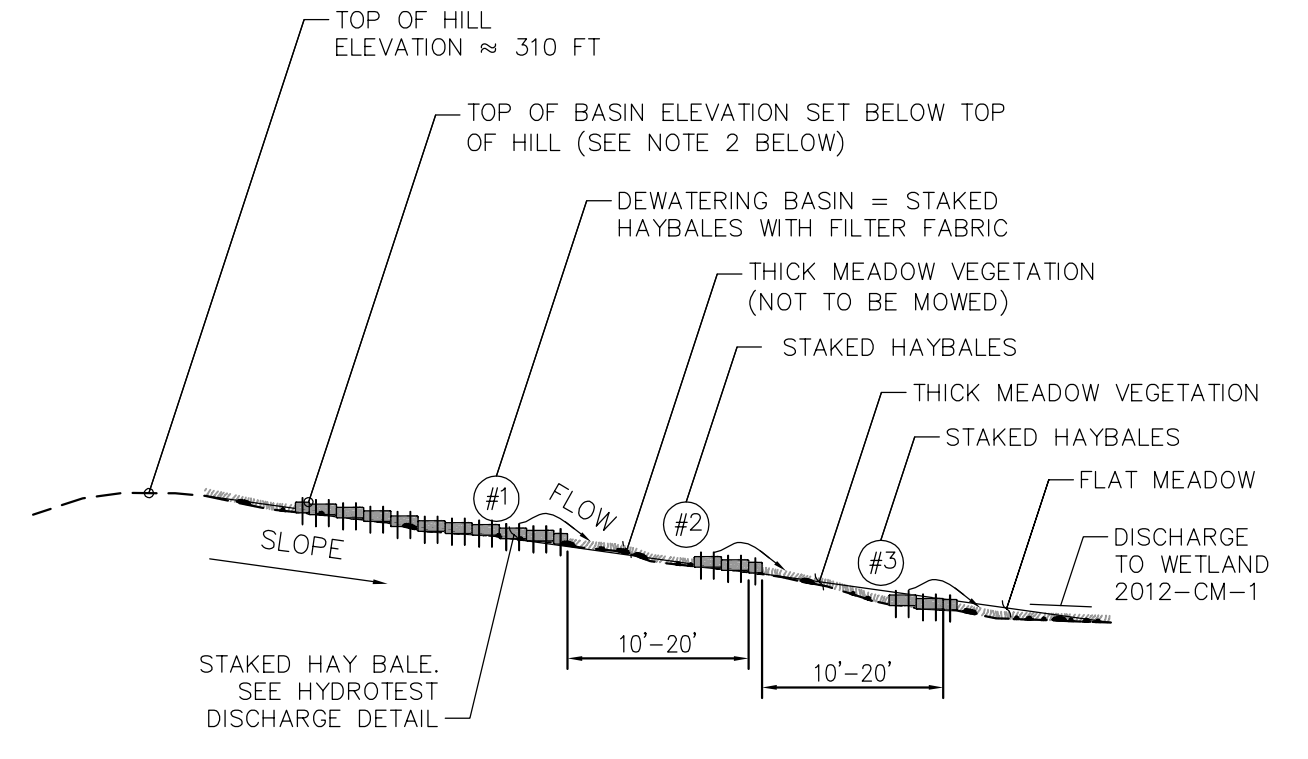

- NOTES:**
- THE DEWATERING SITE SHALL CONSIST OF THREE ROWS OF STAKED HAYBALES. THE TOP ROW SHALL BE ENCLOSED TO ACT AS A BASIN WITH FILTER FABRIC AND STONE OUTFALL AT THE DISCHARGE OUTLET. EACH DOWNSLOPE ROW OF HAYBALES SHALL BE CONSECUTIVELY LONGER THAN THE ROW UPSLOPE OF IT AS PER THE PLAN VIEW DETAIL. THE BOTTOM ROW IS TO EXTEND ACROSS THE ENTIRE WIDTH OF THE DENSELY VEGETATED MEADOW.
 - THE HIGHEST ELEVATION OF THE TOP ROW OF HAY BALES SHALL BE LOWER THAN THE ELEVATION AT THE TOP OF THE HILL TO ENSURE DISCHARGE DOES NOT FLOW OVER THE HILL.
 - DURING TESTING, THE CONTRACTOR SHALL HAVE ADDITIONAL STONE, HAYBALES, AND STAKES ON SITE FOR USE IF ADDITIONAL EPSC MEASURES ARE NEEDED.
 - SEE HYDROTEST DISCHARGE DETAIL FOR DEWATERING BASIN INSTALLATION SPECIFICATIONS.
 - SEE HAY BALE BARRIER DETAIL FOR STAKED HAYBALE INSTALLATION SPECIFICATIONS.
 - MEADOW IS NOT TO BE MOWED PRIOR TO USE FOR FILTERING FLOW.

5 Dewatering Site - Profile View 09/13
N.T.S. Source: VHB

PRODUCT DESCRIPTION	MATERIAL COMPOSITION	LONGEVITY (MONTHS)	SLOPE APPLICATIONS*		CHANNEL APPLICATIONS*	MINIMUM TENSILE STRENGTH ¹ kN/m (lbs/ft)
			MAXIMUM GRADIENT (H:V)	C FACTOR ^{2,3}		
MULCH CONTROL NETS	MESH OR WOVEN BIODEGRADABLE NATURAL FIBER NETTING.	3	5:1	≤ 0.10	12 (0.25)	0.073 (5)
		12	5:1	≤ 0.10	12 (0.25)	0.073 (5)
		24	5:1	≤ 0.10	12 (0.25)	0.36 (25)
NETLESS ROLLED EROSION CONTROL BLANKETS	NATURAL FIBERS MECHANICALLY INTERLOCKED TOGETHER TO FORM A RECP.	3	4:1	≤ 0.10	24 (0.5)	0.073 (5)
		12	4:1	≤ 0.10	24 (0.5)	0.073 (5)
SINGLE-NET EROSION CONTROL BLANKETS	PROCESSED BIODEGRADABLE NATURAL FIBERS MECHANICALLY BOUND TOGETHER BY A SINGLE NATURAL FIBER NETTING OF PROCESSED NATURAL YARNS OR TWINES WOVEN INTO A CONTINUOUS MATRIX.	3	3:1	≤ 0.15	72 (1.5)	0.73 (50)
		12	3:1	≤ 0.15	72 (1.5)	0.73 (50)
DOUBLE-NET EROSION CONTROL BLANKETS	PROCESSED BIODEGRADABLE NATURAL FIBERS MECHANICALLY BOUND TOGETHER BETWEEN TWO NATURAL FIBER NETTING OF PROCESSED NATURAL YARNS OR TWINES WOVEN INTO A CONTINUOUS MATRIX.	3	2:1	≤ 0.20	84 (1.75)	1.09 (75)
		12	2:1	≤ 0.20	84 (1.75)	1.09 (75)
		24	1.5:1	≤ 0.25	96 (2.00)	1.45 (100)
		36	1:1	≤ 0.25	108 (2.25)	1.82 (125)

- * "C" FACTOR AND SHEAR STRESS FOR MULCH CONTROL NETTINGS MUST BE OBTAINED WITH NETTING USED IN CONJUNCTION WITH PRE-APPLIED MATERIAL.
1. MINIMUM AVERAGE ROLL VALUES, MACHINE DIRECTION USING EROSION CONTROL TECHNOLOGY COUNCIL (ECTC) MOD. ASTM D 5035.
2. "C" FACTOR CALCULATED AS RATIO OF SOIL LOSS FROM RECP PROTECTED SLOPE (TESTED AT SPECIFIED OR GREATER GRADIENT, H:V) TO RATIO OF SOIL LOSS FROM UNPROTECTED (CONTROL) PLOT IN LARGE-SCALE TESTING. THESE PERFORMANCE TEST VALUES SHOULD BE SUPPORTED BY PERIODIC BENCH SCALE TESTING UNDER SIMILAR TEST CONDITIONS AND FAILURE CRITERIA USING ECTC TEST METHOD #2.
3. REQUIRED MINIMUM SHEAR STRESS RECP (UNVEGETATED) CAN SUSTAIN WITHOUT PHYSICAL DAMAGE OR EXCESS EROSION (> 12.7mm (0.5 IN) SOIL LOSS) DURING A 30-MINUTE FLOW EVENT IN LARGE-SCALE TESTING. THESE PERFORMANCE TEST VALUES SHOULD BE SUPPORTED BY PERIODIC BENCH SCALE TESTING UNDER SIMILAR TEST CONDITIONS AND FAILURE CRITERIA USING ECTC TEST METHOD #3.
4. THE PERMISSIBLE SHEAR STRESS LEVELS ESTABLISHED FOR EACH PERFORMANCE CATEGORY ARE BASED ON HISTORICAL EXPERIENCE WITH PRODUCTS CHARACTERIZED BY MANNINGS ROUGHNESS COEFFICIENTS IN THE RANGE OF 0.01 - 0.05.
5. ACCEPTABLE LARGE SCALE TEST METHODS MAY INCLUDE ASTM D 6459, ECTC TEST METHOD #2 OR OTHER INDEPENDENT TESTING DEEMED ACCEPTABLE BY THE DEC.
6. RECOMMENDED ACCEPTABLE LARGE-SCALE TESTING PROTOCOL MAY INCLUDE ASTM D 6440, ECTC TEST METHOD #3 OR OTHER INDEPENDENT TESTING DEEMED ACCEPTABLE BY THE DEC.

6 Specifications for Temporary RECP 04/13
N.T.S. Source: VT S+S EPSC


TYPE	PRODUCT DESCRIPTION	MATERIAL COMPOSITION	SLOPE APPLICATIONS		CHANNEL APPLICATIONS	
			MAXIMUM GRADIENT	MAXIMUM SHEAR STRESS ^{4,5} Pa(lbs/ft ²)	MAXIMUM GRADIENT	MINIMUM TENSILE STRENGTH ^{3,3} kN/m (lbs/ft)
A	TURF REINFORCED MAT	NON-DEGRADABLE SYNTHETIC FIBERS, FILAMENTS, NETS, WIRE MESH AND/OR OTHER ELEMENTS, PROCESSED INTO A PERMANENT THREE-DIMENSIONAL MATRIX OF SUFFICIENT THICKNESS. TRM'S, WHICH MAY BE SUPPLEMENTED WITH DEGRADABLE COMPONENTS ARE DESIGNED TO IMPART IMMEDIATE EROSION PROTECTION, ENHANCED VEGETATION ESTABLISHMENT AND PROVIDE LONG-TERM FUNCTIONALITY BY PERMANENTLY REINFORCING VEGETATION DURING AND AFTER MATURATION. NOTE: TRM'S ARE TYPICALLY USED IN HYDRAULIC APPLICATIONS, SUCH AS HIGH FLOW DITCHES AND CHANNELS, STEEP SLOPES, STREAM BANKS, AND SHORELINES, WHERE EROSION FORCES MAY EXCEED THE LIMITS OF NATURAL UNREINFORCED VEGETATION OR IN AREAS WHERE LIMITED VEGETATION ESTABLISHMENT IS ANTICIPATED.	0.5:1	288 (6.0)	1.82 (125)	
B	TURF REINFORCED MAT		0.5:1	384 (8.0)	2.19 (150)	
C	TURF REINFORCED MAT		0.5:1	480 (10.0)	2.55 (175)	

- PERMANENT¹ - ALL CATEGORIES OF TURF REINFORCEMENT MAT (TRM) MUST HAVE A MINIMUM THICKNESS OF 6.35mm (0.25 INCHES) PER ASTM D 6525 AND U.V. STABILITY OF 80% PER ASTM D 4355 (500 HOURS EXPOSURE)
- FOR TRMS CONTAINING DEGRADABLE COMPONENTS ALL PROPERTY VALUES MUST BE OBTAINED ON THE NON-DEGRADABLE PORTION OF THE MATTING ALONE.
 - MINIMUM AVERAGE ROLL VALUES, MACHINE DIRECTION ONLY FOR TENSILE STRENGTH DETERMINATION USING ASTM D 6818 (SPURSE'S MOD. ASTM D 5035 FOR RECP'S).
 - FIELD CONDITIONS WITH HIGH LOADING AND/OR HIGH SURVIVABILITY REQUIREMENTS MAY WARRANT THE USE OF A TRM WITH A TENSILE STRENGTH OF 44 kN/m(3,000 lb/ft) OR GREATER.
 - REQUIRED MINIMUM SHEAR STRESS TRM (FULLY VEGETATED) CAN SUSTAIN WITHOUT PHYSICAL DAMAGE OR EXCESS EROSION (>12.7mm (0.5 IN) SOIL LOSS) DURING A 30-MINUTE FLOW EVENT IN LARGE SCALE TESTING. THESE PERFORMANCE TEST VALUES SHOULD BE SUPPORTED BY PERIODIC BENCH SCALE TESTING UNDER SIMILAR TEST CONDITIONS AND FAILURE CRITERIA USING ECTC TEST METHOD #3.
 - ACCEPTABLE LARGE-SCALE TESTING PROTOCOL MAY INCLUDE ASTM D 6460 ECTC TEST METHOD #3 OR OTHER INDEPENDENT TESTING DEEMED ACCEPTABLE BY THE DEC.

7 Specifications for Permanent RECP 04/13
N.T.S. Source: VT S+S EPSC

MILEPOST	STREAM NAME	CHANNEL WIDTH (A)	FEH WIDTH (B)	CHANNEL ELEV. (C)	ELEV. BELOW CHANNEL (D)	ENTRY ELEV. (E)	EXIT ELEV. (F)
3.62	INDIAN BROOK	7	N/A (185)	430 ²	< 420	< 430	< 430
6.60	ALDER BROOK	35	N/A (150)	281 ¹	< 274	< 281	< 281
10.32	ALLEN BROOK	35	360	376 ²	< 366	< 376	< 376
13.79	SUCKER BROOK	15	120	371 ²	< 364	< 371	< 371
18.93	UNNAMED TRIBUTARY TO LAPLATTE RIVER	4	N/A (310)	328 ¹	< 321	< 328	< 328
20.45	UNNAMED TRIBUTARY TO LAPLATTE RIVER	4	185	364 ²	< 357	< 364	< 364
24.40	UNNAMED TRIBUTARY TO LEWIS CREEK	6	106	437 ²	< 430	< 437	< 437
29.11	UNNAMED TRIBUTARY TO LITTLE OTTER CREEK	8	N/A (400)	364 ²	< 357	< 364	< 364
30.94	UNNAMED TRIBUTARY TO LITTLE OTTER CREEK	4	200	267 ²	< 260	< 267	< 267

1. CHANNEL ELEVATION BASED ON CONTOURS SHOWN ON EPSC PLAN PROVIDED BY CHA, INC. DATED 02/28/2013 AND MOOFED BASED ON FIELD ASSESSMENT BY VHB.
2. CHANNEL ELEVATION BASED ON CONTOURS SHOWN ON EPSC PLAN PROVIDED BY CHA, INC. DATED 02/28/2013 AND NOT ASSESSED IN THE FIELD BY VHB.

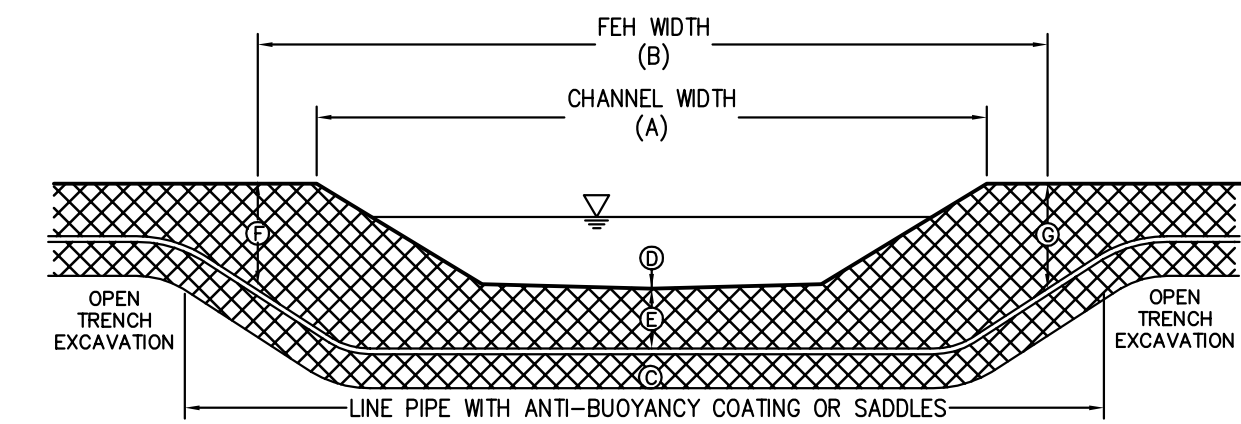

- Notes:**
- THIS CONFIGURATION IS FOR OPEN TRENCH EXCAVATION OF STREAM CROSSINGS AS SHOWN ON PROJECT PLANS. SEE ALIGNMENT SHEETS FOR LOCATIONS OF THIS CONFIGURATION.
 - THE INFORMATION PROVIDED IN THIS TABLE WAS UTILIZED FOR PERMITTING. ACCURATE PIPELINE PROFILE DRAWINGS HAVE BEEN CREATED THAT SHOW THE INTENT OF THIS TABLE USING FIELD VERIFIED SURVEY. CONTRACTOR SHALL REFERENCE SHEETS ANGP-T-G-028A, 039A, 042A, 051A, 061AA, AND 065A FOR CONSTRUCTION.
 - TOP OF PIPELINE MUST BE AT LEAST AS DEEP AS THE CHANNEL BOTTOM (DIMENSION D) THROUGHOUT THE FLUVIAL EROSION HAZARD (FEH) CORRIDOR.
 - MINIMUM SEPARATION BETWEEN THE TOP OF PIPELINE AND THE CHANNEL BOTTOM (DIMENSION E) MUST BE AT LEAST 7 FEET.
 - ELEVATIONS PROVIDED ARE BASED ON APPROXIMATE NAVD 88 DATUM AND MUST BE FIELD VERIFIED PRIOR TO INSTALLATION OF PIPELINE.
 - FEH CORRIDOR IS LISTED AS NOT APPLICABLE (N/A) WHERE THE STREAM CROSSES OR IS ADJACENT TO AN EXISTING ROADWAY OR OTHER INFRASTRUCTURE THAT RESULTS IN RIVER MANAGEMENT CONSTRAINTS AT THAT LOCATION. FEH CORRIDOR WIDTHS AT THESE LOCATIONS ARE SHOWN FOR INFORMATION PURPOSES ONLY.
 - RESTORE DISTURBED CHANNEL, STREAM BANKS, AND APPROACHES FOLLOWING PIPELINE INSTALLATION PER EPSC PLAN.

8 Open Trench Stream Crossing - Typical Section 04/13
N.T.S. Source: VHB


DWG. NO.	REFERENCE DWG.	REV	DSN	CK	DESCRIPTION	INITIALS	DATE	INITIALS	DATE
		2	BCK	TDB	VHB EDITS (12/10/15)				
		1	BCK	TDB	VHB EDITS (6/09/15)				

ENVIRONMENTAL		DRAFTING DESIGNER		DRAFTING SUPERVISOR		DESIGN ENGINEER		DESIGN MANAGER	
JLS	06/28/13	GIL	06/28/13	BZD	06/28/13	MDF	06/28/13	SAB	06/28/13


CONSTRUCTION		VERMONT GAS	
JLS	05/2016	PROPOSED 12" PIPELINE	
GJM	05/2016	ADDISON NATURAL GAS PROJECT	
BCK	05/2016	CONSTRUCTION DETAILS	
GEW	05/2016	LOC. CHITTENDEN & ADDISON COUNTIES	
JEO	05/2016	YEAR: 2016	

YEAR: 2016	W.O.	SCALE: NOTED	DWG. ANGP-T-G-017	REV. 2
------------	------	--------------	-------------------	--------

DEBRIS FROM SLOPE ABOVE IS CAUGHT BY STEPS

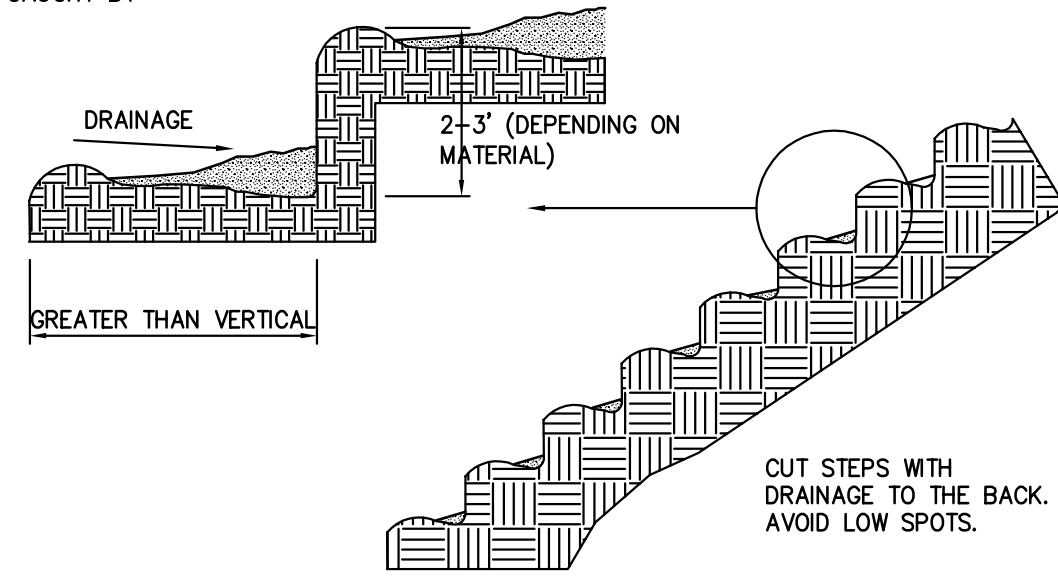

STAIR STEPPING CUT SLOPES

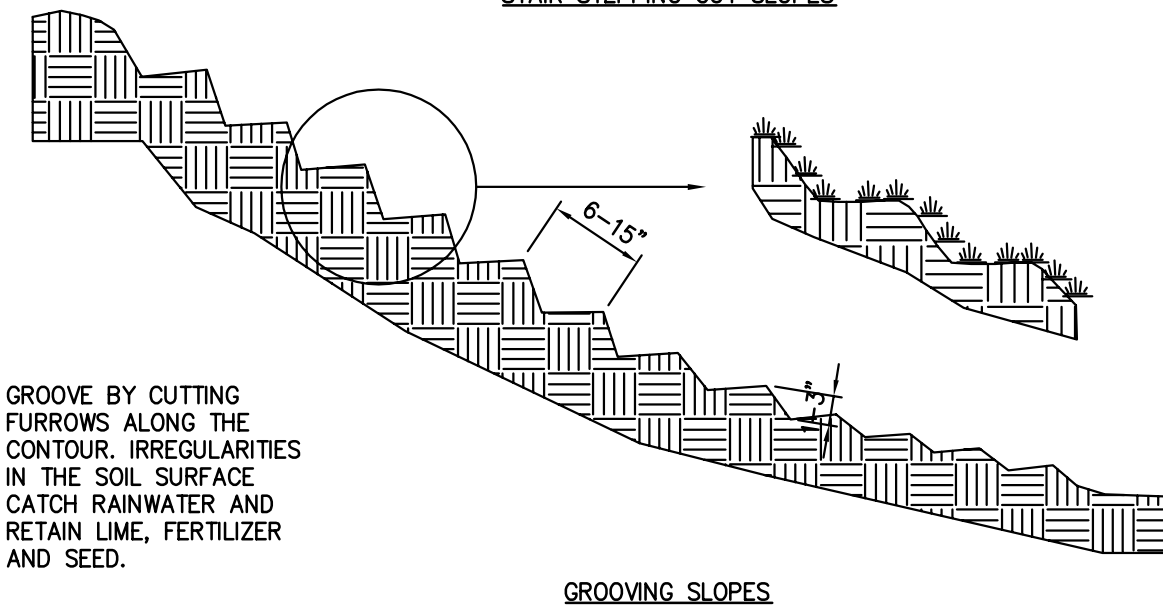

GROOVING SLOPES

MULCH MATERIAL AND APPLICATION				
MULCH MATERIAL	QUALITY STANDARDS	PER 1,000 SQ-FT	PER ACRE	DEPTH OF APPLICATION
WOOD CHIPS OR SHAVINGS	AIR DRIED, FREE OF OBJECTIONABLE MATERIAL	500 - 900 LBS	10 - 20 TONS	2" - 7"
WOOD FIBER CELLULOSE (PARTIALLY DIGESTED WOOD FIBERS)	MADE FROM NATURAL WOOD USUALLY WITH GREEN DYE AND DISPERSING AGENT	50 LBS	2,000 LBS	N/A
GRAVEL CRUSHED STONE OR SLAG	WASHED; SIZE 2B OR 3A - 1 1/2"	9 CY	405 CY	3"
HAY OR STRAW	AIR-DRIED; FREE OF UNDESIRABLE SEEDS AND COARSE MATERIALS	90 - 100 LBS, 2-3 BALES	2 TONS (100-120 BALES)	COVER ABOUT 90% SURFACE
COMPOST	UP TO 3" PIECES, MODERATELY TO HIGHLY STABLE	3 - 9 CY	3 - 9 CY	1-3"
Erosion Control Mix	WELL-GRADED MIXTURE OF PARTICLE SIZES, ORGANIC CONTENT BETWEEN 80-100% DRY WEIGHT. PARTICLE SIZE SHALL PASS 6" SCREEN (100%)	*Slopes 3(Hz.):1(Vert.) = 2 inch depth plus additional 1/2 inch depth per 20 ft. of slope up to 100 ft. **Slopes between 3(Hz.):1(Vert.) and 2(Hz.):1(Vert.) = 4 inch depth plus additional 1/2 inch per 20 ft. of slope up to 100 ft. ***Slopes steeper than 2(Hz.):1(Vert.) applicability to specific site and mulch depth to be reviewed and approved prior to use by OPSC or EPSC Specialist		

Notes:

1. APPLY TACKIFIER AS NEEDED TO MINIMIZE POTENTIAL FOR MULCH TO BLOW AWAY.
2. MULCH MUST NOT CONTAIN INVASIVE PLANT SPECIES. (SEEDS OR SEEDLINGS)
3. TACKIFIER MAY BE WATER, NETTING, OR SIMILAR.
4. OTHER THAN EROSION CONTROL MIX, MULCH IS NOT TO BE INSTALLED ON SLOPES > 3:1.

TEMPORARY SEEDING

1. AREA TO BE SEEDED MUST BE ROUGH GRADED AND SLOPES PHYSICALLY STABLE.
2. SEEDING METHOD TO RESULT IN GOOD SOIL TO SEED CONTACT.
3. AFTER SEEDING, MULCH THE AREA WITH HAY OR STRAW AT 2 TONS/AC (APPROX 90 LBS/1,000 SF OR 2 BALES/1,000 SF); SEE MULCH DETAIL AND SPECIFICATIONS.
4. MULCH ANCHORING MAY BE NEEDED WHERE WIND OR AREAS OF CONCENTRATED WATER ARE POSSIBLE.
5. WOOD FIBER HYDROMULCH OR OTHER SPRAYABLE PRODUCTS APPROVED FOR EROSION CONTROL MAY BE USED IF APPLIED ACCORDING TO MANUFACTURERS' SPECIFICATIONS.

PERMANENT SEEDING

1. SEE SEEDING SPECIFICATIONS FOR RECOMMENDED SEED MIXES. USE RIPARIAN AND WETLAND SEEDING MIX WITHIN 50 FEET OF STREAM CROSSINGS AND IN DISTURBED WETLAND AREAS. USE UPLAND NATURAL COMMUNITY MIX WITHIN AREAS IDENTIFIED AS SIGNIFICANT NATURAL COMMUNITIES. USE PERMANENT SEEDING MIX FOR ALL OTHER DISTURBED/UPLAND AREAS. SEE VERMONT STANDARDS AND SPECIFICATIONS FOR EROSION PREVENTION AND SEDIMENT CONTROL FOR ADDITIONAL SEED MIXTURES.
2. AREA TO BE SEEDED MUST BE ROUGH GRADED AND SLOPES PHYSICALLY STABLE; CHISELING OR DISKING MAY BE NEEDED IF SOIL IS COMPACTED.
3. SEEDING METHOD TO RESULT IN GOOD SOIL TO SEED CONTACT.
4. PERMANENT SEEDING TO OCCUR PRIOR TO SEPTEMBER 15TH UNLESS WEATHER PERMITS SEEDING BEYOND SEPTEMBER 15TH.
5. AFTER SEEDING, MULCH THE AREA WITH HAY OR STRAW AT 2 TONS/AC (APPROX 90 LBS/1,000 SF OR 2 BALES/1,000 SF); SEE MULCH DETAIL AND SPECIFICATIONS.
6. MULCH ANCHORING MAY BE NEEDED WHERE WIND OR AREAS OF CONCENTRATED WATER ARE POSSIBLE.
7. WOOD FIBER HYDROMULCH OR OTHER SPRAYABLE PRODUCTS APPROVED FOR EROSION CONTROL MAY BE USED IF APPLIED ACCORDING TO MANUFACTURERS' SPECIFICATIONS.
8. IRRIGATION MAY BE NEEDED TO FACILITATE GRASS GROWTH AND ESTABLISH ADEQUATE GRASS COVER.

TEMPORARY SEEDING MIX		
TYPE	SEASON	RATE (LBS/ACRE)
RYEGRASS (ANNUAL OR PERENNIAL)	APRIL 15 - SEPTEMBER 15	20
"AROSTOOK" WINTER RYE	SEPTEMBER 15 - APRIL 15	90

PERMANENT SEEDING MIX*		
TYPE	SEASON	RATE (LBS/ACRE)
BIRDSFOOT TREFLOID(1)**	APRIL 15 - SEPTEMBER 15	5
COMMON WHITE CLOVER (1)**	APRIL 15 - SEPTEMBER 15	8
TALL FESCUE (2)	APRIL 15 - SEPTEMBER 15	10
REDTOP (3)	APRIL 15 - SEPTEMBER 15	2
RYEGRASS (PERENNIAL) (3)	APRIL 15 - SEPTEMBER 15	5

*PERMANENT SEEDING MIX IS A COMBINATION OF BIRDSFOOT TREFLOID OR COMMON WHITE CLOVER PLUS TALL FESCUE PLUS REDTOP OR RYEGRASS (PERENNIAL). I.E. PERMANENT SEEDING MIX = (1) + (2) + (3). (SEE PAGE 4.27 OF THE VERMONT STANDARDS AND SPECIFICATIONS FOR EROSION PREVENTION AND SEDIMENT CONTROL.)
** ADD INOCULANT IMMEDIATELY PRIOR TO SEEDING

RIPARIAN AND WETLAND SEEDING MIX		
TYPE	SEASON	RATE (LBS/ACRE)
"WET MEADOW AND DETENTION BASIN" OR APPROVED EQUAL	APRIL 15 - SEPTEMBER 15	35

*SEED SPECIFIED IS FROM VERMONT WETLAND PLANT SUPPLY AND COMPOSED OF THE FOLLOWING SPECIES: PANICUM VIRGATUM, ELYMUS VIRGINICUS, FESTUCA RUBRA, CAREX VULPINOIDEA, CAREX SCOPARIA, SCIRPUS CIPERINUS, SCIRPUS ATROVIRENS, BIDENS CERNUA, EUPATORIUM PERFORIATUM, EUPATORIUM MACULATUM, JUNCUS EFFUSUS, ONOCLEA SENSIBILIS, VERBENA HASTATA, SYMPHYOTRICHUM NOVAE-ANGLIAE

UPLAND NATURAL COMMUNITY MIX		
TYPE	SEASON	RATE (LBS/ACRE)
"VERMONT CONSERVATION AND WILDLIFE" OR APPROVED EQUIVALENT	APRIL 15 - SEPTEMBER 15	25


*SEED SPECIFIED IS, IN PART, FROM VERMONT WETLAND PLANT SUPPLY AND COMPOSED OF THE FOLLOWING SPECIES: ELYMUS VIRGINICUS, FESTUCA RUBRA, SCHIZACHYRIUM SCOPARIUM, ANDROPOGON GERARDII, PANICUM CLANDESTINUM, SORGHASTRUM NUTANS, ASCLEPIA SYRIACA, VERBENA HASTATA, EUPATORIUM FISTULOSUM, EUTHAMIA GRAMINIFOLIA, SOLIDAGO JUNCEA, SYMPHYOTRICHUM NOVAE-ANGLIAE
NOTE: SEE MIX SHOULD EXCLUDE BOTH CHAMAECRISTA FASCICULATA AND HELIOPSIS HELIANTHOIDES, WHICH ARE BOTH COMMONLY INCLUDED IN THIS COMMERCIAL MIX.

1 Surface Roughening 12/12
N.T.S. Source: VHB LD_

2 Mulch Table 12/12
N.T.S. Source: VHB LD_

3 Seeding Notes 12/12
N.T.S. Source: VHB LD_



4 Seeding Specifications 06/13
N.T.S. Source: VHB LD_

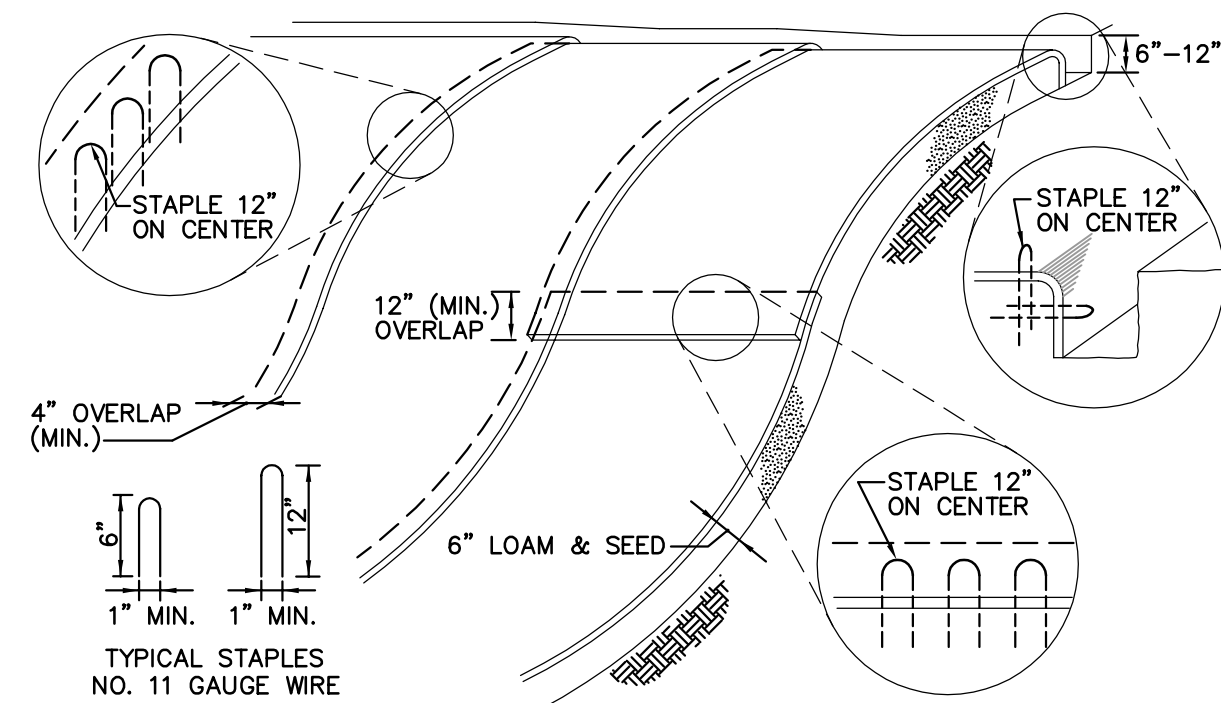

Notes:

1. APPLY TO SLOPES GREATER THAN 3H:1V OR WHERE NECESSARY TO AID IN ESTABLISHING VEGETATION.
2. APPLY TOP SOIL, FERTILIZER, LIME AND SEED PRIOR TO PLACING MATTING.
3. STAPLES ARE TO BE PLACED ALTERNATELY, IN COLUMNS APPROXIMATELY 2' APART AND IN ROWS APPROXIMATELY 3' APART. APPROXIMATELY 175 STAPLES ARE REQUIRED PER 4'x225' ROLL OF MATERIAL AND 125 STAPLES ARE REQUIRED PER 4'x150' ROLL OF MATERIAL.
4. DISTURBED AREAS SHALL BE SMOOTHLY GRADED. EROSION PREVENTION AND SEDIMENT CONTROL MATERIAL SHALL BE PLACED LOOSELY OVER GROUND SURFACE, DO NOT STRETCH AND ENSURE CLOSE CONTACT WITH THE GROUND SURFACE..
5. ALL TERMINAL ENDS AND TRANSVERSE LAPS SHALL BE STAPLED AT APPROXIMATELY 12" INTERVALS.
6. BEGIN AT THE TOP OF BLANKET INSTALLATION AREA BY ANCHORING BLANKET IN A 6" TO 12" DEEP TRENCH BACKFILL AND COMPACT TRENCH AFTER STAPLING.
7. ROLL THE BLANKET DOWN IN THE DIRECTION OF THE WATER FLOW.
8. THE EDGES OF BLANKETS MUST BE STAPLED WITH APPROX. 4" OVERLAP WHERE 2 OR MORE STRIP WIDTHS ARE REQUIRED.
9. WHEN BLANKETS MUST BE SPLICED, PLACE UPPER BLANKET END OVER LOWER END WITH 12" (MIN.) OVERLAP AND STAPLE BOTH TOGETHER.
10. METHOD OF INSTALLATION SHALL BE AS PER MANUFACTURER'S RECOMMENDATIONS. SEE SHEET ANGP-T-G-017 FPR RECP SPECIFICATIONS


5 Rolled Erosion Control Blanket (RECP) - Slope Installation 12/12
N.T.S. Source: VHB LD_680-vt

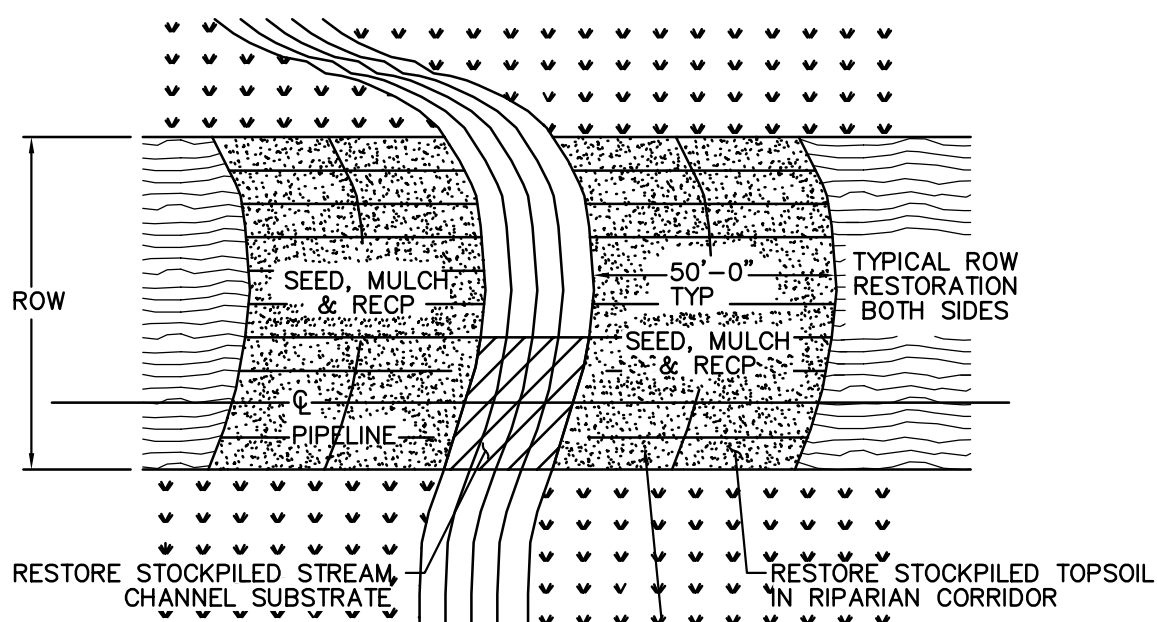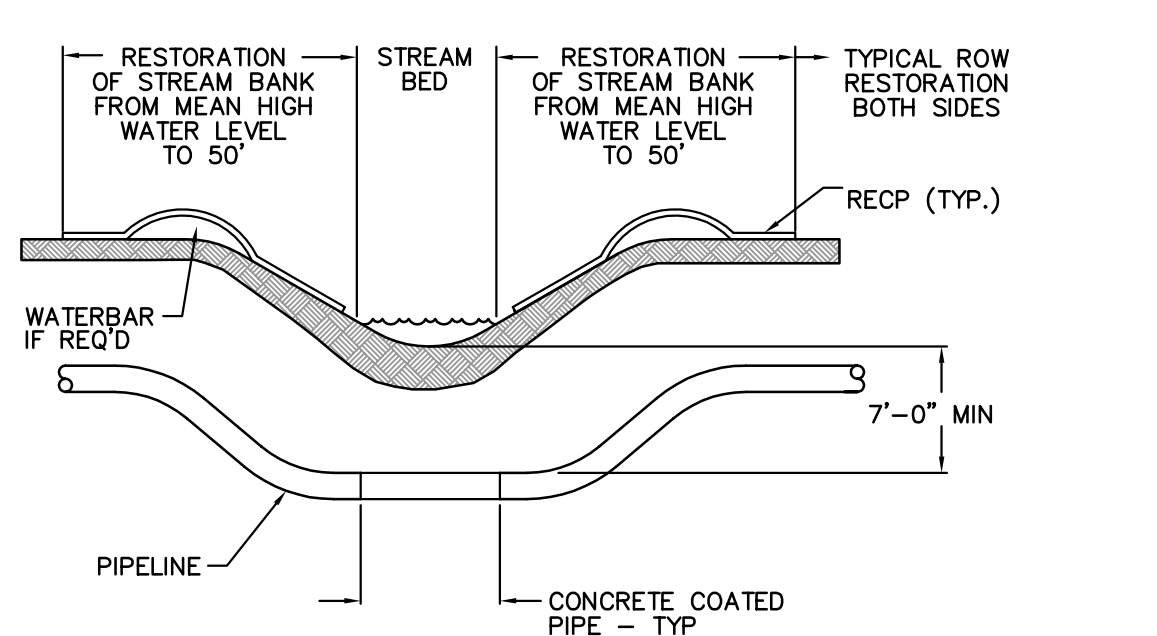

Notes:

1. SEE SHEET ANGP-T-G-017 FOR RECP SPECIFICATIONS


6 Streambank Restoration with RECP 12/12
N.T.S. Source: CHA LD_

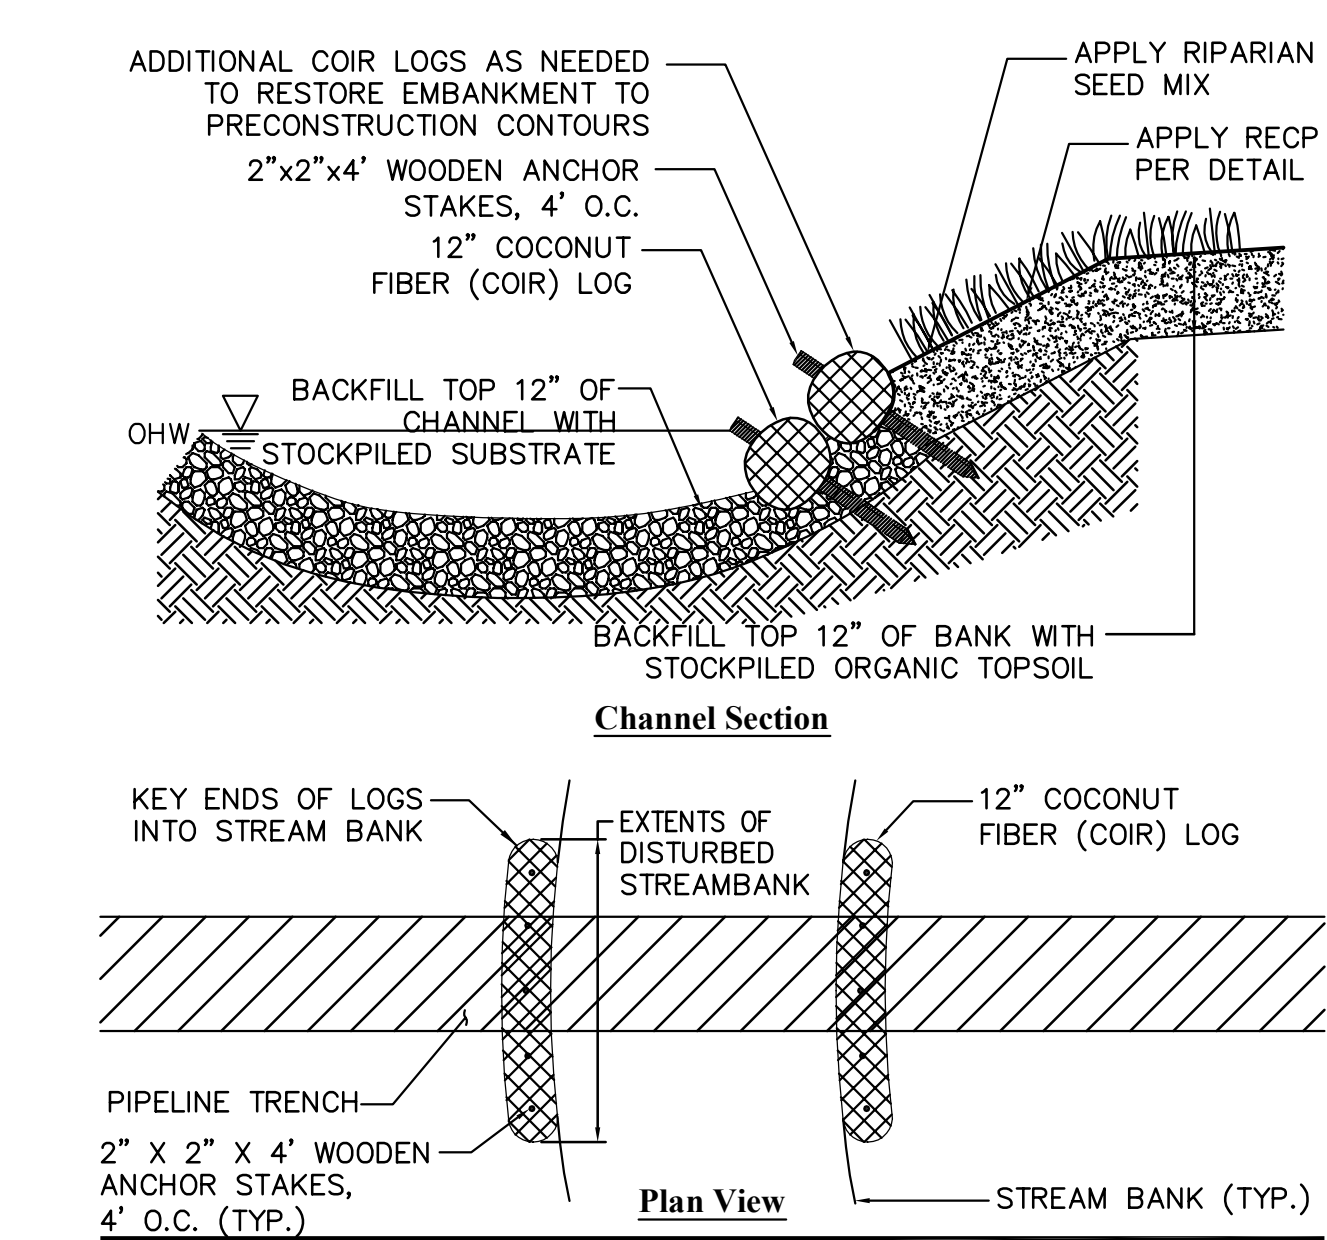

Notes:

1. APPLY COIR LOG DETAIL TO SITES WHERE STREAMBANK IS DISTURBED OR TRENCHED THROUGH DURING PIPELINE INSTALLATION AND BANK COMPOSITION PERMITS STAKES TO BE DRIVEN
2. INSTALL ROLLED EROSION CONTROL PRODUCT (RECP) PRIOR TO INSTALLATION OF COIR LOGS
3. PLACE COIR LOG IN 2" DEEP TRENCH ALONG SLOPE OF EMBANKMENT AND STAKE INTO PLACE THROUGH RECP
4. KEY-IN COIR LOG BOTH UPSTREAM AND DOWNSTREAM FROM PIPELINE TRENCH TO MAKE COIR LOG FLUSH WITH STREAMBANK IN ORDER TO PREVENT UNRAVELING OF BANK DURING HIGH FLOW EVENTS.
5. COIR LOG MESH TO CONSIST OF BIODEGRADABLE MATERIAL.

7 Streambank Restoration with Coir Logs 6/13
N.T.S. Source: VHB LD_

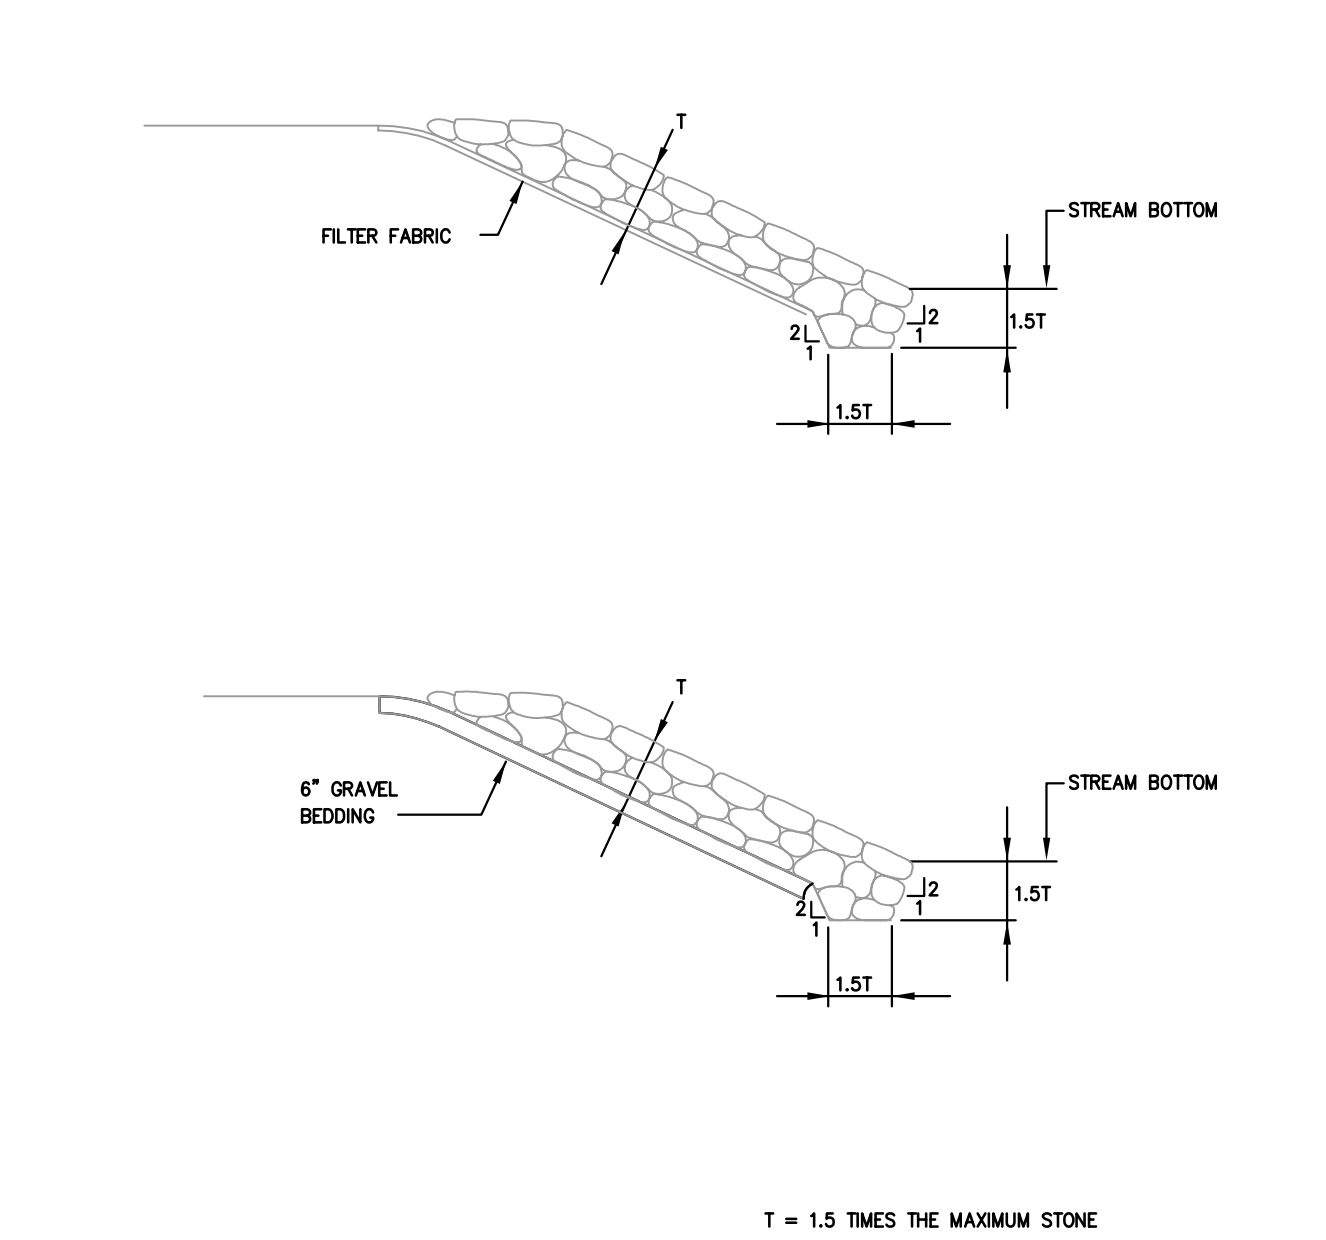

T = 1.5 TIMES THE MAXIMUM STONE DIAMETER, BUT NO LESS THAN 6 INCHES.

8 Streambank Stabilization with Rip Rap 12/12
N.T.S. Source: VHB LD_

DWG. NO.	REFERENCE DWG.	REV	DSN	CK	DESCRIPTION	INITIALS	DATE	INITIALS	DATE	YEAR:	W.O.	SCALE:	DWG.	ANGP-T-G-018	REV.
										2016		NOTED			0


	BID	CONSTRUCTION
ENVIRONMENTAL	JLS 06/28/13	JLS 05/2016
DRAFTING DESIGNER	GIL 06/28/13	GJM 05/2016
DRAFTING SUPERVISOR	BZD 06/28/13	BCK 05/2016
DESIGN ENGINEER	MDF 06/28/13	GEW 05/2016
DESIGN MANAGER	SAB 06/28/13	JEO 05/2016

VERMONT GAS PROPOSED 12" PIPELINE ADDISON NATURAL GAS PROJECT CONSTRUCTION DETAILS	
LOC. CHITTENDEN & ADDISON COUNTIES	YEAR: 2016
W.O.	SCALE: NOTED




Vermont Gas

38 Eastwood Drive, Suite 105
South Burlington, VT 05403
Main: (802) 795-0372 - www.chaco.companies.com

CIA



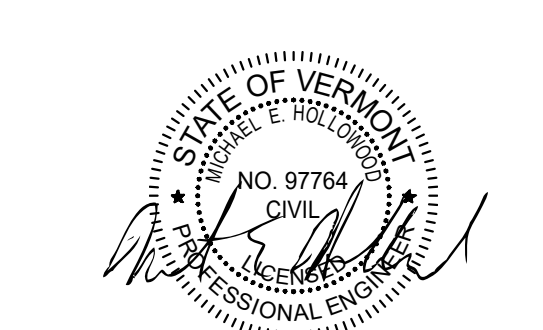


VHB Vanasse Hangen Brustlin, Inc.

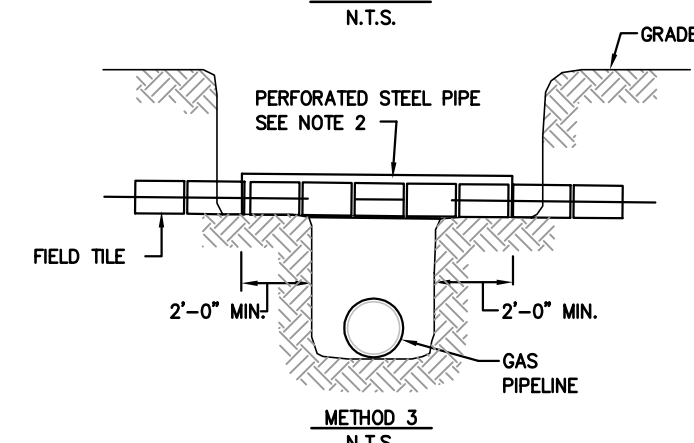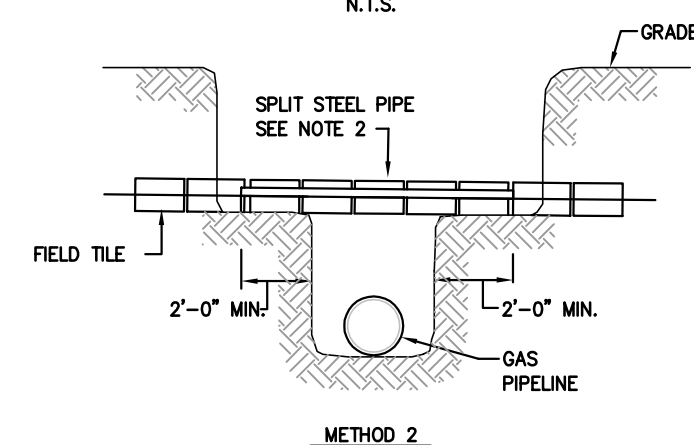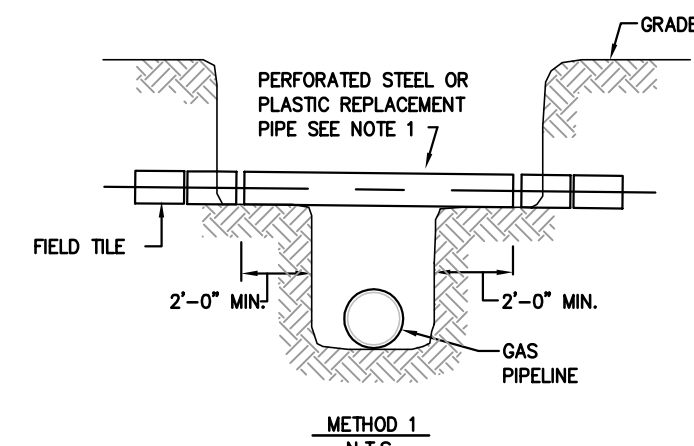



- NOTES:
- REPLACEMENT PIPE TO BE AS NEAR AS POSSIBLE TO THE DIAMETER OF THE FIELD TILE.
 - STEEL CARRIER PIPE TO HAVE INSIDE DIAMETER AS NEAR AS POSSIBLE TO THE OUTSIDE DIAMETER OF THE FIELD TILE.
 - MAINTAIN ORIGINAL FLOW LINE OF FIELD TILE IN ALL METHODS.

1 Typical Drain Tile Protection 12/12
N.T.S. Source: VHB LD_

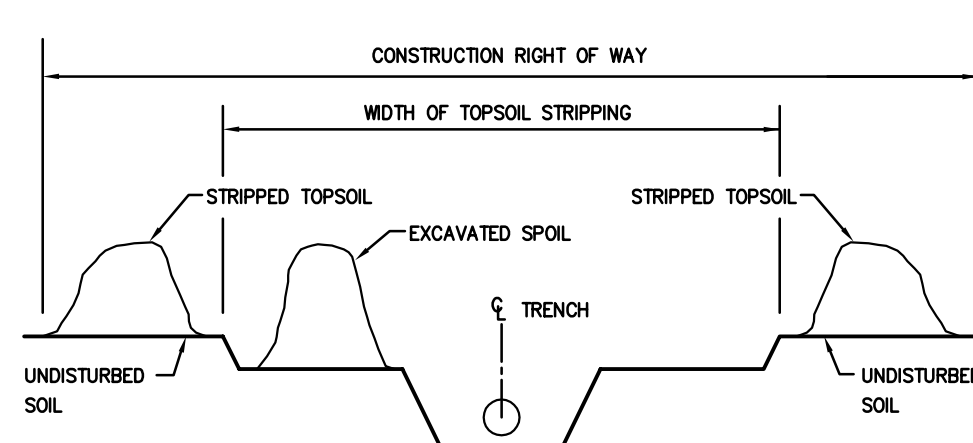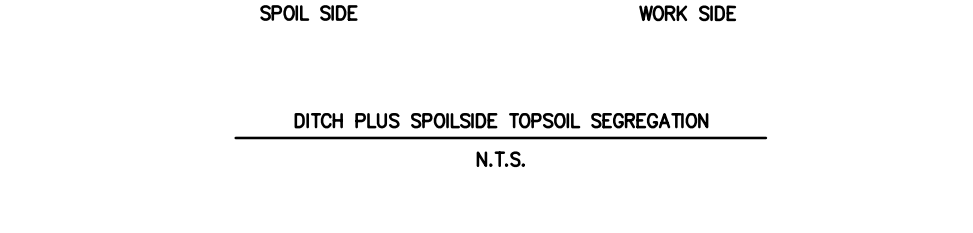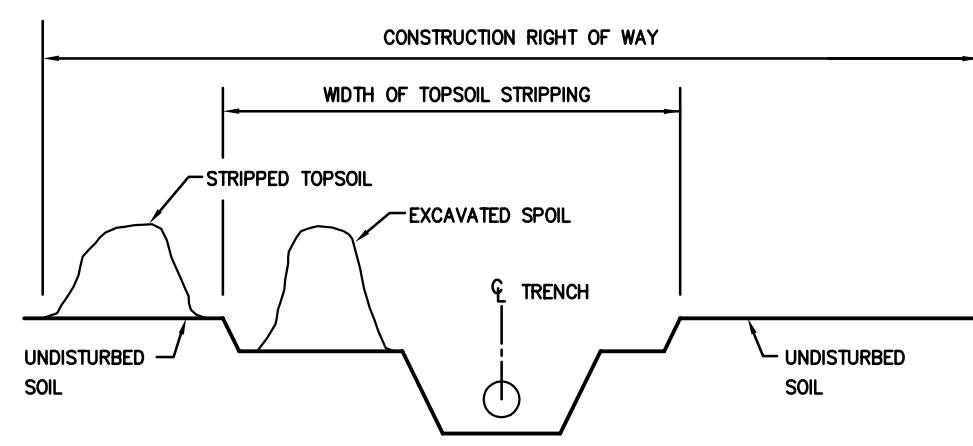





- NOTES:
- TOPSOIL MAY BE STORED IN LOCATIONS AS SHOWN ABOVE OR AT OTHER LOCATIONS WITHIN THE CONSTRUCTION ROW.
 - SEE SHEET ANGP-T-G-015 FOR TRENCH BACK-FILLING DETAIL AND SPECIFICATIONS

2 Topsoil Segregation 12/12
N.T.S. Source: VHB LD_

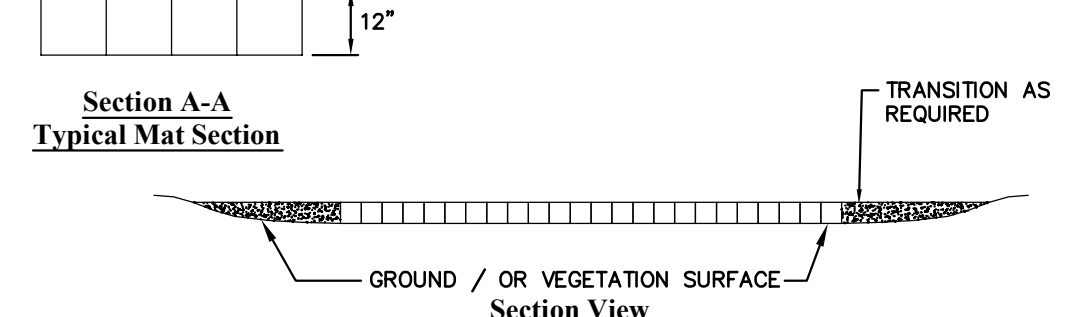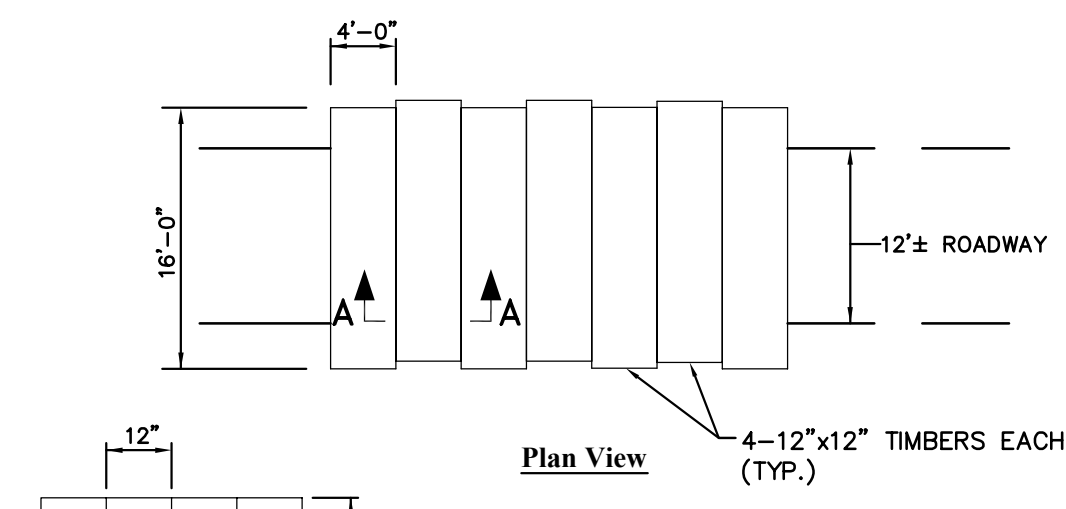


- Notes:
- TO BE INSTALLED WHERE NECESSARY IN WETLAND FOR ACCESS FOR CONSTRUCTION. ALTERNATIVE CONSTRUCTION MATTING (E.G., RUBBER MATS) MAY BE SUBSTITUTED FOR TIMBER MATTING.
 - PREPARATION FOR INSTALLATION OF TIMBER MATS WILL CONSIST OF CUTTING TALL WOODY SPECIES AND TRIMMING SHRUBS IF CONDITIONS REQUIRE. VEGETATION ROOT MASS IS TO REMAIN UNDISTURBED. MATS TO BE PLACED TO MAINTAIN NATURAL SOIL CONTOURS/CONDITIONS.
 - TIMBER SECTIONS TO BE SECURED TOGETHER WITH NO SPACES BY BOLTS, NAILS, STRAPS OR OTHER APPROPRIATE METHODS.
 - TIMBER MATS TO BE REMOVED UPON COMPLETION OF PROJECT AND AREA RESTORED TO NEAR ORIGINAL CONDITIONS PER EPSC PLANS
 - SNOW/ICE REMOVAL BY MECHANICAL METHODS; NO DEICING SALT OR CHEMICALS TO BE USED. LIGHT APPLICATION OF SAND FOR TRACTION ACCEPTABLE SO AS RESIDUE DOES NOT ACCUMULATE IN WETLAND.
 - MATS ARE TO BE IN PLACE FOR MINIMUM DURATION FEASIBLE.

3 Construction Matting - Timber Mat Typ. 12/12
N.T.S. Source: VHB LD_

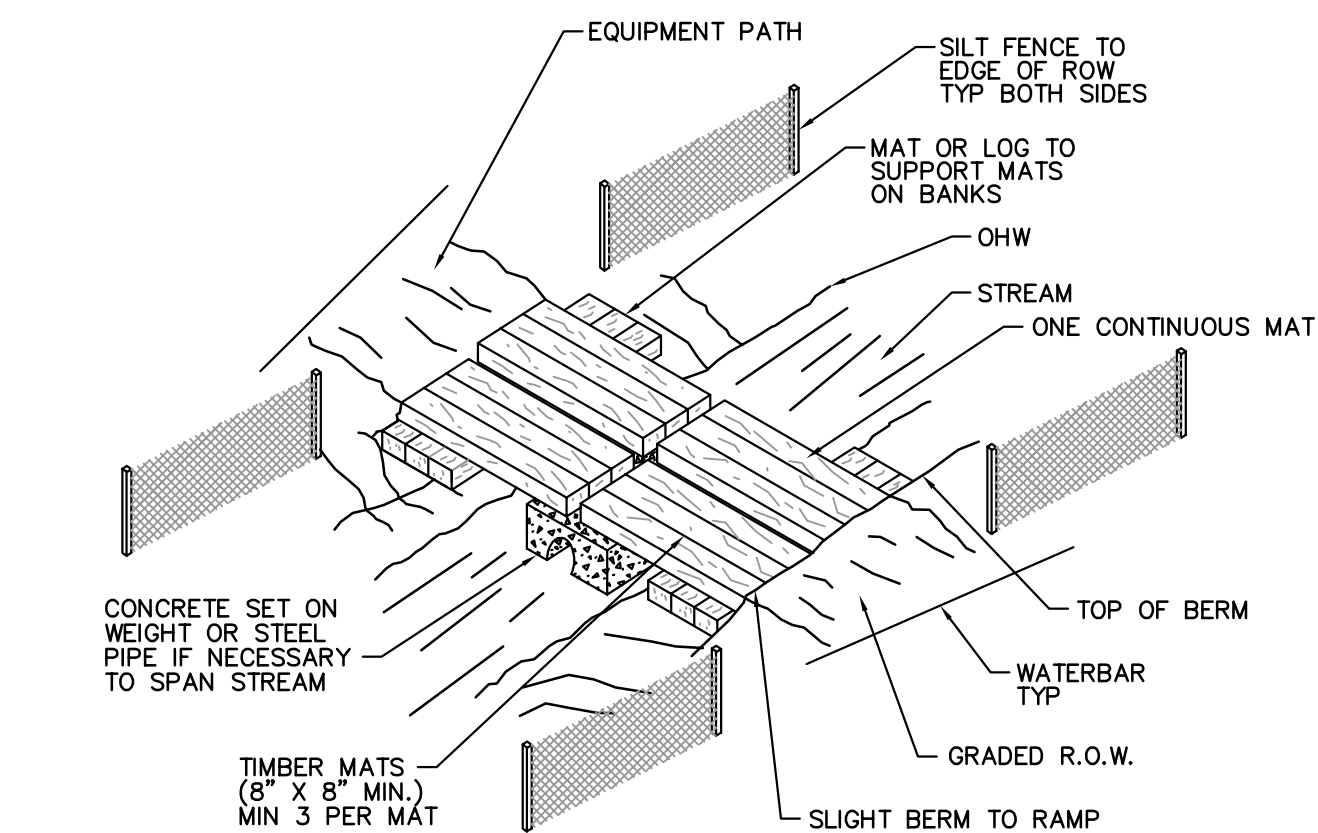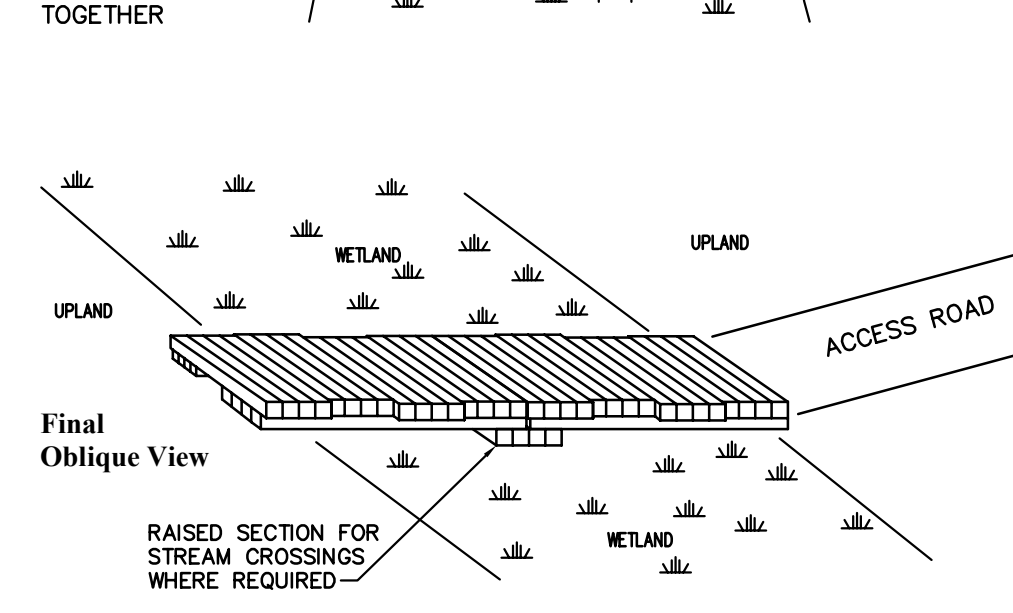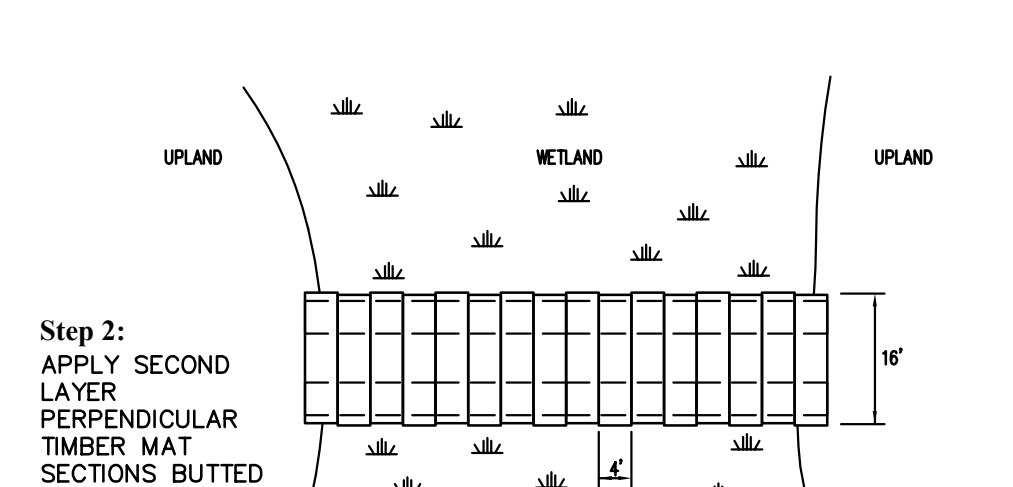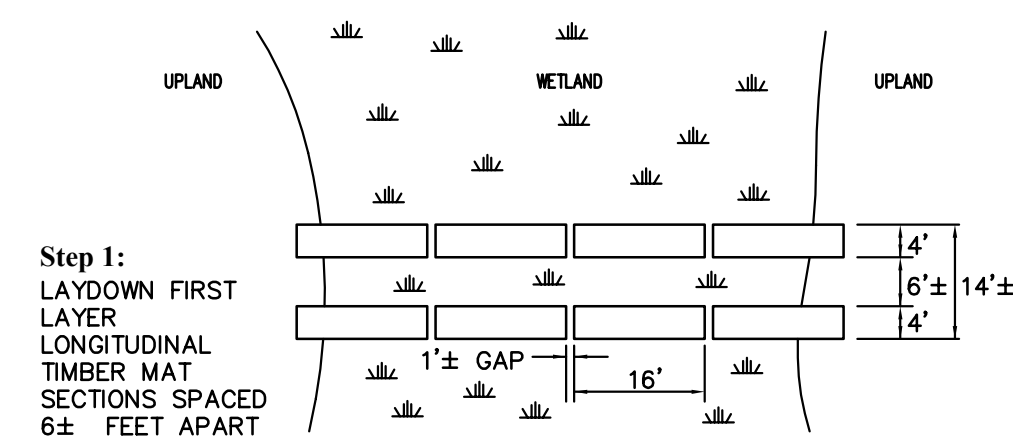


- NOTES:
- THERE IS TO BE NO UNNECESSARY MOVEMENT OF EQUIPMENT THROUGH WATER.
 - TIMBER MATS TO BE POSITIONED TO RUN FROM TOP OF BANK TO TOP OF BANK WHERE POSSIBLE. AT MINIMUM, THE TIMBER MAT BRIDGE SHALL SPAN THE ORDINARY HIGH WATER (OHW) WIDTH OF THE CHANNEL.
 - TIMBER MATS SHALL BE CLEANED OF SEDIMENT PRIOR TO EACH INSTALLATION.
 - TIMBER MATS SHOULD BE INSTALLED SO THERE ARE NO GAPS BETWEEN MATS.

4 Construction Mat Bridge 12/12
N.T.S. Source: CHA LD_

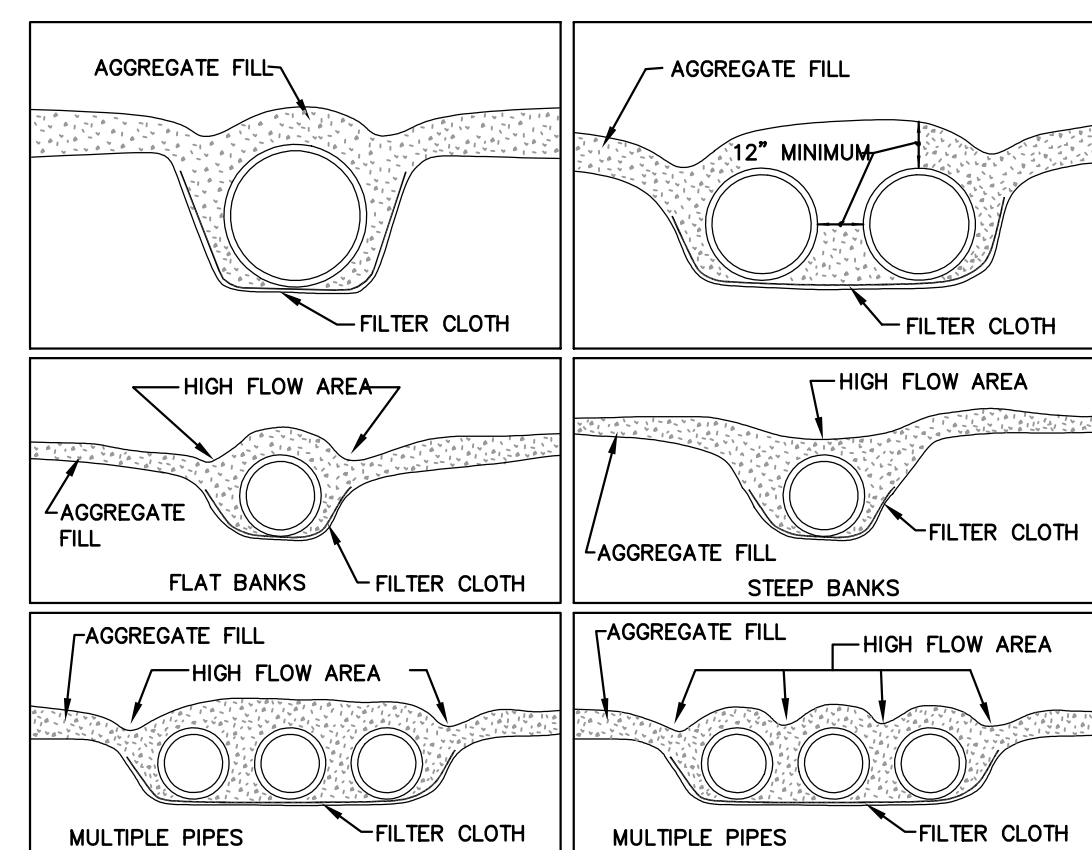


5 Temporary Access Culverts 12/12
N.T.S. Source: VHB LD_

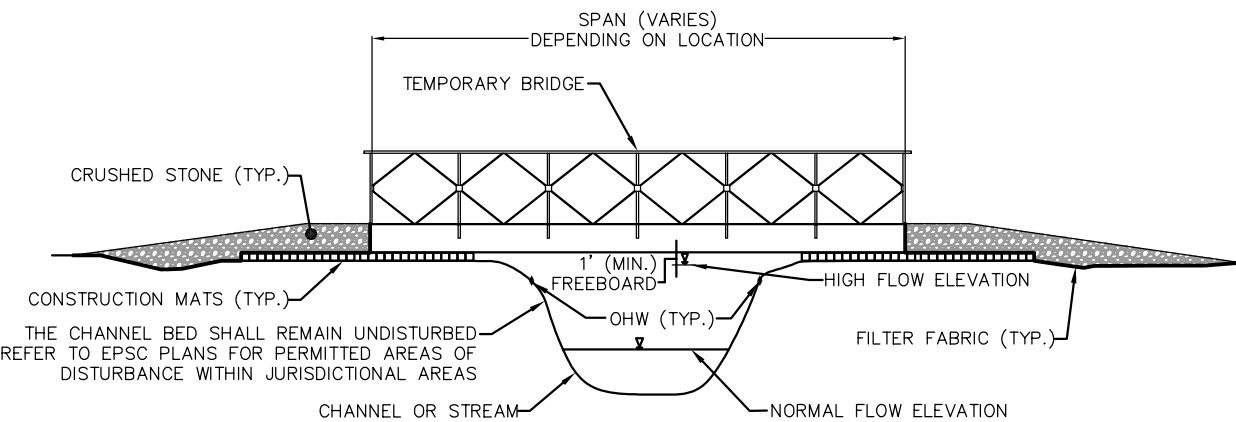


- NOTES:
- BRIDGE SHALL BE DESIGNED TO PROVIDE A CLEAR SPAN THAT IS EQUAL TO OR GREATER THAN OHW AT THE CROSSING SITE.
 - NO MATERIALS SHALL BE PLACED IN THE CHANNEL BELOW OHW WITHOUT PRIOR AUTHORIZATION.
 - BRIDGE SHALL BE DESIGNED TO CARRY THE MAXIMUM ANTICIPATED CONSTRUCTION LOADS. HOWEVER SHALL NOT BE LESS THAN AASHTO HS-20 LOADING CRITERIA.
 - BRIDGE SHALL BE DESIGNED SUCH THAT A MINIMUM ONE FOOT (1 FT) OF FREE BOARD EXISTS BETWEEN THE LOWEST MEMBER AND THE ANTICIPATED HIGH FLOW (Q25) WATER ELEVATION.
 - ADDITIONAL LOAD BEARING DEVICES BEYOND CONSTRUCTION MATTING MAY BE REQUIRED. THE CONTRACTOR SHALL CONDUCT A GEOTECHNICAL ANALYSIS OF EACH BRIDGE SITE TO DETERMINE THE NECESSARY BEARING CAPACITY OF SOILS AND TO DETERMINE THE MINIMUM DISTANCE BETWEEN BEARING SURFACES AND THE TOP OF STREAM/CHANNEL BANK.
 - APPROACH GRADES SHALL BE AS DEEMED NECESSARY BY THE CONTRACTOR.

6 Temporary Bridge Detail 12/12
N.T.S. Source: VHB LD_

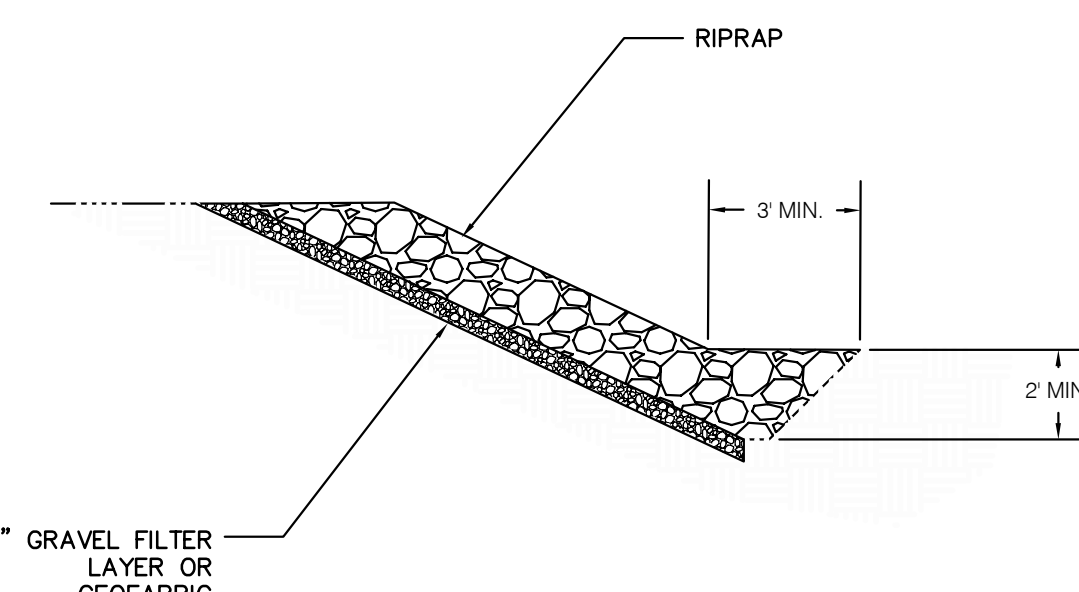

- Notes:
- MINIMUM THICKNESS SHALL BE 1.5X MAX STONE DIAMETER, BUT IN NO CASE < 6".
 - THE TOE OF RIP RAP SHALL BE KEYED IN STABLE FOUNDATION @ IT'S BASE.
 - STONE SIZE SHOULD BE BASED ON ANGLE OF REPOSE FOR SPECIFIC SIZE. (FIG 4.3 P 4.38)

7 Riprap Slope Protection 12/12
N.T.S. Source: VHB LD_

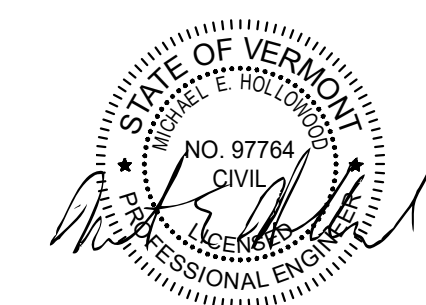

VHB Vanasse Hangen Brustlin, Inc.

DWG. NO.	REFERENCE DWG.	REV	DSN	CK	DESCRIPTION	INITIALS	DATE	INITIALS	DATE	YEAR:	W.O.	SCALE:	DWG.	ANGP-T-G-019	REV.
										2016		NOTED			0


	BID	CONSTRUCTION
ENVIRONMENTAL	JLS 06/28/13	JLS 05/2016
DRAFTING DESIGNER	GIL 06/28/13	GJM 05/2016
DRAFTING SUPERVISOR	BZD 06/28/13	BCK 05/2016
DESIGN ENGINEER	MDF 06/28/13	GEW 05/2016
DESIGN MANAGER	SAB 06/28/13	JEO 05/2016

VERMONT GAS
PROPOSED 12" PIPELINE
ADDISON NATURAL GAS PROJECT
CONSTRUCTION DETAILS
LOC. CHITTENDEN & ADDISON COUNTIES

38 Eastwood Drive, Suite 105
South Burlington, VT 05403
Main: (802) 795-0372 - www.chacompanies.com

NOTES:

- USE DIVERSION FLUME STREAM CROSSING ON WATER COURSES WITH LIMITED STREAM FLOW TO PREVENT SEDIMENTATION AND INTERRUPTION OF STREAM FLOW DURING CONSTRUCTION. THIS METHOD IS APPROPRIATE IN LOCATIONS WHERE FISH PASSAGE IS A CONCERN.
- SCHEDULE CONSTRUCTION DURING LOW FLOW PERIOD, IF POSSIBLE.
- THIS DETAIL REPRESENTS ONE POSSIBLE CONFIGURATION OF CONSTRUCTION ELEMENTS WITHIN THE TEMPORARY AND PERMANENT ROW. ALTERNATE CONFIGURATIONS OF CONSTRUCTION ELEMENTS BETWEEN THE UPSTREAM AND DOWNSTREAM DIVERSION STRUCTURES ARE ALLOWABLE SO LONG AS APPROPRIATE MEASURES ARE MAINTAINED TO PROTECT WATER QUALITY.
- SET UP STEEL OR HDPE PIPE AS SHOWN, OR USE PRACTICAL ALTERNATIVES. PIPE (OR PIPES) MUST BE SIZED TO HAVE TWICE THE CAPACITY OF ANTICIPATED FLOW. DEPENDING ON STREAM FLOW, DIG SUMP HOLE TO CONCENTRATE WATER AT INTAKE.
- INSTALL UPSTREAM DAM COMPOSED OF SANDBAGS, METAL PLATING OR A COMBINATION OF BOTH. INSTALL DOWNSTREAM DAM, IF REQUIRED, TO KEEP STREAM BED DRY.
- AFTER DAMS ARE IN PLACE, IT MAY BE NECESSARY TO USE A SUMP PUMP AND DEWATERING FILTER BAG TO KEEP WORK AREA DRY.
- ALL MECHANIZED EQUIPMENT TO PERFORM WORK FROM ADJACENT TOP OF BANK AREAS. MAT STREAM IF WORK TO OCCUR IN STREAM CHANNEL.
- EXCAVATE TRENCH AND LOWER IN PIPE UNDER DIVERSION FLUME. MOVE FLUME AS REQUIRED OR DISCONNECT IF TEMPORARY FLOW BLOCKAGE IS ACCEPTABLE. BACKFILL TRENCH.
- DISMANTLE DOWNSTREAM DAM, THEN UPSTREAM DAM.
- RESTORE DISTURBED CHANNEL, STREAM BANKS AND APPROACHES FOR A MINIMUM DISTANCE OF AT LEAST 50 FT. FROM THE STREAM EDGES AND PERMANENTLY STABILIZE WITHIN 1 DAY OF INITIAL RESTORATION. REFER TO THE STREAMBANK RESTORATION DETAIL FOR RESTORATION REQUIREMENTS.

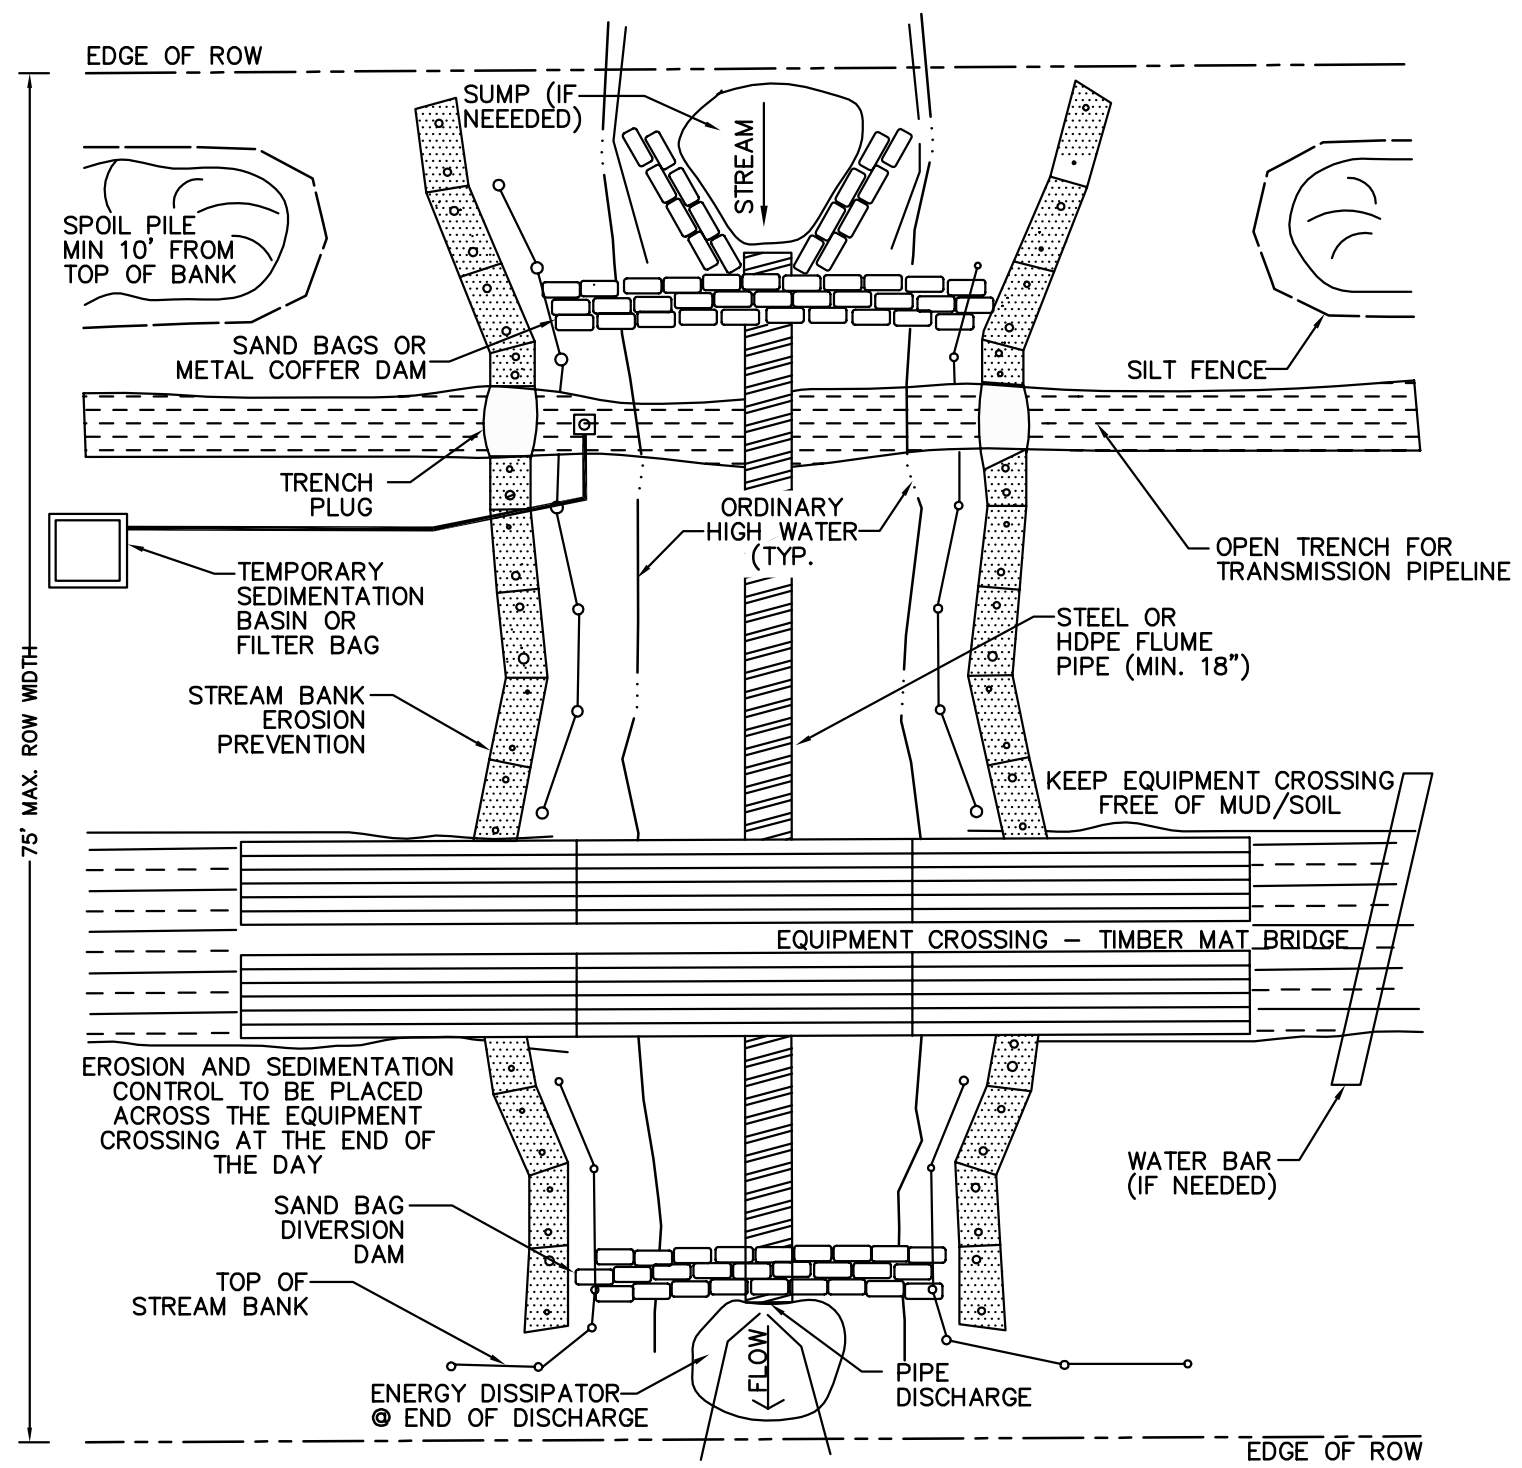


1 Diversion Flume Stream Crossing

N.T.S. Source: VHB 12/12 LD_

NOTES:

- USE DAM AND PUMP METHOD ON WATER COURSES WITH LIMITED STREAM FLOW TO PREVENT SEDIMENTATION AND INTERRUPTION OF STREAM FLOW DURING CONSTRUCTION.
- SCHEDULE CONSTRUCTION DURING LOW FLOW PERIOD, IF POSSIBLE.
- THIS DETAIL REPRESENTS ONE POSSIBLE CONFIGURATION OF CONSTRUCTION ELEMENTS WITHIN THE TEMPORARY AND PERMANENT ROW. ALTERNATE CONFIGURATIONS OF CONSTRUCTION ELEMENTS BETWEEN THE UPSTREAM AND DOWNSTREAM DIVERSION STRUCTURES ARE ALLOWABLE SO LONG AS APPROPRIATE MEASURES ARE MAINTAINED TO PROTECT WATER QUALITY.
- SET UP PUMP AND HOSE AS SHOWN, OR USE PRACTICAL ALTERNATIVES. PUMP SHOULD HAVE TWICE THE PUMPING CAPACITY OF ANTICIPATED FLOW. HAVE STANDBY PUMP ON SITE. DEPENDING ON STREAM FLOW, DIG SUMP HOLE TO CONCENTRATE WATER AT INTAKE.
- USE TEMPORARY SEDIMENTATION BASIN OR FILTER BAG PRIOR TO DISCHARGING WATER BACK TO STREAM.
- INSTALL UPSTREAM DAM COMPOSED OF SANDBAGS, METAL PLATING OR A COMBINATION OF BOTH. INSTALL DOWNSTREAM DAM, IF REQUIRED, TO KEEP STREAM BED DRY.
- AFTER DAMS ARE IN PLACE, IT MAY BE NECESSARY TO USE ADDITIONAL PUMPS TO HANDLE STREAM FLOW.
- EXCAVATE TRENCH AND LOWER IN PIPE UNDER HOSE. BACKFILL TRENCH.
- ALL MECHANIZED EQUIPMENT TO PERFORM WORK FROM TEMPORARY BRIDGE OR ADJACENT TOP OF BANK AREAS. USE TIMBER MATS IS TO OCCUR IN STREAM CHANNEL.
- DISMANTLE DOWNSTREAM DAM, THEN UPSTREAM DAM.
- RESTORE DISTURBED CHANNEL, STREAM BANKS AND APPROACHES FOR A MINIMUM DISTANCE OF AT LEAST 50 FT. FROM THE STREAM EDGES AND PERMANENTLY STABILIZE WITHIN 1 DAY OF INITIAL RESTORATION. REFER TO THE STREAMBANK RESTORATION DETAIL FOR RESTORATION REQUIREMENTS.

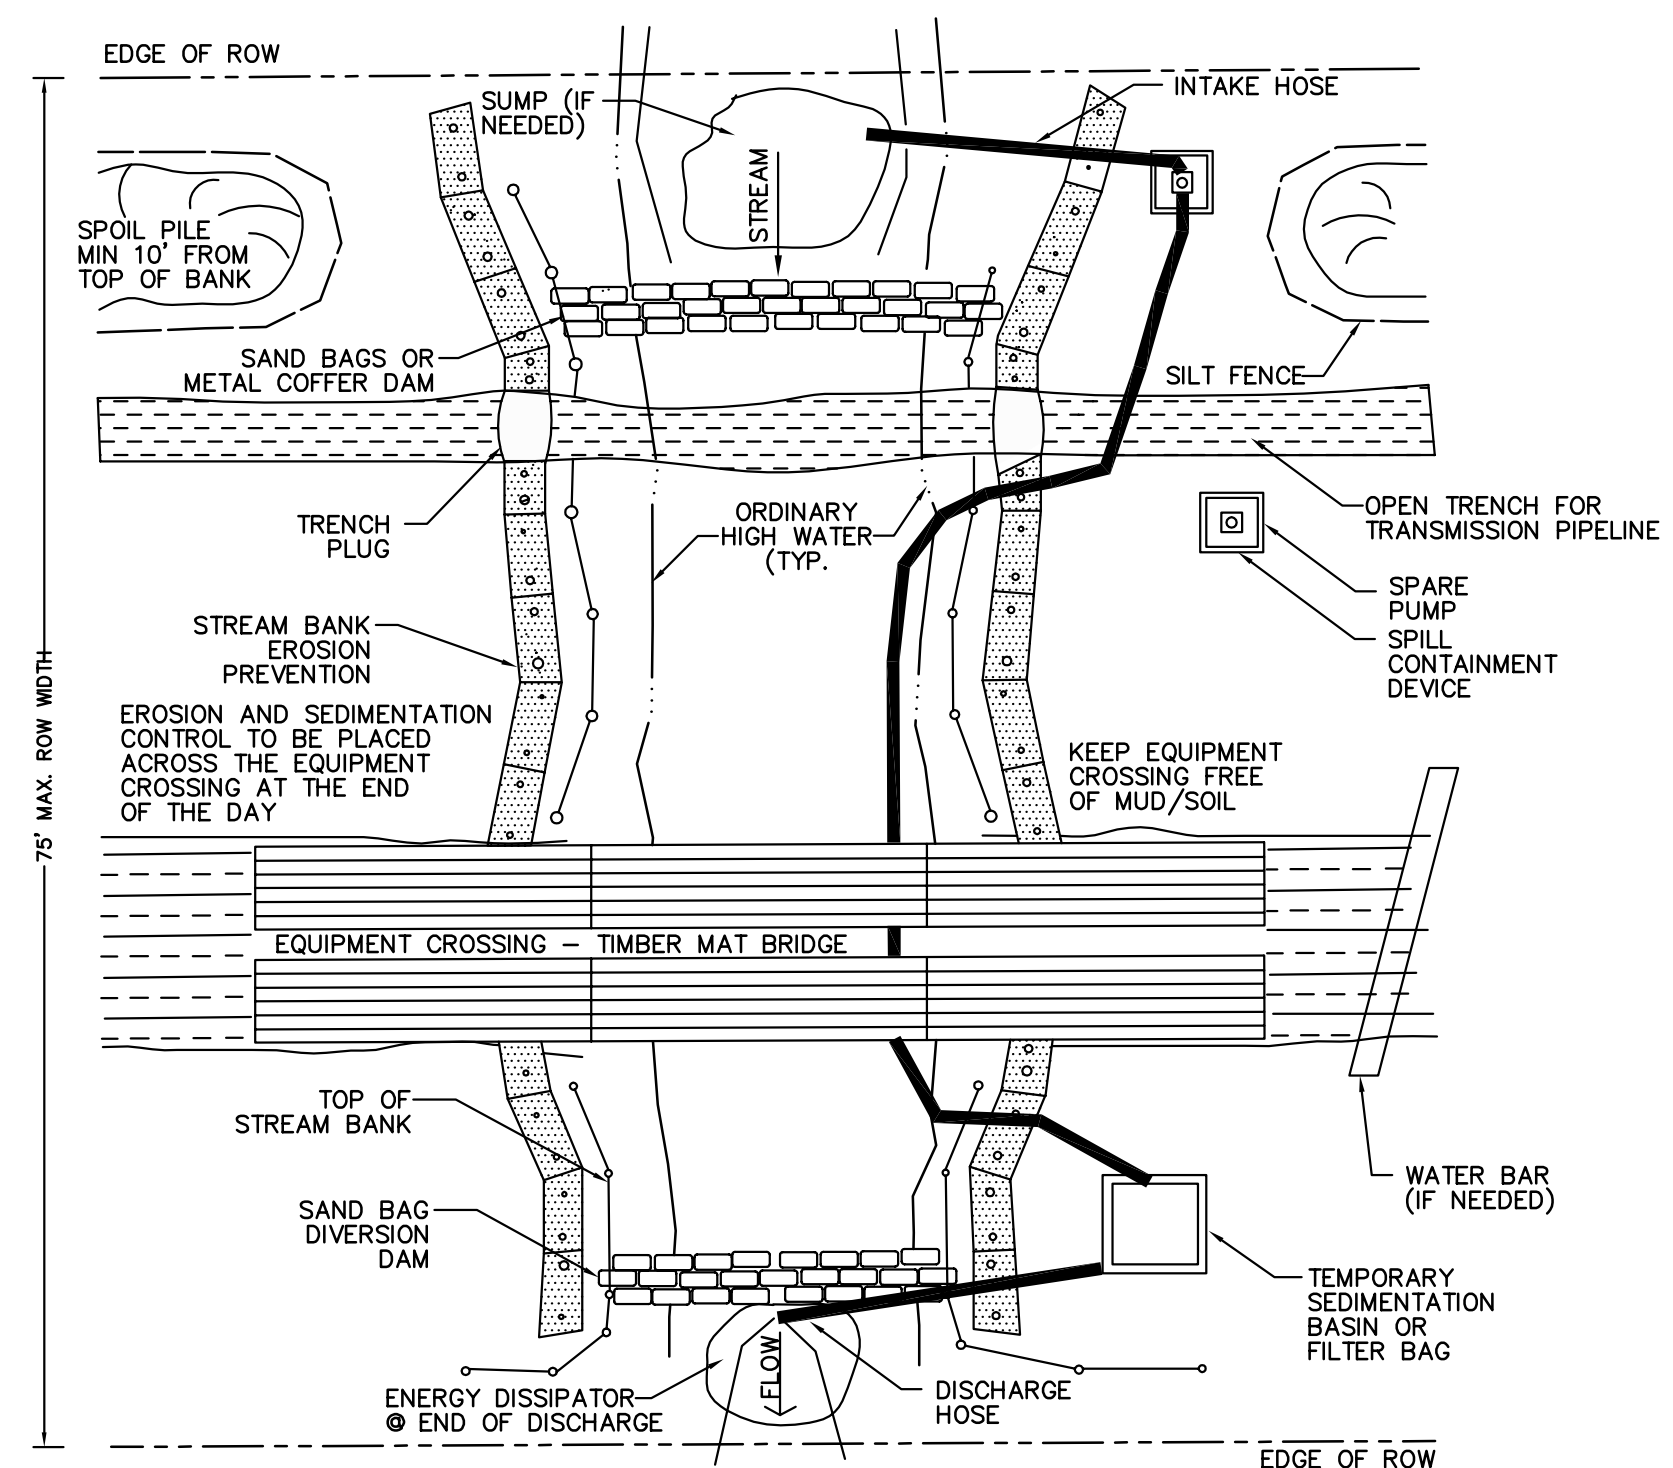


2 Open Trench Stream Crossing - Dam and Pump Around

N.T.S. Source: VHB 12/12 LD_

MILEPOST	RESOURCE NAME	RESOURCE AREA WIDTH (A)	HDD LENGTH (C)	DEPTH OF RESOURCE AREA (D)	ELEV. BELOW RESOURCE (E)	ENTRY ELEV. (F)	EXIT ELEV. (G)
28.2	VT-AD-1560 VT-AD-1561	300	775	400	< 393	396	396
28.57	VT-AD-1562	200	375	406	<399	412	412
35.77	VT-AD-806	160	950	310	< 303	323	323

MILEPOST	WETLAND ID	WETLAND WIDTH (A)	BUFFER WIDTH (B)	HDD LENGTH (C)	UNCON. MATERIAL ELEV. (D)	CONSOL. MATERIAL ELEV. (E)	ENTRY ELEV. (F)	EXIT ELEV. (G)
22.1	2012-CM-84 2012-PW-85	1,110	1,520	1,600	398	< 391	424	404
27.3	2012-PW-67 RTE-PS-045	2,300	2,450	2,270	358	< 356	< 376	< 400

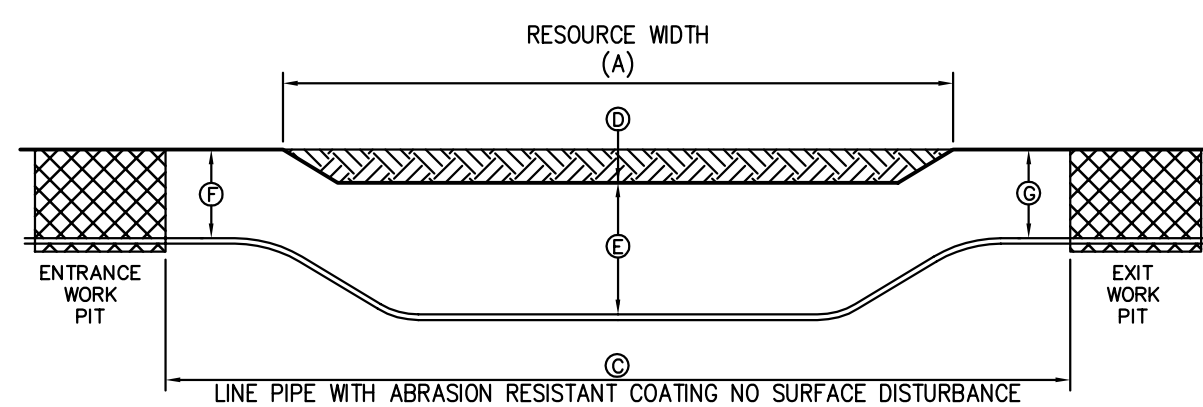


Notes:

- THIS CONFIGURATION IS FOR HORIZONTAL DIRECTIONAL DRILL OF UPLAND NATURAL AND CULTURAL (ARCHAEOLOGICAL) RESOURCE SITES AS SHOWN ON PROJECT PLANS. SEE ALIGNMENT SHEETS FOR LOCATIONS OF THIS CONFIGURATION.
- MINIMUM SEPARATION BETWEEN THE TOP OF PIPELINE AND THE CHANNEL RESOURCE BOTTOM (DIMENSION E) MUST BE AT LEAST 2 FEET.
- ELEVATIONS PROVIDED ARE BASED ON APPROXIMATE NAVD 88 DATUM AND MUST BE FIELD VERIFIED PRIOR TO INSTALLATION OF PIPELINE.

3 Horizontal Directional Drill (HDD) Upland Natural / Cultural Resource - Typical Section

N.T.S. Source: VHB 04/13

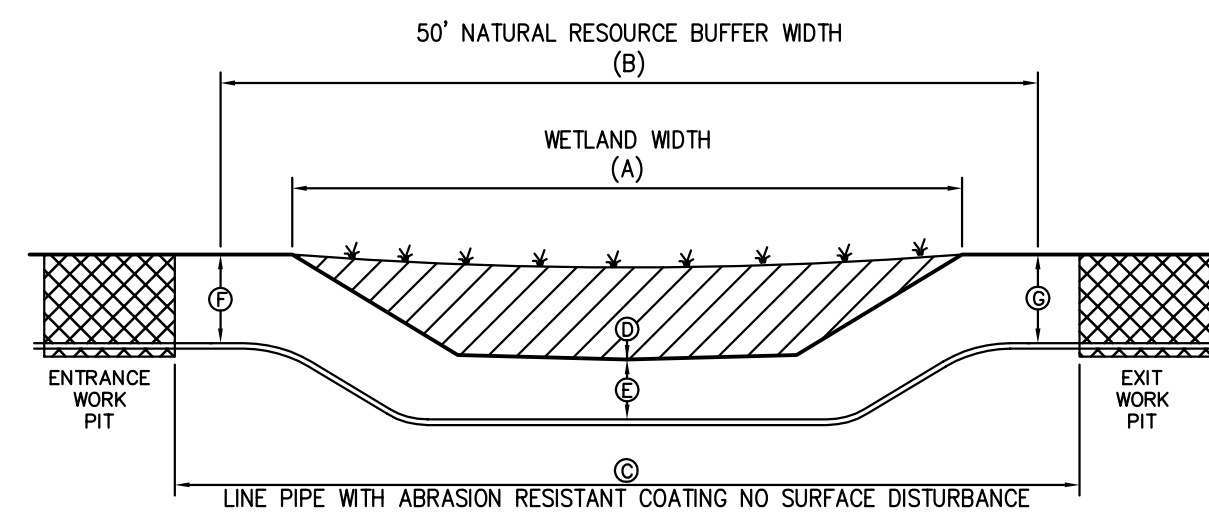

Notes:

- THIS CONFIGURATION IS FOR HORIZONTAL DIRECTIONAL DRILL OF WETLAND CROSSINGS AS SHOWN ON PROJECT PLANS. SEE ALIGNMENT SHEETS FOR LOCATIONS OF THIS CONFIGURATION.
- TOP OF PIPELINE MUST BE BELOW THE DEPTH OF PEAT OR OTHER UNCONSOLIDATED ORGANIC MATERIALS (DIMENSION D) THROUGHOUT THE LENGTH OF THE DRILL.
- MINIMUM SEPARATION BETWEEN THE UNCONSOLIDATED MATERIAL AND THE TOP OF PIPELINE (DIMENSION E) MUST BE AT LEAST 2 FEET.
- ELEVATIONS PROVIDED ARE BASED ON APPROXIMATE NAVD 88 DATUM AND MUST BE FIELD VERIFIED PRIOR TO INSTALLATION OF PIPELINE.

4 Horizontal Directional Drill (HDD) Wetland Crossing - Typical Section

N.T.S. Source: VHB 04/13

SPACE INTENTIONALLY LEFT BLANK

SPACE INTENTIONALLY LEFT BLANK



VHB Vanasse Hangen Brustlin, Inc.

DWG. NO.	REFERENCE DWG.	REV	DSN	TDB	CK	DESCRIPTION	INITIALS	DATE	INITIALS	DATE	YEAR:	W.O.	SCALE:	DWG.	ANGP-T-G-020	REV.
		1	BCK	TDB		ADDED ARCH. SITE (6/08/15)					2016		NOTED			1

	BID	CONSTRUCTION
ENVIRONMENTAL	JLS 06/28/13	JLS 05/2016
DRAFTING DESIGNER	GIL 06/28/13	GJM 05/2016
DRAFTING SUPERVISOR	BZD 06/28/13	BCK 05/2016
DESIGN ENGINEER	MDF 06/28/13	GEW 05/2016
DESIGN MANAGER	SAB 06/28/13	JEO 05/2016

VERMONT GAS
PROPOSED 12" PIPELINE
ADDISON NATURAL GAS PROJECT
CONSTRUCTION DETAILS

LOC. CHITTENDEN & ADDISON COUNTIES

YEAR: 2016 W.O. SCALE: NOTED DWG. ANGP-T-G-020 REV. 1

38 Eastwood Drive, Suite 105
South Burlington, VT 05403
Main: (802) 735-0372 - www.chacompanies.com

Begin Station	End Station	Min. Depth (ft.)	Reason	Notes
553+00	584+87	4		
584+87	585+08	5	STREAM 2012-SC-CM-34 (I)	
585+08	587+96	4		
587+96	590+46	5	STREAMS 2012-TB-CM-35 (P) and 2012-TB/SC-CM-36 (P)	
590+46	596+50	4		
596+50	605+25	N/A	I-89 HDD	Refer to VTRANS Permit plans for depth of cover in this area
605+25	606+00	5	Paved/Travelled Way	
606+00	606+60	5	Paved Road/Driveway	
606+60	614+00	5	Paved/Travelled Way	
614+00	616+25	4	Paved Crossing/VELCO	Includes VELCO access point
616+25	617+22	4		
617+22	618+06	5	STREAMS 2013-SC-CM-3 (E) and 2013-SC-CM-2 (E)	
618+06	628+00	4		
628+00	645+00	4	VELCO Access	
645+00	651+25	4		
651+25	653+50	4	VELCO	
653+50	655+25	4	Agriculture	
655+25	656+25	N/A	State Road Crossing - St. George Road (Route 2A)	Refer to VTRANS Permit plans for depth of cover in this area
656+25	659+75	4		
659+75	662+25	4	VELCO	
662+25	673+00	4		
673+00	692+25	4		
692+25	712+75	4	VELCO	
712+75	718+25	4		
718+25	719+75	4	VELCO/VELCO Access	
719+75	723+43	4	Agriculture	
723+43	728+63	Varies	FEH STREAM 2012-TB-SB-01 (P) - Sucker Brook	See Detail - DWG. ANGP-T-C-028A
728+63	732+00	4	VELCO Access / Agriculture	
732+00	755+50	4		
755+50	756+25	4,5	Road Crossing - Lincoln Road	4' in ditch line, 5' under road
756+25	767+75	4		
767+75	787+75	4	VTRANS/Agriculture/VELCO Access	
787+75	788+25	4,5	Road Crossing - Breezy Valley Drive	4' in ditch line, 5' under road
788+25	792+25	4	Agricultural	
792+25	795+75	4	VTRANS	Along Route 2A
795+75	798+75	4		
798+75	832+81	4	VELCO/Agriculture	
832+81	832+91	5	STREAM 2012-DITCH-CM-40 (D)	
832+91	838+25	4	VELCO / Agriculture	
838+25	853+75	4		
853+75	855+50	4	VELCO	
855+50	863+75	4		
863+75	884+30	4	VELCO Access / VTRANS	See VTRANS Permit plans for details
884+30	887+00	5	Landowner Condition - Peet (LL #86)	
887+00	887+75	N/A	State Road Crossing - St. George Road (Route 2A)	Refer to VTRANS Permit plans for depth of cover in this area
887+75	892+75	4		
892+75	893+75	N/A	State Road Crossing - Hinesburg Road (Route 116)	Refer to VTRANS Permit plans for depth of cover in this area
893+75	900+75	4		
900+75	902+50	4	VELCO	
902+50	904+67	4		
904+67	904+83	5	STREAM 2012-SC-PW-42 (P)	
904+83	910+25	4		
910+25	911+25	4	Agricultural	
911+25	915+50	4		
915+50	927+25	4	Agricultural / Landowner Condition - Garvey (LL #97)	
927+25	943+25	4	VELCO / Agriculture	
943+25	947+75	4		
947+75	948+25	4,5	Road Crossing - Hickory Place	4' in ditch line, 5' under road
948+25	957+50	4		
957+50	979+50	4	Agricultural	
979+50	997+93	4		
997+93	999+01	Varies	FEH STREAM 2012-SC-JB-10 (P) - Unnamed tributary to LaPlatte River	See Detail - DWG. ANGP-T-C-039A
999+01	999+25			
999+25	1000+25	4,5	Road Crossing - Shelburne Falls Road	4' in ditch line, 5' under road
1000+25	1004+50	4	Landowner Condition - Fortin (LL #106)	

Begin Station	End Station	Min. Depth (ft.)	Reason	Notes
1004+50	1010+50	4	VELCO Access / Landowner Condition - Fortin (LL #106)	Station Equation in area - 1004+50 is adjacent to LL111/LL112 Boundary
1010+50	1015+50	4	Landowner Condition - Fortin (LL #106)	
1015+50	1023+00	4	VELCO/Agriculture	
1023+00	1025+75	4	VELCO/Agriculture / Landowner Condition - Clark (LL #108)	
1025+75	1032+50	Varies	HDD - LaPlatte River	
1032+50	1047+75	4	VELCO/Agriculture / Landowner Condition - Clark (LL #108)	
1047+75	1048+50	4,5	Road Crossing - Charlotte Road	4' in ditch line, 5' under road
1048+50	1079+38	4	VELCO/Agriculture	
1079+38	1080+53	Varies	FEH STREAM 2015-SC-1 (P)	See Detail - DWG. ANGP-T-C-042A
1080+53	1104+80	4	VELCO/Agriculture	
1104+80	1113+00	4	VELCO / Agriculture / Landowner Condition - UVM and State Ag. College (LL #112)	
1113+00	1114+00	4	Landowner Condition - UVM and State Ag. College (LL #112)	
1114+00	1114+75	4,5	Road Crossing - Baldwin Road	4' in ditch line, 5' under road
1114+75	1117+25	4	Landowner Condition - Thibault (LL #116)	
1117+25	1123+25	4	VELCO / Landowner Condition - Thibault (LL #116)	
1123+25	1175+25	4	Landowner Condition - Thibault (LL #116)	
1175+25	1167+75	4	VELCO / Agriculture / Landowner Condition - Baldwin (LL #117) and Baldwin (LL #118)	
1167+75	1180+20	Varies	HDD - Drinkwater Road Complex / Landowner Condition - Baldwin (LL #117) and Baldwin (LL #118)	
1180+20	1185+97	4	VELCO/Agriculture	
1185+97	1186+20	5	STREAM 2012-SC-PW-38 (P)	
1186+20	1195+15	4	VELCO/Agriculture	
1195+15	1221+30	Varies	HDD - Lewis Creek / Landowner Condition - Mobbs (LL #121)	
1221+30	1268+45	4	VELCO / Agriculture / Landowner Condition - Ames (LL #124)	
1268+45	1268+55	5	STREAM 2012-DITCH-PW-30 (D)	
1268+55	1270+74	4	VELCO/Agriculture	
1270+74	1271+88	5	STREAM 2012-SC-PW-29 (I)	
1271+88	1287+63	4	Agriculture	
1287+63	1288+71	Varies	STREAM 2012/2015-TB/SC-PW-28 (P)	See Detail - DWG. ANGP-T-C-051A
1288+71	1293+50	4	Agriculture	
1293+50	1294+25	4,5	Road Crossing - Rotax Road	4' in ditch line, 5' under road
1294+25	1320+00	4	Agriculture	
1320+00	1329+50	4		
1329+50	1340+25	4	Agriculture	
1340+25	1343+00	4		
1343+00	1357+75	4	VELCO / Agriculture	
1357+75	1361+30	4	VELCO / Agriculture / Landowner Condition - Mejia and Lauer (LL #151)	
1361+30	1378+25	4	VELCO / Agriculture	
1378+25	1378+75	4,5	Road Crossing - Shelton Road (Paper Street)	4' in ditch line, 5' under road
1378+75	1397+25	4	VELCO/Agriculture	
1397+25	1397+75	4,5	Road Crossing - Hollow Road	4' in ditch line, 5' under road
1397+75	1405+24	4	VELCO/Agriculture	
1405+24	1406+63	5	STREAM 2012-TB/SC-RS-3 (P)	
1406+63	1424+00	4	VELCO/Agriculture	
1424+00	1424+50	4,5	Road Crossing - Post Road	4' in ditch line, 5' under road
1424+50	1427+96	4	VELCO/Agriculture	
1427+96	1429+06	5	STREAM 2012-SC-RS-2 (I)	
1429+06	1433+51	4	VELCO/Agriculture	
1433+51	1434+92	5	STREAM 2012-TB/SC-RS-1 (P)	
1434+92	1439+50	4	VELCO/Agriculture	
1439+50	1468+75	Varies	HDD - Monkton Swamp / Landowner Condition - Boisse (LL #178.02, 178.04, 178.05)	
1468+75	1490+25	4	VELCO / Agriculture / Landowner Condition - Boisse (LL #178.02, 178.04, 178.05)	
1490+25	1497+75	Varies	HDD - Archaeology Site VTAD-1560 and Monkton Road / Landowner Condition - Huizenga (LL #176)	
1497+75	1503+45	4	VELCO / Agriculture / Landowner Condition - Huizenga (LL #176)	
1503+45	1503+61	5	STREAM 2012-DITCH-PW-26 (D)	
1503+61	1508+75	4	VELCO / Agriculture / Landowner Condition - Huizenga (LL #176)	
1508+75	1512+04	Varies	HDD - Archaeology Site VTAD-1562 / Landowner Condition - Huizenga (LL #176)	
1512+04	1514+82	4	VELCO / Agriculture / Landowner Condition - Huizenga (LL #176)	
1514+82	1525+50	5	VELCO / Agriculture / Landowner Condition - Hurlburt (LL #181)	
1525+50	1536+14	5	Landowner Condition - Hurlburt (LL #181)	



Begin Station	End Station	Min. Depth (ft.)	Reason	Notes
1536+14	1537+40	Varies	STREAM 2012-TB-JB-7 (P)	See Detail - DWG. ANGP-T-C-061AA, Minimum 5 feet deep
1537+40	1547+25	5	Landowner Condition - Hurlburt (LL #181)	
1547+25	1547+75	5	Road Crossing - Old Stage Road	
1547+75	1553+25	5	Landowner Condition - Hurlburt (LL #181)	
1553+25	1553+75	5	Road Crossing - Old Stage Road	
1553+75	1565+26	5	Landowner Condition - Hurlburt (LL #181)	
1565+26	1565+50	5	STREAM 2013-AS-SC-RS-1 (I)	
1565+50	1566+00	5	Road Crossing - Old Stage Road	
1566+00	1580+32	5	VELCO / Agriculture / Landowner Condition - Hurlburt (LL #192)	
1580+32	1588+00	5	VELCO / Agriculture / Landowner Condition - Hurlburt (LL #196)	
1588+00	1588+75	5	Road Crossing - Parks-Hurlburt Road	
1588+75	1633+35	5	VELCO/Agriculture / Landowner Condition - Hurlburt (LL #196)	
1633+35	1635+35	Varies	FEH Stream 2012-SC-RS-5A (P) and 2012-SC-RS-5 (P)	See Detail - DWG. ANGP-T-C-065A
1635+35	1642+50	5	VELCO/Agriculture / Landowner Condition - Hurlburt (LL #196)	
1642+50	1696+00	4	VELCO / Agriculture / Landowner Condition - Choireire (LL #213)	
1696+00	1712+80	Varies	HDD - Little Otter Creek and Plank Road, VELCO	Landowner Condition - Smith (LL #215) and Four Hill Farms (LL #216) Minimum 4 feet
1712+80	1768+00	4	VELCO Access/Agriculture	
1768+00	1768+75	4,5	Road Crossing - Quarry Road	4' in ditch line, 5' under road
1768+75	1775+00	4	Agriculture	
1775+00	1780+20	4		
1780+20	1784+00	4	Landowner Condition - Smith (LL #222)	
1784+00	1786+25	4	Agriculture / Landowner Condition - Smith (LL #222)	
1786+25	1787+25	4	Landowner Condition - Smith (LL #222)	
1787+25	1793+00	4	Agriculture / Landowner Condition - Smith (LL #222)	
1793+00	1794+25	4	Landowner Condition - Smith (LL #222)	
1794+25	1798+50	4	Agriculture / Landowner Condition - Smith (LL #222)	
1798+50	1799+50	4	Landowner Condition - Smith (LL #223)	
1799+50	1841+75	4	Agriculture / Landowner Condition - Smith (LL #223) and Four Hills Farm (LL #225)	
1841+75	1842+75	N/A	Road Crossing - VT State Route 117	Refer to VTRANS Permit plans for depth of cover in this area
1842+75	1863+47	4	VELCO/VELCO Access/Agricultural	
1863+47	1865+48	5	STREAM 2012-SC-CM-63 (I)	
1865+48	1881+50	4	VELCO/VELCO Access/Agricultural	
1881+50	1882+25	4,5	Road Crossing - Town Hill Road	4' in ditch line, 5' under road
1882+25	1888+95	4	VELCO/Agriculture	
1888+95	1899+25	Varies	HDD - Archaeology Site VT-AD-806	Need to be 3 feet under STREAM 2012-TB-CM-62 (P). Need to be 5 feet deep Landowner Condition - Independent Explosives (LL #236)
1899+25	1930+25	4	VELCO / VELCO Access / Agricultural / Landowner Condition - Independent Explosives (LL #236) and Palmer (LL #237)	
1930+25	1939+30	4	Landowner Condition - Middlebury Area Land Trust (LL #238)	
1939+30	1957+50	4		
1957+50	2001+92	4	Agriculture/VELCO Access	
2001+92	2001+99	5	STREAM 2012-SC-CM-61 (E)	
2001+99	2010+50	4	Agriculture/VELCO Access	
2010+50	2012+75	4,5	Road Crossing - Hunt Road	4' in ditch line, 5' under road
2012+75	2020+97	4	VELCO / Agriculture / Landowner Condition - Sturtevant (LL #248)	
2020+97	2029+49	5	VELCO / Agriculture / Landowner Condition - Four Hill Farms (LL #249)	
2029+49	2047+50	5	VELCO / Agriculture / Landowner Condition - Four Hill Farms (LL #252)	
2047+50	2058+00	4	VELCO / Agriculture	
2058+00	2058+69	4	Landowner Condition - Miller and Burke (LL #254)	
2058+69	2058+81	5	STREAM 2012-SC-CM-59 (E)	
2058+81	2059+00	4	Landowner Condition - Miller and Burke (LL #254)	
2059+00	2068+00	4	Agriculture / Landowner Condition - Miller and Burke (LL #254)	
2068+00	2069+50	4	Landowner Condition - Miller and Burke (LL #254)	
2069+50	2070+50	4	Agriculture / Landowner Condition - Miller and Burke (LL #254)	
2070+50	2071+75	4	Landowner Condition - Miller and Burke (LL #254)	


Begin Station	End Station	Min. Depth (ft.)	Reason	Notes
2071+75	2074+80	4	Agriculture / Landowner Condition - Miller and Burke (LL #254)	
2074+80	2080+10	Varies	HDD - New Haven River	Minimum 4 feet of cover Landowner Condition - Miller and Burke (LL #254). Minimum 5 feet of cover Landowner Condition - Four Hill Farms (LL #255)
2080+10	2087+50	5	Agriculture / Landowner Condition - Four Hill Farms (LL #255)	
2087+50	2091+85	5	Landowner Condition - Four Hill Farms (LL #255)	
2091+85	2092+15	5	STREAM 2012-TB/SC-PW-7 (P)	
2092+15	2096+35	5	Landowner Condition - Four Hill Farms (LL #255)	
2096+35	2096+65	5	STREAM 2012-TB/SC-PW-6 (P)	
2096+65	2105+28	5	Landowner Condition - Four Hill Farms (LL #255)	
2105+28	2109+10	4		
2109+10	2109+40	5	STREAM 2012-SC-PW-5 (I)	
2109+40	2113+00	5	Landowner Condition - Four Hill Farms (LL #255)	
2113+00	2113+30	5	STREAM 2012-TB-PW-4 (I)	
2113+30	2126+75	4		
2126+75	2179+88	N/A	Along Vermont State Road	Refer to VTRANS Permit plans for depth of cover in this area, 5 feet under streams

1 DEPTH OF COVER TABLE
N.T.S.

05/2016

SOURCE: CHA/VHB/VGS

DWG. NO.	REFERENCE DWG.	1	GJM	BCK	IFC PLAN EDITS (05/2016)	DESCRIPTION	ENVIRONMENTAL	JLS	06/28/13	BID	JLS	05/2016	VERMONT GAS PROPOSED 12" PIPELINE ADDISON NATURAL GAS PROJECT CONSTRUCTION DETAILS			VERMONT GAS 38 Eastwood Drive, Suite 105 South Burlington, VT 05403 Main: (802) 795-0372 • www.chacompanies.com		
		REV	DSN	CK			DRAFTING DESIGNER	GIL	06/28/13	CONSTRUCTION	GJM	05/2016						
							DRAFTING SUPERVISOR	BZD	06/28/13		BCK	05/2016						
							DESIGN ENGINEER	MDF	06/28/13		GEW	05/2016						
							DESIGN MANAGER	SAB	06/28/13		JEO	05/2016	LOC. CHITTENDEN & ADDISON COUNTIES					
										INITIALS	DATE	INITIALS	DATE	YEAR: 2016	W.O.	SCALE: NOTED	DWG. ANGP-T-G-020A	REV. 1

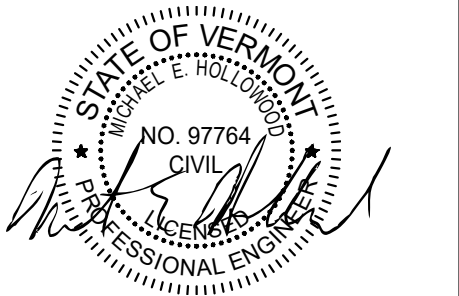

VHB Vanasse Hangen Brustlin, Inc.

Station	Type	Comments
556+65	SAND	
558+16	SAND	
559+66	SAND	
560+63	SAND	
562+30	BENTONITE	
563+35	BENTONITE	
571+00	BENTONITE	
582+92	BENTONITE	
584+80	BENTONITE	
585+25	BENTONITE	
586+21	BENTONITE	
587+27	BENTONITE	
588+37	BENTONITE	
588+78	BENTONITE	
589+18	SAND	
590+00	BENTONITE	
590+39	BENTONITE	
591+87	SAND	
594+06	BENTONITE	
594+97	BENTONITE	
616+31	SAND	
617+76	SAND	
619+31	SAND	
620+81	SAND	
622+31	SAND	
623+79	SAND	
625+30	SAND	
626+80	SAND	
628+30	SAND	
629+81	SAND	
631+26	BENTONITE	
631+55	BENTONITE	
632+81	SAND	
634+30	SAND	
635+81	SAND	
637+31	SAND	
638+81	SAND	
640+57	SAND	
640+94	SAND	
641+95	SAND	
642+93	SAND	
643+94	SAND	
644+94	SAND	
646+17	SAND	
647+66	SAND	
649+17	SAND	
651+07	SAND	
652+52	BENTONITE	
653+16	BENTONITE	
654+84	SAND	
660+29	SAND	
661+29	SAND	
662+30	SAND	
683+77	SAND	
685+27	SAND	
686+78	SAND	
688+28	SAND	
689+79	SAND	
691+29	SAND	
692+77	SAND	
694+29	SAND	
695+77	SAND	
697+27	SAND	
698+78	SAND	
700+28	SAND	
701+78	SAND	
703+27	SAND	
704+27	SAND	
706+20	BENTONITE	
707+00	BENTONITE	
707+91	SAND	
709+27	SAND	
710+32	SAND	
726+82	BENTONITE	
728+11	BENTONITE	
731+39	SAND	
753+49	BENTONITE	
754+68	BENTONITE	
763+13	SAND	
765+50	BENTONITE	

Station	Type	Comments
766+70	BENTONITE	
779+19	BENTONITE	
780+18	BENTONITE	
787+68	SAND	
799+53	BENTONITE	
799+86	BENTONITE	
800+91	SAND	
802+40	SAND	
803+91	SAND	
805+41	SAND	
806+34	SAND	
810+67	SAND	
811+47	SAND	
812+25	SAND	
813+06	SAND	
813+86	SAND	
814+83	SAND	
815+41	SAND	
816+26	SAND	
832+77	BENTONITE	
833+64	BENTONITE	
838+50	BENTONITE	
840+36	BENTONITE	
843+67	BENTONITE	
844+20	BENTONITE	
854+78	BENTONITE	
855+66	BENTONITE	
866+91	SAND	
870+39	SAND	
871+95	SAND	
878+41	SAND	
879+93	SAND	
881+42	SAND	
882+92	SAND	
884+41	SAND	
885+90	SAND	
887+42	SAND	
888+96	SAND	
890+49	SAND	
893+44	SAND	
894+93	SAND	
896+45	SAND	
898+05	SAND	
899+56	SAND	
901+04	SAND	
902+55	BENTONITE	
905+65	BENTONITE	
945+26	SAND	
946+79	SAND	
948+29	SAND	
949+81	SAND	
951+30	SAND	
952+78	SAND	
955+18	SAND	
956+00	SAND	
957+03	SAND	
958+04	SAND	
959+01	SAND	
960+05	SAND	
961+02	SAND	
995+65	BENTONITE	
1004+23	BENTONITE	
1005+00	BENTONITE	
1014+16	BENTONITE	
1023+10	BENTONITE	
1078+51	BENTONITE	
1080+19	BENTONITE	
1087+77	BENTONITE	
1088+03	BENTONITE	
1100+77	BENTONITE	
1101+68	BENTONITE	
1102+05	BENTONITE	
1103+05	BENTONITE	
1103+88	SAND	
1104+68	SAND	
1105+50	SAND	
1106+30	SAND	
1107+14	SAND	
1107+91	SAND	
1108+70	SAND	

Station	Type	Comments
1109+50	SAND	
1110+32	SAND	
1111+14	SAND	
1111+92	SAND	
1112+71	SAND	
1113+22	SAND	
1114+02	SAND	
1114+82	SAND	
1116+37	BENTONITE	
1118+41	BENTONITE	
1119+95	SAND	
1121+44	SAND	
1122+93	SAND	
1124+44	SAND	
1124+89	SAND	
1126+58	SAND	
1128+12	SAND	
1129+08	SAND	
1130+59	SAND	
1131+70	SAND	
1135+40	SAND	
1136+43	SAND	
1137+41	SAND	
1138+40	SAND	
1139+39	SAND	
1140+40	SAND	
1141+41	SAND	
1142+41	SAND	
1143+55	BENTONITE	
1143+85	BENTONITE	
1149+73	SAND	
1150+57	SAND	
1158+77	SAND	
1159+93	SAND	
1161+19	SAND	
1162+42	SAND	
1163+68	SAND	
1164+93	SAND	
1166+20	SAND	
1167+12	SAND	
1180+41	BENTONITE	
1184+61	SAND	
1185+86	SAND	
1188+55	SAND	
1189+97	SAND	
1191+49	SAND	
1192+98	SAND	
1222+24	SAND	
1223+70	SAND	
1225+21	SAND	
1226+68	SAND	
1227+82	SAND	
1233+97	BENTONITE	
1234+25	BENTONITE	
1238+67	BENTONITE	
1240+03	BENTONITE	
1243+93	BENTONITE	
1246+28	BENTONITE	
1247+72	BENTONITE	
1249+97	BENTONITE	
1258+54	BENTONITE	
1260+25	BENTONITE	
1263+17	BENTONITE	
1263+93	BENTONITE	
1271+13	BENTONITE	
1271+45	BENTONITE	
1288+00	BENTONITE	
1288+29	BENTONITE	
1297+30	BENTONITE	
1301+00	BENTONITE	
1301+77	BENTONITE	
1302+70	BENTONITE	
1303+78	BENTONITE	
1306+46	BENTONITE	
1307+81	BENTONITE	
1308+77	BENTONITE	
1310+74	BENTONITE	
1313+38	BENTONITE	
1314+20	BENTONITE	
1314+92	BENTONITE	

ELEVATION DATA IS SPORADIC IN THIS LOCATION. VGS CONSTRUCTION MANAGEMENT TO DETERMINE LOCATION OF SAND TRENCH BREAKERS IN FIELD.

Station	Type	Comments
1356+97	BENTONITE	
1357+42	BENTONITE	
1359+49	BENTONITE	
1360+35	BENTONITE	
1372+82	SAND	
1374+31	SAND	
1380+74	SAND	
1381+62	SAND	
1382+54	SAND	
1383+45	SAND	
1384+33	SAND	
1385+45	SAND	
1386+93	SAND	
1388+41	SAND	
1389+94	SAND	
1391+45	SAND	
1392+93	SAND	
1394+59	SAND	
1395+56	SAND	
1396+62	SAND	
1398+16	BENTONITE	
1399+18	BENTONITE	
1399+93	SAND	
1402+65	SAND	
1403+90	SAND	
1405+15	SAND	
1405+71	BENTONITE	
1405+95	BENTONITE	
1406+30	SAND	
1406+82	SAND	
1407+62	SAND	
1408+41	SAND	
1409+20	SAND	
1410+05	SAND	
1410+79	SAND	
1411+60	SAND	
1412+43	SAND	
1413+21	SAND	
1414+01	SAND	
1414+85	SAND	
1415+64	SAND	
1416+25	SAND	
1417+78	SAND	
1418+08	SAND	
1418+93	SAND	
1419+86	SAND	
1420+75	SAND	
1421+68	SAND	
1422+56	SAND	
1423+43	SAND	
1424+36	SAND	
1425+27	SAND	
1426+14	SAND	
1427+07	SAND	
1427+96	SAND	
1428+85	SAND	
1429+64	BENTONITE	
1433+85	BENTONITE	
1436+41	BENTONITE	
1439+00-1463+00	ELEVATION DATA IS SPORADIC IN THIS LOCATION. VGS CONSTRUCTION MANAGEMENT TO DETERMINE LOCATION OF SAND TRENCH BREAKERS IN FIELD.	
1472+42	BENTONITE	
1473+74	BENTONITE	
1503+85	BENTONITE	
1506+89	BENTONITE	
1536+26	BENTONITE	
1537+46	BENTONITE	
1538+20	SAND	
1539+73	SAND	
1541+20	SAND	
1541+95	SAND	
1544+02	SAND	
1545+51	SAND	
1547+05	SAND	
1548+52	SAND	
1549+35	SAND	
1550+87	SAND	
1552+35	SAND	
1553+86	SAND	
1555+35	SAND	

ELEVATION DATA IS SPORADIC IN THIS LOCATION. VGS CONSTRUCTION MANAGEMENT TO DETERMINE LOCATION OF SAND TRENCH BREAKERS IN FIELD.

1 TRENCH BREAKER LOCATION
N.T.S. SOURCE: CHA 05/2016

NOTE: THE FOLLOWING APPROXIMATE STATIONS ARE THE MINIMUM LOCATIONS FOR BOTH SAND AND BENTONITE TRENCH BREAKERS FOR SEGMENT 2 & 3 OF THE ADDISON NATURAL GAS PROJECT. THIS LIST WAS CREATED USING INFORMATION FROM DETAILS #2 AND #5 ON DRAWING ANGP-T-G-015 REV. 2 FROM THE PLAN SET TITLED "ADDISON NATURAL GAS PROJECT TRANSMISSION MAINLINE" DATED 04-02-15. THE CONSTRUCTION MANAGEMENT TEAM/INSPECTORS SHOULD REVIEW ACTUAL FIELD CONDITIONS AND DIRECT THE CONTRACTOR TO INSTALL ADDITIONAL TRENCH BREAKERS AS NECESSARY TO SUPPLEMENT THE LISTED AREAS.




DWG. NO.	REFERENCE DWG.	REV	DSN	BCK	CK	DESCRIPTION	INITIALS	DATE	INITIALS	DATE	YEAR: 2016	W.O.	SCALE: NOTED	DWG. ANGP-T-G-020B	REV. 1
		1	GJM	BCK		IFC PLAN EDITS (05/2016)									


VHB Vanasse Hangen Brustlin, Inc.




	BID	CONSTRUCTION
ENVIRONMENTAL	JLS 06/28/13	JLS 05/2016
DRAFTING DESIGNER	GIL 06/28/13	GJM 05/2016
DRAFTING SUPERVISOR	BZD 06/28/13	BCK 05/2016
DESIGN ENGINEER	MDF 06/28/13	GEW 05/2016
DESIGN MANAGER	SAB 06/28/13	JEO 05/2016

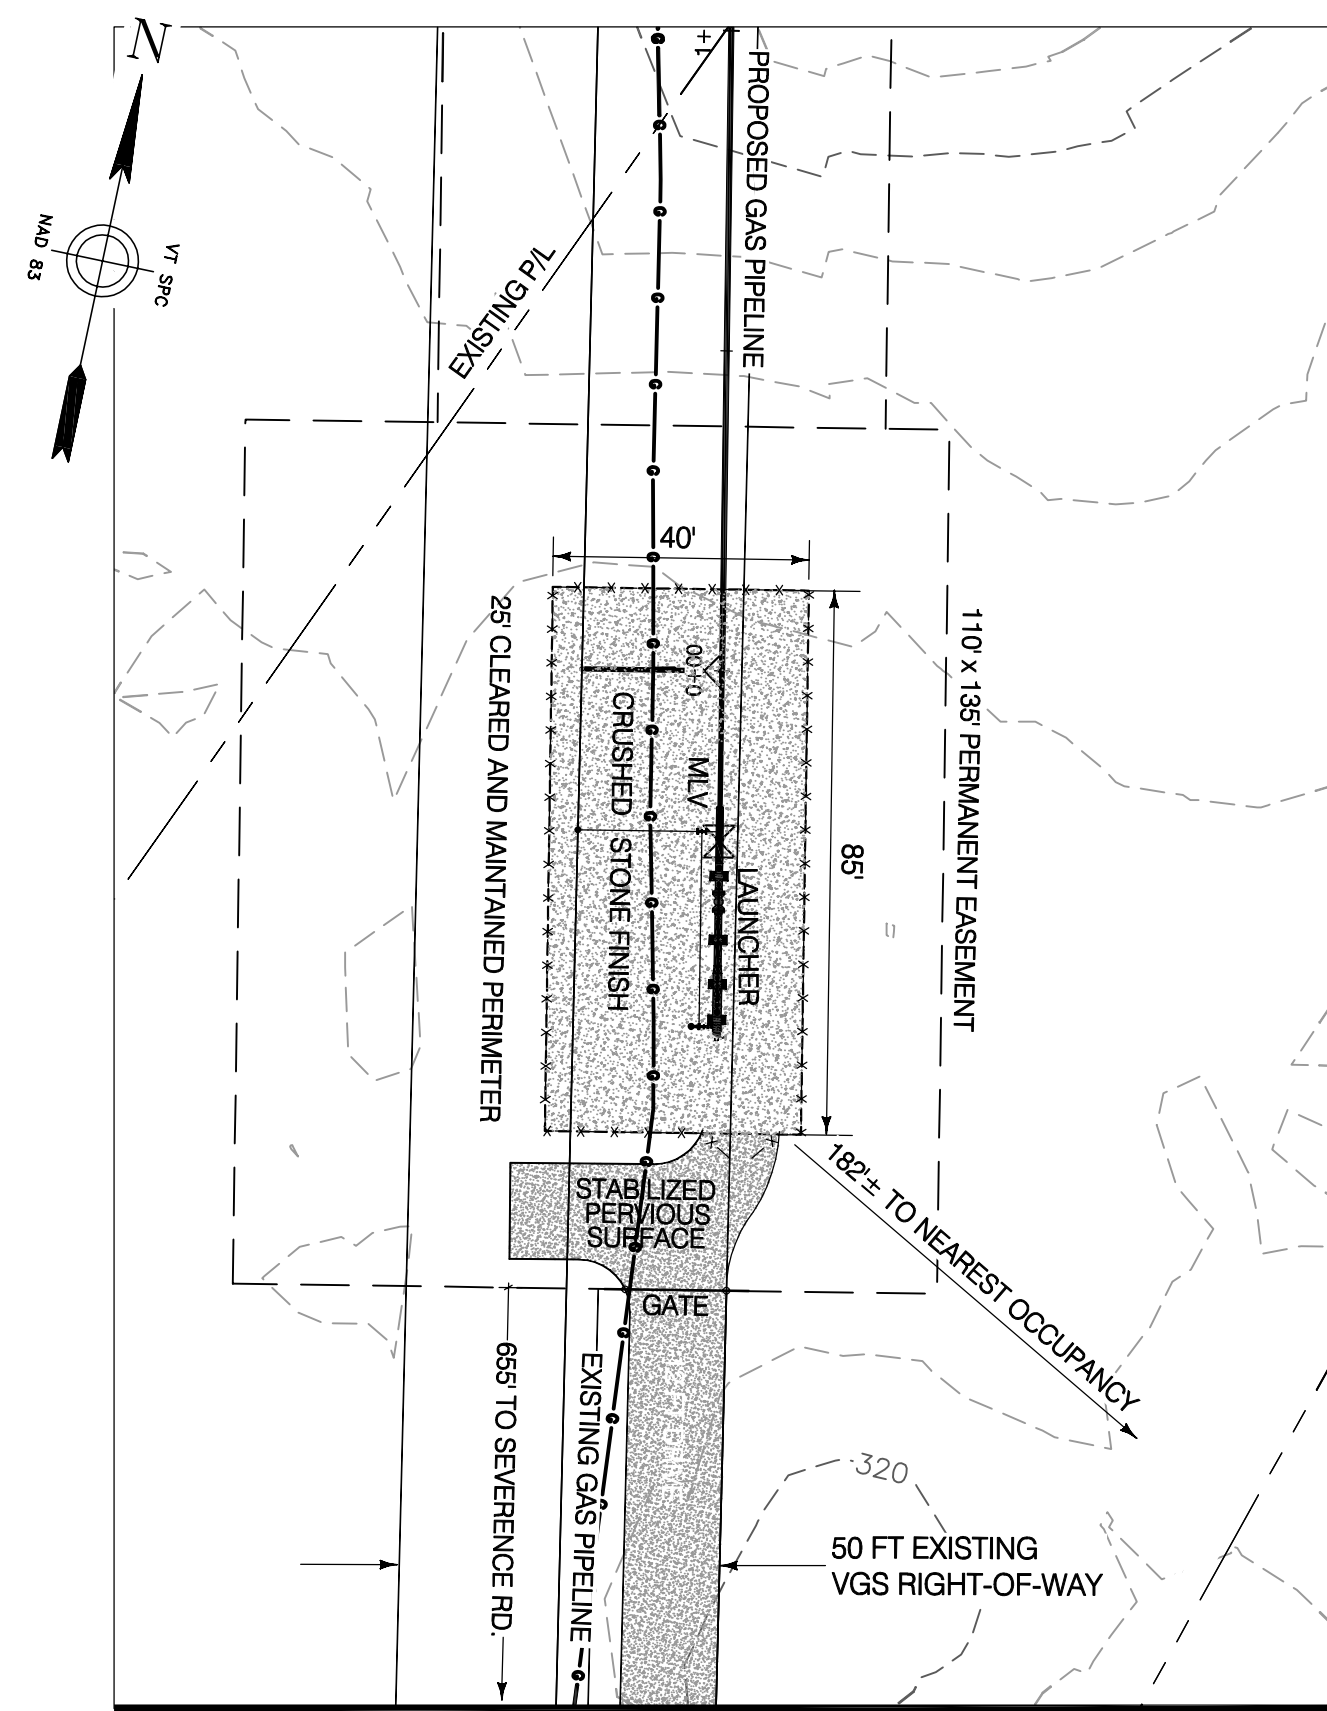


1 Colchester Tie-In 4/30
Scale: 1"=30'

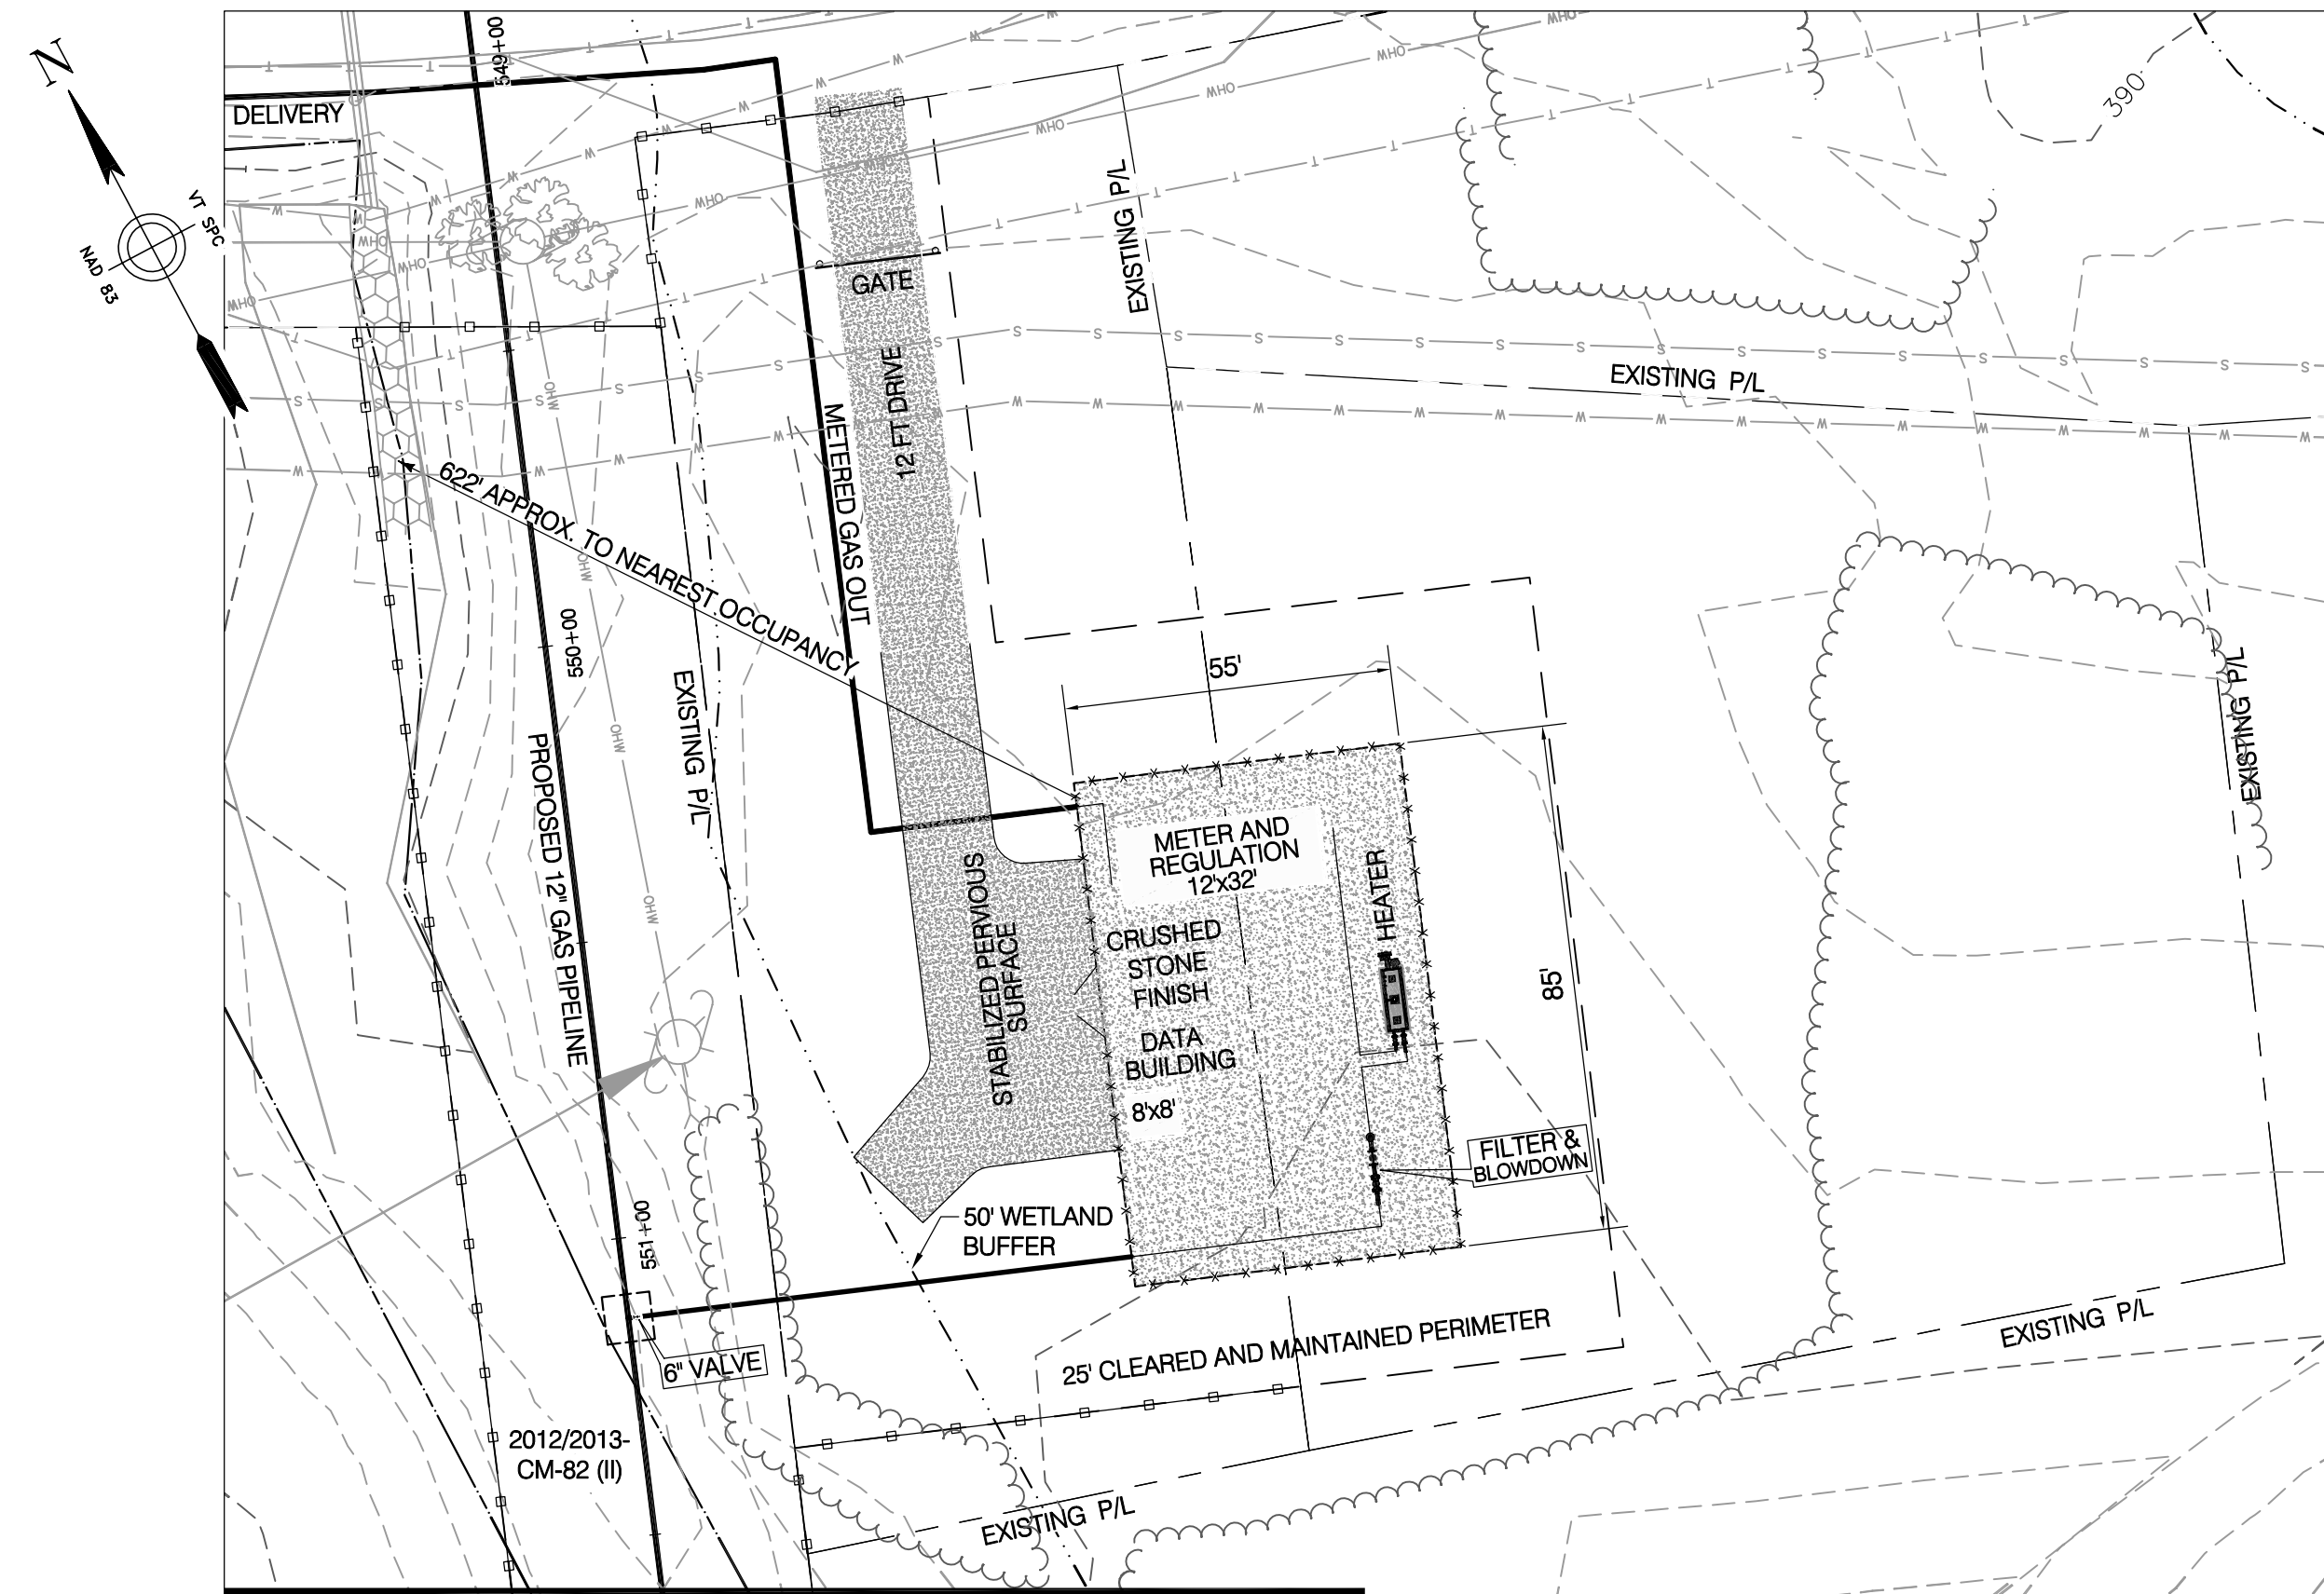


2 Williston Road Station 4/30
Scale: 1"=30'

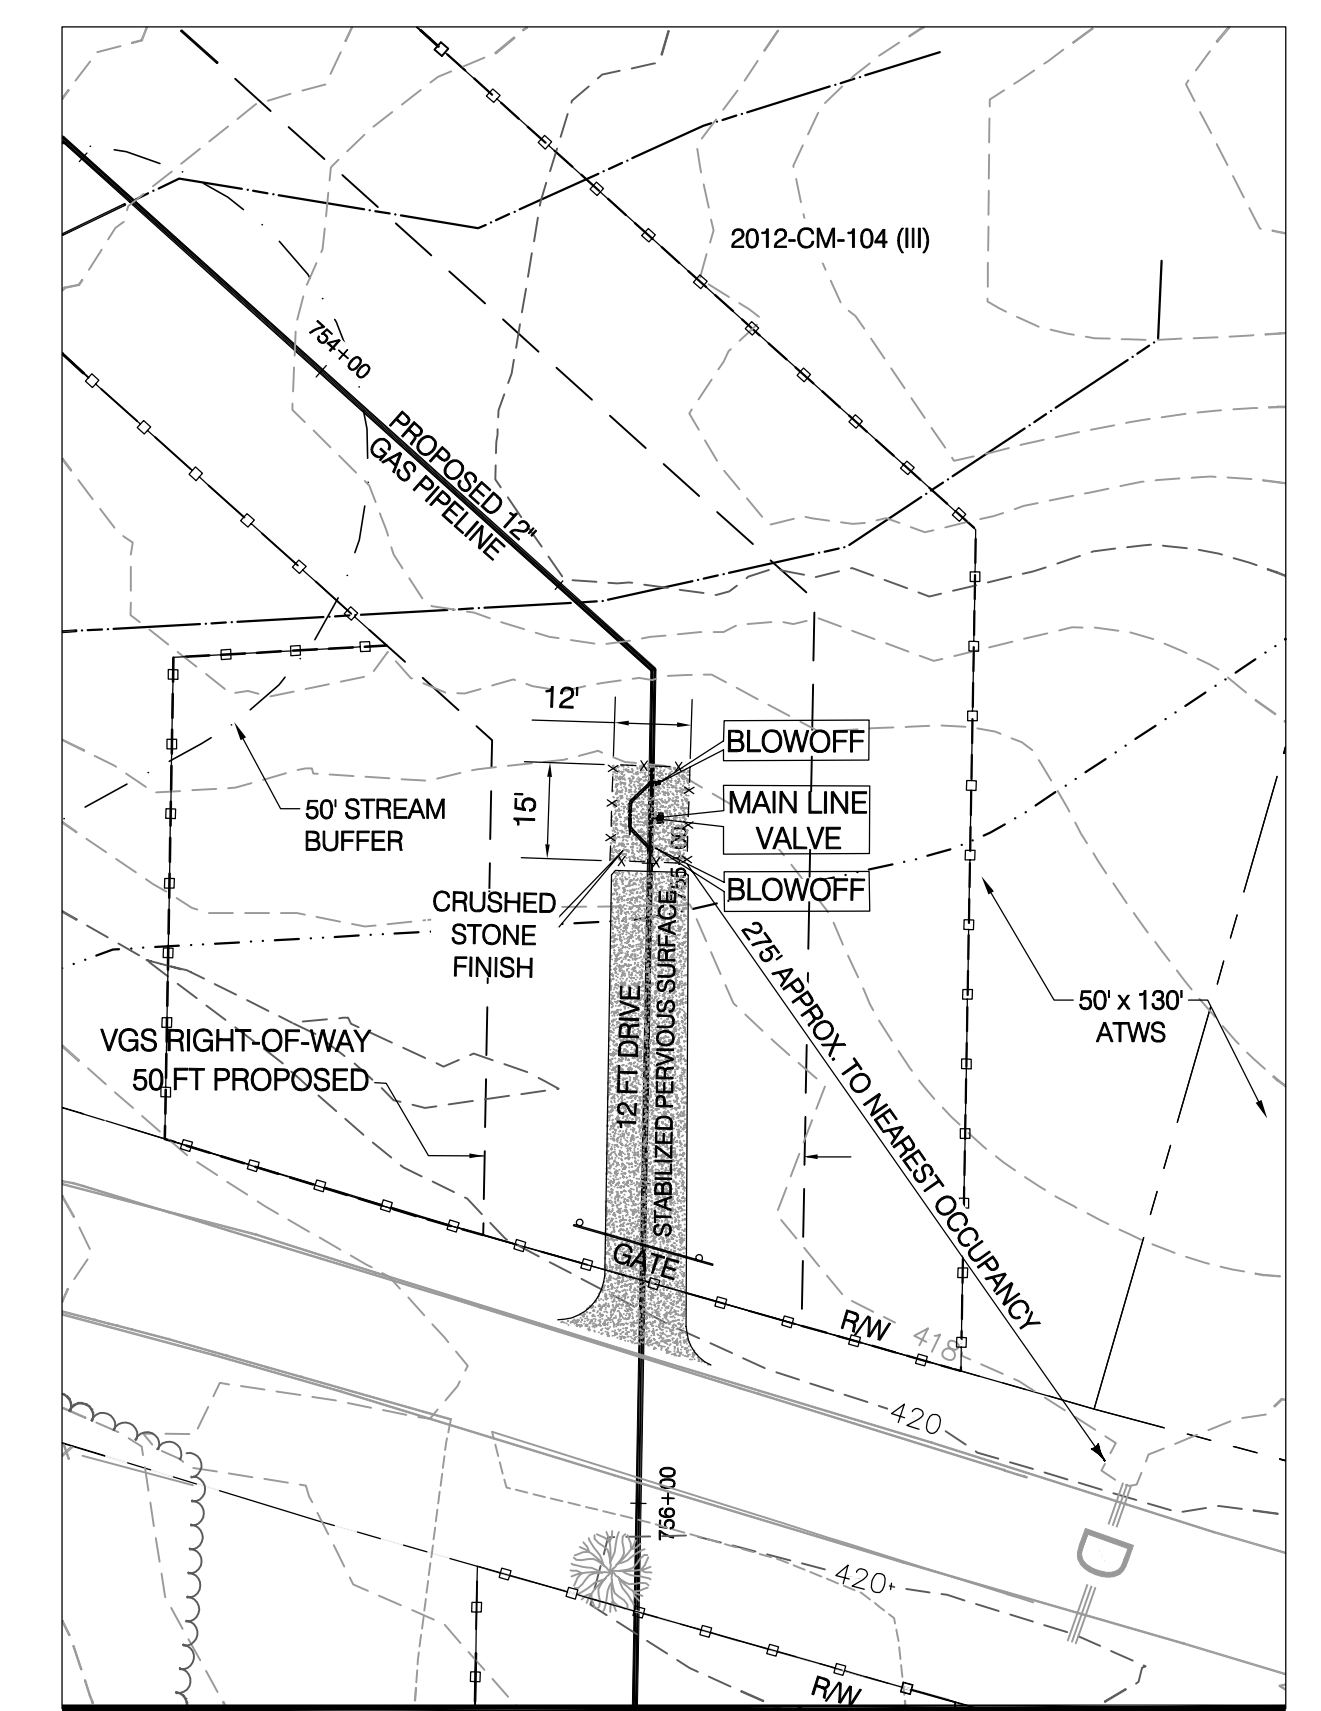

3 Typical Main Line Valve 4/30
Scale: 1"=30'

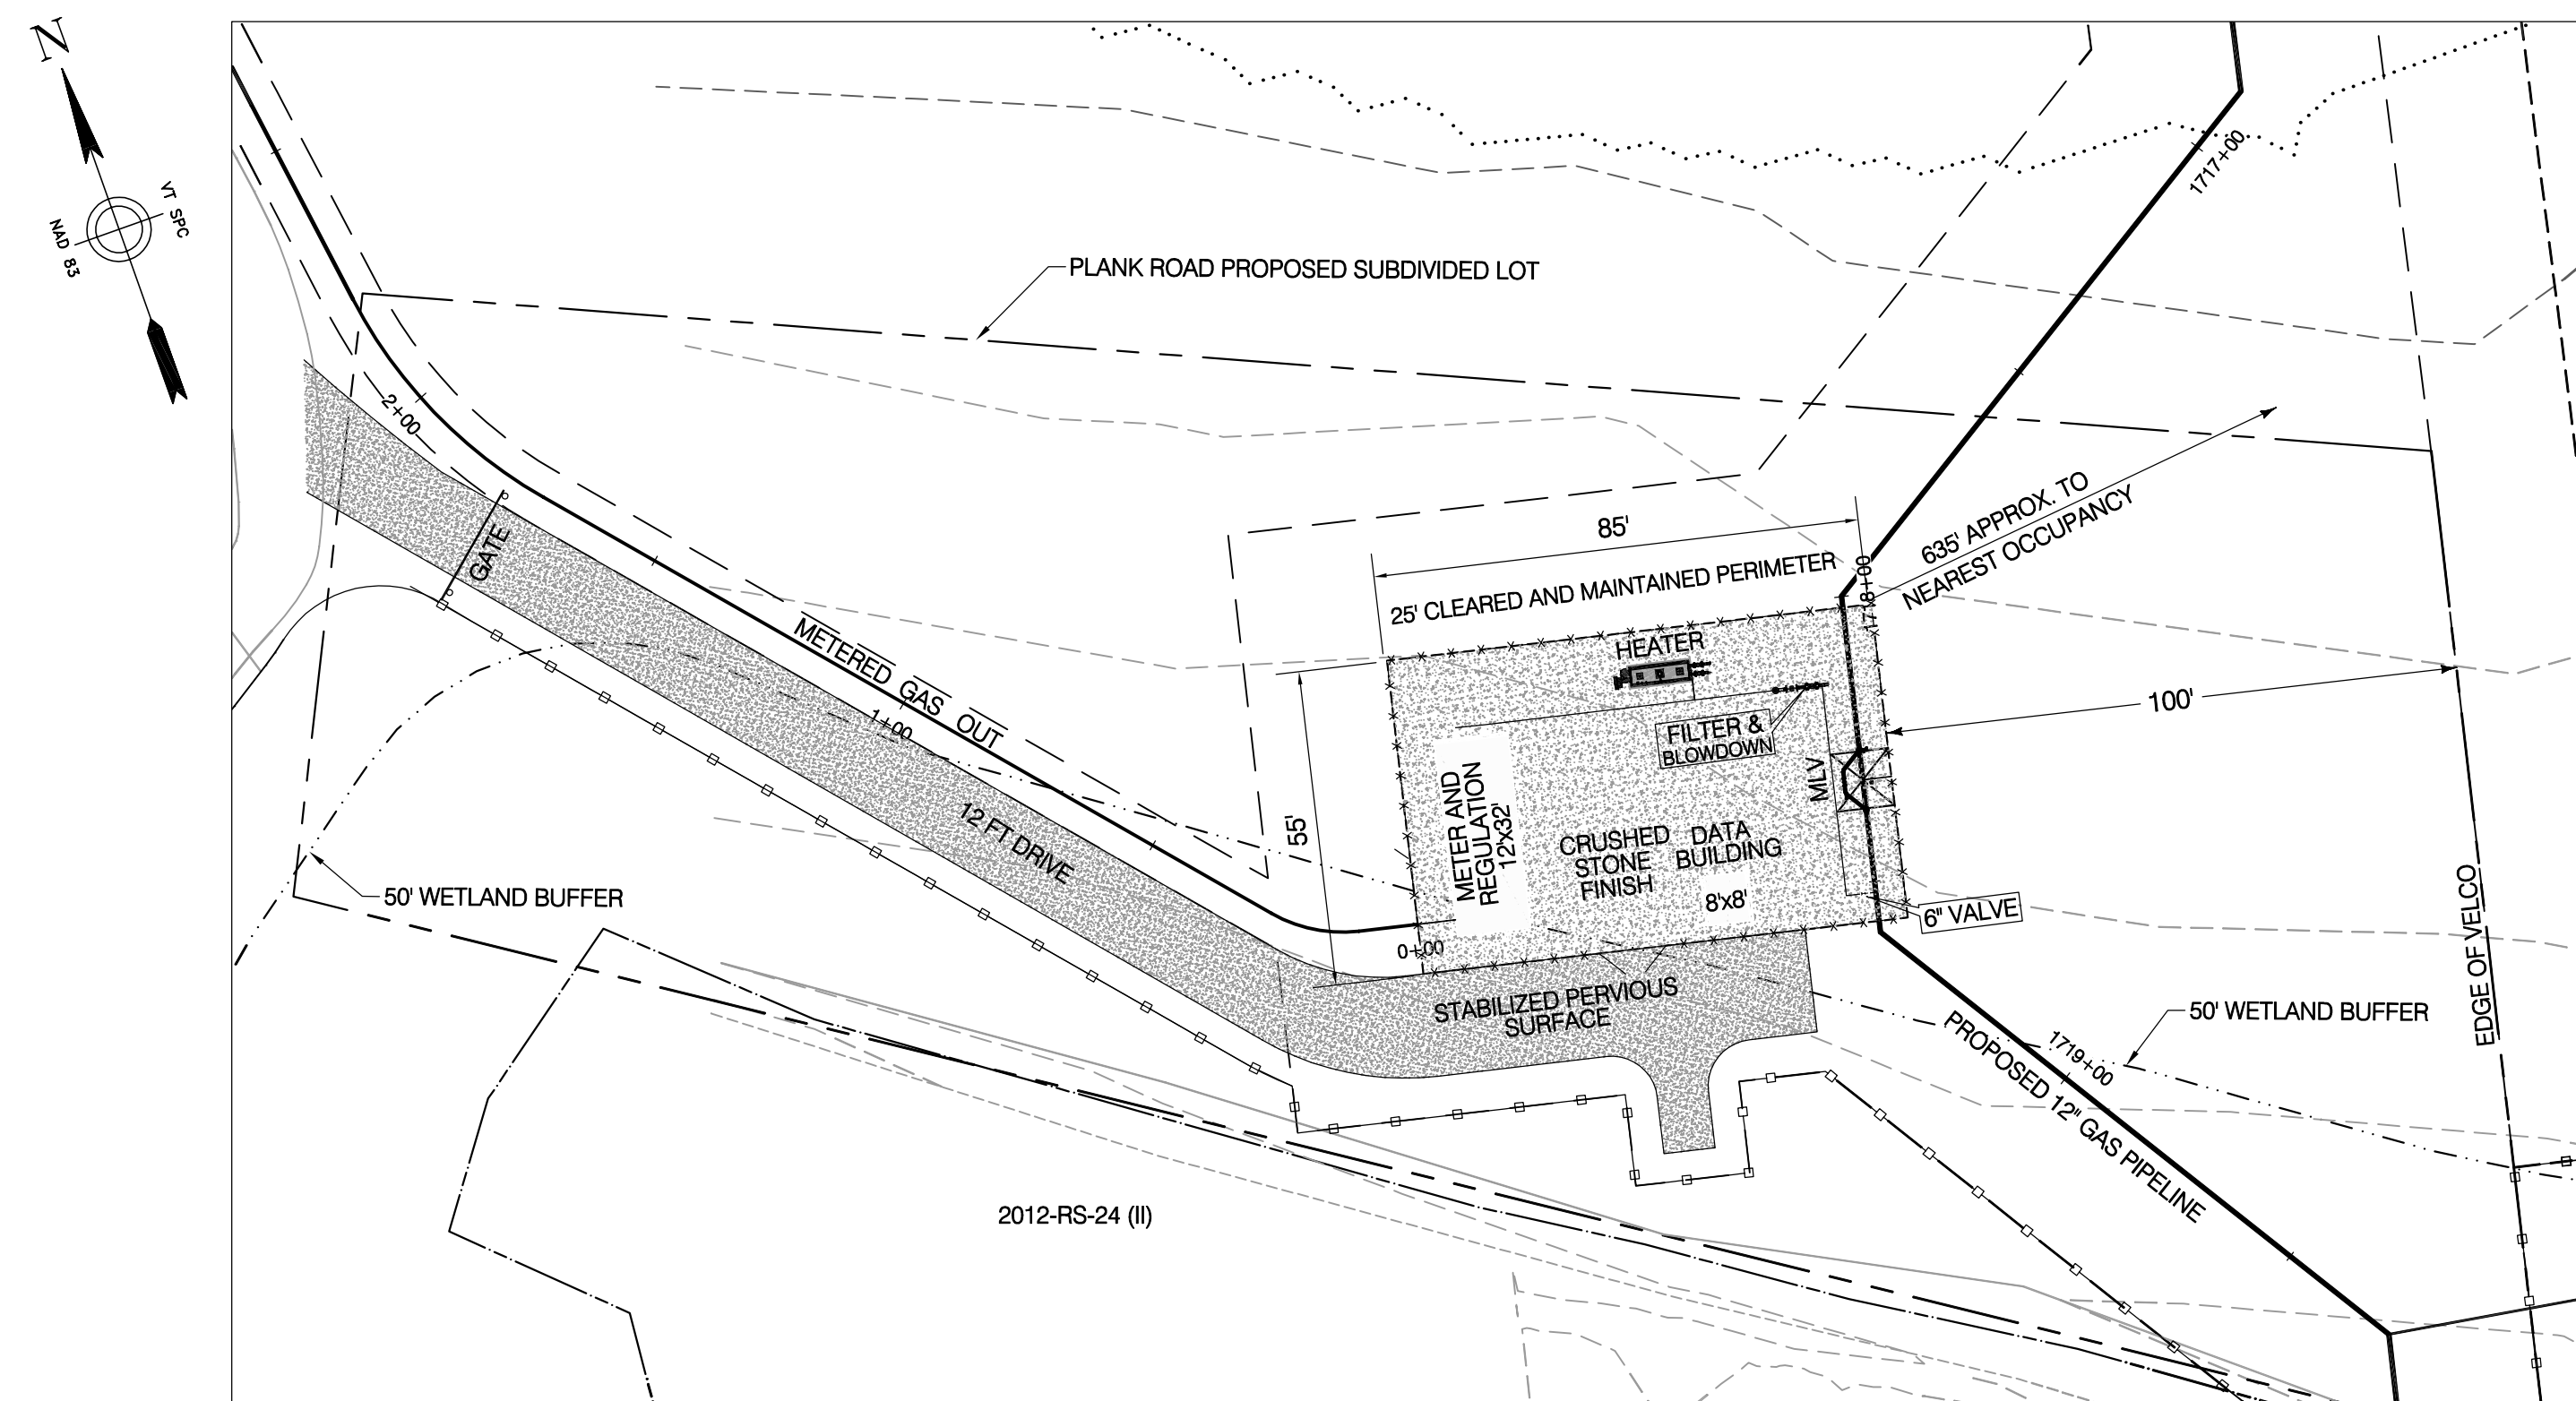

4 Plank Road Station 4/30
Scale: 1"=30'

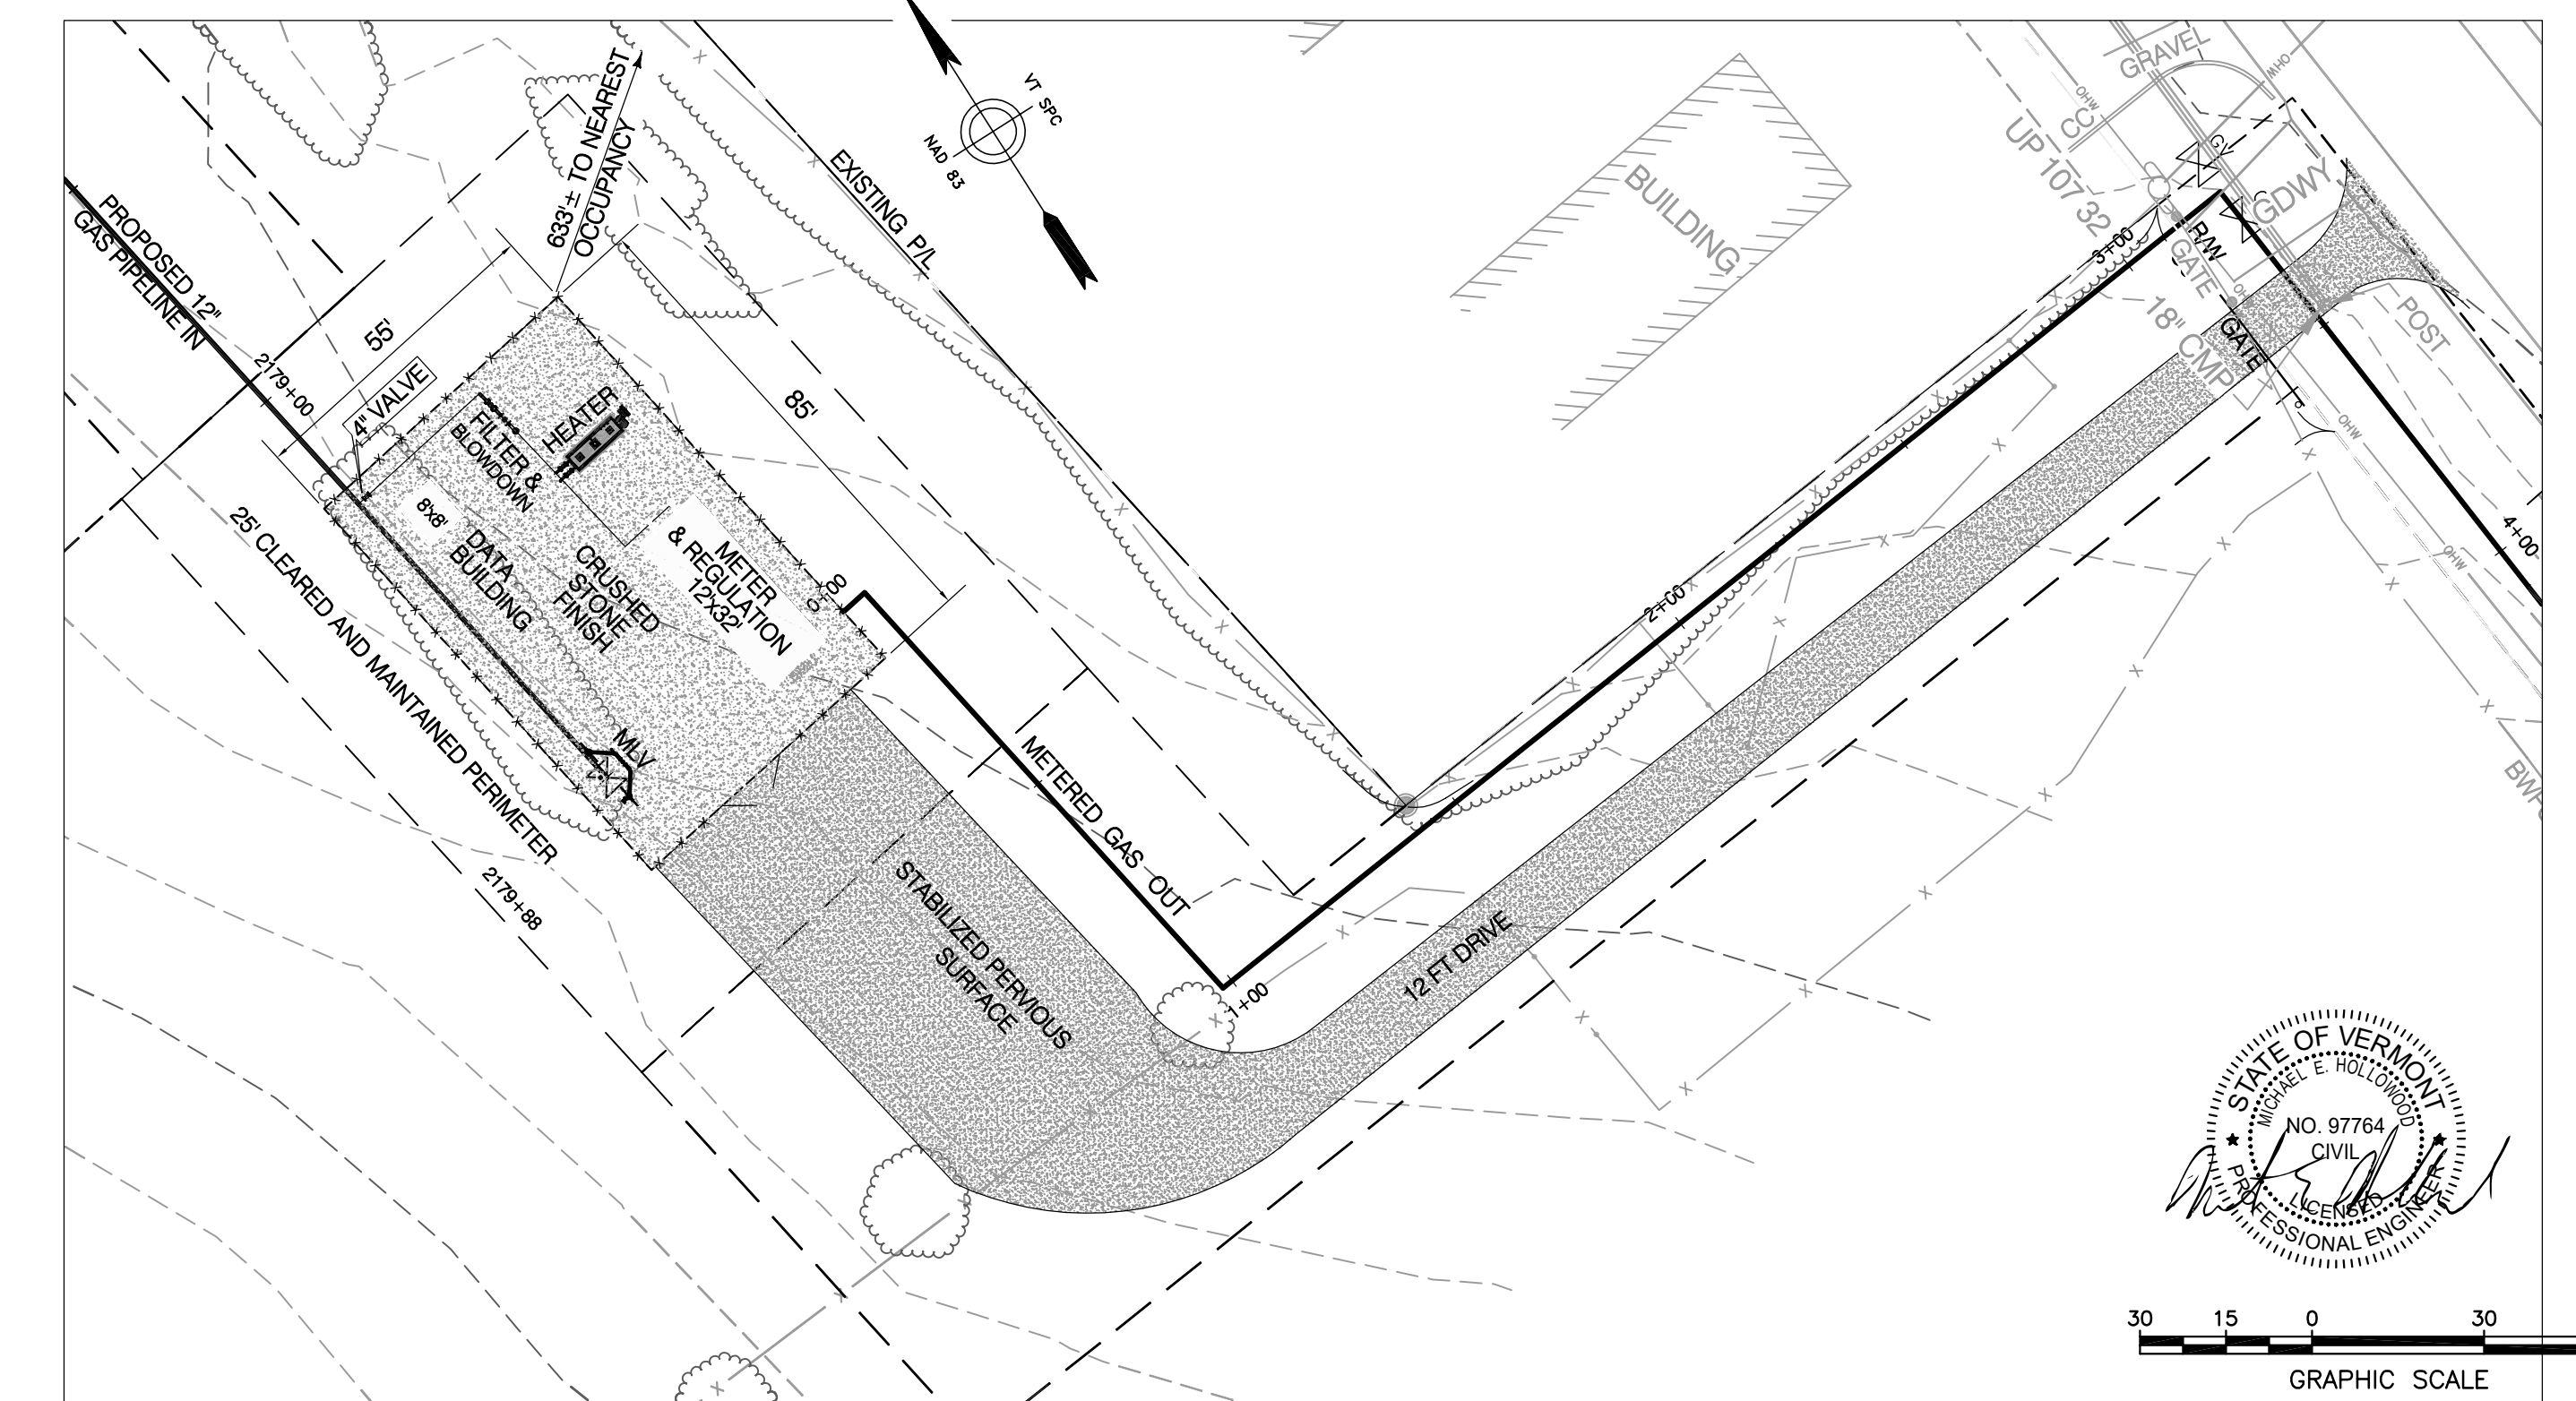

5 Middlebury Station RT 7 4/30
Scale: 1"=30'

DWG. NO.	REFERENCE DWG.	REV	DSN	CK	DESCRIPTION	INITIALS	DATE	INITIALS	DATE	YEAR:	W.O.	SCALE:	DWG.	ANGP-T-G-021	REV.
15-713-G-500	TYPICAL MAIN LINE VALVE					JLS	06/28/13	JLS	05/2016	2016		AS NOTED			0
15-713-G-400	COLCHESTER TIE IN					GIL	06/28/13	GJM	05/2016						
15-713-G-300	MIDDLEBURY STATION RT 7					BZD	06/28/13	BCK	05/2016						
15-713-G-200	PLANK ROAD STATION					MDF	06/28/13	GEW	05/2016						
15-713-G-100	WILLISTON ROAD STATION					SAB	06/28/13	JEO	05/2016						

VERMONT GAS
PROPOSED 12" PIPELINE
ADDITION NATURAL GAS PROJECT
STATION AND VALVE DETAILS



LOC. CHITTENDEN & ADDISON COUNTIES

YEAR: 2016 W.O. SCALE: AS NOTED DWG. ANGP-T-G-021 REV. 0

VHB Vanasse Hangen Brustlin, Inc.



CIA
38 Eastwood Drive, Suite 105
South Burlington, VT 05403
Main: (802) 795-0372 • www.chocompanies.com

TOWN OF WILLISTON
CHITTENDEN COUNTY

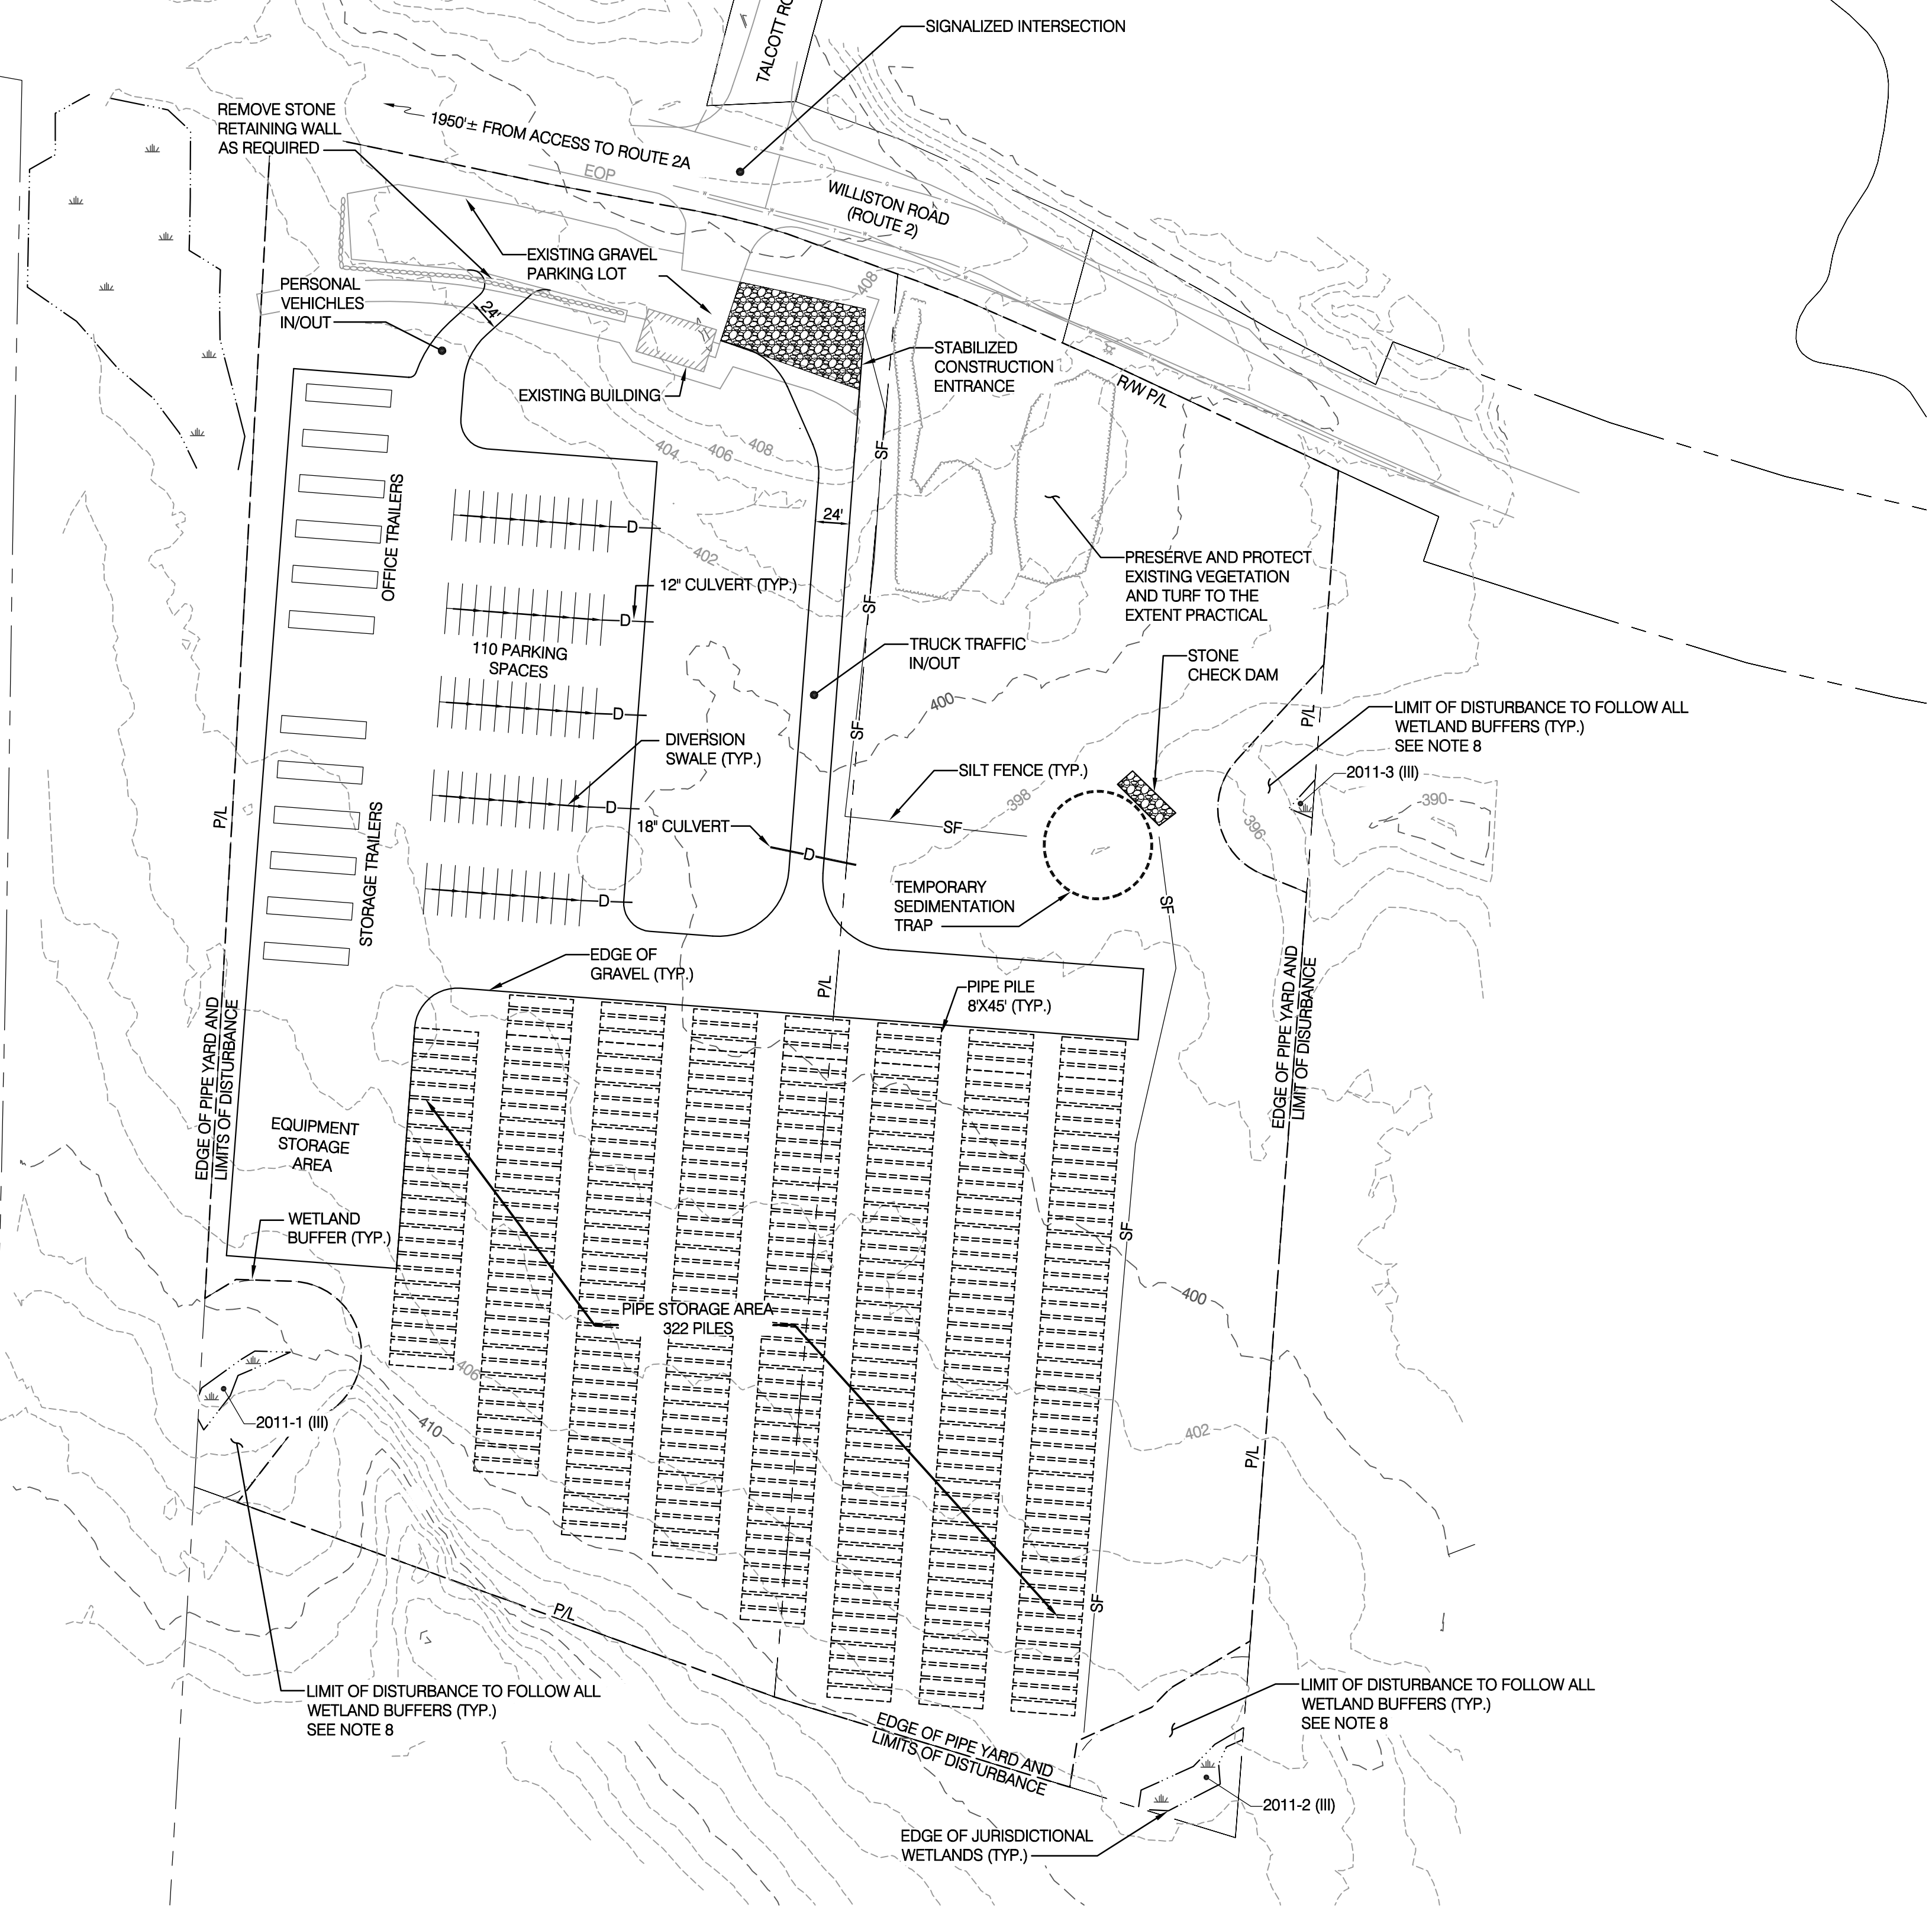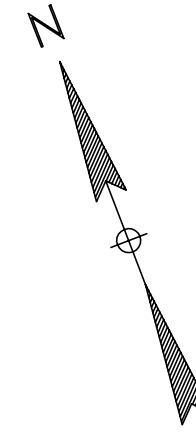

NOTES:

- PURPOSE OF PLAN: TO SHOW A GENERAL LAYOUT CONFIGURATION OF A CONSTRUCTION LAYDOWN AREA (PIPE YARD) ON THE SHOWN PARCELS.
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR SITE SECURITY AND JOB SAFETY. CONSTRUCTION ACTIVITIES SHALL BE IN ACCORDANCE WITH OSHA AND LOCAL REQUIREMENTS.
- THIS PROJECT FALLS WITHIN THE INDIVIDUAL NPDES CONSTRUCTION STORMWATER PERMIT PROGRAM. THE CONTRACTOR SHALL FOLLOW THE CONDITIONS OF THE INDIVIDUAL PERMIT AND EROSION AND SEDIMENT CONTROL PLAN (EPCS).
- THE CONTRACTOR SHALL NOTIFY DIG-SAFE (1-888-344-7233) AT LEAST 72 HOURS BEFORE ANY EXCAVATION.
- STORMWATER SHALL BE DIRECTED TO THE TEMPORARY SEDIMENT TRAP THROUGH THE USE OF DIVERSION SWALES, PIPES, WATERS, OR BY OTHER APPROVED METHODS AND MEANS.
- LIMIT OF DISTURBANCE (LOD) TAPE AND/OR FENCE AND/OR FLAGGING SHALL BE INSTALLED PER DETAILS 1 AND 3-5, AS INDICATED ON EPSC PLAN SHEET ANGP-T-G-012.
- LOD TAPE, FENCE, OR FLAGGING SHALL NOT CROSS ACTIVE ENTRANCE/EXITS OR IMPEDE DRAINAGE FLOW PATHS (E.G. SEDIMENT TRAP OUTFALL).
- LOD SHALL BE EXTERNAL TO ANY JURISDICTIONAL WETLAND, WETLAND BUFFER, AND/OR OTHER NATURAL RESOURCE AREAS. THE CONTRACTOR SHALL PRESERVE AND PROTECT SAID AREAS TO THE EXTENT NECESSARY.

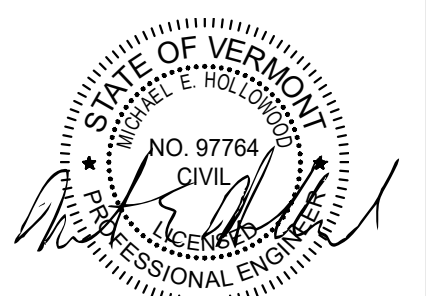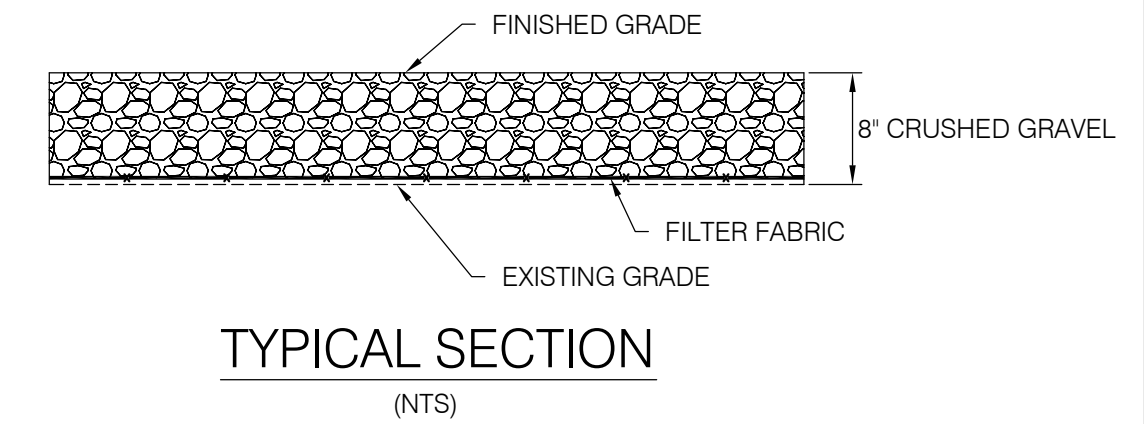

VHB Vanasse Hangen Brustlin, Inc.



DWG. NO.	REFERENCE DWG.	REV	DSN	CK	DESCRIPTION	INITIALS	DATE	INITIALS	DATE	YEAR:	W.O.	SCALE:	DWG.	ANGP-T-G-022	REV.
										2016		1"=80'			0

		BID	CONSTRUCTION
ENVIRONMENTAL	JLS	06/28/13	JLS 05/2016
DRAFTING DESIGNER	GIL	06/28/13	GJM 05/2016
DRAFTING SUPERVISOR	BZD	06/28/13	BCK 05/2016
DESIGN ENGINEER	MDF	06/28/13	GEW 05/2016
DESIGN MANAGER	SAB	06/28/13	JEO 05/2016


VERMONT GAS
PROPOSED 12" PIPELINE
ADDISON NATURAL GAS PROJECT
WILLISTON PIPEYARD
LOC. CHITTENDEN COUNTY
YEAR: 2016 W.O.

38 Eastwood Drive, Suite 105
South Burlington, VT 05403
Main: (802) 795-0372 - www.chacompanies.com

TOWN OF NEW HAVEN
ADDISON COUNTY

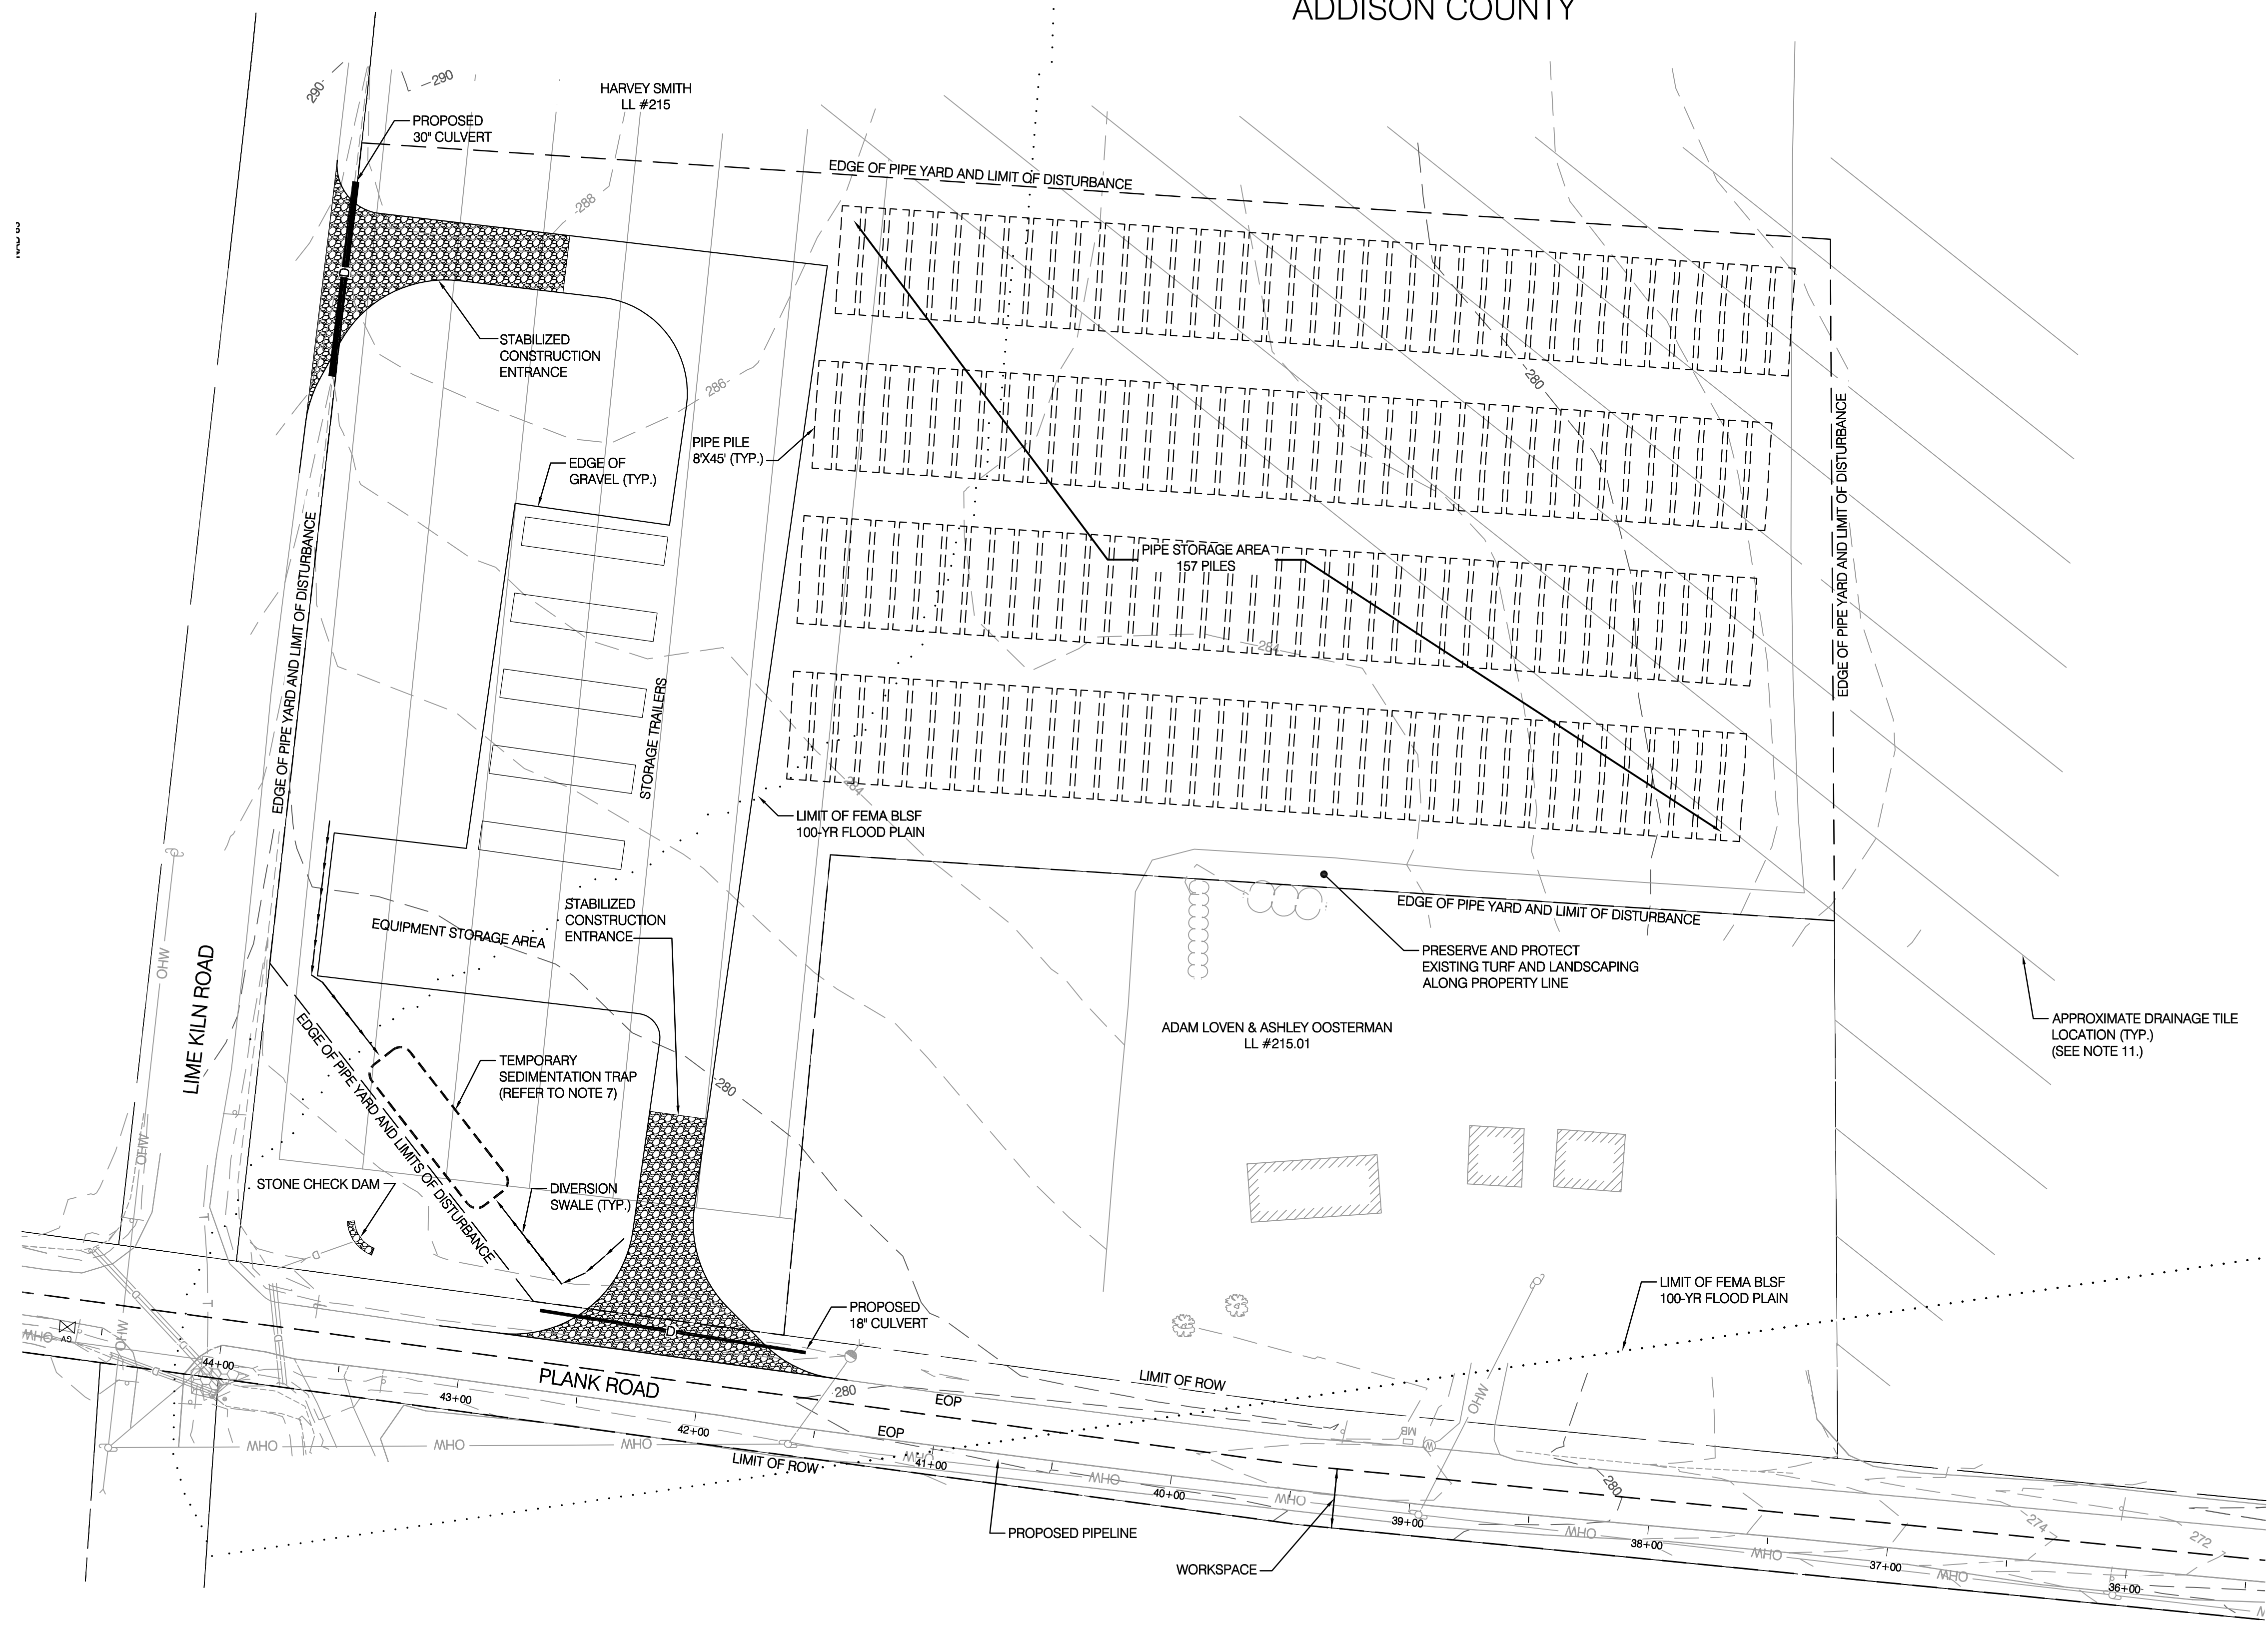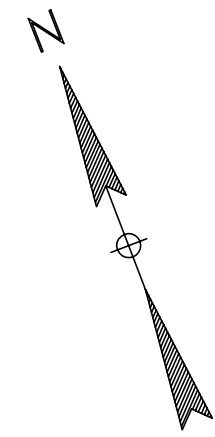

- NOTES:**
- PURPOSE OF PLAN: TO SHOW A GENERAL LAYOUT CONFIGURATION OF A CONSTRUCTION LAYDOWN AREA (PIPE YARD) ON THE SHOWN PARCELS.
 - THE CONTRACTOR SHALL BE RESPONSIBLE FOR SITE SECURITY AND JOB SAFETY. CONSTRUCTION ACTIVITIES SHALL BE IN ACCORDANCE WITH OSHA AND LOCAL REQUIREMENTS.
 - THIS PROJECT FALLS WITHIN THE INDIVIDUAL NPDES CONSTRUCTION STORMWATER PERMIT PROGRAM. THE CONTRACTOR SHALL FOLLOW THE CONDITIONS OF THE INDIVIDUAL PERMIT AND EROSION PREVENTION AND SEDIMENT CONTROL PLAN (EPSC).
 - THE CONTRACTOR SHALL NOTIFY DIG-SAFE (1-888-344-7233) AT LEAST 72 HOURS BEFORE ANY EXCAVATION.
 - TOPSOIL IN ALL DISTURBED AREAS SHALL BE RESTORED TO ITS ORIGINAL CONDITION UPON DECOMMISSIONING OF SITE, PER STABILIZATION NOTES ON EPSC PLAN SHEET ANGP-T-G-011.
 - THE EXISTING FIELD, CONTAINS UNDERDRAINAGE/DRAINAGE TILE WHICH SHALL BE PROTECTED DURING CONSTRUCTION, IF UNDERDRAINAGE SYSTEM IS DAMAGED, IT SHALL BE REPLACED UPON DECOMMISSIONING OF SITE.
 - THE TEMPORARY SEDIMENT TRAP SHALL BE A 'STONE OUTLET SEDIMENT TRAP' AS INDICATED ON EPSC PLAN SHEET ANGP-T-G-016. THE TRAP SHALL BE INSTALLED SUCH THAT THE BOTTOM ELEVATION OF THE TRAP IS NO LOWER, THAN THE BOTTOM ELEVATION OF THE EXISTING TOP SOIL, TO PREVENT DAMAGE TO THE EXISTING UNDERDRAINAGE SYSTEM.
 - STORMWATER SHALL BE DIRECTED TO THE TEMPORARY SEDIMENT TRAP THROUGH THE USE OF DIVERSION SWALES, PIPES, WATER BARS OR BY OTHER APPROVED METHODS AND MEANS.
 - LIMIT OF DISTURBANCE (LOD) TAPE, AND/OR FENCE, AND/OR FLAGGING SHALL BE INSTALLED PER DETAILS 1 AND 3-5 AS INDICATED ON EPSC PLAN SHEET ANGP-T-G-012.
 - LOD TAPE, FENCE, OR FLAGGING SHALL NOT CROSS ACTIVE ENTRANCES/EXITS OR IMPEDE DRAINAGE FLOWPATHS (E.G. SEDIMENT TRAP OUTFALL).
 - DRAINAGE TILE LOCATIONS SHOWN HEREON ARE APPROXIMATE AND BASED ON INFORMATION PROVIDED BY THE LAND OWNER AND CONTRACTOR THAT INSTALLED THE DRAINAGE INFRASTRUCTURE.
 - DEPTH OF CRUSHED GRAVEL SHALL BE DETERMINED BY CONTRACTOR BASED ON EXISTING SOIL CONDITIONS AND PIPE YARD MEANS AND METHODS.

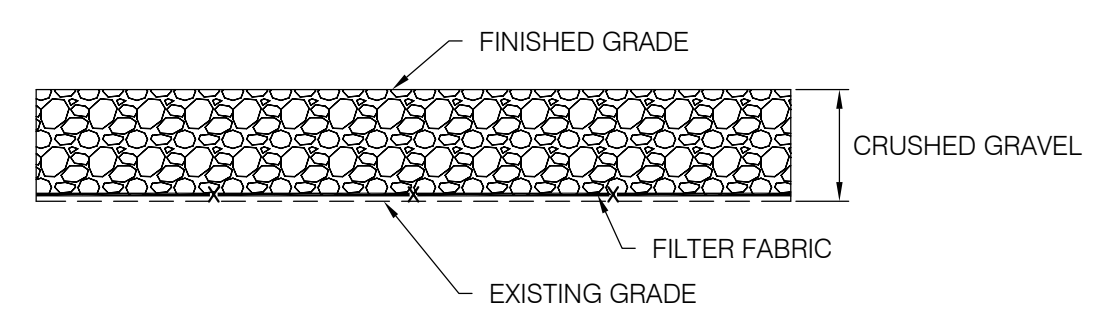

TYPICAL SECTION
(NTS)




VHB Vanasse Hangen Brustlin, Inc.

DWG. NO.	REFERENCE DWG.	REV	DSN	CK	DESCRIPTION	INITIALS	DATE	INITIALS	DATE	YEAR:	W.O.	SCALE:	DWG.	ANGP-T-G-023	REV.
										2016		1"=40'			0



		BID	CONSTRUCTION
ENVIRONMENTAL	JLS	06/28/13	JLS 05/2016
DRAFTING DESIGNER	GIL	06/28/13	GJM 05/2016
DRAFTING SUPERVISOR	BZD	06/28/13	BCK 05/2016
DESIGN ENGINEER	MDF	06/28/13	GEW 05/2016
DESIGN MANAGER	SAB	06/28/13	JEO 05/2016

VERMONT GAS
PROPOSED 12" PIPELINE
ADDISON NATURAL GAS PROJECT
PLANK ROAD PIPEYARD
LOC. ADDISON COUNTY

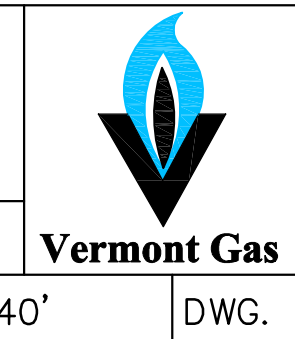


9
N/F
STATE OF VERMONT

RIGHT-OF-WAY	SURVEY DATA		MATCHLINE
	S 76° 49' E	02'01" RT	
	S 74° 48' E		
	S 72° 46' E	02'01" RT	
	S 70° 45' E	02'01" RT	
	S 68° 44' E	02'01" RT	
	S 66° 42' E	02'01" RT	
	S 64° 50' E	01'51" RT	
	S 64° 39' E	00'11" RT	
	S 64° 39' E	45'00" RT	
	S 19° 39' E	45'00" LT	
	S 64° 39' E	45'00" LT	
	N 70° 21' E	45'00" LT	
	Bk: 148+39	N 70° 21' E	
	And: 148+31	S 64° 39' E	
		45'00" RT	
		7.3 FT	
		00'43" LT	
	S 65° 22' E		
	S 64° 14' E		
	S 65° 11' E	00'57" LT	
	S 65° 26' E	00'15" LT	
	S 64° 02' E	01'24" RT	
	S 64° 02' E	00'00" RT	
	S 64° 02' E		
	S 62° 53' E	18'51" LT	
	N 86° 57' E	10'09" LT	
	N 86° 57' E	00'00" RT	
	N 86° 57' E	00'00" LT	
	N 86° 57' E		
	S 67° 38' E	25'25" RT	

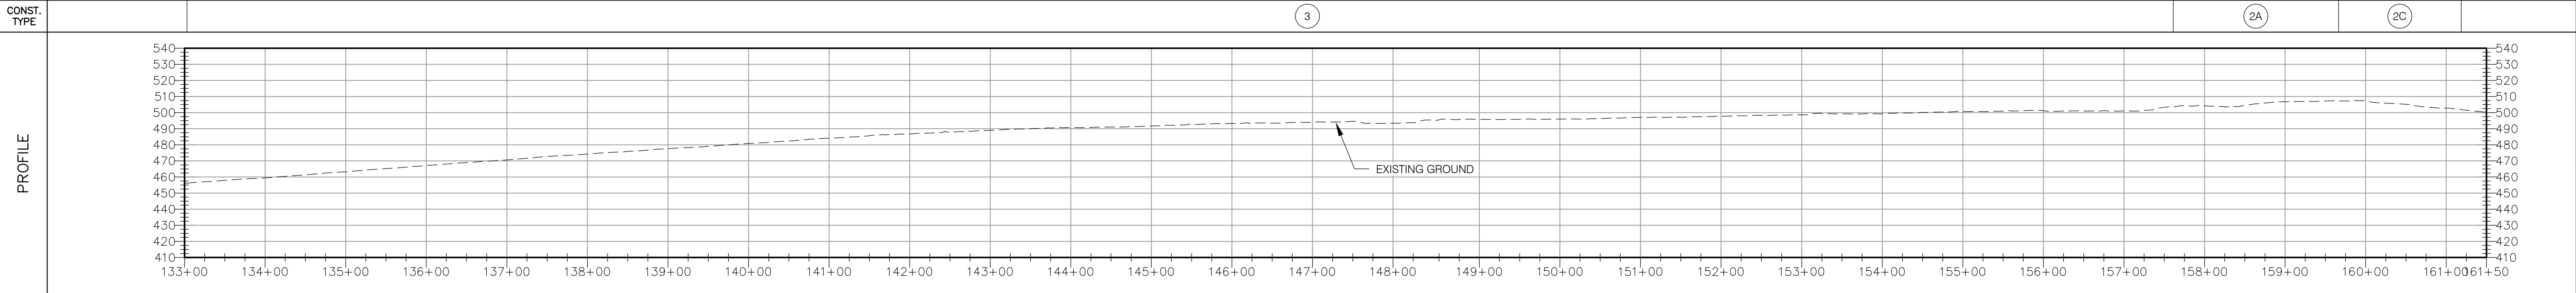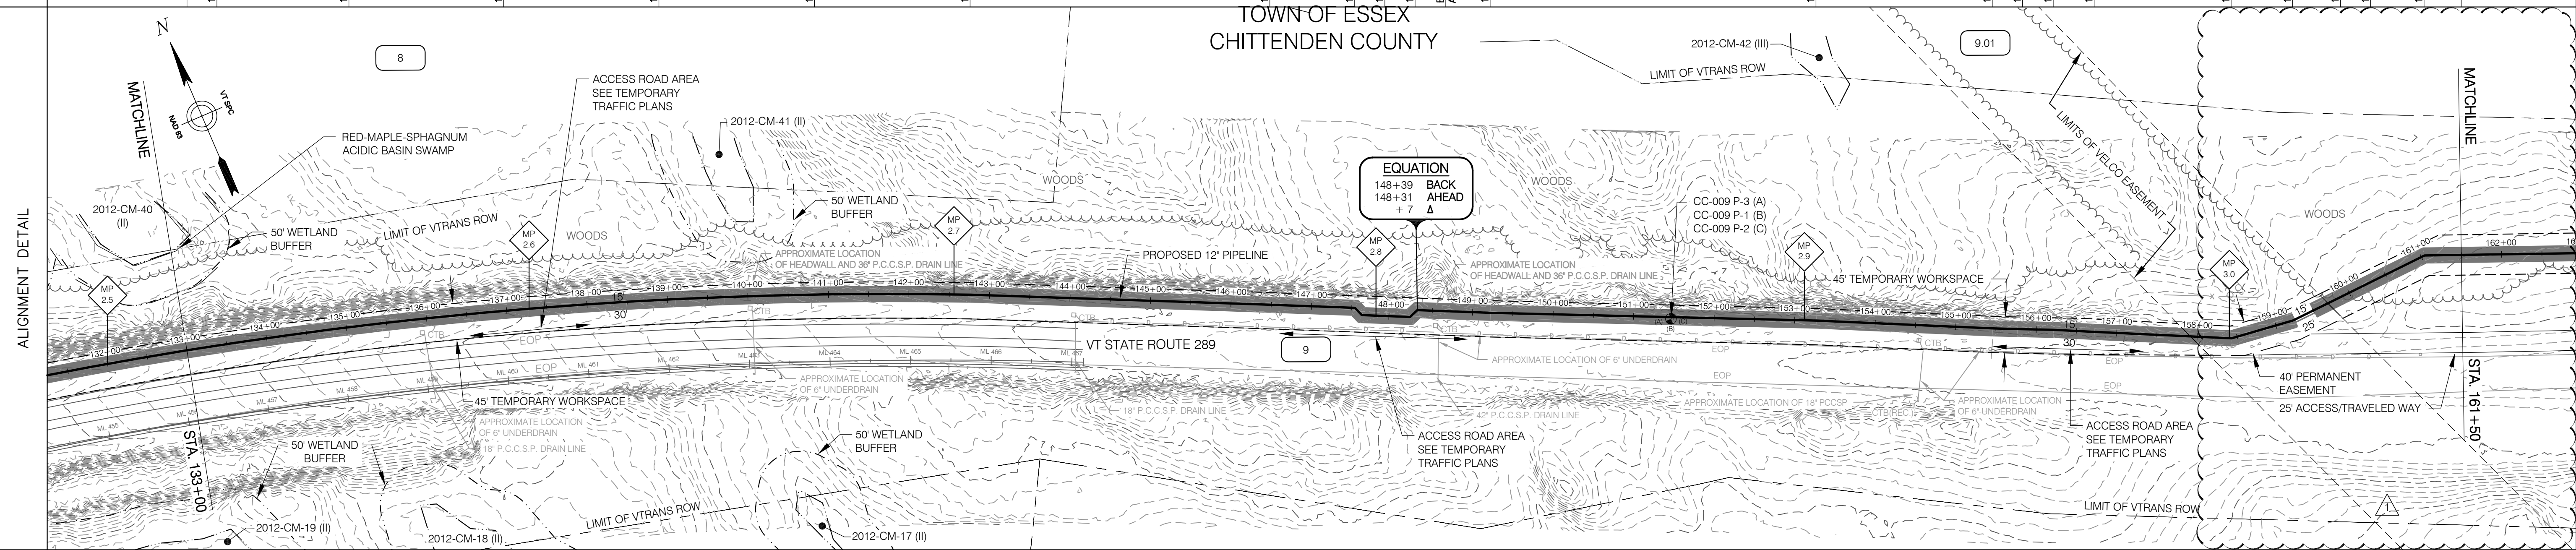


MATERIALS	CONST. TYPE
	3
	2A
	2C

COATING	CLASSIFICATION	DESIGN FACTOR
A	1	0.5

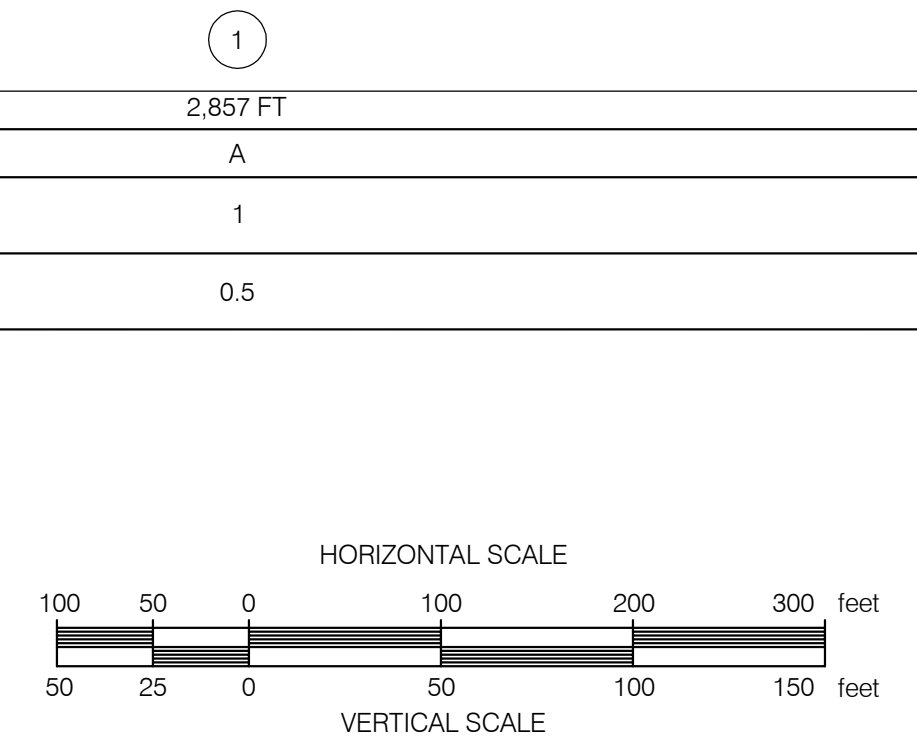

PIPE MATERIAL:
 1 12.75" O.D. X 0.312" WT, API-5L, GR. X65, PSL-2, AND ADDITIONAL SPECIFICATIONS IN 192.112
 2 20" O.D. X 0.375" WT, API-5L, GR. B

PIPE COATING:
 A EPOXY POLYETHYLENE 10/40 2.857 FT
 B FBE, ABRASION RESISTANT OVERCOAT, 14-16 MILS/40 MILS, 54-56 MILS TOTAL 0 FT
 C FBE 14-16 MILS, W/ 1-1/2" REINFORCED CONCRETE W/ 140 LBS/FT' 0 FT

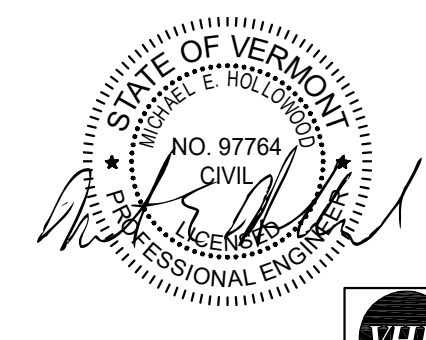


ANGP-VAOT-006	ANGP-EPSC-006	G-001 - 010	DWG. NO.	DESCRIPTION	INITIALS	DATE	BID	CONSTRUCTION	YEAR:	W.O.	SCALE:	DWG.	REV.
VAOT ALIGNMENT SHEET	EPSC PLAN	COVER, INDEX, LEGEND & NOTES, AND CONSTRUCTION DETAILS		1 IFC 2016 EDITS (05/2016)			JLS	06/28/13	2016		1" = 100'	ANGP-T-C-006	1
							GJM	06/28/13					
							BCK	06/28/13					
								05/2016					
								05/2016					
								05/2016					
								05/2016					


VERMONT GAS
 PROPOSED 12" PIPELINE
 ADDISON NATURAL GAS PROJECT
 ALIGNMENT SHEET
 LOC. CHITTENDEN COUNTY, VERMONT
 Vermont Gas

38 Eastwood Drive, Suite 105
 South Burlington, VT 05403
 Main: (802) 735-0372 • www.ciacompanies.com

RIGHT-OF-WAY	MATCHLINE	19 N/F BABCOCK, JAMES	20 N/F NEW ENGLAND CENTRAL RAILROAD	21 N/F CHITTENDEN SOLID WASTE DISTRICT	22 N/F STATE OF VERMONT; AGENCY OF TRANSPORTATION	23 N/F CHITTENDEN SOLID WASTE DISTRICT	23 N/F CHITTENDEN SOLID WASTE DISTRICT	MATCHLINE
	SURVEY DATA	N 55° 32' W	S 43° 23' W	N 55° 50' W	N 62° 46' W	S 71° 31' W		

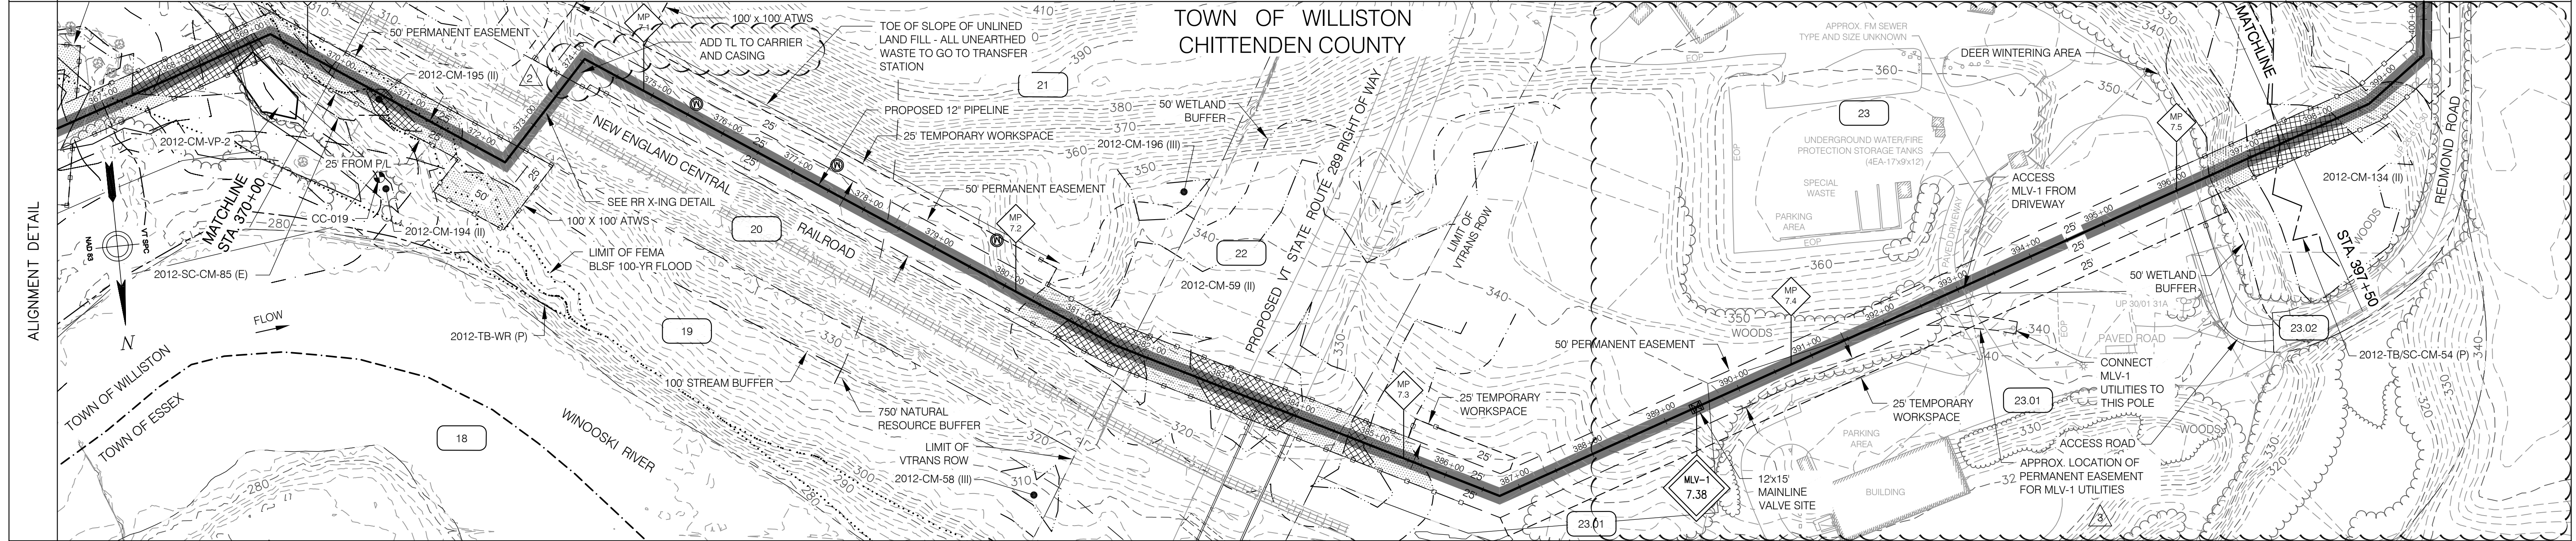

CONST. TYPE	(W)	(2A)	(10)	(1A)	(W)	(2A)	(W)	(1A)	(E)	(7)	(W)
-------------	-----	------	------	------	-----	------	-----	------	-----	-----	-----

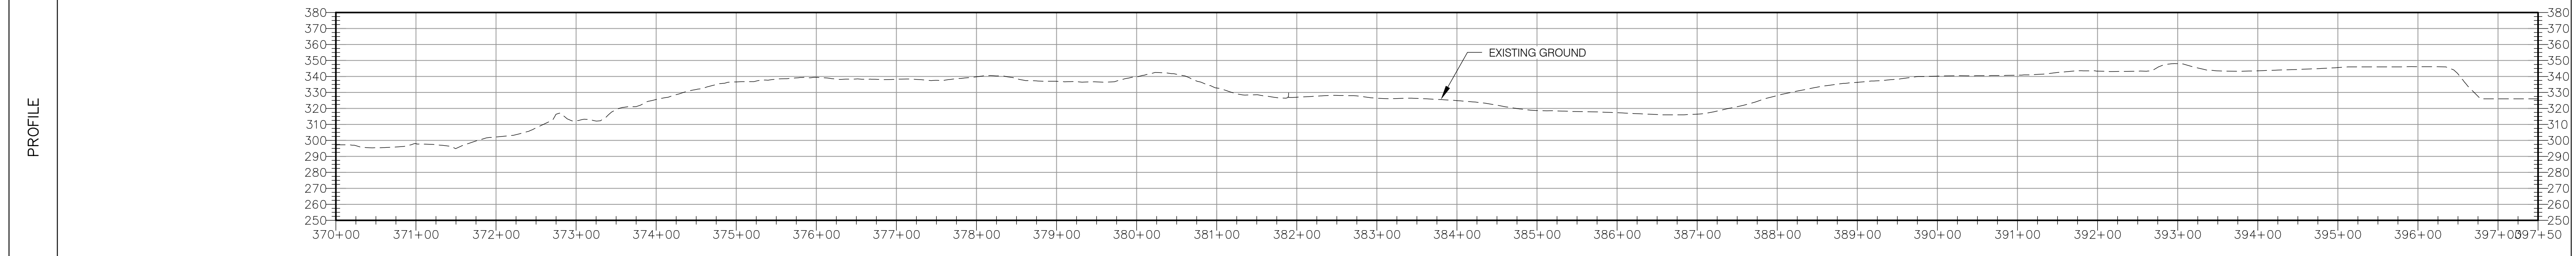

MATERIALS	MATCHLINE	(1)	(1)	(1)	(2)	(1)	(1)	(1)	(1)	MATCHLINE
COATING		179 FT	80 FT	121 FT	656 FT	557 FT	1,052 FT	105 FT		
CLASSIFICATION		C	A	C	A	C	A	C		

DESIGN FACTOR						0.5				
---------------	--	--	--	--	--	-----	--	--	--	--

HORIZONTAL SCALE

VERTICAL SCALE

PIPE MATERIAL:

1 12.75" O.D. X 0.312" WT, API-5L, GR. X65, PSL-2, AND ADDITIONAL SPECIFICATIONS IN 192.112 2,750 FT

2 20" O.D. X 0.375" WT, API-5L, GR. B 121 FT

PIPE COATING:

A EPOXY POLYETHYLENE 10/40 1788 FT



B FBE, ABRASION RESISTANT OVERCOAT, 14-16 MILS/40 MILS, 54-56 MILS TOTAL 0 FT

C FBE 14-16 MILS, W/ 1-1/2" REINFORCED CONCRETE W/ 140 LBS/FT' 962 FT

VHB Vanasse Hangen Brustlin, Inc.

ANGP-VAOT-015	VAOT ALIGNMENT SHEET																		
ANGP-T-C-015A	RAILROAD CROSSING DETAIL	3	GJM	BCK	IFC 2016 EDITS (05/2016)	ENVIRONMENTAL	JLS	06/28/13	JLS	05/2016	VERMONT GAS PROPOSED 12" PIPELINE ADDISON NATURAL GAS PROJECT ALIGNMENT SHEET				38 Eastwood Drive, Suite 105 South Burlington, VT 05403 Main: (802) 735-0372 - www.chacompanies.com				
ANGP-EPSC-015	EPSC PLAN	2	BCK	TDB	CP TEST LEAD EDIT (9/14/15)	DRAFTING DESIGNER	GIL	06/28/13	GJM	05/2016									
G-001 - 010	COVER, INDEX, LEGEND & NOTES, AND CONSTRUCTION DETAILS	1	BCK	TDB	MLV 1 RELOC., PROP. LN. ADJ., CONST. TYPE CHNG. (6/09/15)	DRAFTING SUPERVISOR	BZD	06/28/13	BCK	05/2016	LOC. CHITTENDEN COUNTY, VERMONT								
DWG. NO.	REFERENCE DWG.	REV	DSN	CK	DESCRIPTION	DESIGN ENGINEER	MDF	06/28/13	GEW	05/2016	YEAR: 2016	W.O.	SCALE: 1" = 100'	DWG.	ANGP-T-C-015	REV.	3		

RIGHT-OF-WAY	28 N/F CHITTENDEN SOLID WASTE DISTRICT												29 N/F CHITTENDEN SOLID WASTE DISTRICT												30 N/F VERMONT TRANSCO., LLC												30 N/F CHITTENDEN SOLID WASTE DISTRICT												31 N/F CHITTENDEN SOLID WASTE DISTRICT												30 N/F CHITTENDEN SOLID WASTE DISTRICT												MATCHLINE																																																																																																																																																																																																																																																
SURVEY DATA	S 22° 38' W 00'00" LT 427+18												S 22° 38' W 02'35" LT 427+46												S 20° 03' W 45'00" RT 427+70												S 65° 03' W 44'38" LT 427+97												S 20° 24' W 45'21" LT 429+11												S 24° 57' E 67.2' LT Bk: 428+39 A/C: 428+72 45'00" RT												S 26° 03' W												S 20° 03' W 00'00" RT 432+64												S 16° 50' W 03'12" LT 432+78												S 18° 07' W 01'16" RT 433+43												S 18° 45' W 00'38" RT 434+07												S 19° 44' W 00'56" RT 434+65												S 21° 42' W 01'57" RT 435+51												S 22° 59' W 01'17" RT 436+17												S 22° 56' W 00'03" LT 436+38												S 18° 40' RT 437+95												01'13" RT 441+23												S 44° 58' W												01'55" LT 448+24												S 43° 03' W 01'59" LT 448+64												S 41° 03' W 01'59" LT 449+04												S 39° 03' W 01'59" LT 449+44												S 37° 03' W 06'16" LT 449+84												S 28° 47' W 13'00" LT 451+82												S 15° 46' W 27'18" LT 453+50												S 11° 33' E												MATCHLINE

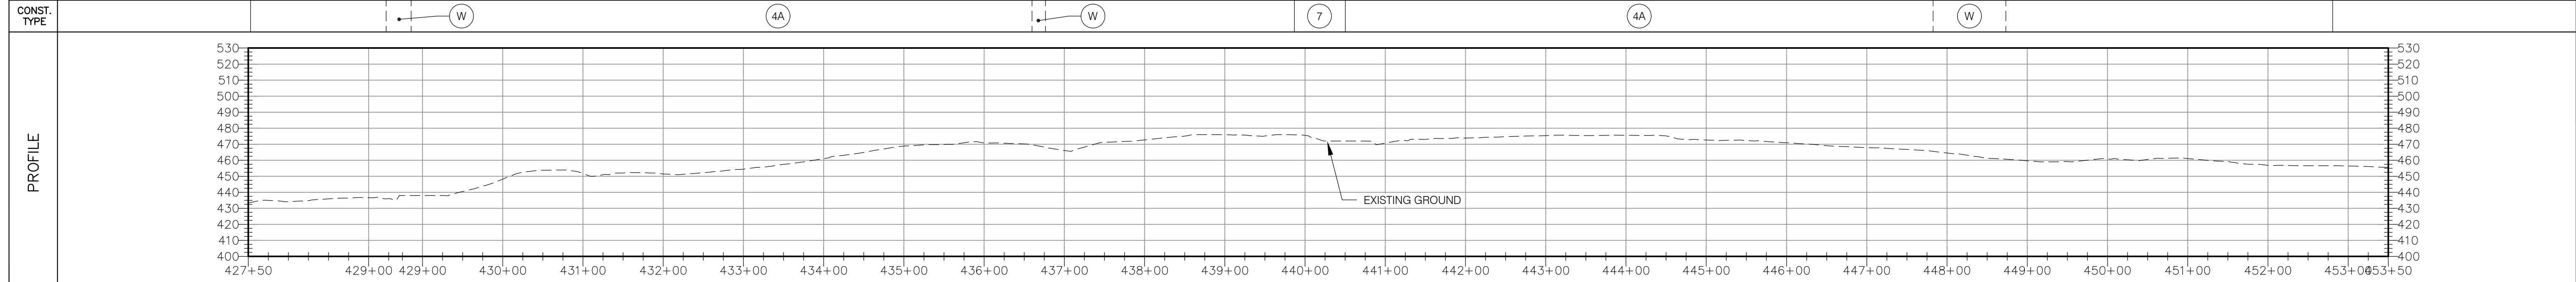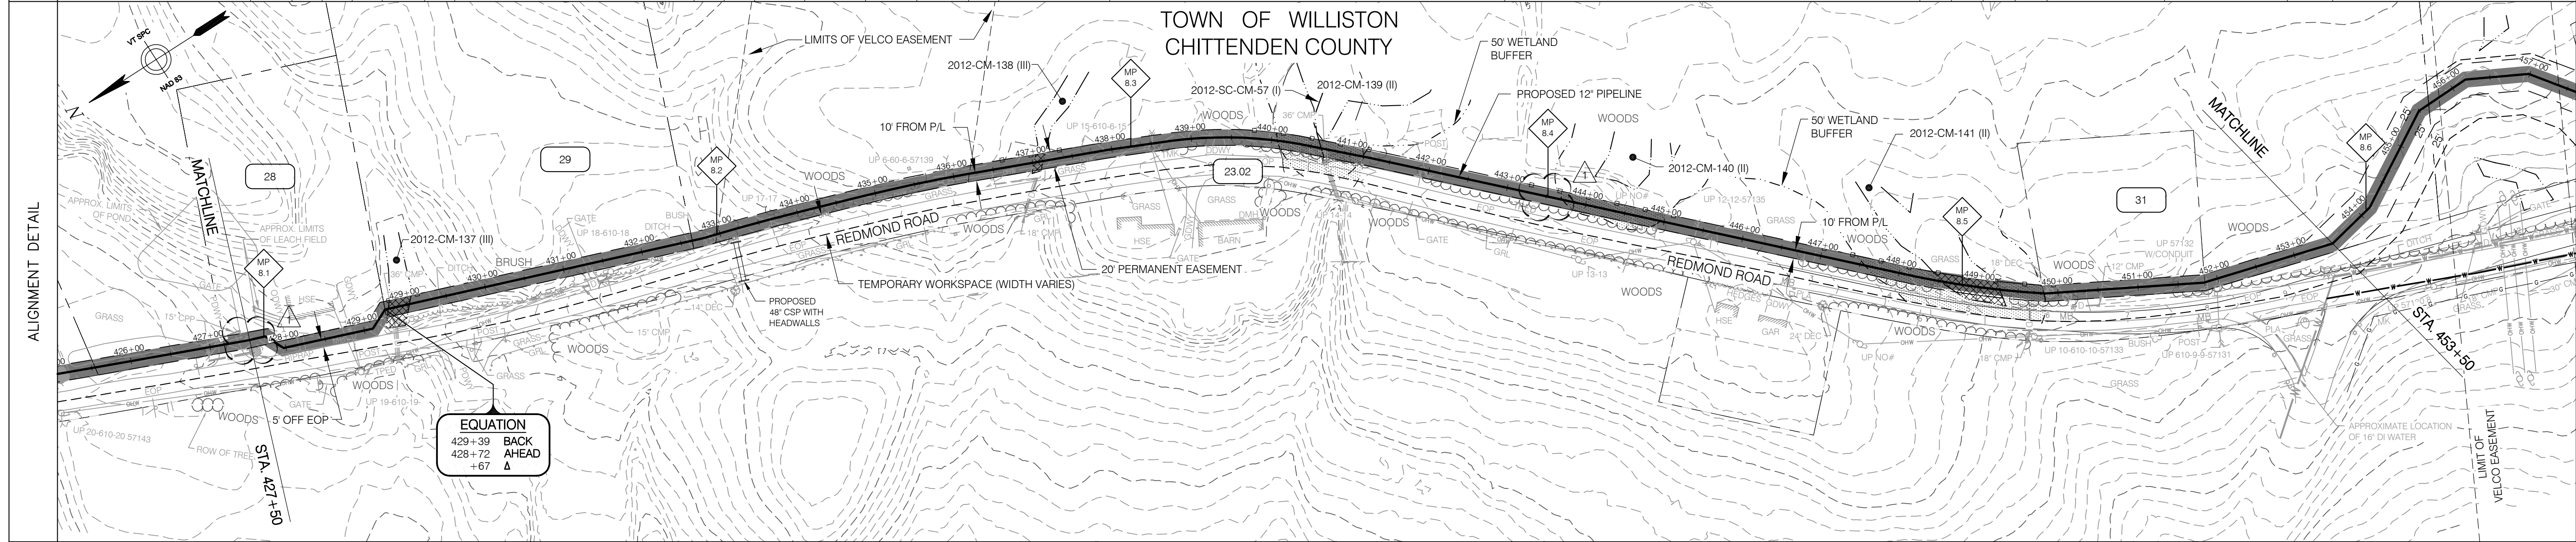

MATERIALS	MATCHLINE												MATCHLINE											
COATING	1												1											
CLASSIFICATION	A												C											
DESIGN FACTOR	3												0.5											

CONST. TYPE	W												4A												7												4A												W											
-------------	---	--	--	--	--	--	--	--	--	--	--	--	----	--	--	--	--	--	--	--	--	--	--	--	---	--	--	--	--	--	--	--	--	--	--	--	----	--	--	--	--	--	--	--	--	--	--	--	---	--	--	--	--	--	--	--	--	--	--	--

PIPE MATERIAL:

- 1 12.75" O.D. X 0.312" WT, API-5L, GR. X65, PSL-2, AND ADDITIONAL SPECIFICATIONS IN 192.112 2,667 FT
- 2 20" O.D. X 0.375" WT, API-5L, GR. B 0 FT

PIPE COATING:


- A EPOXY POLYETHYLENE 10/40 2,165 FT
- B FBE, ABRASION RESISTANT OVERCOAT, 14-16 MILS/40 MILS, 54-56 MILS TOTAL 0 FT
- C FBE 14-16 MILS, W/ 1-1/2" REINFORCED CONCRETE W/ 140 LBS/FT' 502 FT

HORIZONTAL SCALE


VERTICAL SCALE

ANGP-EPSC-017				EPSC PLAN				CP TEST LEAD EDIT (9/14/15)				ENVIRONMENTAL				JLS 06/28/13				JLS 05/2016				VERMONT GAS PROPOSED 12" PIPELINE ADDISON NATURAL GAS PROJECT ALIGNMENT SHEET LOC. CHITTENDEN COUNTY, VERMONT											
G-001 - 010				COVER, INDEX, LEGEND & NOTES, AND CONSTRUCTION DETAILS								DRAFTING DESIGNER				GJM 05/2016																			
DWG. NO.				REFERENCE DWG.				REV DSN CK				DESIGN ENGINEER				GEW 05/2016																			
								DESIGN MANAGER				SAB 06/28/13				JEO 05/2016																			
YEAR: 2016		W.O.		SCALE: 1" = 100'		DWG. ANGP-T-C-017		REV. 1		INITIALS		DATE		INITIALS		DATE																			

RIGHT-OF-WAY	23.02 REDMOND ROAD										36 MOUNTAIN VIEW ROAD			
	30 N/F CHITTENDEN SOLID WASTE DISTRICT					33 N/F VERMONT TRANSCO, LLC					35 N/F STATE OF VERMONT			
SURVEY DATA	18'44" LT	28'56" RT	28'56" RT	25'51" RT	25'51" RT	29'59" LT	28'56" LT	10'35" LT	10'35" RT	04'75" RT	30'13" LT	-5.1' E	09'46" LT	36
	S 11° 33' E	S 30° 17' E	S 01° 21' E	S 27° 35' W	S 53° 27' W	S 79° 18' W	S 49° 19' W	S 19° 19' W	S 08° 24' W	S 19° 00' W	S 23° 25' W	S 06° 48' E	S 51° 48' E	S 01° 35' E
	454+14	455+48	456+19	456+99	457+71	458+65	459+35	461+43	463+07	463+44	473+98	474+16	474+21	475+68

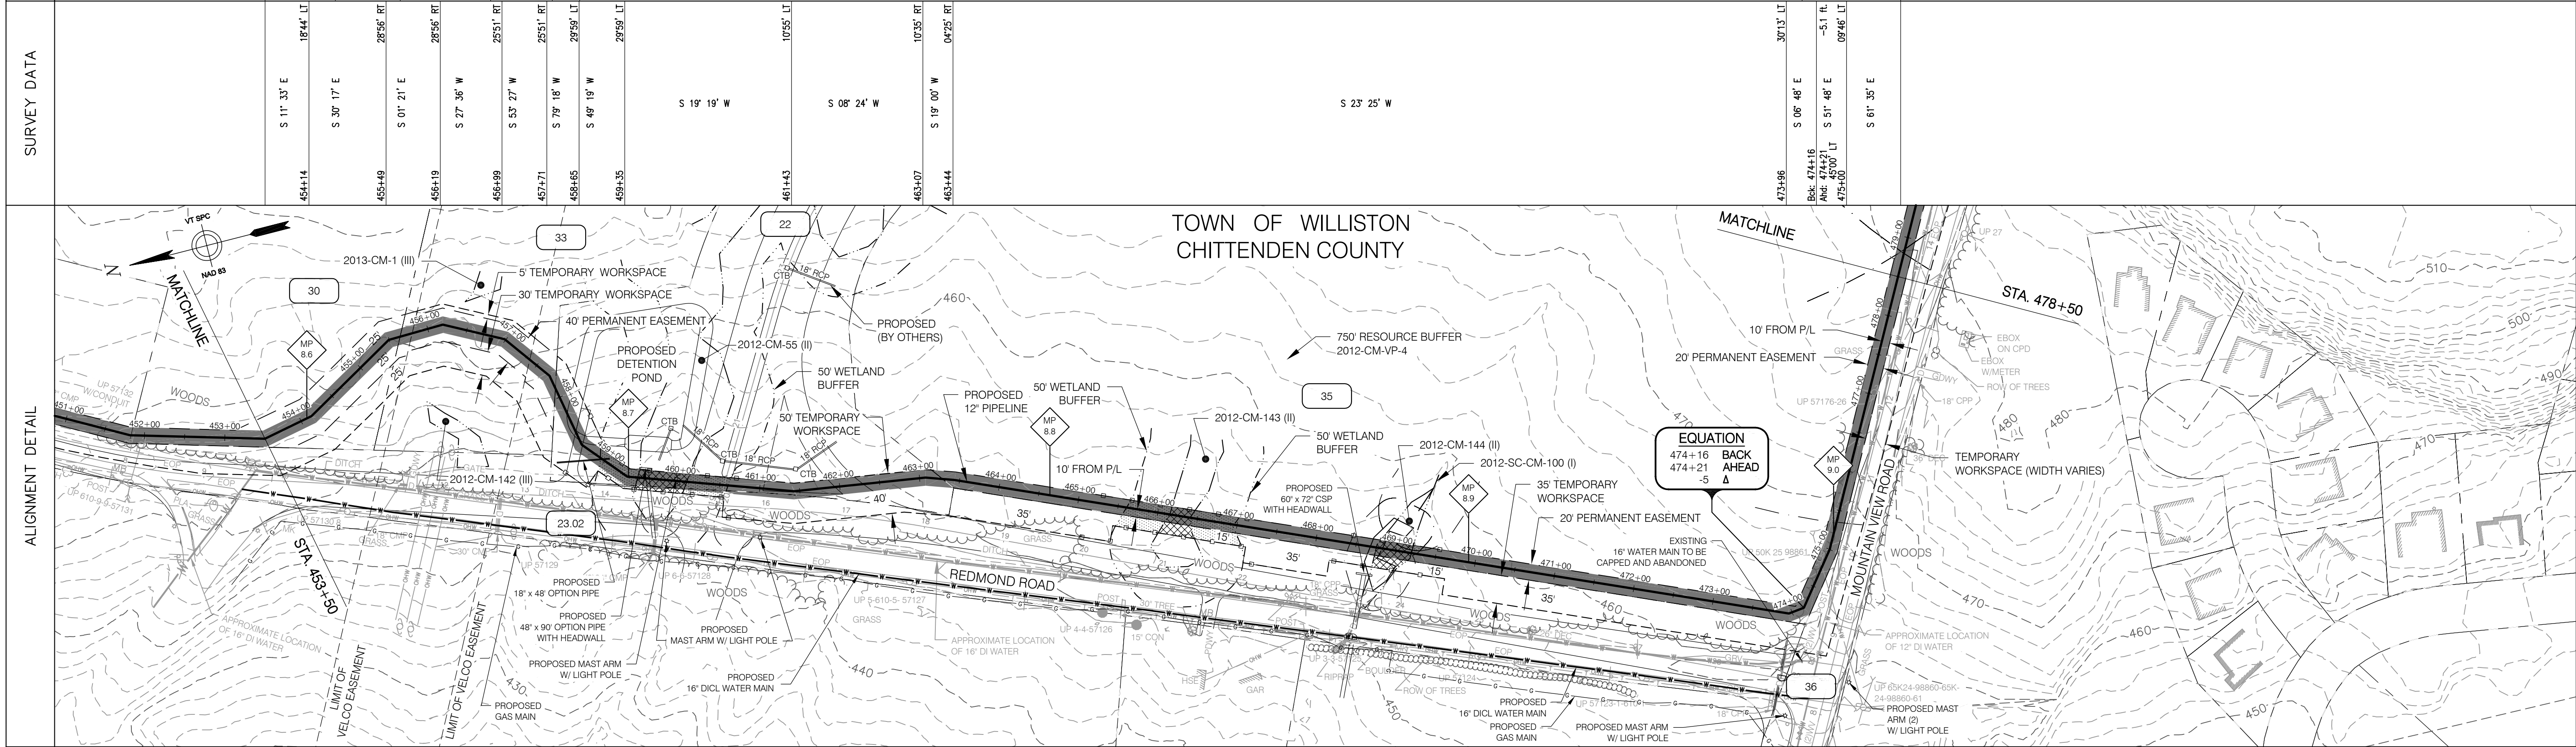

CONST. TYPE	1E	1J	1E	W	4C	4A	W	7	W	4A
-------------	----	----	----	---	----	----	---	---	---	----

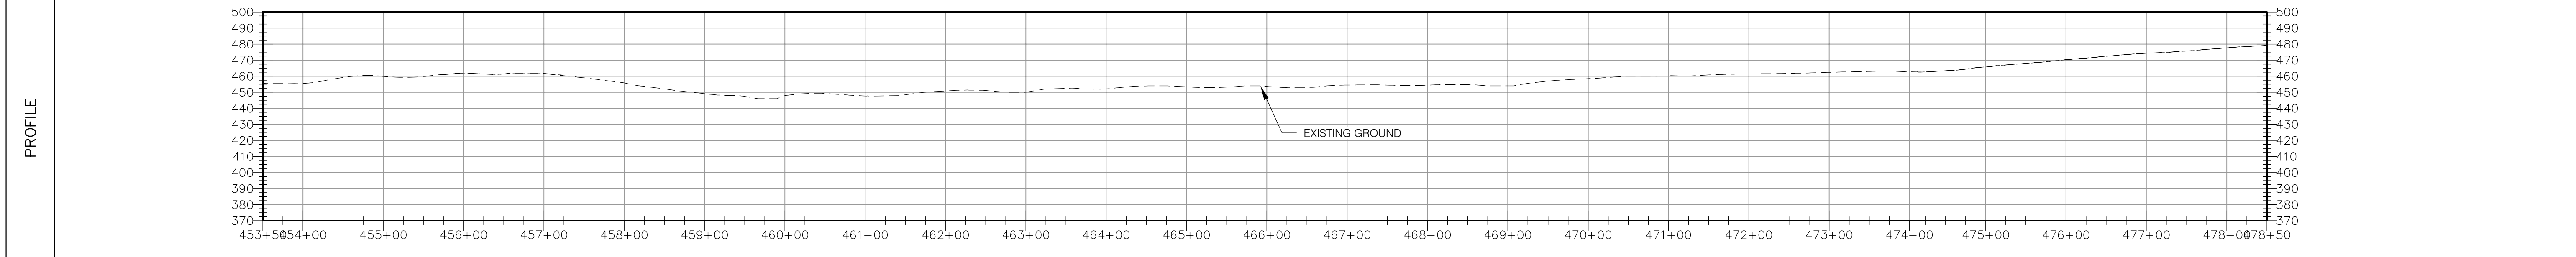

MATERIALS	1	1	1	1	1	1
	544 FT	167 FT	500 FT	136 FT	179 FT	44 FT
COATING	A	C	A	C	A	C

CLASSIFICATION	1	3
DESIGN FACTOR	0.5	

PIPE MATERIAL:

- 1 12.75" O.D. X 0.312" WT, API-5L, GR. X65, PSL-2, AND ADDITIONAL SPECIFICATIONS IN 192.112 2,495 FT
- 2 20" O.D. X 0.375" WT, API-5L, GR. B 0 FT

PIPE COATING:

- A EPOXY POLYETHYLENE 10/40 2,148 FT
- B FBE, ABRASION RESISTANT OVERCOAT, 14-16 MILS/40 MILS, 54-56 MILS TOTAL 0 FT
- C FBE 14-16 MILS, W/ 1-1/2" REINFORCED CONCRETE W/ 140 LBS/FT' 347 FT


HORIZONTAL SCALE: 1" = 100'

VERTICAL SCALE: 1" = 10'




ANGP-VAOT-018	VAOT ALIGNMENT SHEET	BID	JLS 06/28/13	CONSTRUCTION	JLS 05/2016	VERMONT GAS PROPOSED 12" PIPELINE ADDISON NATURAL GAS PROJECT ALIGNMENT SHEET				
ANGP-EPSC-018	EPSC PLAN	DRAFTING DESIGNER	GIL 06/28/13	DRAFTING SUPERVISOR	GJM 05/2016	LOC. CHITTENDEN COUNTY, VERMONT				
G-001 - 010	COVER, INDEX, LEGEND & NOTES, AND CONSTRUCTION DETAILS	DESIGN ENGINEER	MDF 06/28/13	DESIGN ENGINEER	GEW 05/2016					
DWG. NO.	REFERENCE DWG.	DESIGN MANAGER	SAB 06/28/13	DESIGN MANAGER	JEO 05/2016	YEAR: 2016	W.O.	SCALE: 1" = 100'	DWG. ANGP-T-C-018	REV. 0

RIGHT-OF-WAY			56 N/F BOSS, BRADLEY		57 N/F OAK HILL ESTATES ASSOCIATION		58 ST. GEORGE ROAD VT STATE ROUTE 2A		62.01 N/F PALMER, DAVID		61 N/F BLACKBERRY RIDGE HOMEOWNERS ASSOCIATION		62 N/F LUNNA, STEPHEN R. & JENNIFER J.	
SURVEY DATA			S 24° 29' W	00'29" RT 00'11" RT	43'39" RT -26" FL 44'09" RT	N 68° 23' W	S 66° 26' W S 21° 39' W S 21° 10' W	S 20° 49' W S 21° 31' W	S 21° 46' W	S 66° 46' W -8.1" FL 48'36" LT	S 62° 38' W	S 39° 38' W	S 17° 31' W	
			637+40	638+26	639+78 Bk: 640+12 Ahd: 640+38 640+93	644+91	645+47 645+93	646+79	648+48	651+91	655+19 Bk: 655+39 Ahd: 655+47 655+26 RT 655+50	661+71	662+84	

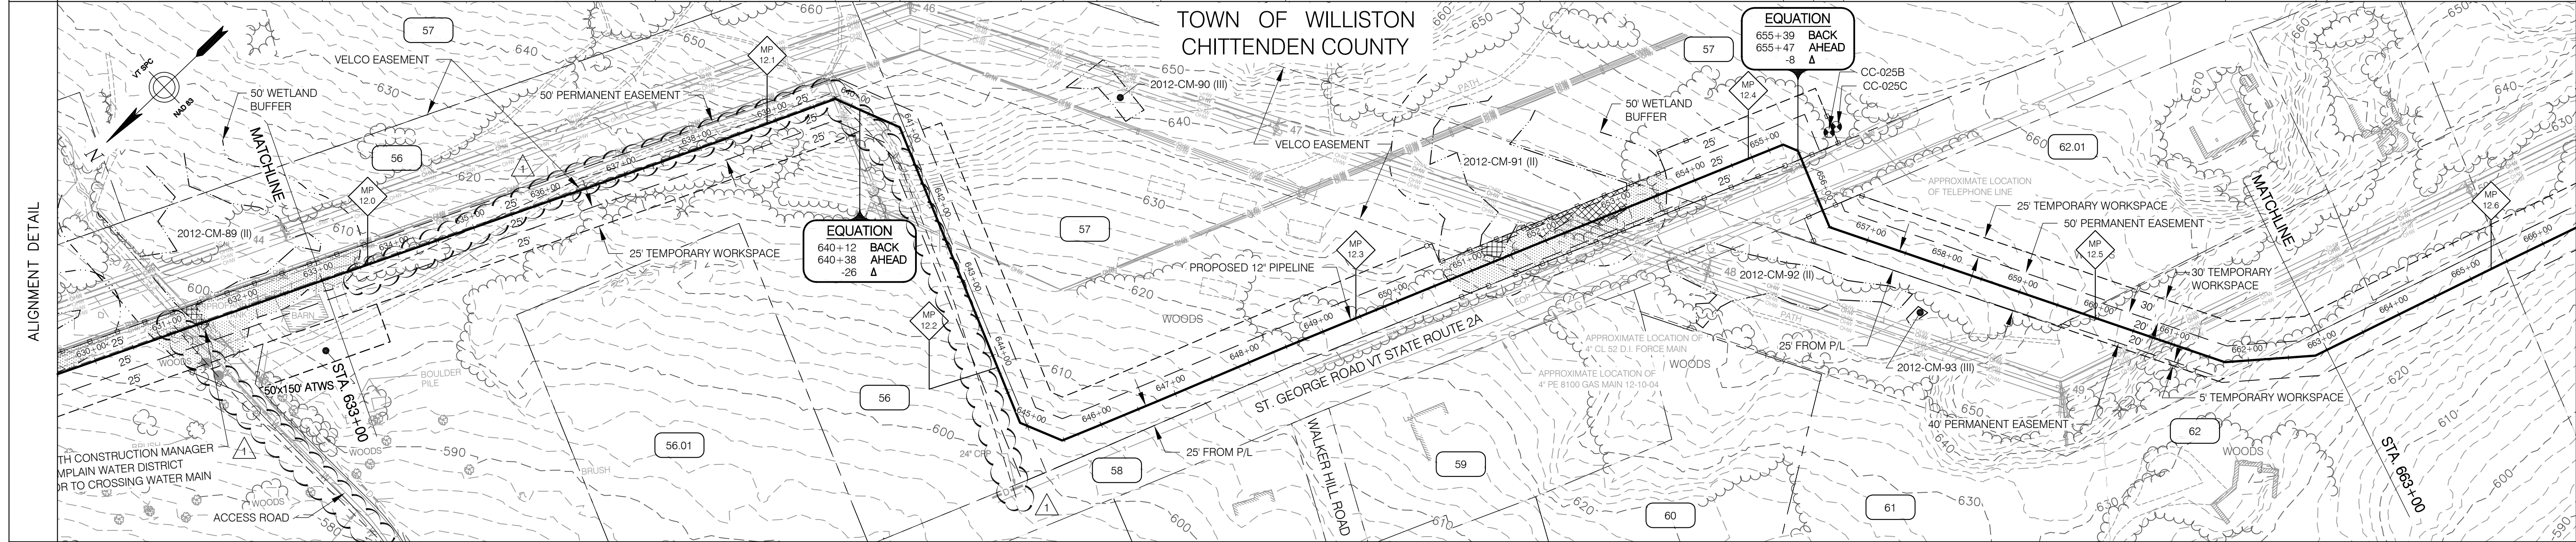

CONST. TYPE			1E	2A	1A	2A	W	1H	W	1A	9	1A	1H	1A
-------------	--	--	----	----	----	----	---	----	---	----	---	----	----	----

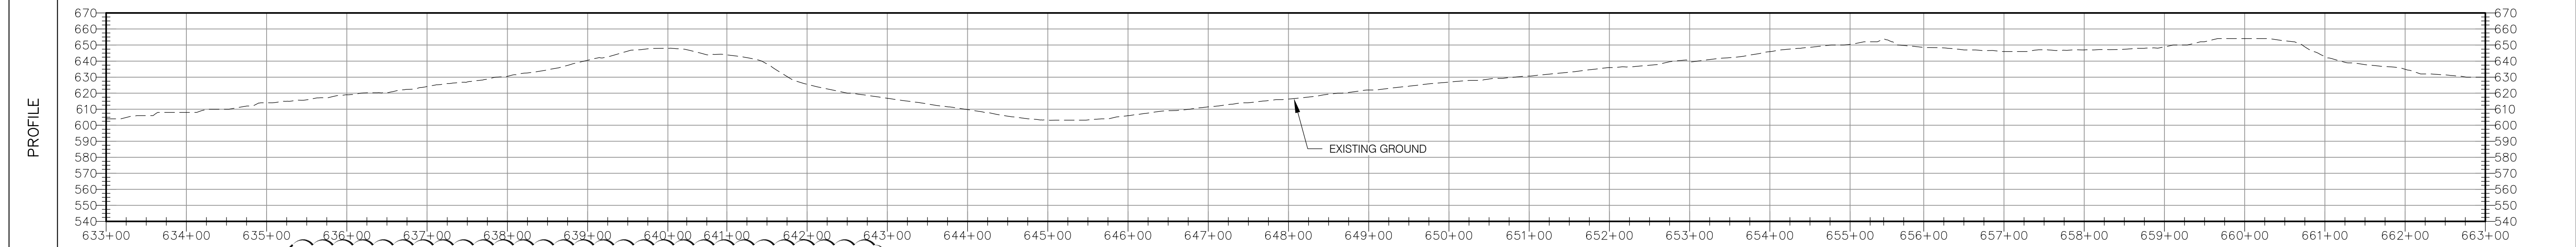

MATERIALS														
COATING														
CLASSIFICATION														
DESIGN FACTOR														


PIPE MATERIAL:
 1 12.75" O.D. X 0.312" WT, API-5L, GR. X65, PSL-2, AND ADDITIONAL SPECIFICATIONS IN 192.112 2,966 FT
 2 20" O.D. X 0.375" WT, API-5L, GR. B 0 FT
PIPE COATING:
 A EPOXY POLYETHYLENE 10/40 2,384 FT
 B FBE, ABRASION RESISTANT OVERCOAT, 14-16 MILS/40 MILS, 54-56 MILS TOTAL 0 FT
 C FBE 14-16 MILS, W/ 1-1/2" REINFORCED CONCRETE W/ 140 LBS/FT' 582 FT

STATE OF VERMONT
 CIVIL ENGINEER
 NO. 97764
 J. VANASSE HANGEN BRUSTLIN, INC.


HORIZONTAL SCALE: 1" = 100'
VERTICAL SCALE: 1" = 10'

ANGP-VAOT-025A	VAOT ALIGNMENT SHEET														
ANGP-EPSC-025	EPSC PLAN														
G-001 - 010	COVER, INDEX, LEGEND & NOTES, AND CONSTRUCTION DETAILS	1	GJM	BCK	IFC 2016 EDITS (05/2016)										
DWG. NO.	REFERENCE DWG.	REV	DSN	CK	DESCRIPTION	INITIALS	DATE	INITIALS	DATE	YEAR: 2016	W.O.	SCALE: 1" = 100'	DWG. ANGP-T-C-025	REV. 1	

RIGHT-OF-WAY	63 N/F MARCOTTE, NORMAN & RITA A.		67 N/F SPENCER, REBECCA		68 N/F TANDAN, RUP & PATRICIA		69 N/F MORIN, JOHN M.; PELKEY-MORIN, LAUREL		70 N/F SPERONI, ALDO E. & MARY L.		71 N/F VERMONT TRANSCO LLC		72 N/F LACLAIR, KERMIT E., DIANE D. & RANDALL	
SURVEY DATA	44°59' RT	44°59' RT	00°26' RT	00°26' RT	00°07' LT	00°07' LT	00°55' RT	00°55' RT	44°59' RT	44°59' RT	00°00' LT	00°30' LT	01°35' LT	
	S 27° 17' E	S 17° 42' W	S 18° 08' W	S 18° 01' W	S 17° 53' W	S 18° 49' W	S 26° 42' E	S 17° 57' W	S 17° 57' W	S 17° 57' W	S 17° 27' W	S 17° 27' W	S 15° 51' W	

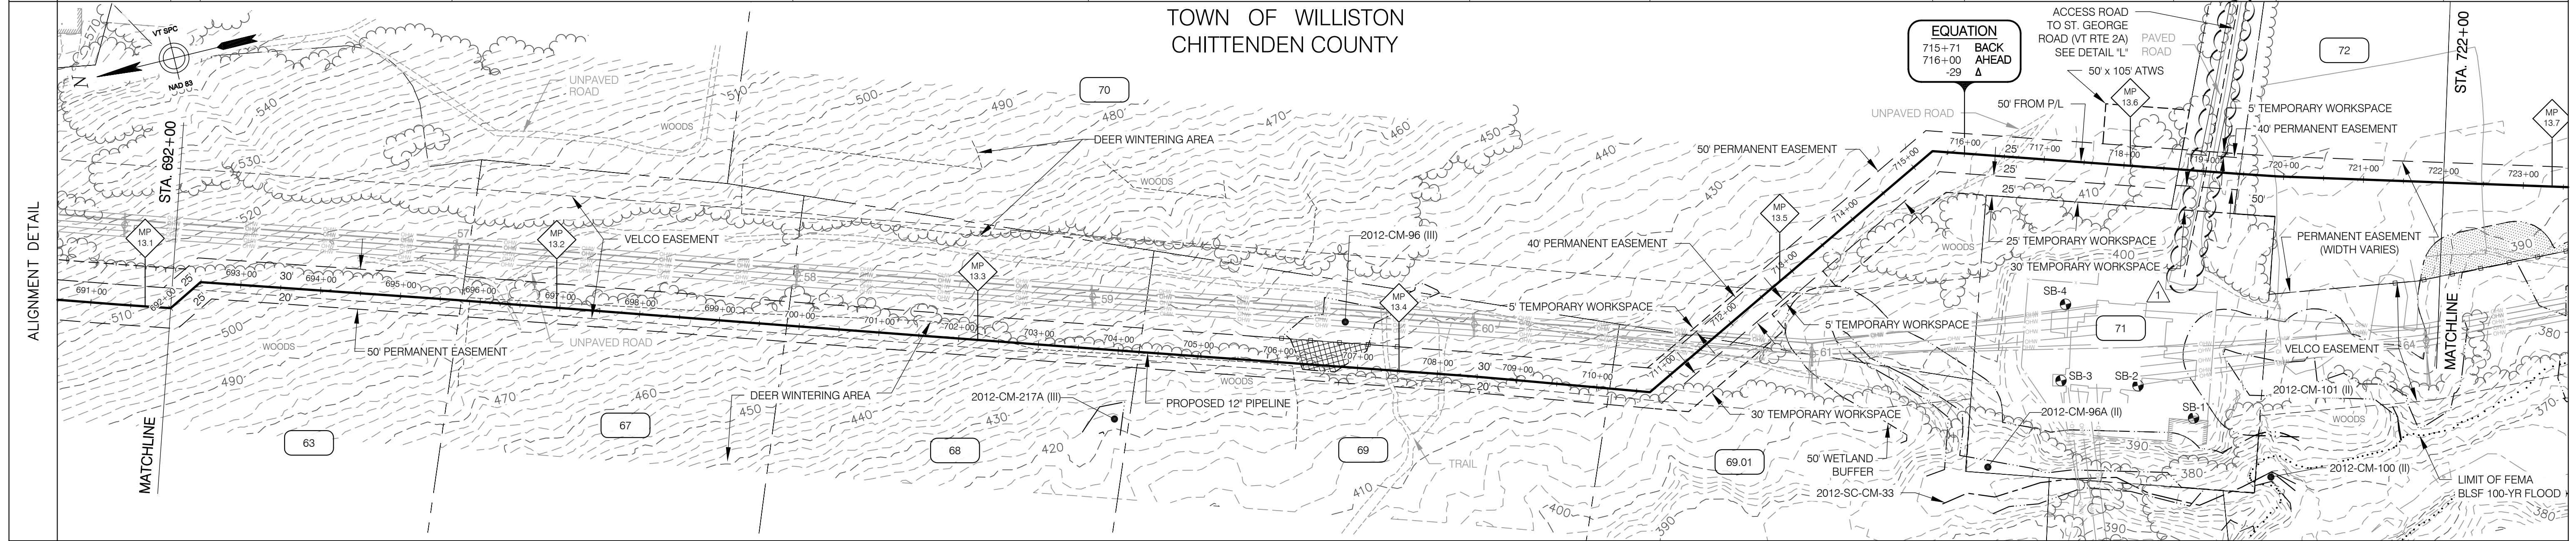

CONST. TYPE	1A	2A	2D	W	1J	2A	1E	1J	1E
-------------	----	----	----	---	----	----	----	----	----

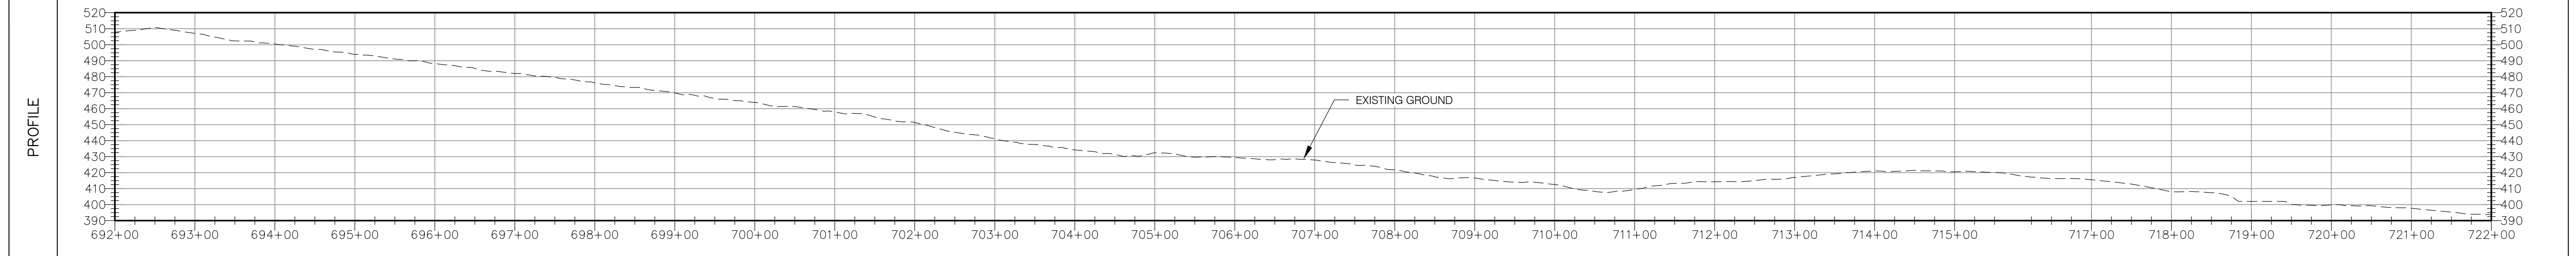

MATERIALS	1		1		1		1		1	
COATING	A		C		A		C		A	
CLASSIFICATION			2							
DESIGN FACTOR			0.5							
	1,428 FT		53 FT		1,159 FT		76 FT		255 FT	

PIPE MATERIAL:

- 1 12.75" O.D. X 0.312" WT, API-5L, GR. X65, PSL-2, AND ADDITIONAL SPECIFICATIONS IN 192.112
- 2 20" O.D. X 0.375" WT, API-5L, GR. B

PIPE COATING:

- A EPOXY POLYETHYLENE 10/40
- B FBE, ABRASION RESISTANT OVERCOAT, 14-16 MILS/40 MILS, 54-56 MILS TOTAL
- C FBE 14-16 MILS, W/ 1-1/2" REINFORCED CONCRETE W/ 140 LBS/FT'

2,971 FT

0 FT

2,842 FT

0 FT


129 FT

HORIZONTAL SCALE

VERTICAL SCALE


				ENVIRONMENTAL		DRAFTING DESIGNER		DRAFTING SUPERVISOR		DESIGN ENGINEER		DESIGN MANAGER		VERMONT GAS PROPOSED 12" PIPELINE ADDISON NATURAL GAS PROJECT ALIGNMENT SHEET		LOC. CHITTENDEN COUNTY, VERMONT		YEAR: 2016		W.O.		SCALE: 1" = 100'		DWG. ANGP-T-C-027		REV. 1	
ANGP-T-G-07-010	ACCESS ROAD DETAILS			JLS	06/28/13	JLS	05/2016	GJM	05/2016	BCK	05/2016	GEW	05/2016	JEO	05/2016												
ANGP-EPSC-027	EPSC PLAN			MDF	06/28/13	GEW	05/2016																				
G-001 - 010	COVER, INDEX, LEGEND & NOTES, AND CONSTRUCTION DETAILS	1	GJM	BCK	IFC 2016 EDITS (05/2016)	SAB	06/28/13	JEO	05/2016																		
DWG. NO.	REFERENCE DWG.	REV	DSN	CK	DESCRIPTION	INITIALS	DATE	INITIALS	DATE	INITIALS	DATE	INITIALS	DATE	INITIALS	DATE	YEAR: 2016	W.O.	SCALE: 1" = 100'	DWG. ANGP-T-C-027	REV. 1							

PROFILE

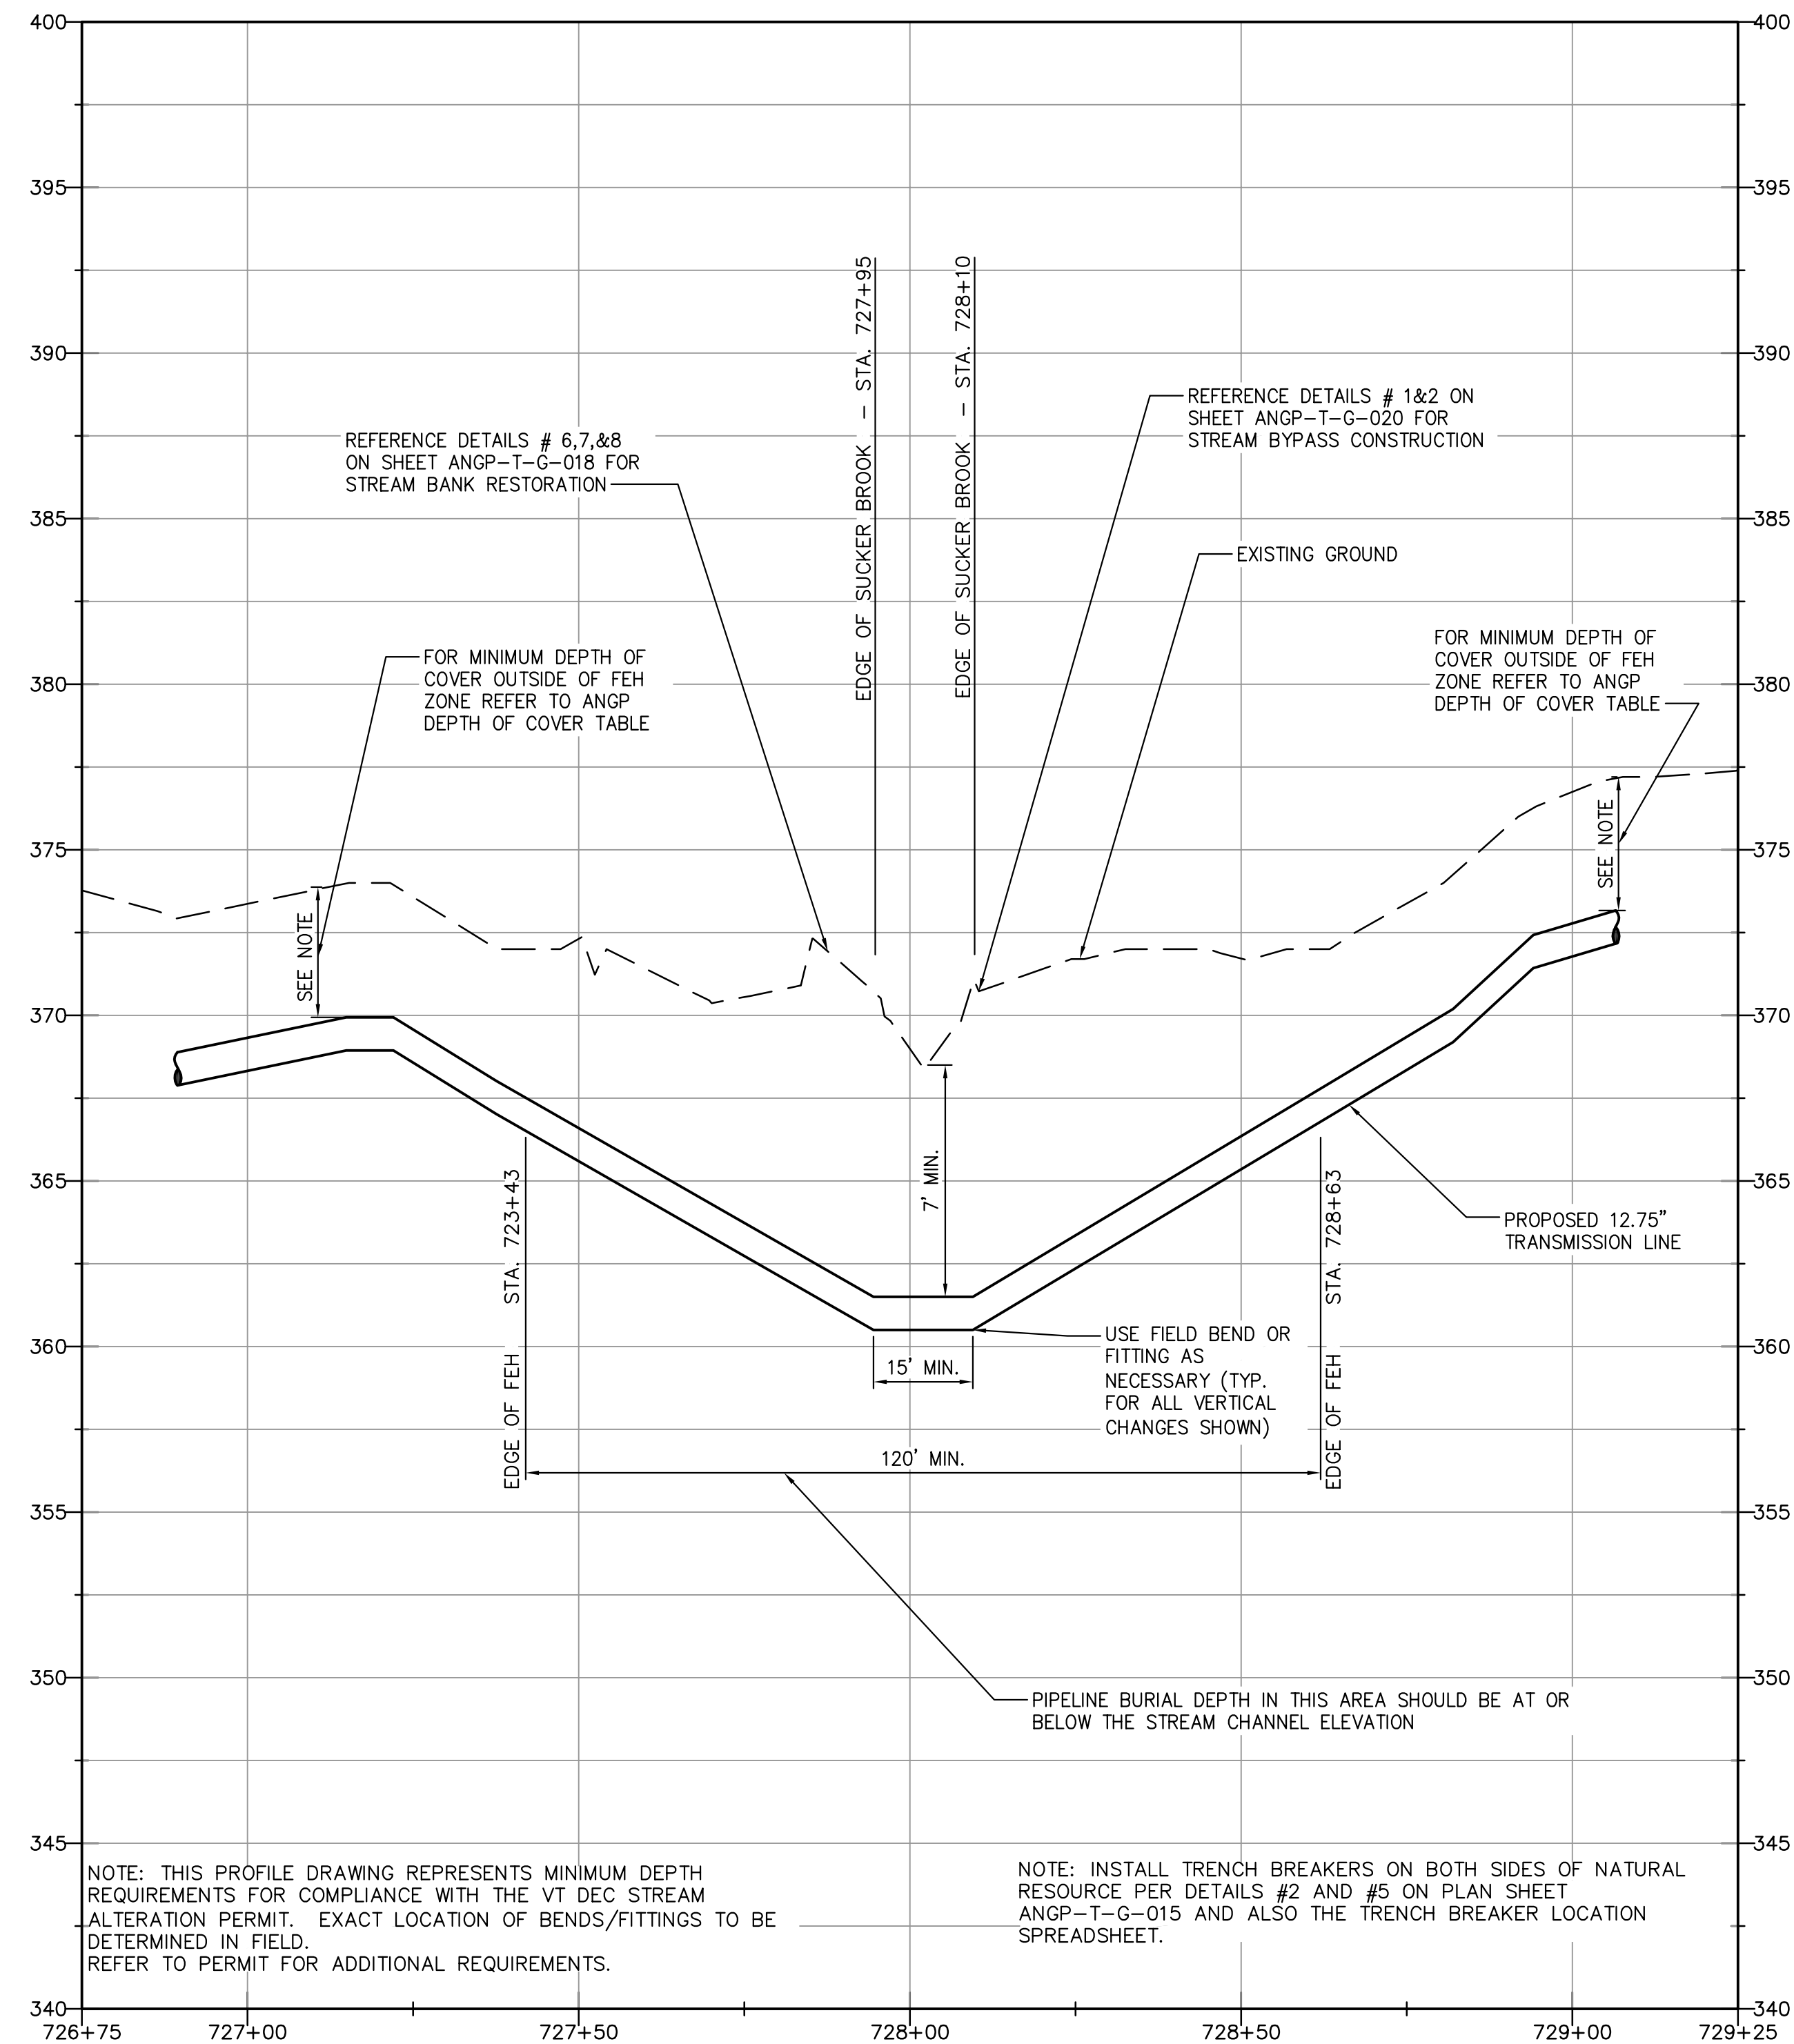


STREAM CROSSING PROFILE
SUCKER BROOK
STATION 728+02±
MILE POST 13.79
 SCALE: HORIZ. 1"=20'
 VERT. 1"=4'

NOTE: STREAM CROSSING MUST BE CONSTRUCTED BETWEEN JUNE 1 AND OCTOBER 1

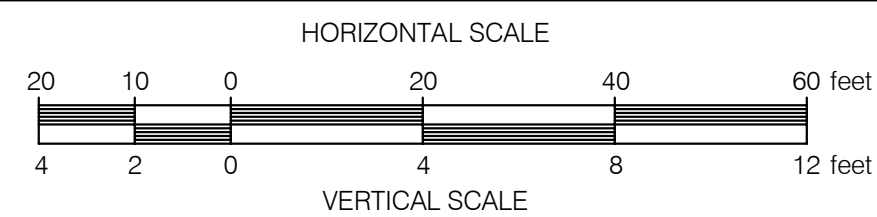


DWG. NO.		REFERENCE DWG.		REV	DSN	CK	DESCRIPTION	INITIALS	DATE	INITIALS	DATE	YEAR: 2016	W.O.	SCALE: AS NOTED	DWG. ANGP-T-C-028A	REV. 0	
								ENVIRONMENTAL JLS 06/28/13 DRAFTING DESIGNER GIL 06/28/13 DRAFTING SUPERVISOR BZD 06/28/13 DESIGN ENGINEER MDF 06/28/13 DESIGN MANAGER SAB 06/28/13		CONSTRUCTION JLS 05/2016 GJM 05/2016 BCK 05/2016 GEW 05/2016 JEO 05/2016		VERMONT GAS PROPOSED 12" PIPELINE ADDISON NATURAL GAS PROJECT OPEN TRENCH STREAM CROSSING PROFILE		LOC. CHITTENDEN COUNTY, VERMONT 		 38 Eastwood Drive, Suite 105 South Burlington, VT 05403 Main: (802) 795-0372 • www.chacompanies.com	

RIGHT-OF-WAY	75 N/F TOWERS, LEE R. & JUDITH A.	76 N/F HAKIZIMANA, SEBASTIAN; MUKANDORI, MARTHA	77 N/F CAMPBELL, ELLEN	78 N/F CHALOUX, YVETTE C/O FRENCH, MARY	79 LINCOLN ROAD	80 N/F CAVANAUGH, WILLIAM F. & CHRISTINE	81 N/F ARMSTRONG, KEVIN & PHILLANE	82 N/F PILLSBURY, DANIEL
SURVEY DATA	S 03° 04' W	S 02° 59' W	S 42° 04' E	S 07° 00' W	S 09° 11' W	S 35° 49' E	S 06° 45' W	S 07° 02' W

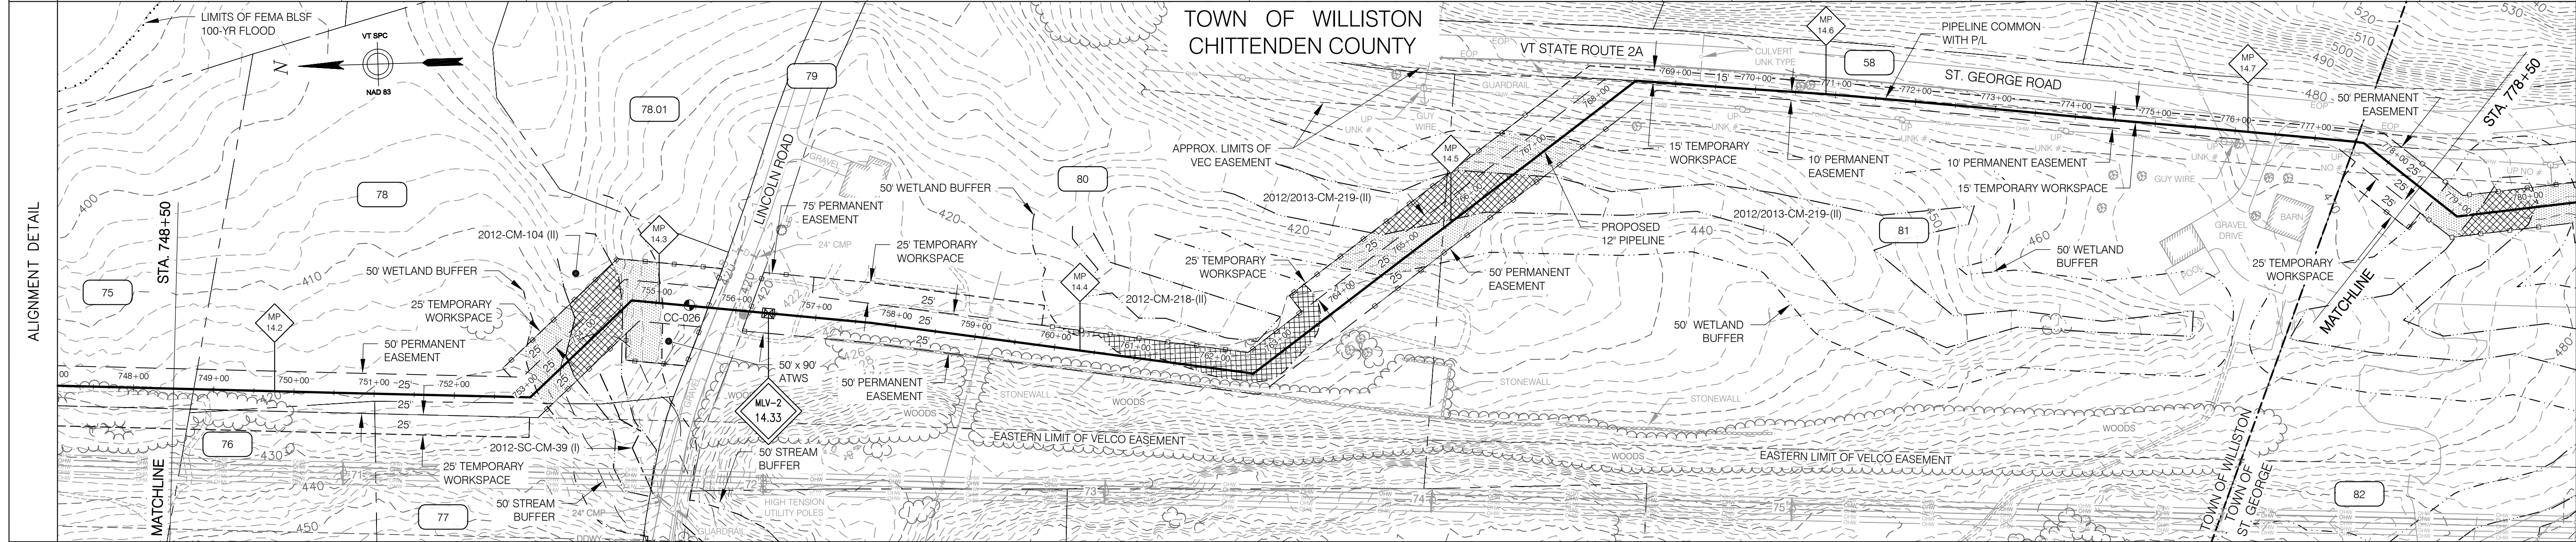

CONST. TYPE	1E	1A	W	7	W	1A	11	1A	2A	W	1A	4H	1E
-------------	----	----	---	---	---	----	----	----	----	---	----	----	----

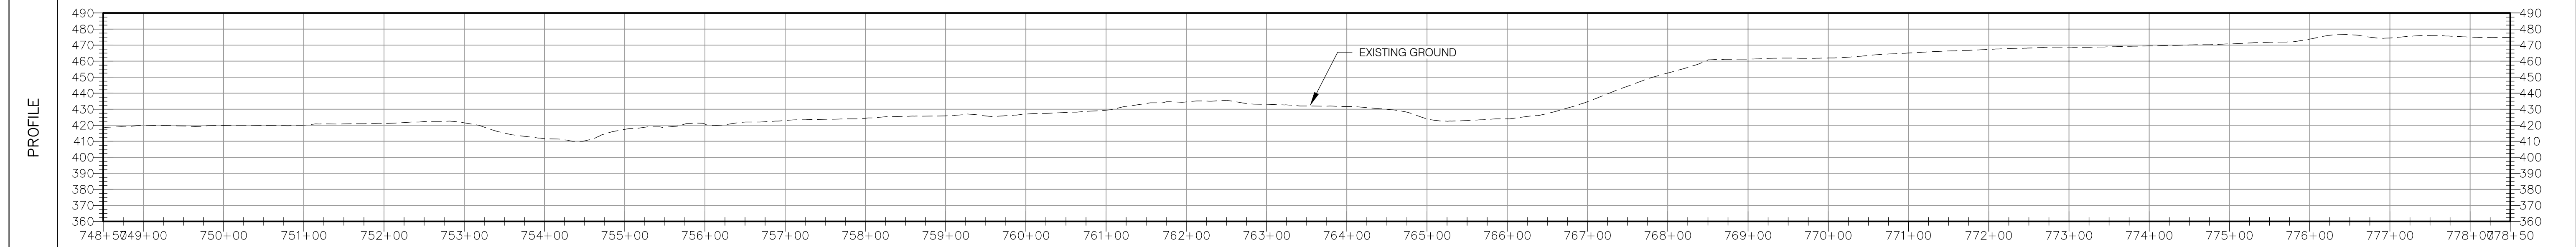

MATERIALS	1	1	1	1	1	1	1	1	1	1	1
COATING	A	C	A	C	A	C	A	C	A	C	A
CLASSIFICATION	2						1				
DESIGN FACTOR	0.5						0.5				

PIPE MATERIAL:

- 1 12.75" O.D. X 0.312" WT, API-5L, GR. X65, PSL-2, AND ADDITIONAL SPECIFICATIONS IN 192.112
- 2 20" O.D. X 0.375" WT, API-5L, GR. B

PIPE COATING:

- A EPOXY POLYETHYLENE 10/40
- B FBE, ABRASION RESISTANT OVERCOAT, 14-16 MILS/40 MILS, 54-56 MILS TOTAL
- C FBE 14-16 MILS, W/ 1-1/2" REINFORCED CONCRETE W/ 140 LBS/FT'

3,000 FT

0 FT

2,204 FT

0 FT



796 FT

HORIZONTAL SCALE

VERTICAL SCALE

ANGP-VAOT-029	VAOT ALIGNMENT SHEET	ENVIRONMENTAL	JLS	06/28/13	JLS	05/2016	VERMONT GAS PROPOSED 12" PIPELINE ADDISON NATURAL GAS PROJECT ALIGNMENT SHEET LOC. CHITTENDEN COUNTY, VERMONT YEAR: 2016 W.O. SCALE: 1" = 100' DWG. ANGP-T-C-029 REV. 0
ANGP-T-G-021	STATION AND VALVE DETAILS	DRAFTING DESIGNER	GIL	06/28/13	GJM	05/2016	
ANGP-EPSC-029	EPSC PLAN	DRAFTING SUPERVISOR	BZD	06/28/13	BCK	05/2016	
G-001 - 010	COVER, INDEX, LEGEND & NOTES, AND CONSTRUCTION DETAILS	DESIGN ENGINEER	MDF	06/28/13	GEW	05/2016	
DWG. NO.	REFERENCE DWG.	DESIGN MANAGER	SAB	06/28/13	JEO	05/2016	

RIGHT-OF-WAY	MATCHLINE	82.09 N/F PILLSBURY, DANIEL & JUDITH	83 N/F BELIVEAU, PHILIP & JALBERT, CAROLINE	MATCHLINE
SURVEY DATA		44'41" LT S 48° 20' W	24'33" RT S 03° 38' W 28'11" LT S 28° 11' W 27'57" LT S 0° 0' W 27'57" RT S 27° 56' E S 1° 51' E -31.0 ft 00'00" LT S 01° 41' E 00'04" RT S 01° 38' E	

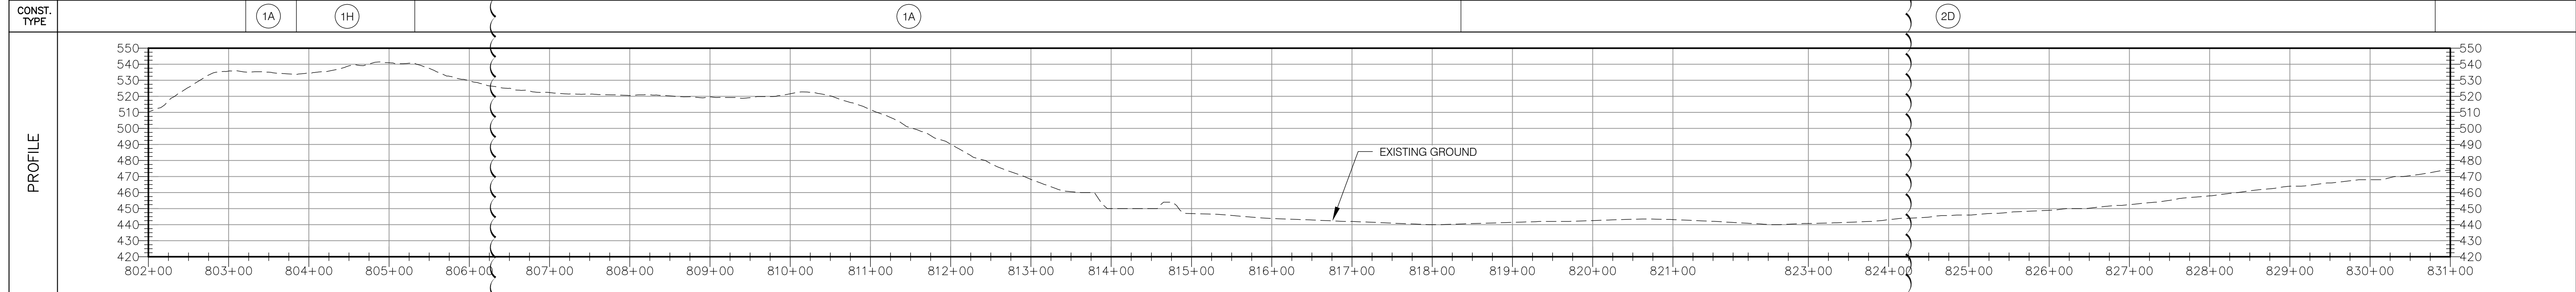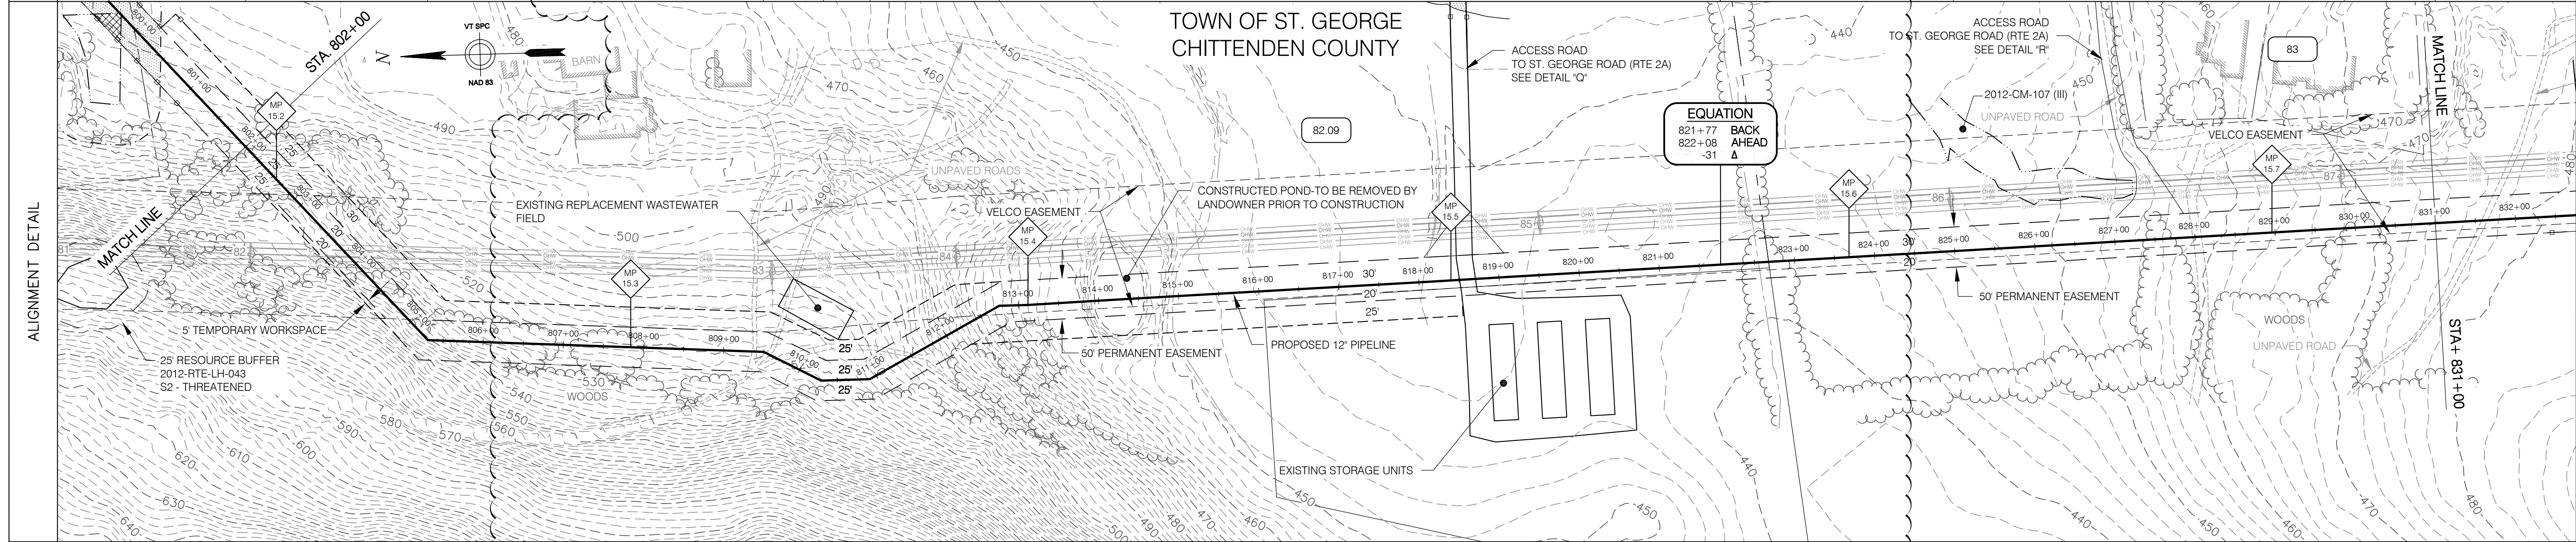

MATERIALS	1A	1H	1A	2D
-----------	----	----	----	----

COATING				
CLASSIFICATION		1		2
DESIGN FACTOR			0.5	

PIPE MATERIAL:

1 12.75" O.D. X 0.312" WT, API-5L, GR. X65, PSL-2, AND ADDITIONAL SPECIFICATIONS IN 192.112

2 20" O.D. X 0.375" WT, API-5L, GR. B

PIPE COATING:

A EPOXY POLYETHYLENE 10/40

B FBE, ABRASION RESISTANT OVERCOAT, 14-16 MILS/40 MILS, 54-56 MILS TOTAL

C FBE 14-16 MILS, W/ 1-1/2" REINFORCED CONCRETE W/ 140 LBS/FT'

2,869 FT



0 FT

2,869 FT

0 FT


ANGP-T-G-07-010 ACCESS ROAD DETAILS										VERMONT GAS PROPOSED 12" PIPELINE ADDISON NATURAL GAS PROJECT ALIGNMENT SHEET						
ANGP-EPSC-031 EPSC PLAN										LOC. CHITTENDEN COUNTY, VERMONT						
G-001 - 010 COVER, INDEX, LEGEND & NOTES, AND CONSTRUCTION DETAILS		1	BCK	TDB	PILLSBURY REROUTE (6/05/15)		ENVIRONMENTAL	JLS	06/28/13	JLS	05/2016	YEAR: 2016	W.O.			SCALE: 1" = 100'
DWG. NO. REFERENCE DWG.		REV	DSN	CK	DESCRIPTION		DESIGN ENGINEER	MDF	06/28/13	GEW	05/2016					

RIGHT-OF-WAY		98 N/F LAFRENIERE, JOANNE T.	99 N/F LUMBRA, LINDA P.	100 N/F PRENGLER, HERSCHEL	101 N/F DATTILO, DANA & KIMBERLY	102 N/F LAVALLETTE, BERNARD & EI	103 N/F BALLARD, TIMOTHY & KAY
SURVEY DATA		S 07° 09' E	S 06° 38' E	S 07° 08' E	S 06° 47' E	S 08° 03' E	S 05° 24' W

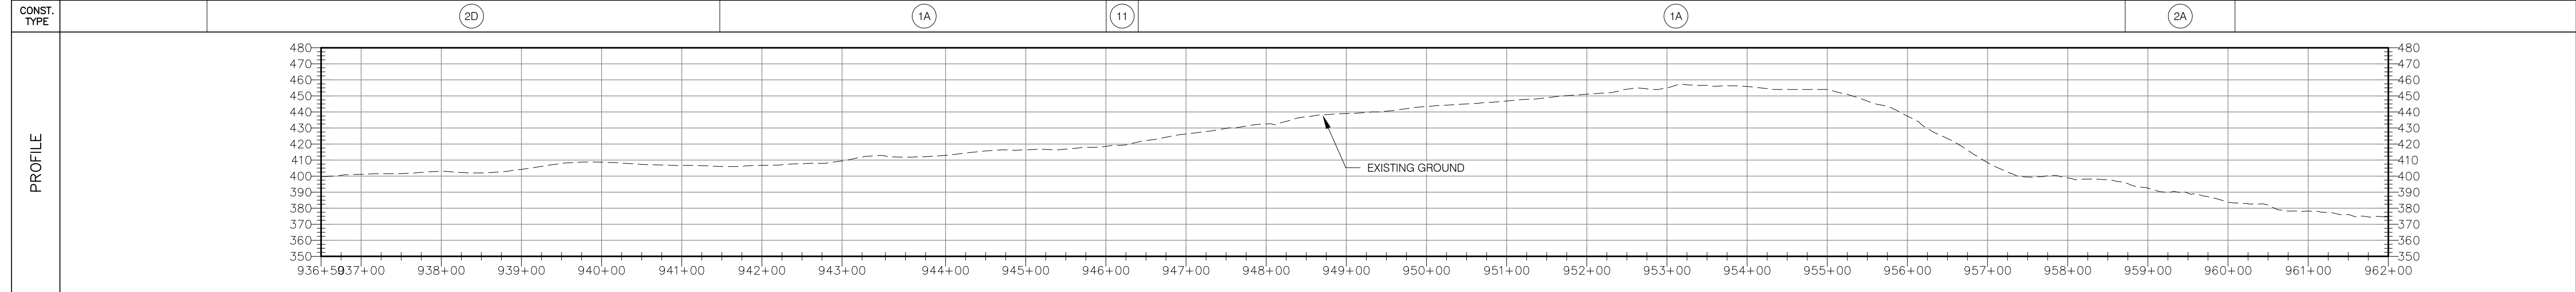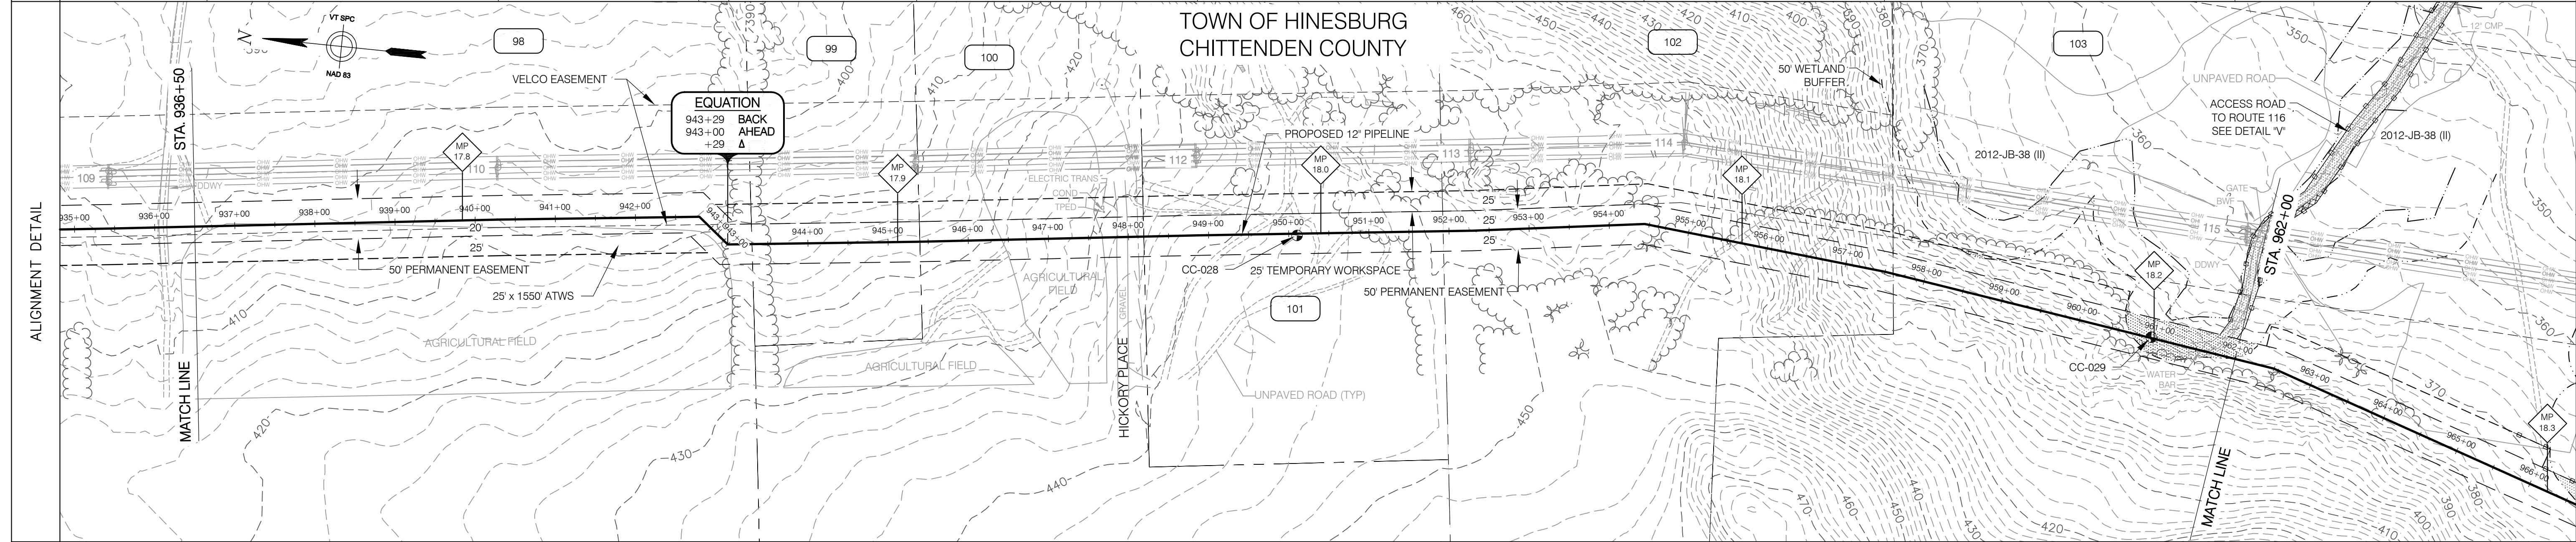



MATERIALS		1	1	1	1
COATING		1,165 FT A	13 FT C	1,266 FT A	135 FT C

CLASSIFICATION		1			
DESIGN FACTOR		0.5			








PIPE MATERIAL:
 1 12.75" O.D. X 0.312" WT, API-5L, GR. X65, PSL-2, AND ADDITIONAL SPECIFICATIONS IN 192.112 2,579 FT
 2 20" O.D. X 0.375" WT, API-5L, GR. B 0 FT


PIPE COATING:
 A EPOXY POLYETHYLENE 10/40 2,431 FT
 B FBE, ABRASION RESISTANT OVERCOAT, 14-16 MILS/40 MILS, 54-56 MILS TOTAL 0 FT
 C FBE 14-16 MILS, W/ 1-1/2" REINFORCED CONCRETE W/ 140 LBS/FT' 148 FT

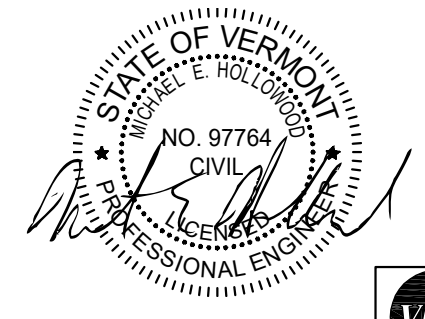



ANGP-T-G-07-010 ACCESS ROAD DETAILS		ANGP-EPSC-037 EPSC PLAN		G-001 - 010 COVER, INDEX, LEGEND & NOTES, AND CONSTRUCTION DETAILS		DWG. NO. REFERENCE DWG.		REV	DSN	CK	DESCRIPTION	INITIALS	DATE	INITIALS	DATE	YEAR: 2016	W.O.	SCALE: 1" = 100'	DWG. ANGP-T-C-037	REV. 0	
ENVIRONMENTAL		JLS	06/28/13	DRAFTING DESIGNER		GIL	06/28/13	DRAFTING SUPERVISOR		BZD	06/28/13	DESIGN ENGINEER		MDF	06/28/13	DESIGN MANAGER		SAB	06/28/13	VERMONT GAS PROPOSED 12" PIPELINE ADDISON NATURAL GAS PROJECT ALIGNMENT SHEET LOC. CHITTENDEN COUNTY, VERMONT	
CONSTRUCTION		JLS	05/2016	CONSTRUCTION		GJM	05/2016	CONSTRUCTION		BCK	05/2016	CONSTRUCTION		GEW	05/2016	CONSTRUCTION		JEO	05/2016	Vermont Gas	

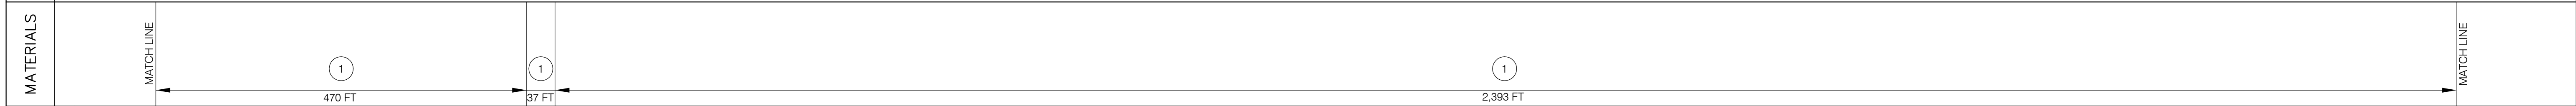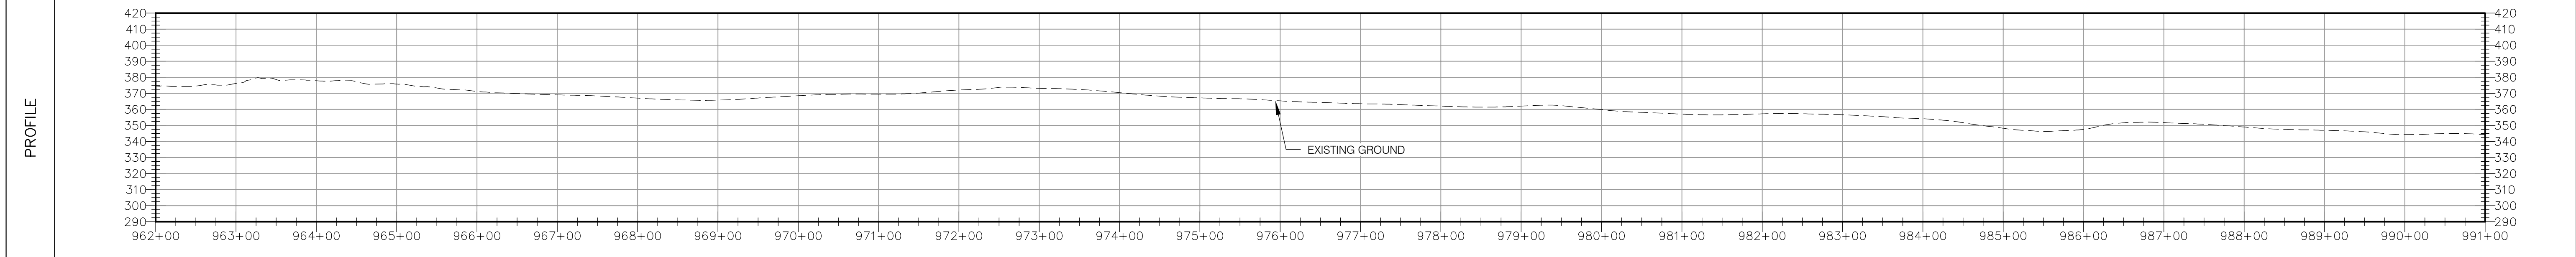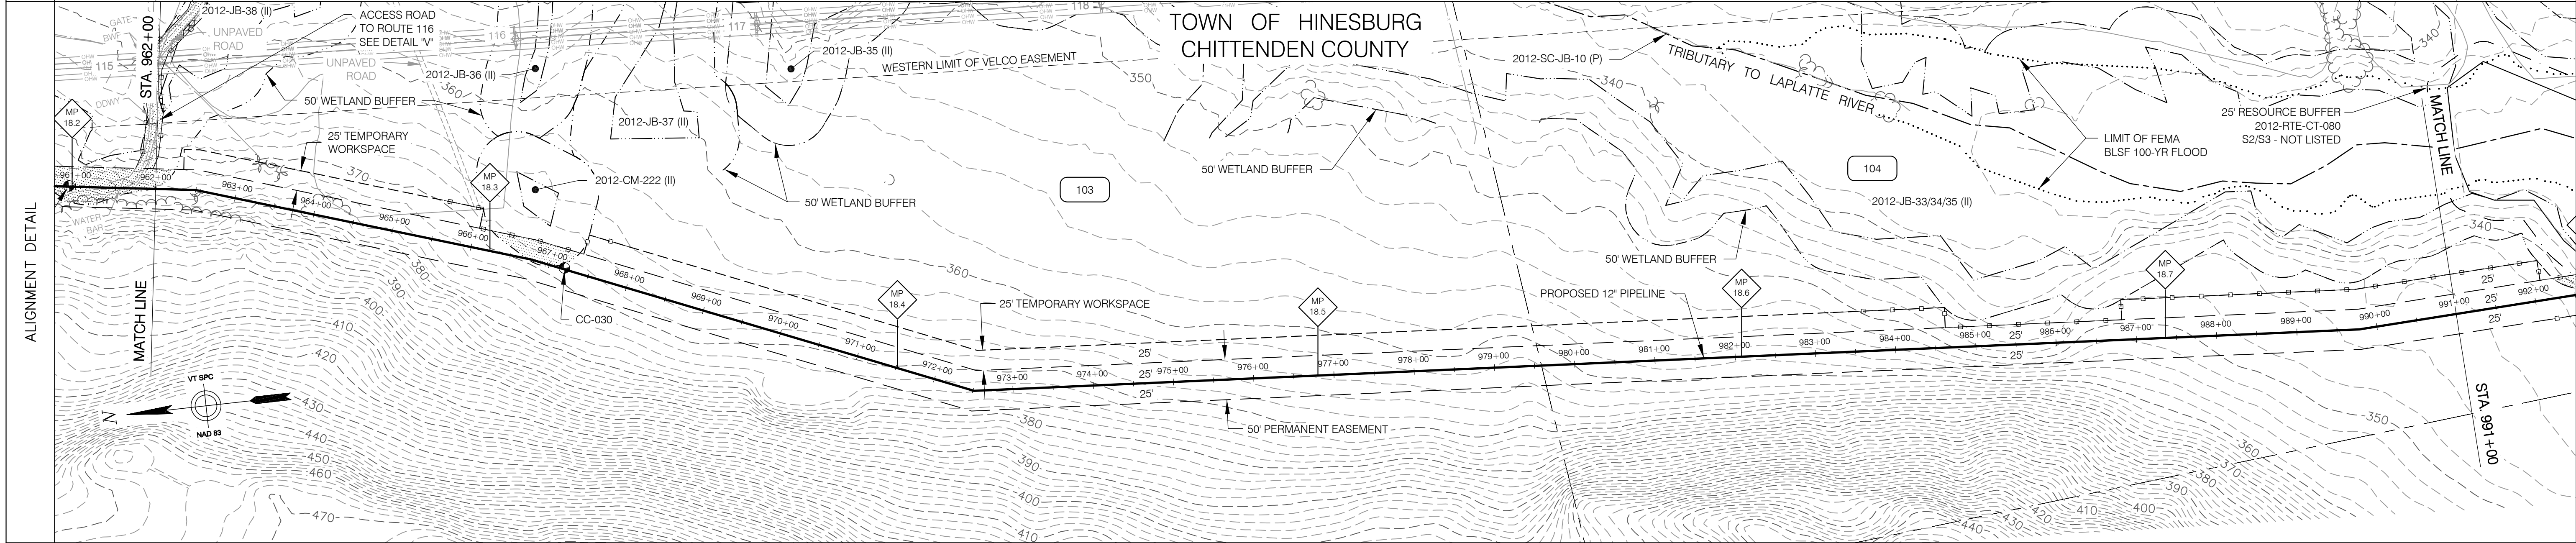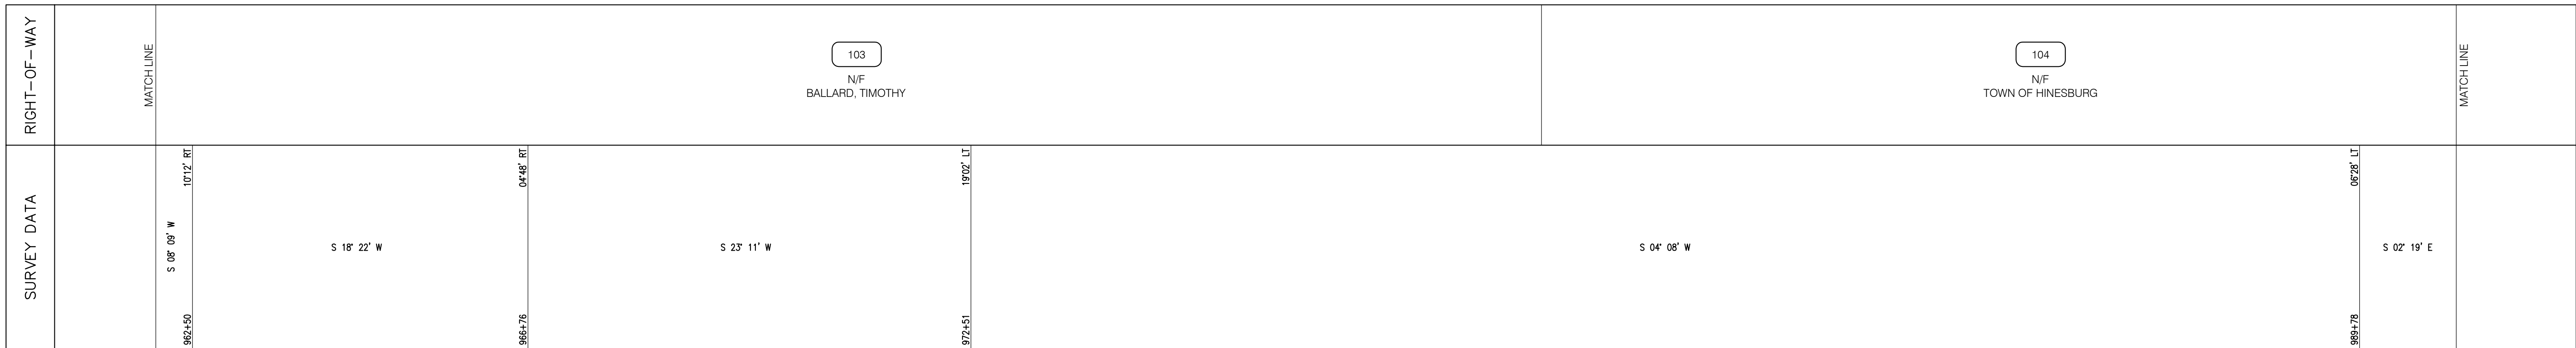

COATING	A	C	A
CLASSIFICATION	1		
DESIGN FACTOR	0.5		




PIPE MATERIAL:		
1 12.75" O.D. X 0.312" WT, API-5L, GR. X65, PSL-2, AND ADDITIONAL SPECIFICATIONS IN 192.112	2,900 FT	
2 20" O.D. X 0.375" WT, API-5L, GR. B	0 FT	
PIPE COATING:		
A EPOXY POLYETHYLENE 10/40	2,863 FT	
B FBE, ABRASION RESISTANT OVERCOAT, 14-16 MILS/40 MILS, 54-56 MILS TOTAL	0 FT	
C FBE 14-16 MILS, W/ 1-1/2" REINFORCED CONCRETE W/ 140 LBS/FT'	37 FT	

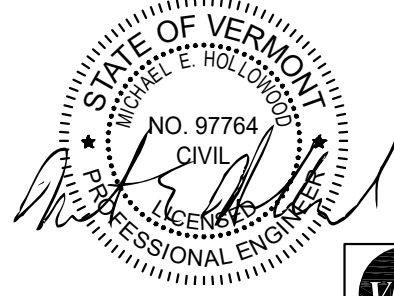


ANGP-EPSC-038		EPSC PLAN								ENVIRONMENTAL JLS 06/28/13 JLS 05/2016 DRAFTING DESIGNER GIL 06/28/13 GJM 05/2016 DRAFTING SUPERVISOR BZD 06/28/13 BCK 05/2016 DESIGN ENGINEER MDF 06/28/13 GEW 05/2016 DESIGN MANAGER SAB 06/28/13 JEO 05/2016		VERMONT GAS PROPOSED 12" PIPELINE ADDISON NATURAL GAS PROJECT ALIGNMENT SHEET		LOC. CHITTENDEN COUNTY, VERMONT YEAR: 2016 W.O. SCALE: 1" = 100' DWG. ANGP-T-C-038 REV. 0		
G-001 - 010		COVER, INDEX, LEGEND & NOTES, AND CONSTRUCTION DETAILS								Vermont Gas 						
DWG. NO.		REFERENCE DWG.		REV	DSN	CK	DESCRIPTION		INITIALS	DATE	INITIALS	DATE				

PROFILE

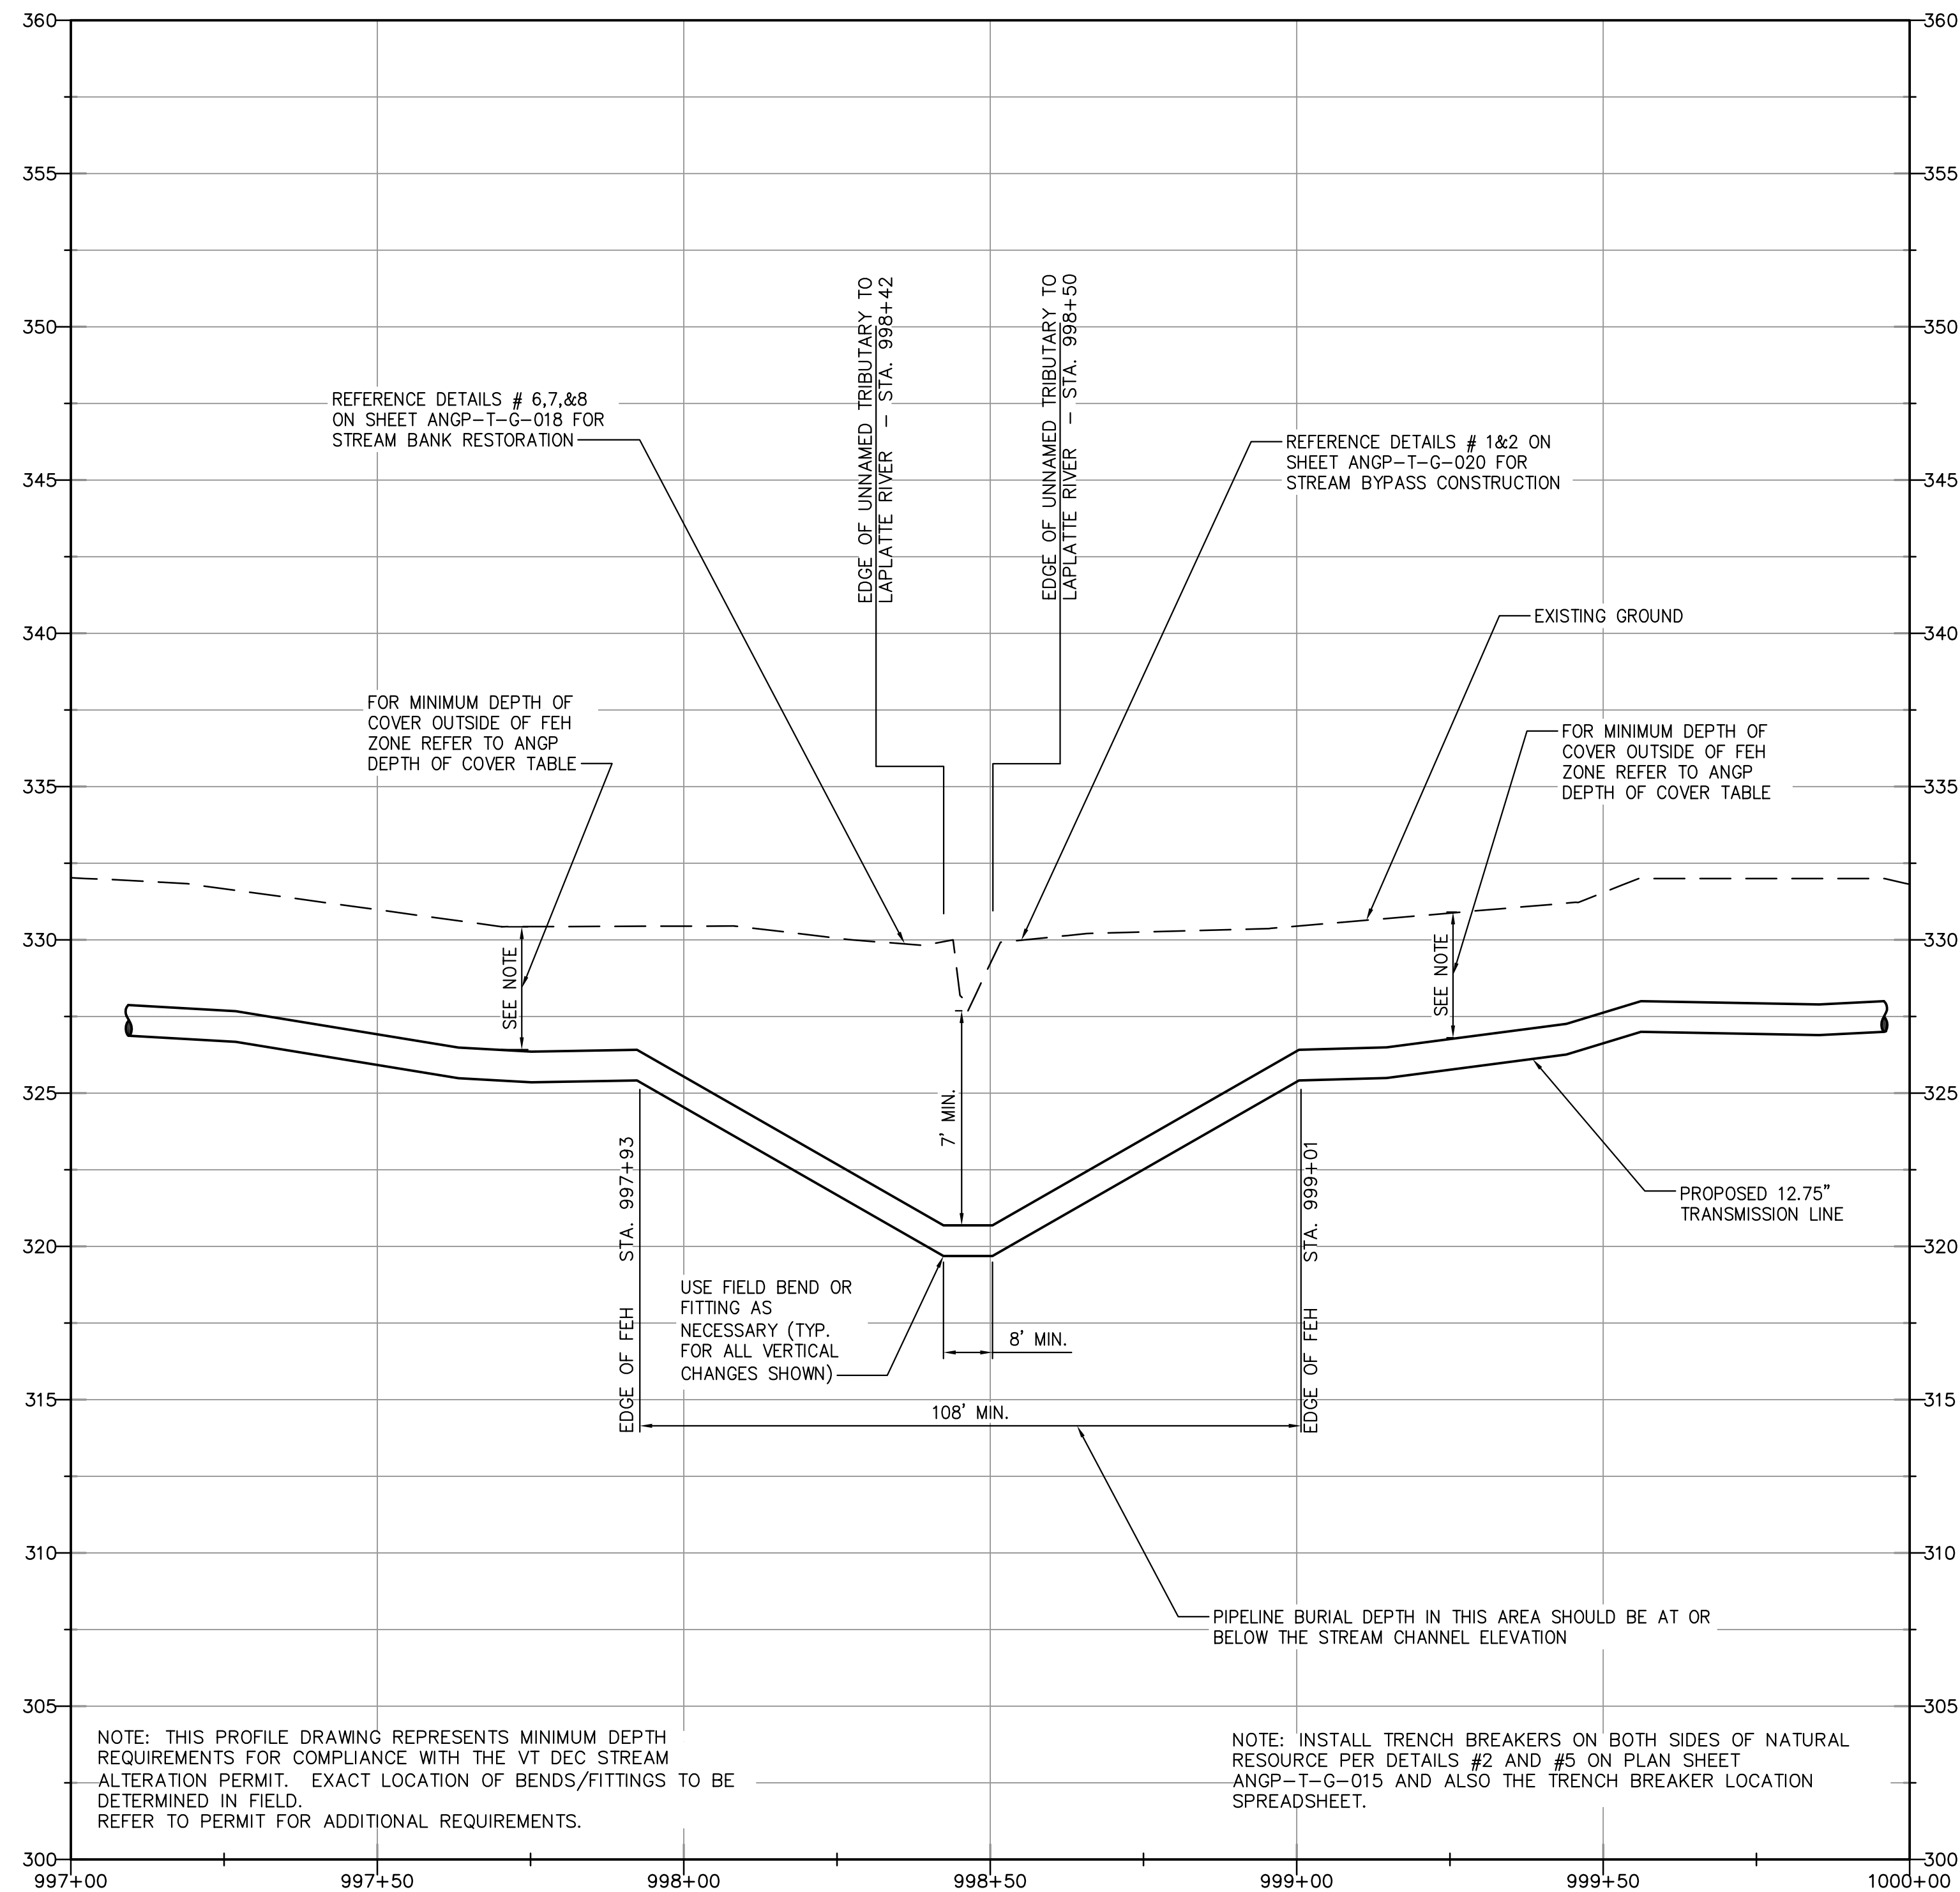

**STREAM CROSSING PROFILE
UNNAMED TRIBUTARY TO
LAPLATTE RIVER
STATION 998+46±
MILE POST 18.91**

SCALE: HORIZ. 1"=20'
VERT. 1"=4'


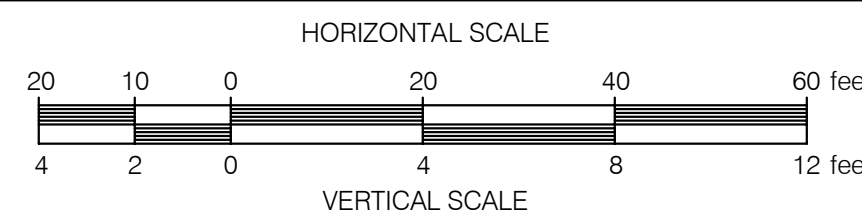


NOTE: STREAM CROSSING MUST BE CONSTRUCTED BETWEEN JUNE 1 AND OCTOBER 1



				<p>ENVIRONMENTAL JLS 06/28/13</p> <p>DRAFTING DESIGNER GIL 06/28/13</p> <p>DRAFTING SUPERVISOR BZD 06/28/13</p> <p>DESIGN ENGINEER MDF 06/28/13</p> <p>DESIGN MANAGER SAB 06/28/13</p>				<p>BID</p> <p>JLS 06/28/13</p> <p>GJM 06/28/13</p> <p>BCK 06/28/13</p> <p>GEW 06/28/13</p> <p>JEO 06/28/13</p>				<p>CONSTRUCTION</p> <p>JLS 05/2016</p> <p>GJM 05/2016</p> <p>BCK 05/2016</p> <p>GEW 05/2016</p> <p>JEO 05/2016</p>				<p>VERMONT GAS PROPOSED 12" PIPELINE ADDISON NATURAL GAS PROJECT OPEN TRENCH STREAM CROSSING PROFILE</p>								<p>38 Eastwood Drive, Suite 105 South Burlington, VT 05403 Main: (802) 795-0372 - www.chacompanies.com</p>	
DWG. NO.		REFERENCE DWG.		REV	DSN	CK	DESCRIPTION				INITIALS	DATE	INITIALS	DATE	YEAR: 2016	W.O.	SCALE: AS NOTED	DWG. ANGP-T-C-039A	REV. 0						

RIGHT-OF-WAY								
SURVEY DATA								

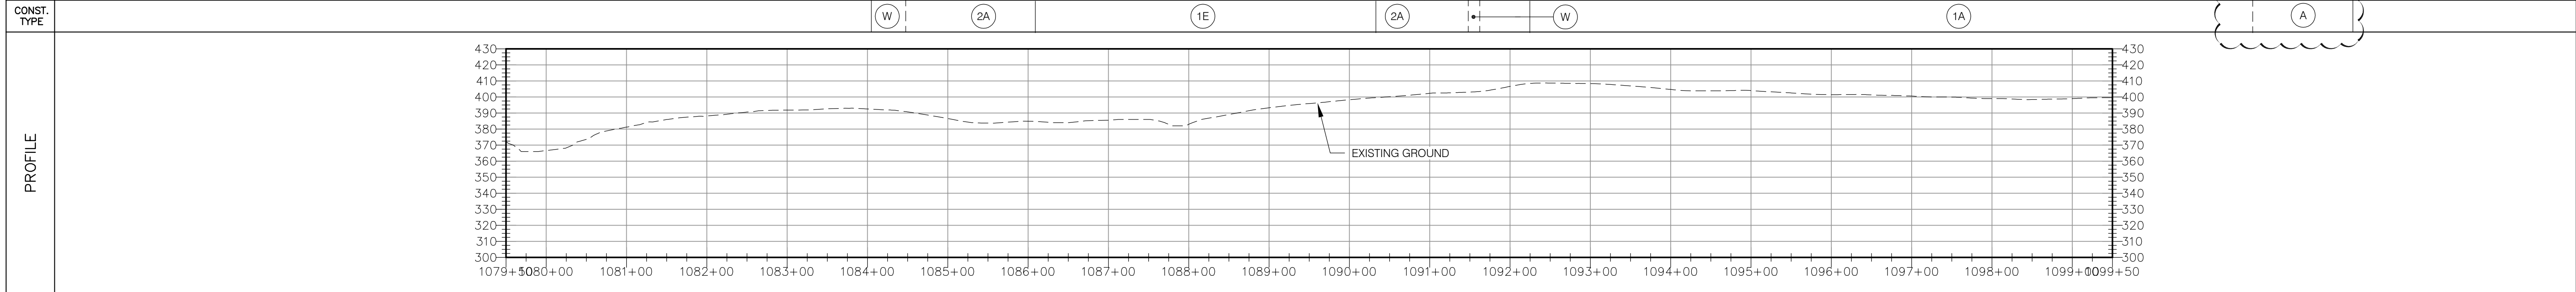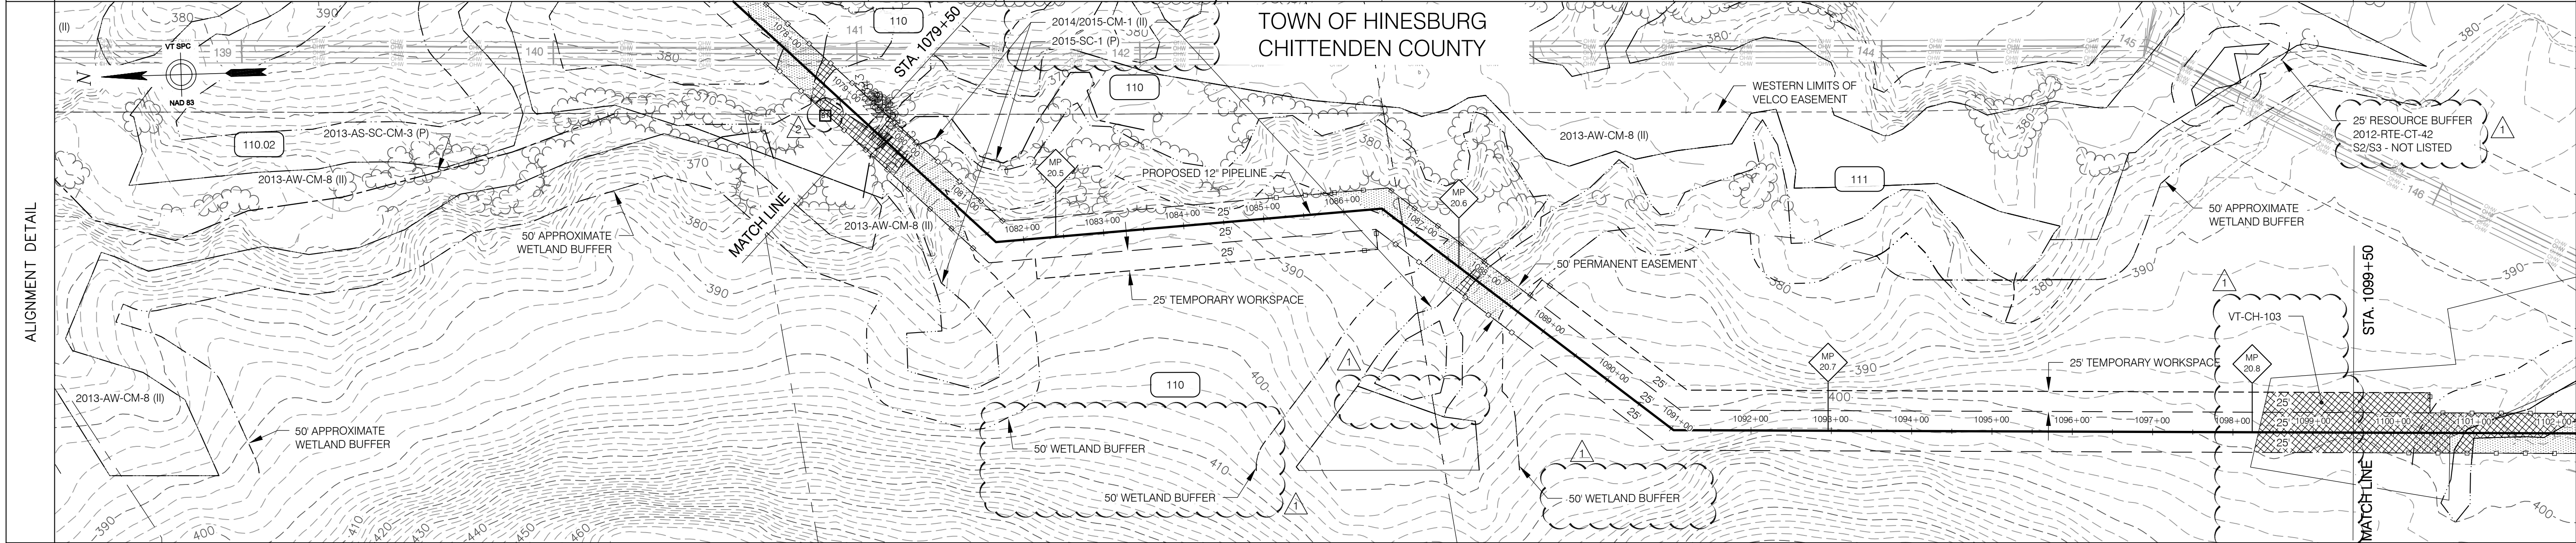

MATERIALS								
-----------	--	--	--	--	--	--	--	--

COATING								
CLASSIFICATION								
DESIGN FACTOR								

PIPE MATERIAL:

- 1 12.75" O.D. X 0.312" WT, API-5L, GR. X65, PSL-2, AND ADDITIONAL SPECIFICATIONS IN 192.112 2,002 FT
- 2 20" O.D. X 0.375" WT, API-5L, GR. B 0 FT

PIPE COATING:

- A EPOXY POLYETHYLENE 10/40 1,748 FT
- B FBE, ABRASION RESISTANT OVERCOAT, 14-16 MILS/40 MILS, 54-56 MILS TOTAL 0 FT
- C FBE 14-16 MILS, W/ 1-1/2" REINFORCED CONCRETE W/ 140 LBS/FT' 254 FT


HORIZONTAL SCALE

VERTICAL SCALE

ANGP-EPSC-042		EPSC PLAN		2	GJM	BCK	IFC 2016 EDITS (05/2016)	ENVIRONMENTAL	JLS	06/28/13	JLS	05/2016	VERMONT GAS PROPOSED 12" PIPELINE ADDISON NATURAL GAS PROJECT ALIGNMENT SHEET		LOC. CHITTENDEN COUNTY, VERMONT	YEAR: 2016	W.O.	SCALE: 1" = 100'	DWG. ANGP-T-C-042	REV. 2
G-001 - 010		COVER, INDEX, LEGEND & NOTES, AND CONSTRUCTION DETAILS		1	BCK	TDB	ADDED ARCH. SITE AND ENV. EDITS (6/08/15)	DRAFTING DESIGNER	GIL	06/28/13	GJM	05/2016								
DWG. NO.		REFERENCE DWG.		REV	DSN	CK	DESCRIPTION	DRAFTING SUPERVISOR	BZD	06/28/13	BCK	05/2016	Vermont Gas							

38 Eastwood Drive, Suite 105
South Burlington, VT 05403
Main: (802) 735-0372 - www.chacompanies.com

PROFILE

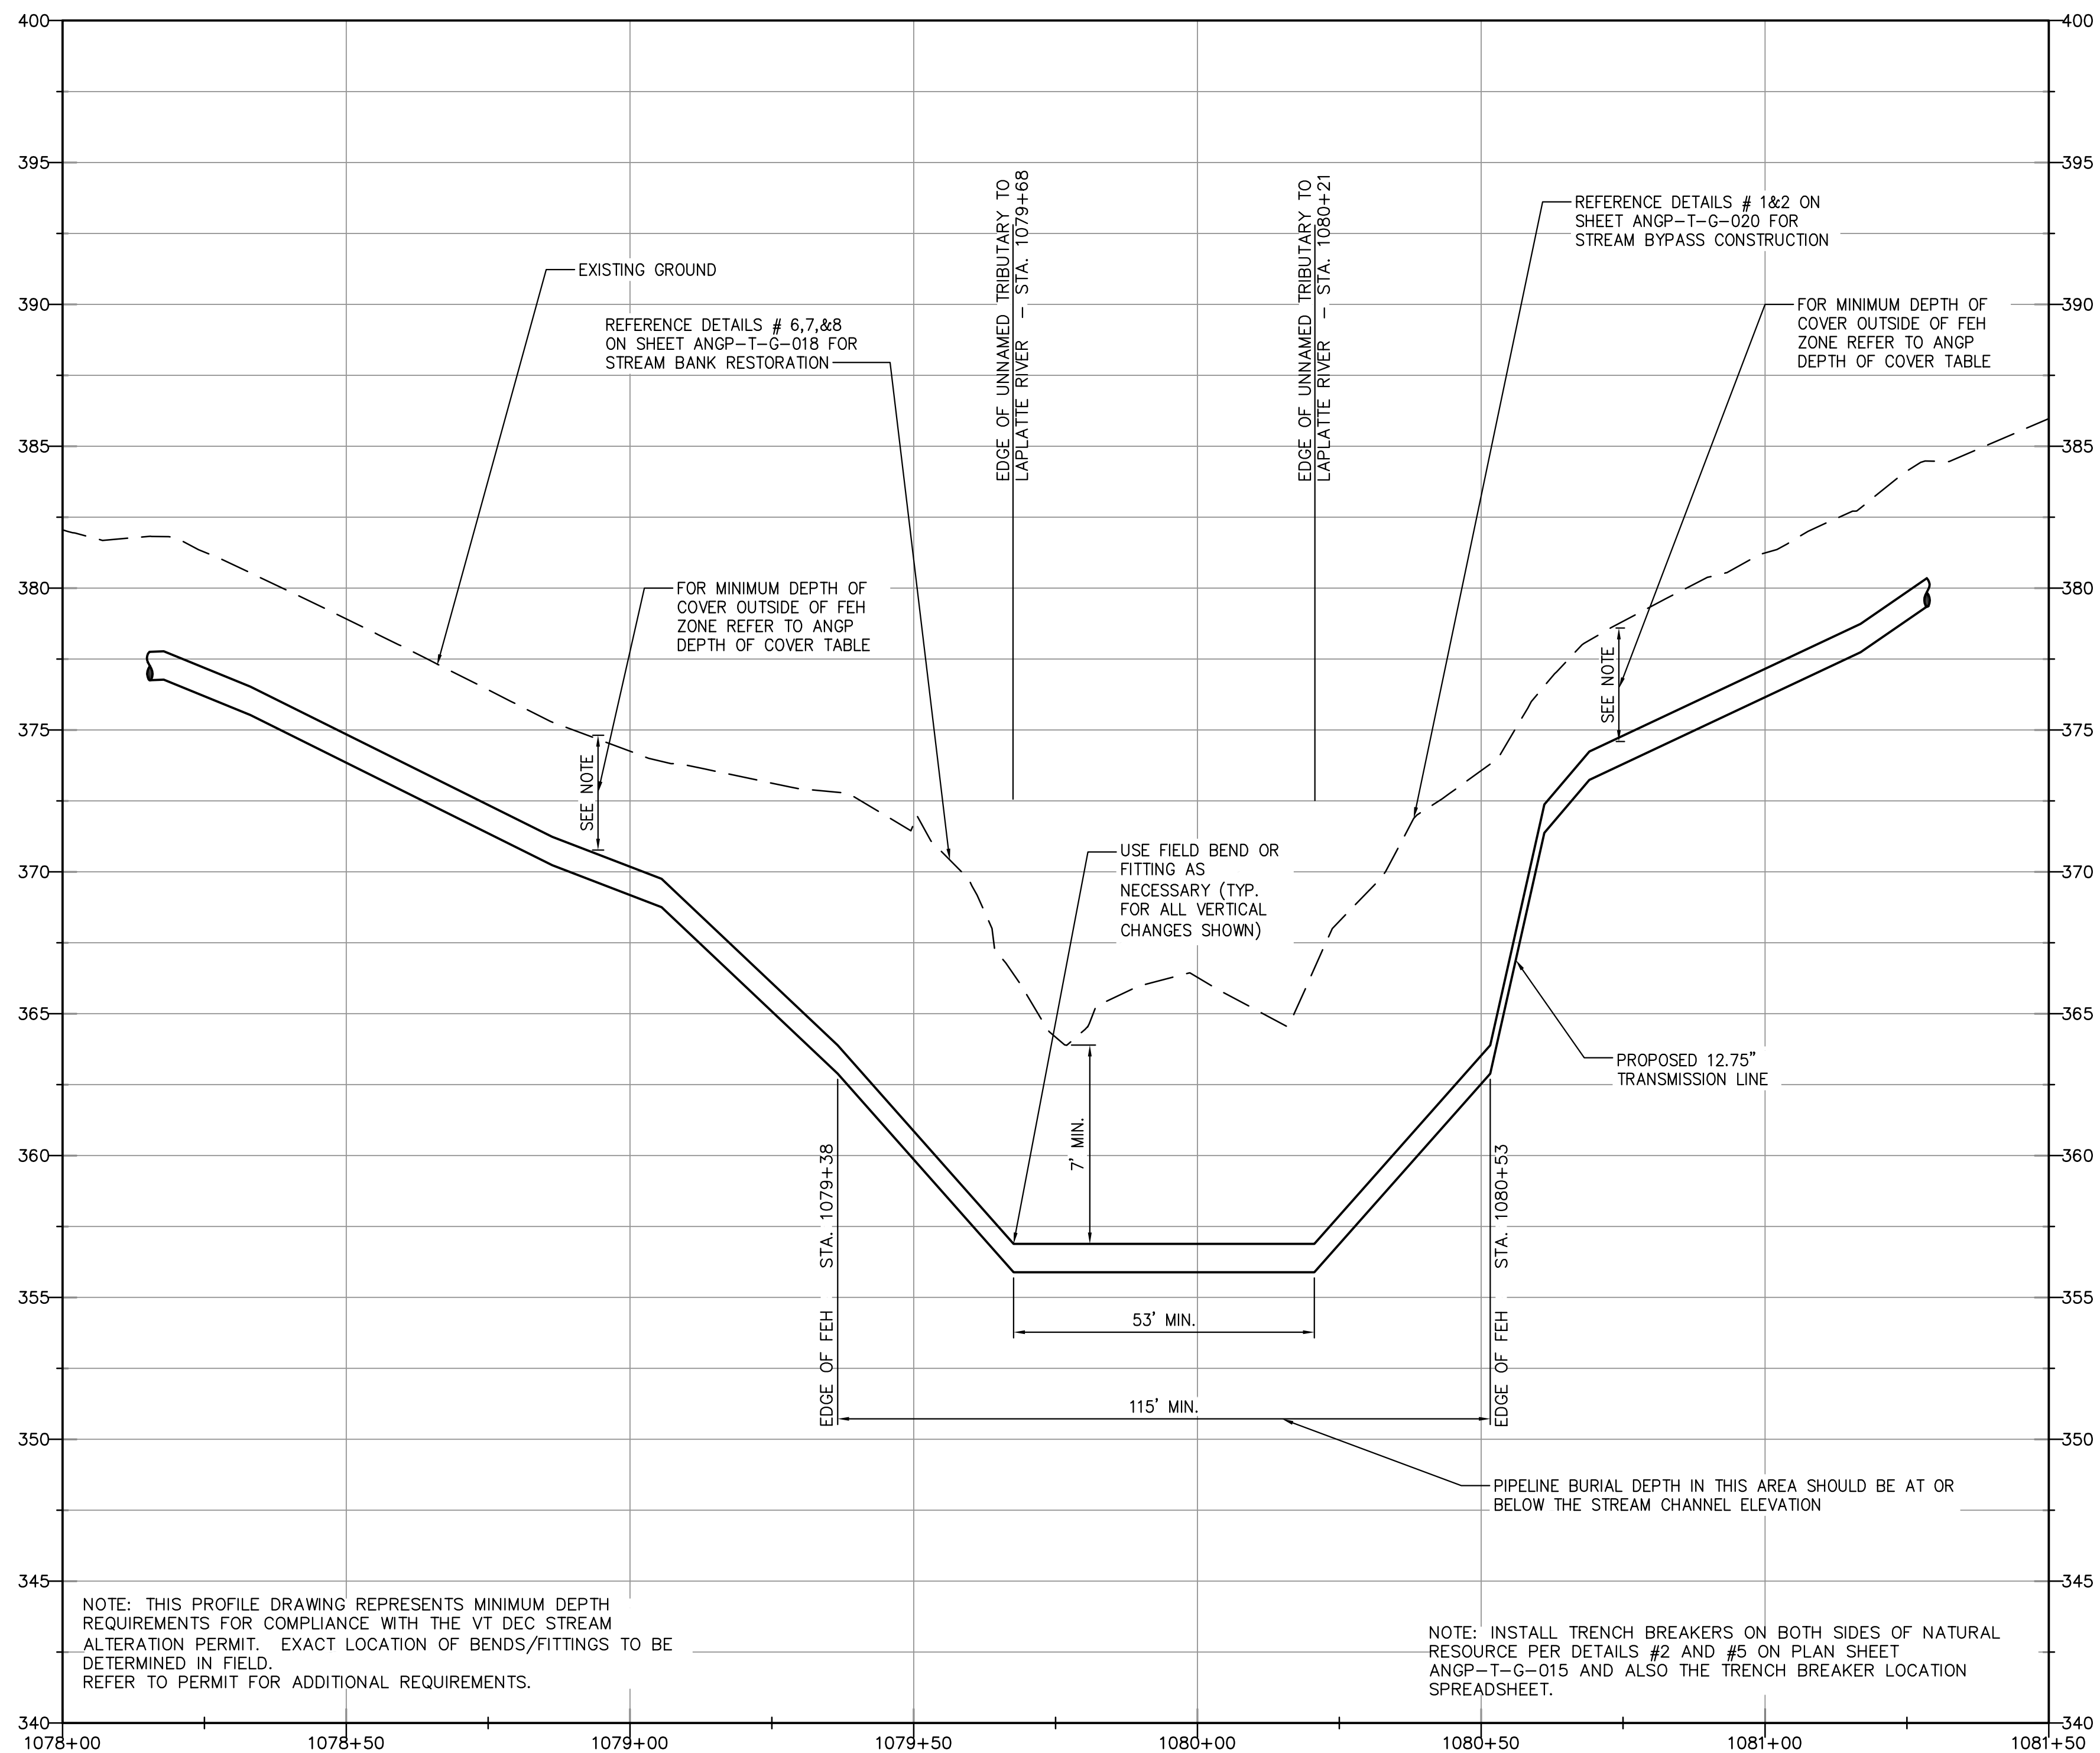


NOTE: THIS PROFILE DRAWING REPRESENTS MINIMUM DEPTH REQUIREMENTS FOR COMPLIANCE WITH THE VT DEC STREAM ALTERATION PERMIT. EXACT LOCATION OF BENDS/FITTINGS TO BE DETERMINED IN FIELD. REFER TO PERMIT FOR ADDITIONAL REQUIREMENTS.

NOTE: INSTALL TRENCH BREAKERS ON BOTH SIDES OF NATURAL RESOURCE PER DETAILS #2 AND #5 ON PLAN SHEET ANGP-T-G-015 AND ALSO THE TRENCH BREAKER LOCATION SPREADSHEET.

**STREAM CROSSING PROFILE
UNNAMED TRIBUTARY TO
LAPLATTIE RIVER
STATION 1079+97±
MILE POST 20.45**

SCALE: HORIZ. 1"=20'
VERT. 1"=4'

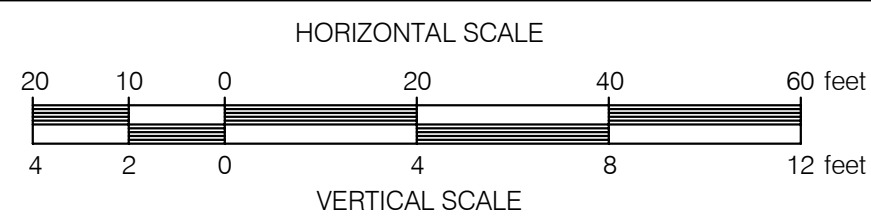


NOTE: STREAM CROSSING MUST BE CONSTRUCTED BETWEEN JULY 1 AND OCTOBER 1





VHB Vanasse Hangen Brustlin, Inc.

DWG. NO.	REFERENCE DWG.	REV	DSN	CK	DESCRIPTION	INITIALS	DATE	INITIALS	DATE	YEAR: 2016	W.O.	SCALE: AS NOTED	DWG. ANGP-T-C-042A	REV. 0
					ENVIRONMENTAL	JLS	06/28/13	JLS	05/2016					
					DRAFTING DESIGNER	GIL	06/28/13	GJM	05/2016					
					DRAFTING SUPERVISOR	BZD	06/28/13	BCK	05/2016					
					DESIGN ENGINEER	MDF	06/28/13	GEW	05/2016					
					DESIGN MANAGER	SAB	06/28/13	JEO	05/2016					


VERMONT GAS
PROPOSED 12" PIPELINE
ADDISON NATURAL GAS PROJECT
OPEN TRENCH STREAM CROSSING PROFILE




RIGHT-OF-WAY													
SURVEY DATA													

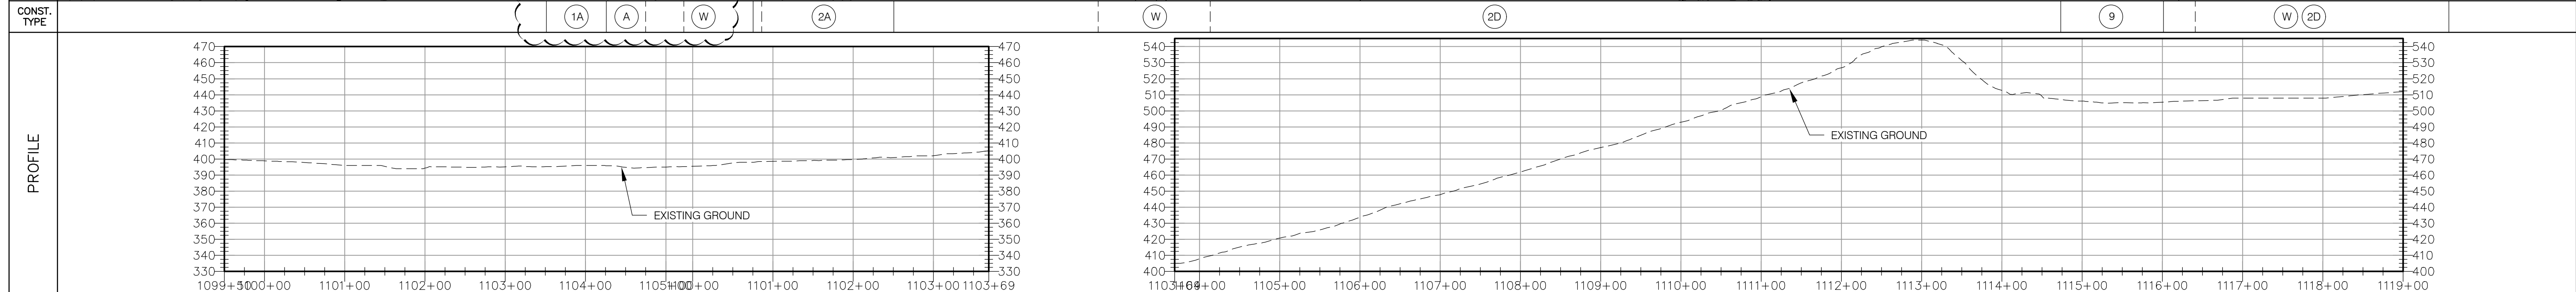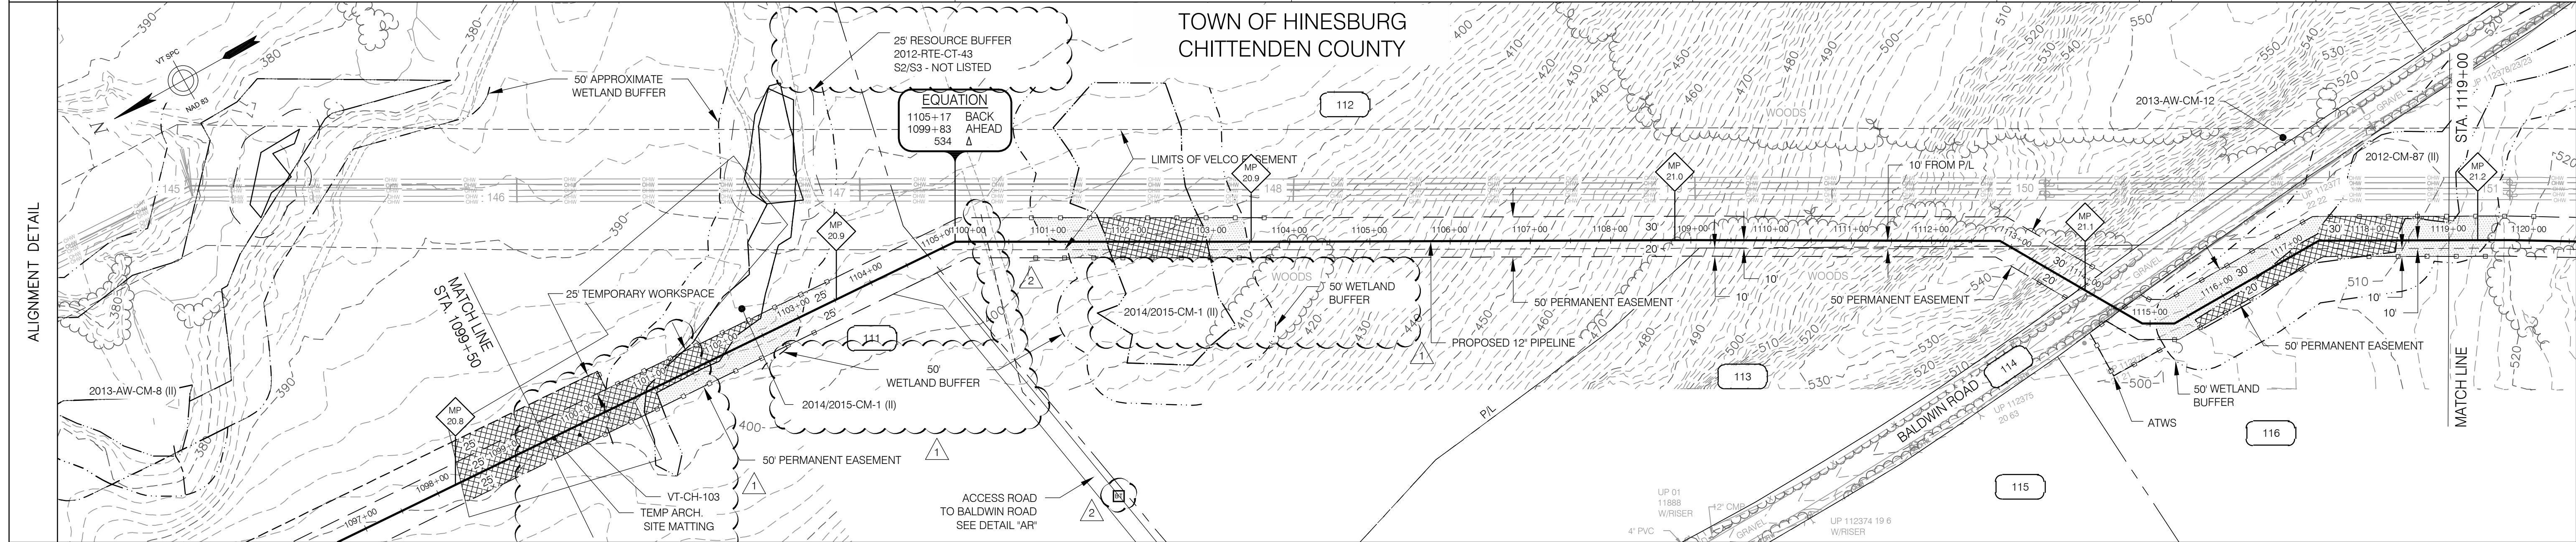

MATERIALS													
COATING													
CLASSIFICATION													
DESIGN FACTOR													



PIPE MATERIAL:		
1	12.75" O.D. X 0.312" WT, API-5L, GR. X65, PSL-2, AND ADDITIONAL SPECIFICATIONS IN 192.112	2,484 FT
2	20" O.D. X 0.375" WT, API-5L, GR. B	0 FT
PIPE COATING:		
A	EPOXY POLYETHYLENE 10/40	1,475 FT
B	FBE, ABRASION RESISTANT OVERCOAT, 14-16 MILS/40 MILS, 54-56 MILS TOTAL	0 FT
C	FBE 14-16 MILS, W/ 1-1/2" REINFORCED CONCRETE W/ 140 LBS/FT'	1,009 FT

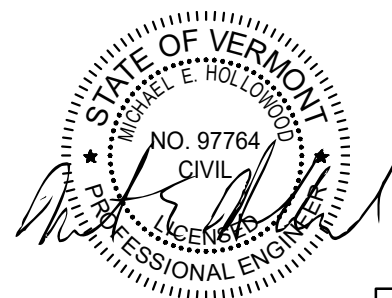


VHB Vanasse Hangen Brustlin, Inc.

ANGP-T-G-007-010	ACCESS ROAD DETAILS																		
ANGP-EPSC-043	EPSC PLAN	2	GJM	BCK															
G-001 - 010	COVER, INDEX, LEGEND & NOTES, AND CONSTRUCTION DETAILS	1	BCK	TDB															
DWG. NO.	REFERENCE DWG.	REV	DSN	CK															


ENVIRONMENTAL	JLS	06/28/13	JLS	05/2016	VERMONT GAS PROPOSED 12" PIPELINE ADDISON NATURAL GAS PROJECT ALIGNMENT SHEET	LOC. CHITTENDEN COUNTY, VERMONT	YEAR: 2016	W.O.	SCALE: 1" = 100'	DWG. ANGP-T-C-043	REV. 2
DRAFTING DESIGNER	GIL	06/28/13	GJM	05/2016							
DRAFTING SUPERVISOR	BZD	06/28/13	BCK	05/2016							
DESIGN ENGINEER	MDF	06/28/13	GEW	05/2016							
DESIGN MANAGER	SAB	06/28/13	JEO	05/2016							



RIGHT-OF-WAY												
	MATCH LINE	127 N/F LEUSCHNER, EDWARD T. JR. & DAWN	128 N/F DERRICK, DIANE M.	TOWN OF HINESBURG TOWN OF MONKTON	129 N/F WEAVER, TODD & TAMMY	130 N/F ALMOND, DAVID	131 N/F STEIN, PHILIP J.	132 N/F MAY, PETER M. & SANDRA	133 N/F NOLAN, KATHLEEN	134 N/F NORRIS, NORMA	MATCH LINE	
SURVEY DATA		S 03° 18' W	S 03° 31' W		S 03° 19' W	S 03° 25' W	S 03° 17' W	S 03° 26' W	S 03° 26' W	S 46° 26' W		

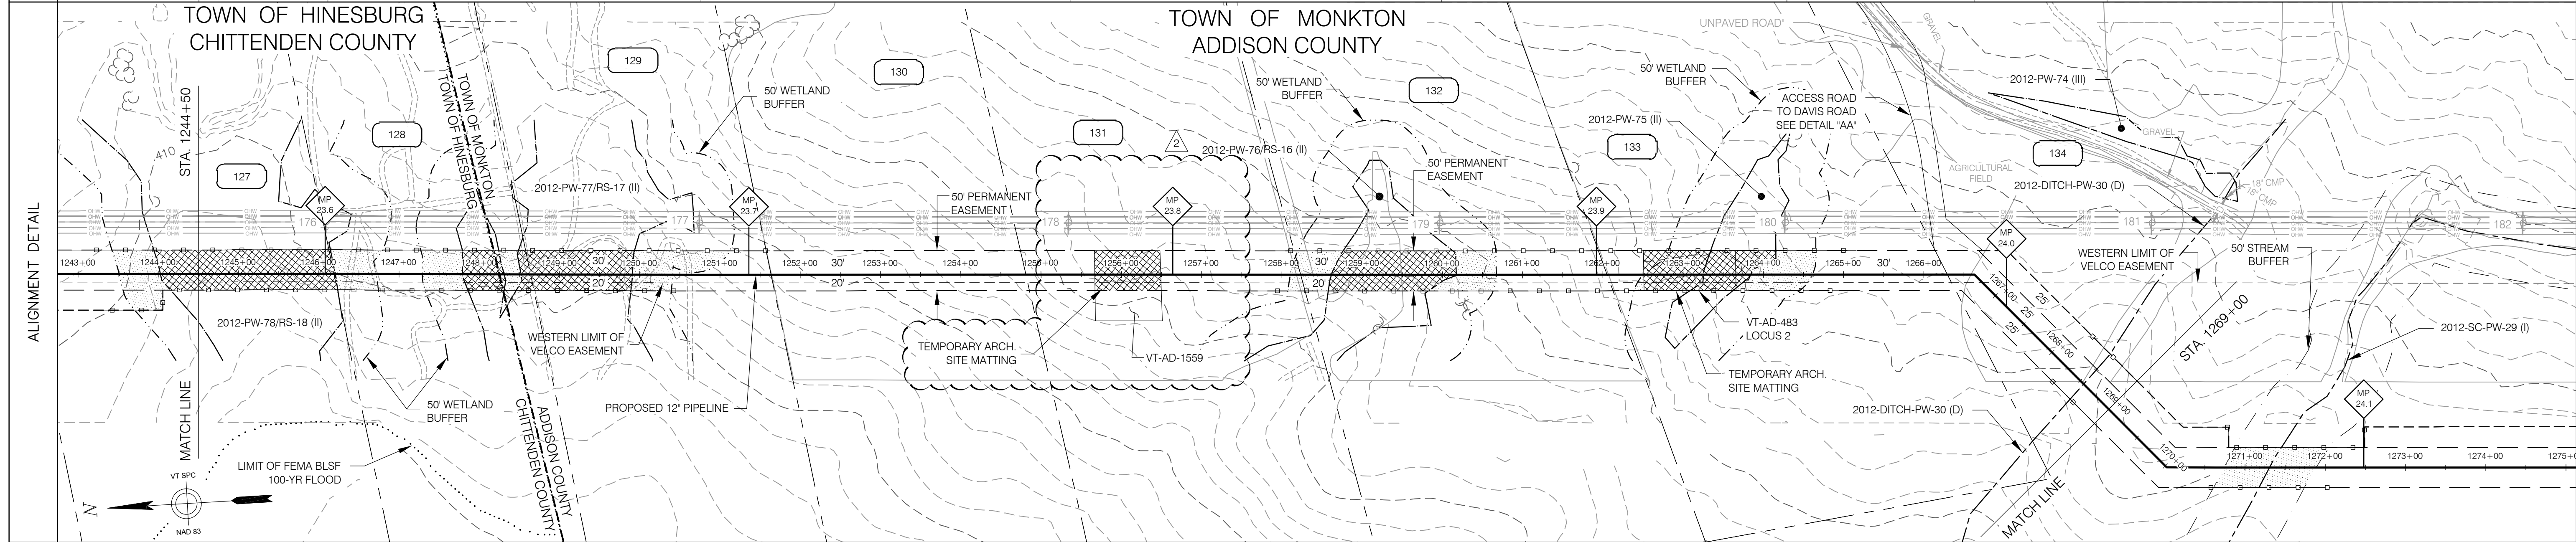

CONST. TYPE		(W)	(W)	(2D)	(A)	(W)	(A)	(W)	(1A)	(1A)		
-------------	--	-----	-----	------	-----	-----	-----	-----	------	------	--	--

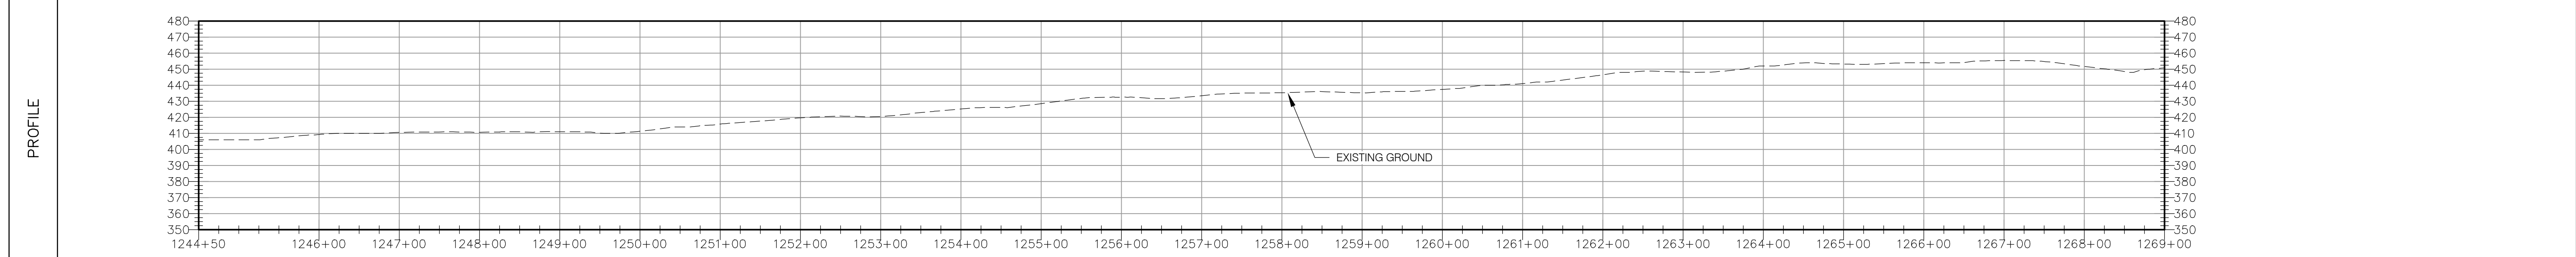

MATERIALS		(1)	(1)	(1)	(1)	(1)	(1)	(1)	(1)		
COATING		223 FT C	57 FT A	311 FT C	771 FT A	257 FT C	184 FT A	212 FT C	438 FT A		
CLASSIFICATION					1						
DESIGN FACTOR					0.5						

HORIZONTAL SCALE

VERTICAL SCALE

PIPE MATERIAL:

1 12.75" O.D. X 0.312" WT, API-5L, GR. X65, PSL-2, AND ADDITIONAL SPECIFICATIONS IN 192.112 2,450 FT

2 20" O.D. X 0.375" WT, API-5L, GR. B 0 FT

PIPE COATING:


A EPOXY POLYETHYLENE 10/40 1,450 FT

B FBE, ABRASION RESISTANT OVERCOAT, 14-16 MILS/40 MILS, 54-56 MILS TOTAL 0 FT


C FBE 14-16 MILS, W/ 1-1/2" REINFORCED CONCRETE W/ 140 LBS/FT' 1,000 FT

										ENVIRONMENTAL JLS 06/28/13 JLS 05/2016 DRAFTING DESIGNER GIL 06/28/13 GJM 05/2016 DRAFTING SUPERVISOR BZD 06/28/13 BCK 05/2016 DESIGN ENGINEER MDF 06/28/13 GEW 05/2016 DESIGN MANAGER SAB 06/28/13 JEO 05/2016		VERMONT GAS PROPOSED 12" PIPELINE ADDISON NATURAL GAS PROJECT ALIGNMENT SHEET			
ANGP-T-G-07-010		ACCESS ROAD DETAILS								LOC. ADDISON COUNTY, VERMONT		YEAR: 2016 W.O. SCALE: 1" = 100' DWG. ANGP-T-C-049 REV. 2			
ANGP-EPSC-049		EPSC PLAN		2 GJM BCK		IFC PLAN SET EDITS (05/2016)									
G-001 - 010		COVER, INDEX, LEGEND & NOTES, AND CONSTRUCTION DETAILS		1 BCK TDB		ROTAX ROAD REROUTE (10/26/15)									
DWG. NO.		REFERENCE DWG.		REV DSN CK		DESCRIPTION		INITIALS DATE		INITIALS DATE					

RIGHT-OF-WAY									
SURVEY DATA									

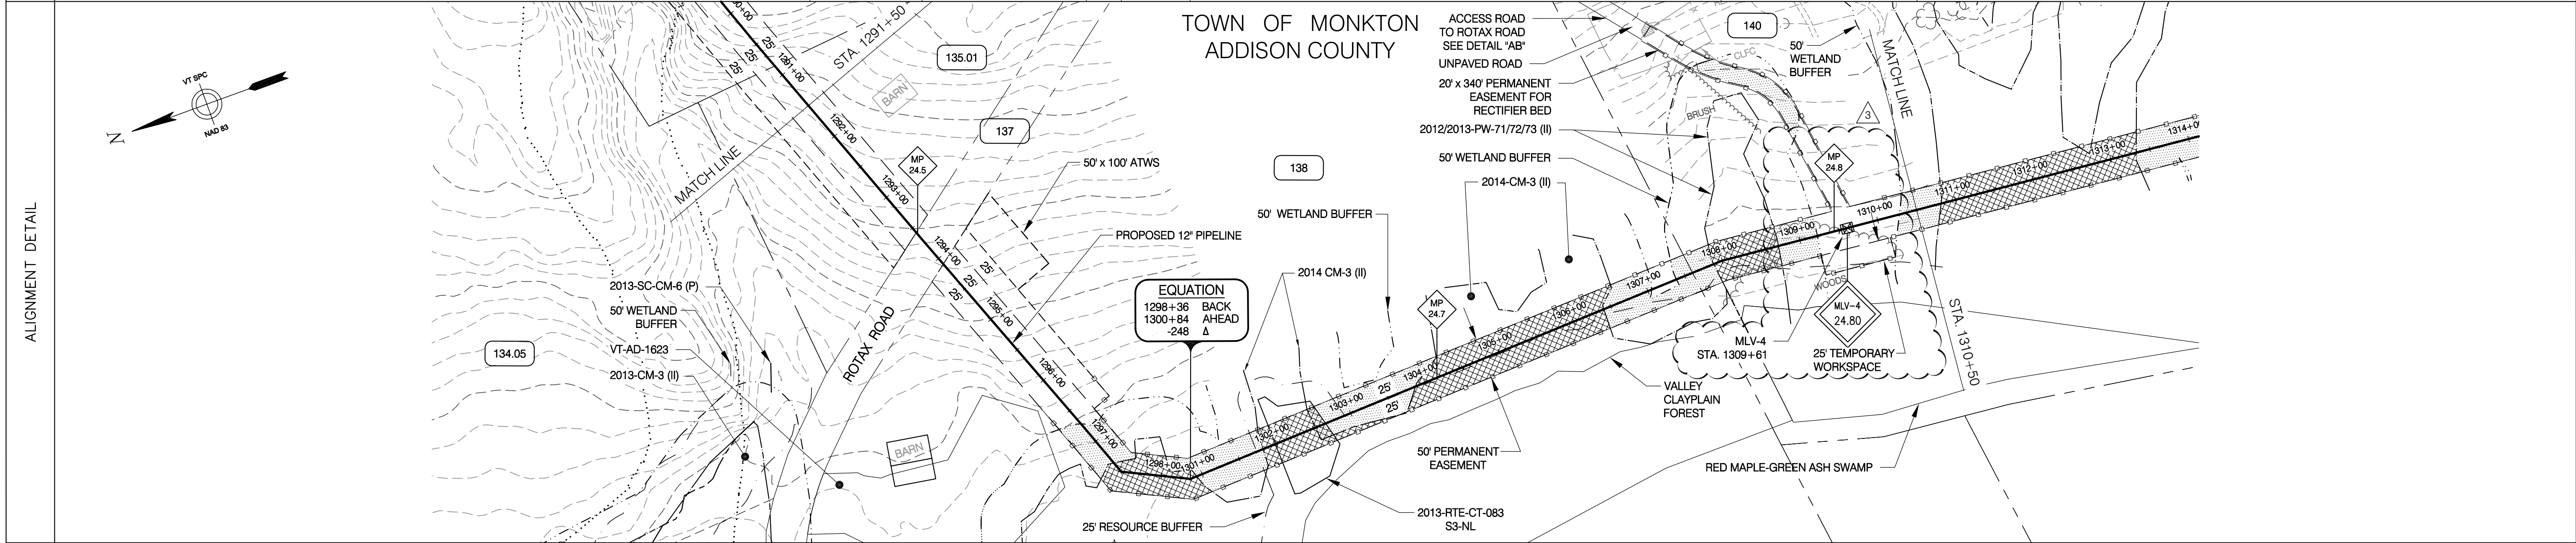


CONST. TYPE									
-------------	--	--	--	--	--	--	--	--	--

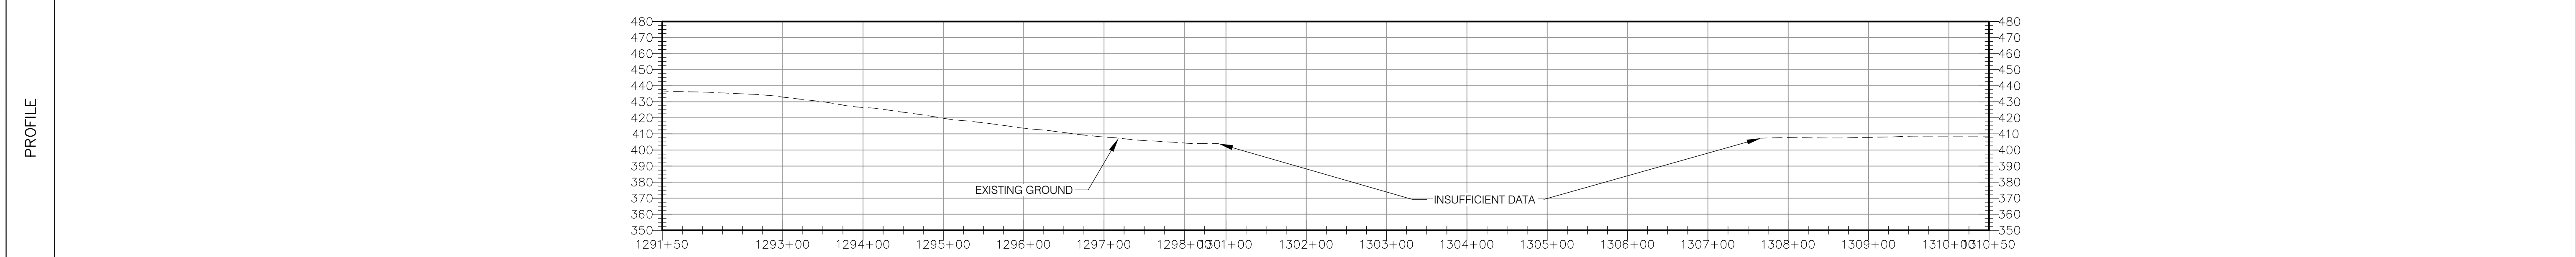


MATERIALS									
-----------	--	--	--	--	--	--	--	--	--



COATING									
CLASSIFICATION									
DESIGN FACTOR									



PIPE MATERIAL:		
1	12.75" O.D. X 0.312" WT, API-5L, GR. X65, PSL-2, AND ADDITIONAL SPECIFICATIONS IN 192.112	1,652 FT
2	20" O.D. X 0.375" WT, API-5L, GR. B	0 FT
PIPE COATING:		
A	EPOXY POLYETHYLENE 10/40	577 FT
B	FBE, ABRASION RESISTANT OVERCOAT, 14-16 MILS/40 MILS, 54-56 MILS TOTAL	0 FT
C	FBE 14-16 MILS, W/ 1-1/2" REINFORCED CONCRETE W/ 140 LBS/FT'	1,075 FT



				ENVIRONMENTAL				VERMONT GAS PROPOSED 12" PIPELINE ADDISON NATURAL GAS PROJECT ALIGNMENT SHEET				LOC. ADDISON COUNTY, VERMONT		YEAR: 2016		W.O.		SCALE: 1" = 100'		DWG. ANGP-T-C-051		REV. 3	
				DRAFTING DESIGNER				DRAFTING SUPERVISOR															
				DESIGN ENGINEER				DESIGN MANAGER															
				MLV-4 RELOCATION (05/01/16)																			
				ROTAX ROAD REROUTE (10/26/15)																			
				ADDED ARCH. SITE AND ENV. EDITS (6/08/15)																			
				DESCRIPTION																			
				INITIALS				DATE				INITIALS		DATE									
ANGP-EPSC-051				EPSC PLAN																			
G-001 - 010				COVER, INDEX, LEGEND & NOTES, AND CONSTRUCTION DETAILS																			
DWG. NO.				REFERENCE DWG.																			

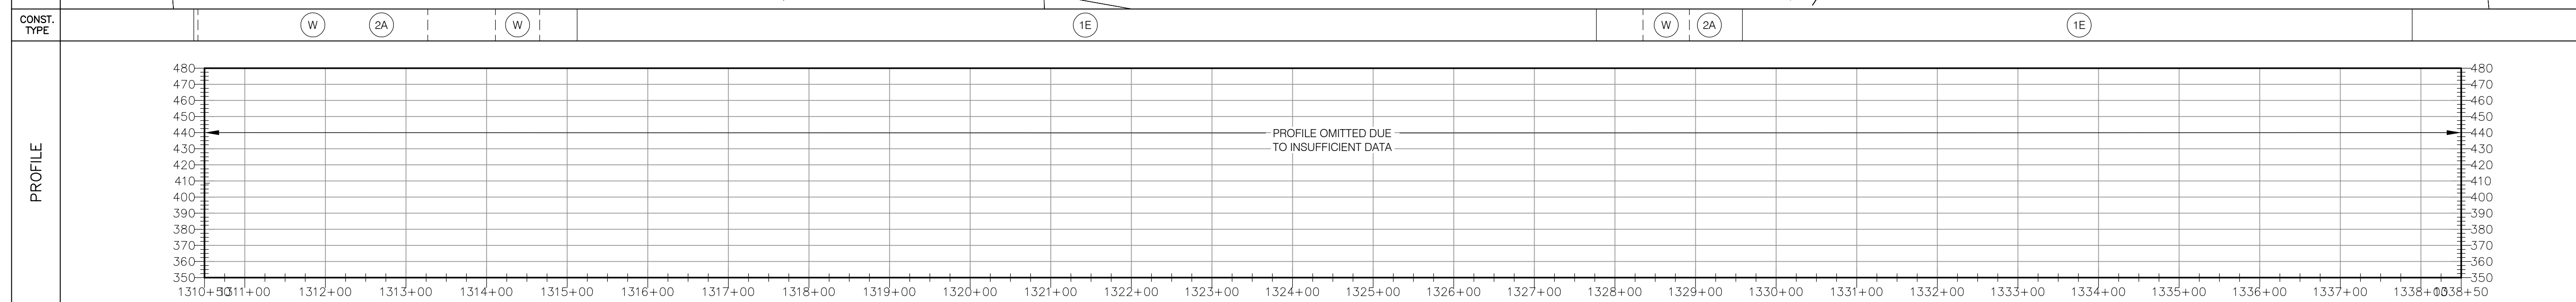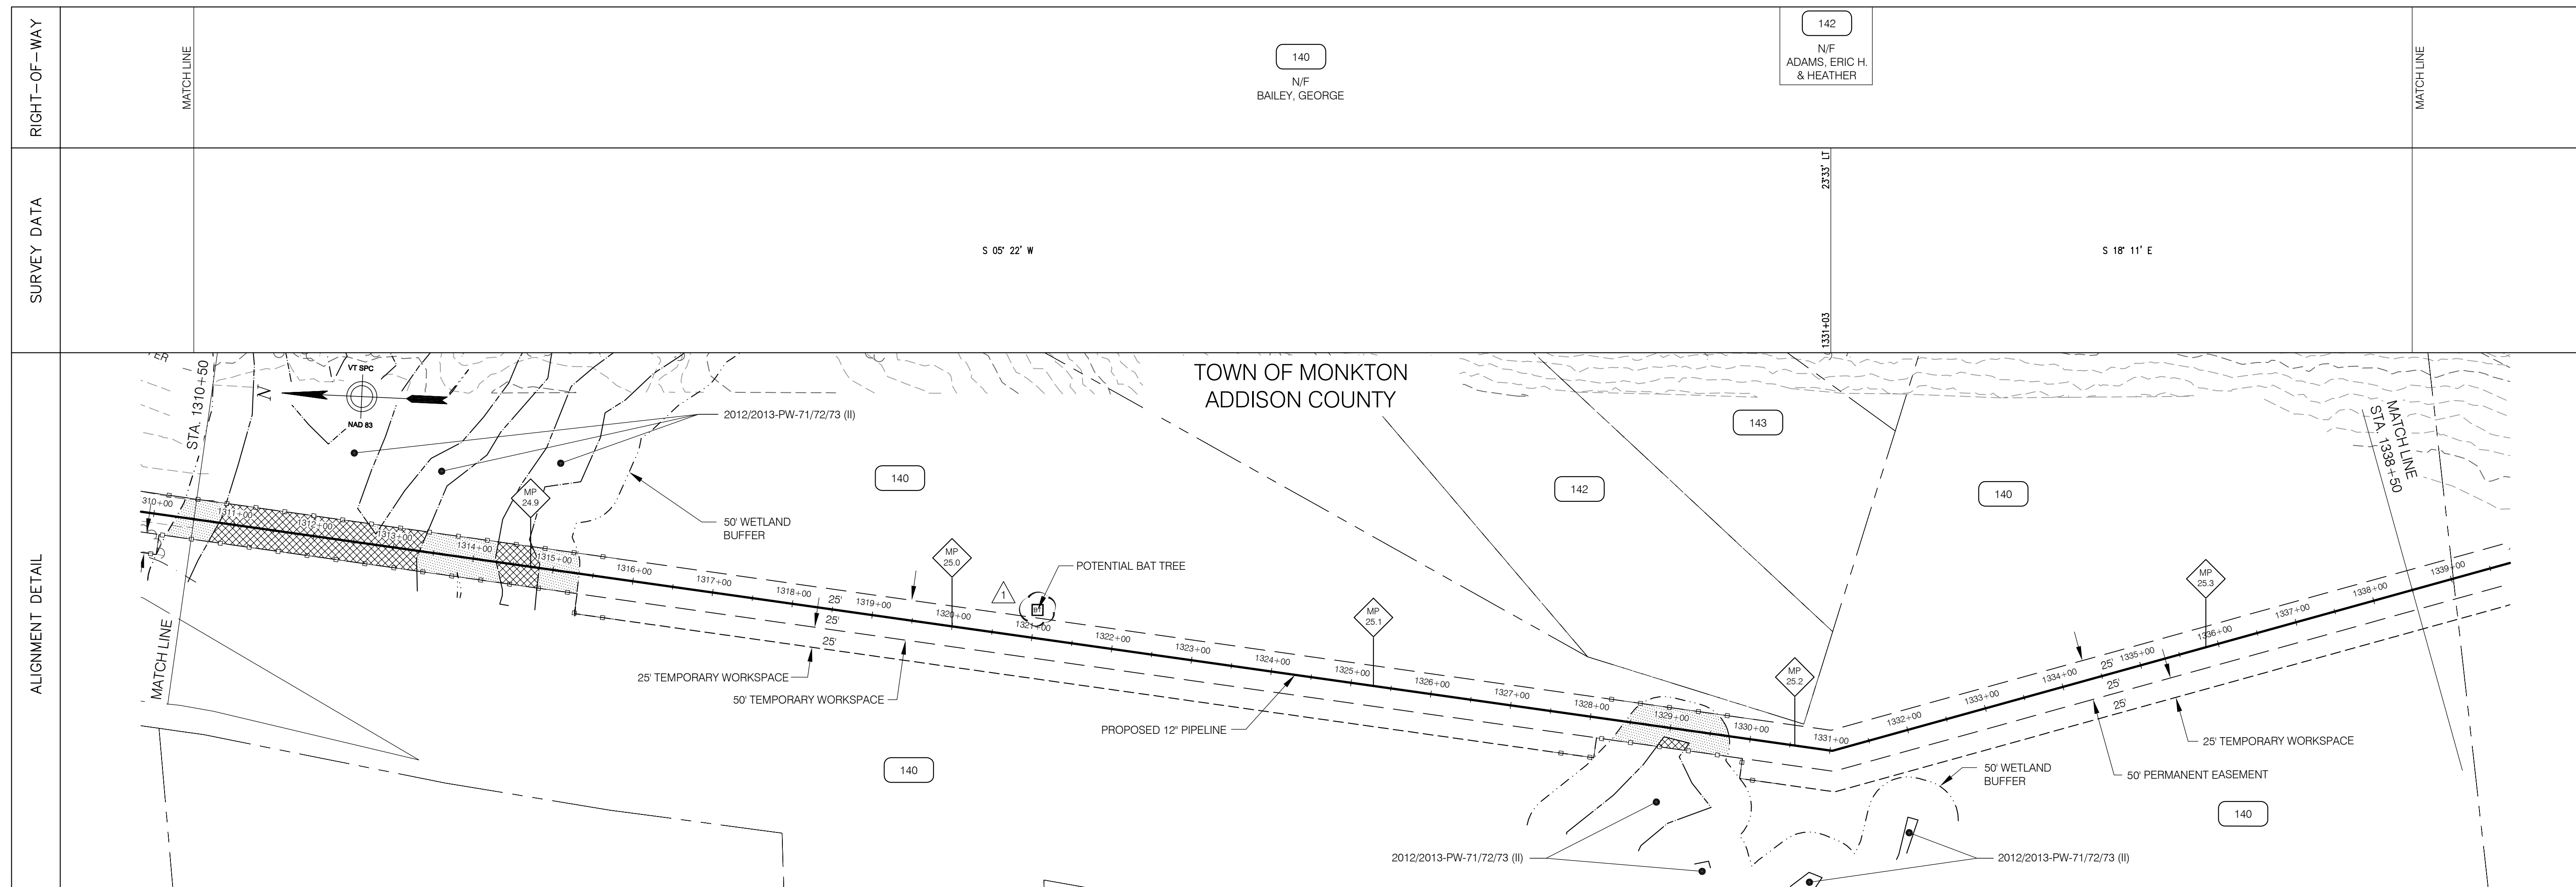

MATERIALS	1	1	1	1
COATING	C	A	C	A
CLASSIFICATION	1			
DESIGN FACTOR	0.5			

COATING	C	A	C	A
CLASSIFICATION	1			
DESIGN FACTOR	0.5			

HORIZONTAL SCALE

VERTICAL SCALE

PIPE MATERIAL:

1 12.75" O.D. X 0.312" WT, API-5L, GR. X65, PSL-2, AND ADDITIONAL SPECIFICATIONS IN 192.112 2,800 FT

2 20" O.D. X 0.375" WT, API-5L, GR. B 0 FT

PIPE COATING:



A EPOXY POLYETHYLENE 10/40 2,187 FT

B FBE, ABRASION RESISTANT OVERCOAT, 14-16 MILS/40 MILS, 54-56 MILS TOTAL 0 FT

C FBE 14-16 MILS, W/ 1-1/2" REINFORCED CONCRETE W/ 140 LBS/FT' 613 FT


ANGP-EPSC-052		EPSC PLAN		1	GJM	BCK	IFC 2016 EDITS (05/2016)	ENVIRONMENTAL	JLS	06/28/13	JLS	05/2016	VERMONT GAS PROPOSED 12" PIPELINE ADDISON NATURAL GAS PROJECT ALIGNMENT SHEET		LOC. ADDISON COUNTY, VERMONT	YEAR: 2016	W.O.	SCALE: 1" = 100'	DWG. ANGP-T-C-052	REV. 1
G-001 - 010		COVER, INDEX, LEGEND & NOTES, AND CONSTRUCTION DETAILS		1	GJM	BCK	IFC 2016 EDITS (05/2016)	DRAFTING DESIGNER	GIL	06/28/13	GJM	05/2016								
DWG. NO.		REFERENCE DWG.		REV	DSN	CK	DESCRIPTION	DESIGN SUPERVISOR	BZD	06/28/13	BCK	05/2016	Vermont Gas							

RIGHT-OF-WAY	155 N/F PEYSER, LOUISE SELINA	156 N/F MENARD, GERALD, NANCY	155 N/F PEYSER, LOUISE SELINA	156 N/F MENARD, GERALD & NANCY	159 HOLLOW ROAD	160 N/F COUSINO, VICKI A.	161 N/F WAGEMAN, EDWIN J. & CAROLE	162 N/F BEAUPRE, MARC & GRETCHEN	163 N/F HENDRY, MARTHA M.
SURVEY DATA	S 23° 51' W	S 23° 42' W	S 23° 43' W	S 23° 43' W	S 23° 42' W	S 23° 43' W	S 23° 43' W	S 24° 51' W	S 44° 47' W S 19° 55' W

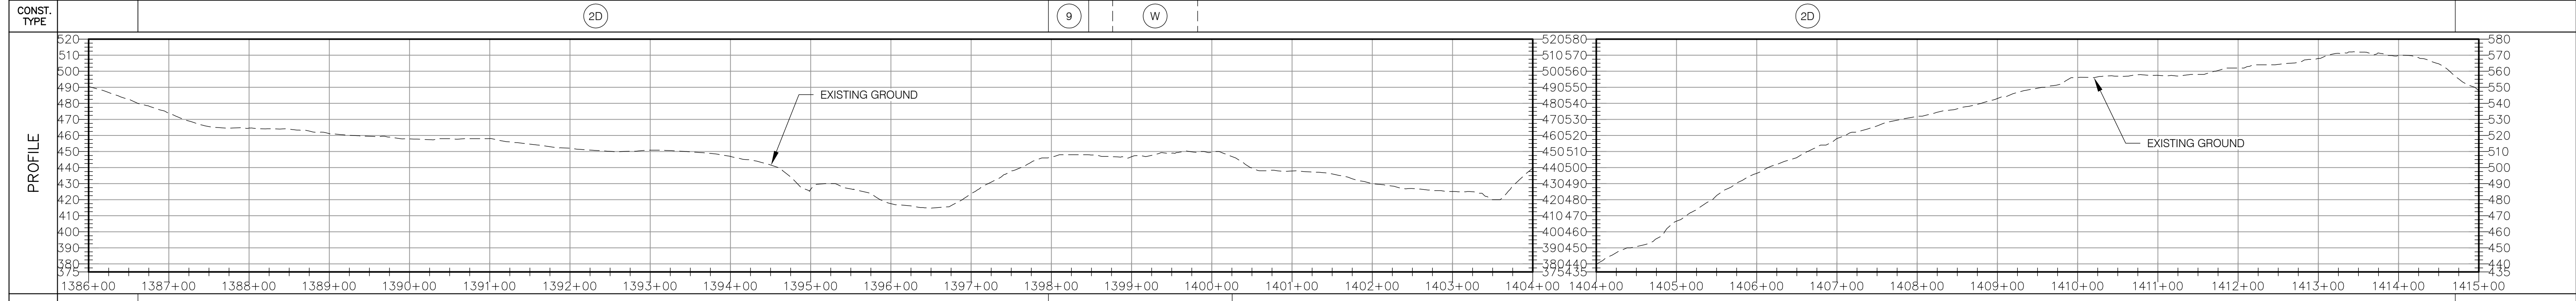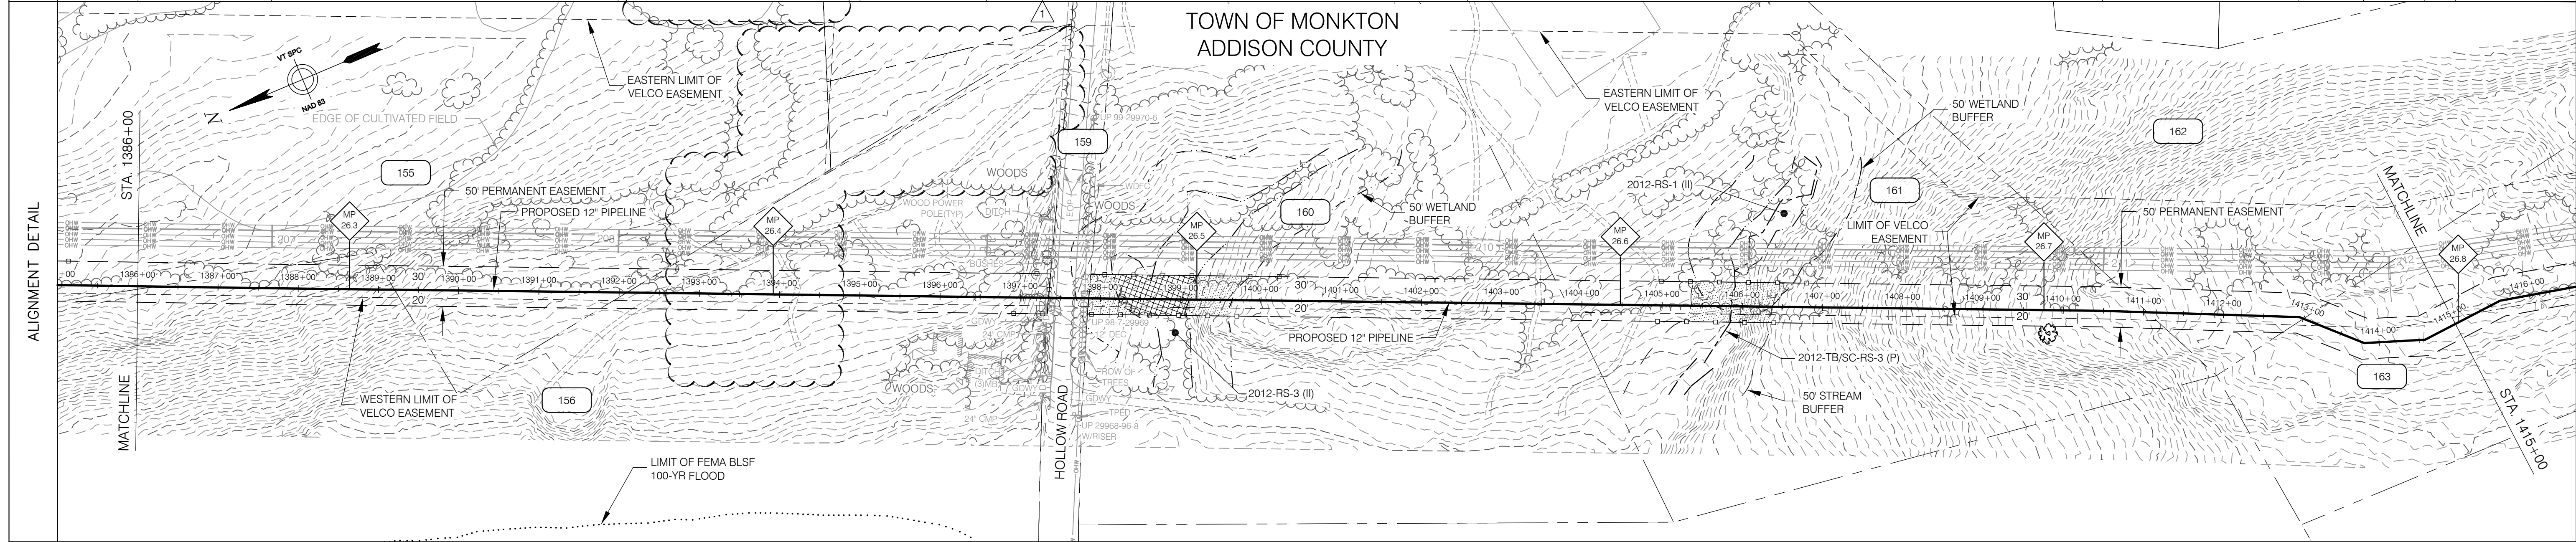

MATERIALS	1 1,135 FT	1 229 FT	1 1,536 FT
-----------	---------------	-------------	---------------


COATING	A	C	A
CLASSIFICATION		1	2
DESIGN FACTOR			0.5



PIPE MATERIAL:
 1 12.75" O.D. X 0.312" WT, API-5L, GR. X65, PSL-2, AND ADDITIONAL SPECIFICATIONS IN 192.112
 2 20" O.D. X 0.375" WT, API-5L, GR. B


PIPE COATING:
 A EPOXY POLYETHYLENE 10/40
 B FBE, ABRASION RESISTANT OVERCOAT, 14-16 MILS/40 MILS, 54-56 MILS TOTAL
 C FBE 14-16 MILS, W/ 1-1/2" REINFORCED CONCRETE W/ 140 LBS/FT'

2,900 FT
 0 FT
 2,671 FT
 0 FT
 229 FT

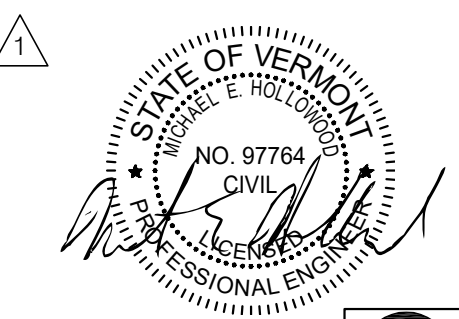


ANGP-EPSC-055	EPSC PLAN	1	BCK	GEW	MLV-4 RELOCATION (05/01/16)	ENVIRONMENTAL	JLS	06/28/13	JLS	05/2016	VERMONT GAS PROPOSED 12" PIPELINE ADDISON NATURAL GAS PROJECT ALIGNMENT SHEET					
G-001 - 010	COVER, INDEX, LEGEND & NOTES, AND CONSTRUCTION DETAILS	REV	DSN	CK	DESCRIPTION	DRAFTING DESIGNER	GIL	06/28/13	GJM	05/2016				LOC. ADDISON COUNTY, VERMONT	YEAR: 2016	W.O.

RIGHT-OF-WAY			163 N/F HENDRY, MARTHA M.	164 N/F RADLER, ROBERT & BUSCAGLIA, CATHIE M.	165 N/F CHARNLEY, JACQUELINE & THOMAS A.	POST ROAD	166 N/F BOWEN, MICHAEL H. & ELLEN L.	167 N/F LITTLE, ROBERT A. & FAITH E.	168 N/F COTA, ROGER & ALYSON	169 N/F CLARK, RICKY D. & MAREN E.	170 N/F ALDERMAN, MICHAEL J.	MATCHLINE
SURVEY DATA		S 04° 33' E 17'08" RT 1415+63	S 12° 36' W 01'46" RT 1418+79	S 14° 22' W 00'03" RT 1421+53	S 14° 26' W 00'10" LT 1425+42		S 14° 15' W 00'02" RT 1435+18	S 14° 18' W 00'14" RT 1438+85	S 14° 32' W 01'25" RT 1439+22	S 15° 58' W 05'10" RT 1439+62	S 21° 08' W 05'10" RT 1445+00	

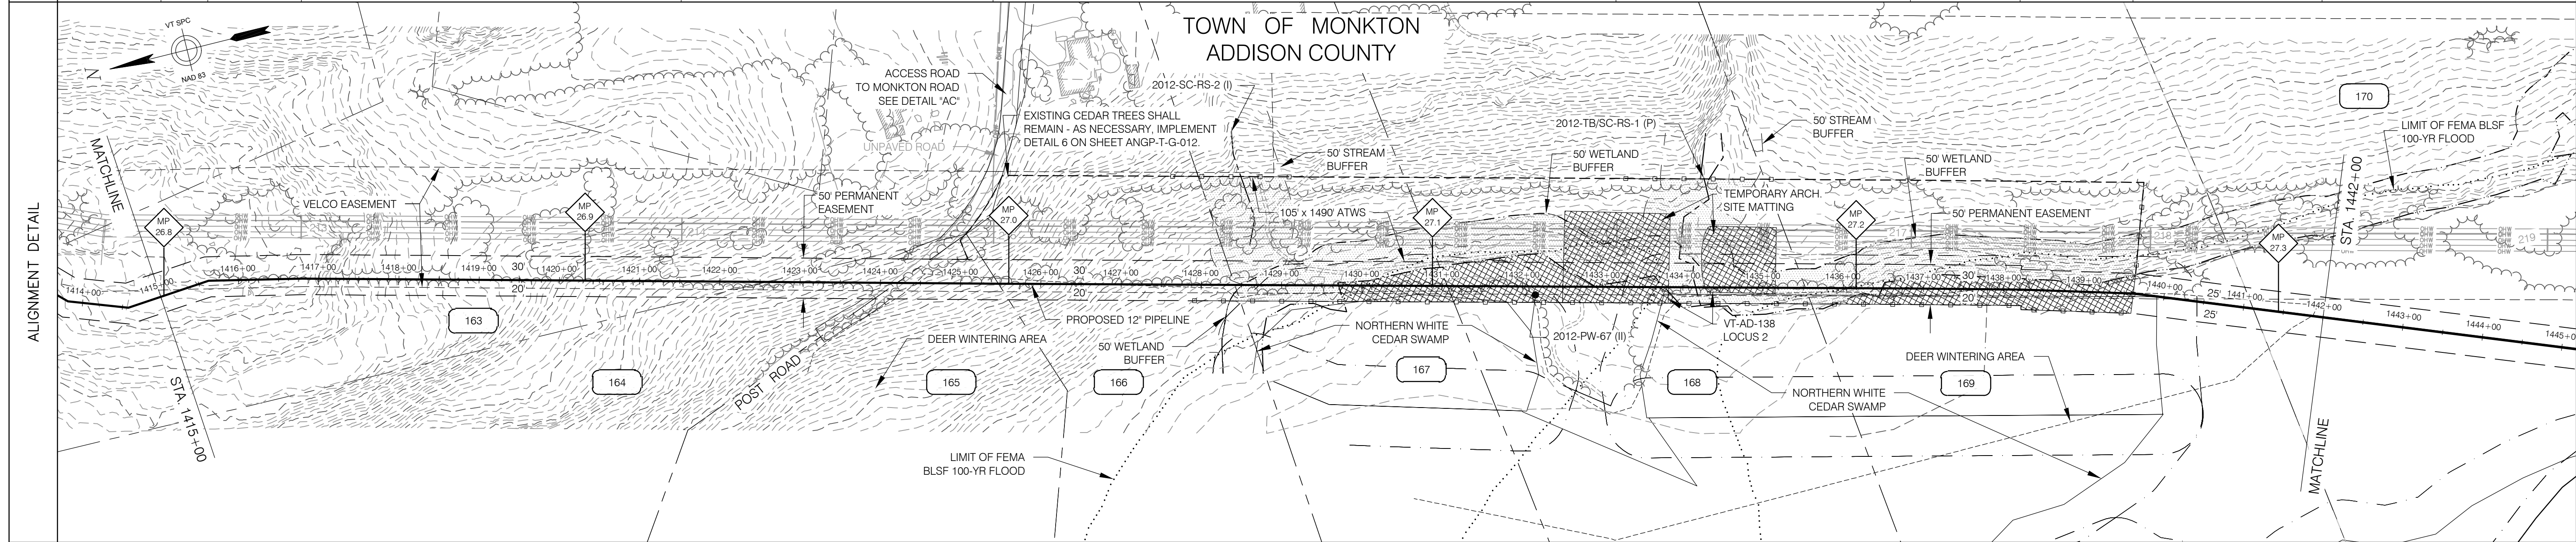

CONST. TYPE			2D	11	2D		W	A	A	W	8	
-------------	--	--	----	----	----	--	---	---	---	---	---	--

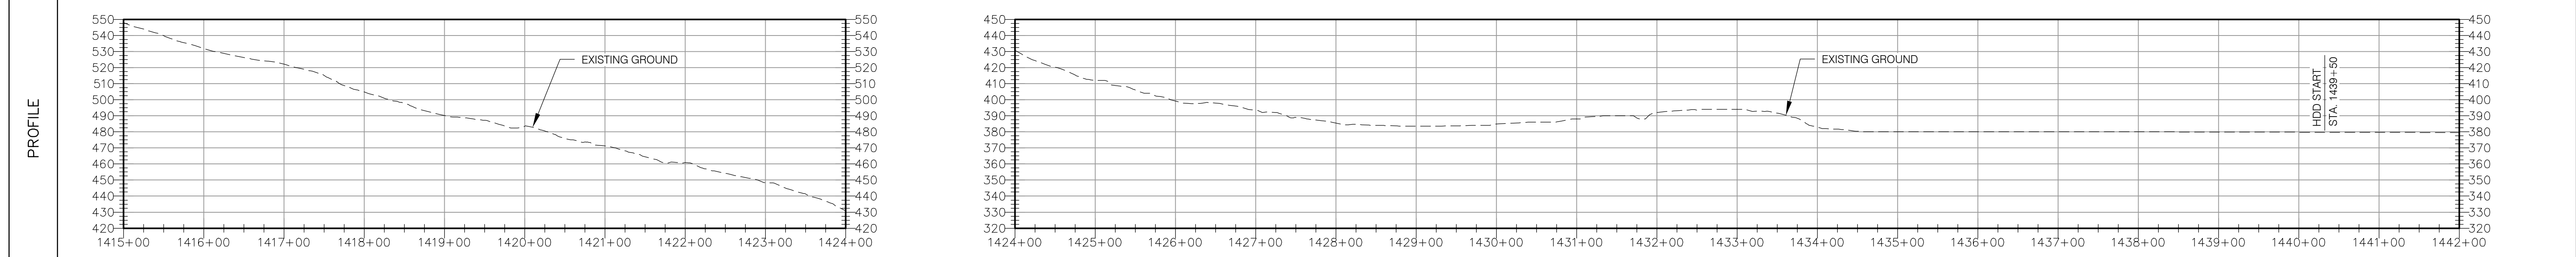

MATERIALS			1	1	1		1			1		
COATING			A	C	A		C			B		
CLASSIFICATION							2					
DESIGN FACTOR							0.5					

PIPE MATERIAL:

- 1 12.75" O.D. X 0.312" WT, API-5L, GR. X65, PSL-2, AND ADDITIONAL SPECIFICATIONS IN 192.112 2,700 FT
- 2 20" O.D. X 0.375" WT, API-5L, GR. B 0 FT

PIPE COATING:

- A EPOXY POLYETHYLENE 10/40 1,281 FT
- B FBE, ABRASION RESISTANT OVERCOAT, 14-16 MILS/40 MILS, 54-56 MILS TOTAL 250 FT
- C FBE 14-16 MILS, W/ 1-1/2" REINFORCED CONCRETE W/ 140 LBS/FT' 1,169 FT


HORIZONTAL SCALE

VERTICAL SCALE


ANGP-T-G-07-010 ACCESS ROAD DETAILS						ENVIRONMENTAL JLS 06/28/13		CONSTRUCTION JLS 05/2016		VERMONT GAS PROPOSED 12" PIPELINE ADDISON NATURAL GAS PROJECT ALIGNMENT SHEET		LOC. ADDISON COUNTY, VERMONT		YEAR: 2016 W.O.		SCALE: 1" = 100'		DWG. ANGP-T-C-056		REV. 0	
ANGP-EPSC-056 EPSC PLAN						DRAFTING DESIGNER GIL 06/28/13		CONSTRUCTION GJM 05/2016													
G-001 - 010 COVER, INDEX, LEGEND & NOTES, AND CONSTRUCTION DETAILS						DRAFTING SUPERVISOR BZD 06/28/13		CONSTRUCTION BCK 05/2016													
DWG. NO. REFERENCE DWG.		REV	DSN	CK	DESCRIPTION		INITIALS	DATE	INITIALS	DATE											

38 Eastwood Drive, Suite 105
South Burlington, VT 05403
Main: (802) 735-0372 • www.chacompanies.com

RIGHT-OF-WAY	MATCHLINE		181 N/F HURLBURT, HERRICK & CHARLOTTE	182 OLD STAGE ROAD	MATCHLINE
	SURVEY DATA		PIPE ALIGNMENT PARALLELS ROAD RIGHT-OF-WAY, FOR CLARITY, NOT ALL SURVEY DATA IS SHOWN		
	S 14° 22' W 32.59' LT 1525+46	S 18° 36' E 00'44" RT 1526+02	S 17° 52' E	S 19° 21' E 02'31" RT 1531+72	S 24° 55' E 08'34" LT 1533+76
					12'00" RT 1537+25
					S 12° 55' E

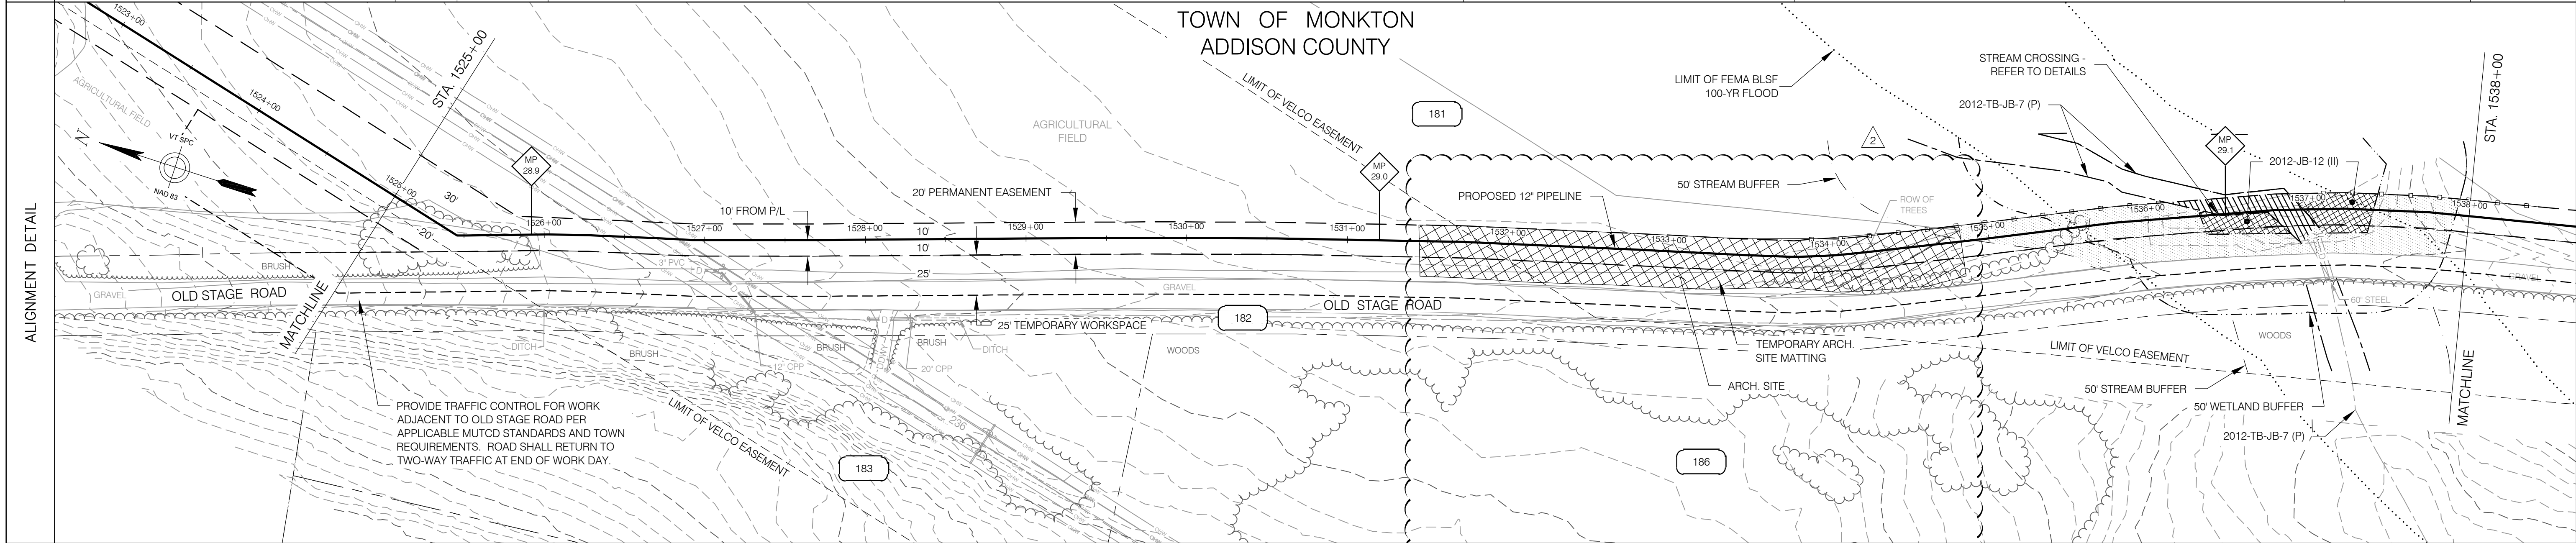


CONST. TYPE	2D	4A	A	7	W	4A
-------------	----	----	---	---	---	----

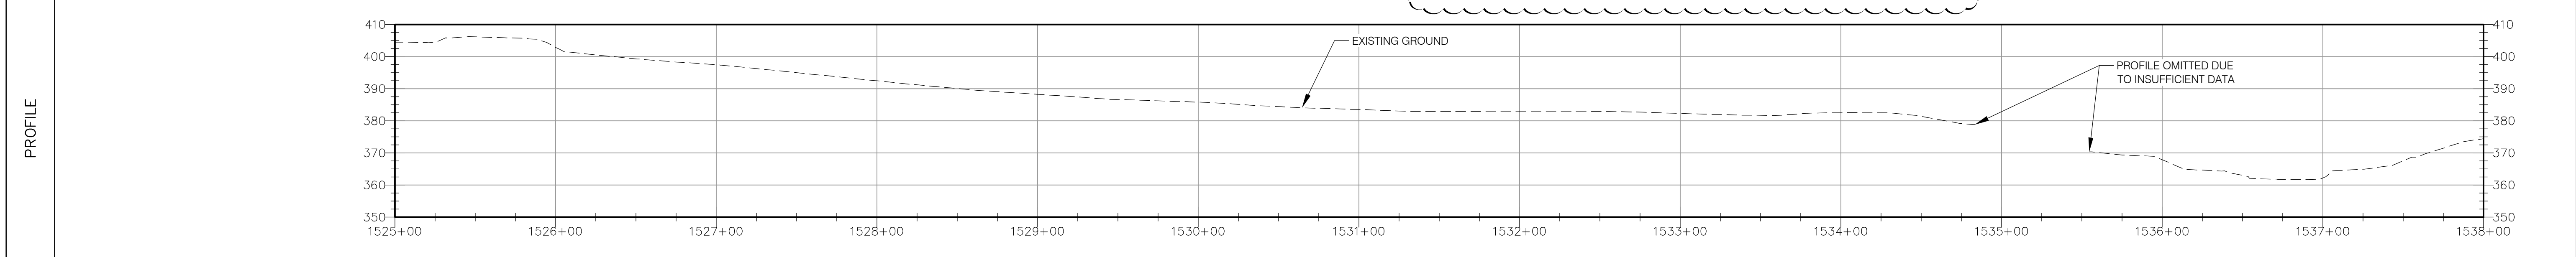


MATERIALS	MATCHLINE	1 989 FT A	1 303 FT C	1 8 FT A	MATCHLINE
-----------	-----------	------------------	------------------	----------------	-----------

COATING	A				
CLASSIFICATION	1				
DESIGN FACTOR	0.5				




PIPE MATERIAL:	1 12.75" O.D. X 0.312" WT, API-5L, GR. X65, PSL-2, AND ADDITIONAL SPECIFICATIONS IN 192.112	1,300 FT
	2 20" O.D. X 0.375" WT, API-5L, GR. B	0 FT
PIPE COATING:	A EPOXY POLYETHYLENE 10/40	997 FT
	B FBE, ABRASION RESISTANT OVERCOAT, 14-16 MILS/40 MILS, 54-56 MILS TOTAL	0 FT
	C FBE 14-16 MILS, W/ 1-1/2" REINFORCED CONCRETE W/ 140 LBS/FT'	303 FT

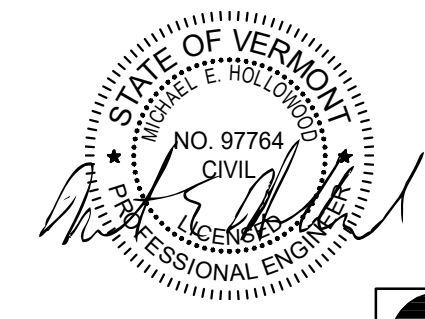

ANGP-EPSC-061A		EPSC PLAN		2	GJM	BCK	IFC 2016 EDITS (05/2016)	ENVIRONMENTAL		JLS	06/28/13	JLS	05/2016	VERMONT GAS PROPOSED 12" PIPELINE ADDISON NATURAL GAS PROJECT ALIGNMENT SHEET			
G-001 - 010		COVER, INDEX, LEGEND & NOTES, AND CONSTRUCTION DETAILS		1	VGS	VGS	OLD STAGE ROAD RE-ROUTE (11/13/15)	DRAFTING DESIGNER		GIL	06/28/13	GJM	05/2016	LOC. ADDISON COUNTY, VERMONT			
DWG. NO.		REFERENCE DWG.		REV	DSN	CK	DESCRIPTION	DRAFTING SUPERVISOR		BZD	06/28/13	BCK	05/2016				
								DESIGN ENGINEER		MDF	06/28/13	GEW	05/2016				
								DESIGN MANAGER		SAB	06/28/13	JEO	05/2016				
								INITIALS			DATE		DATE				

PROFILE

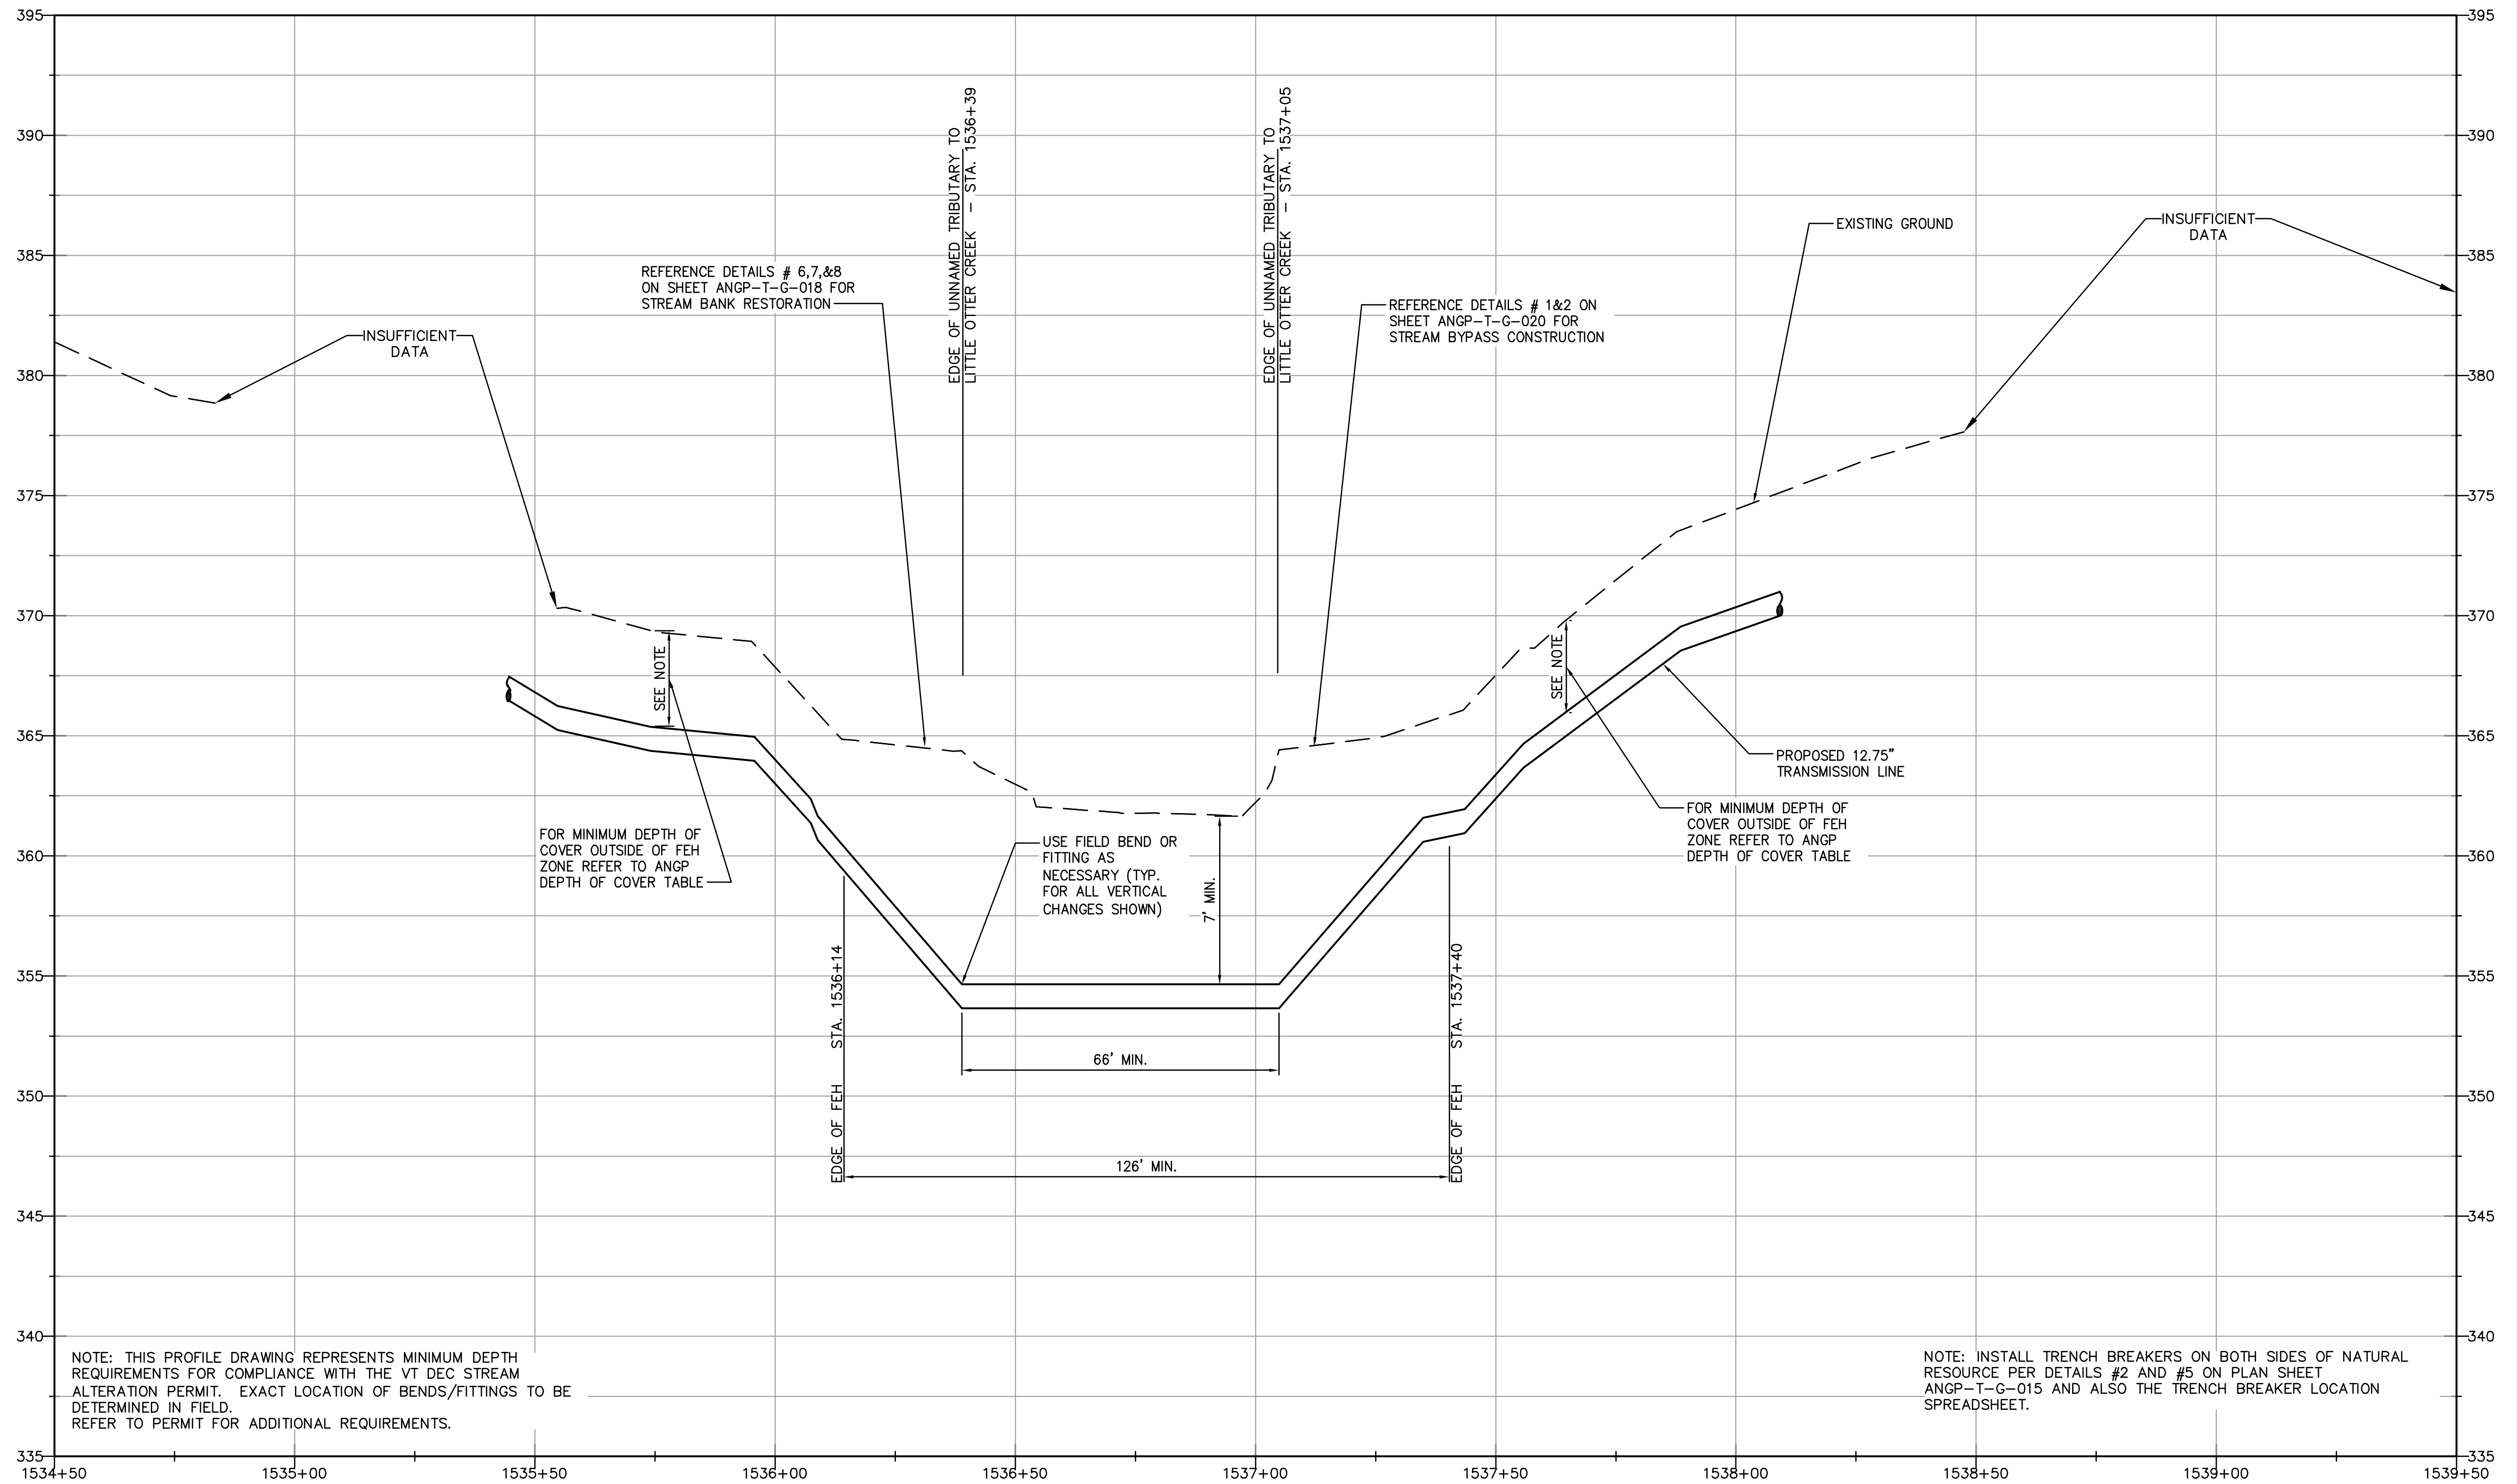


NOTE: THIS PROFILE DRAWING REPRESENTS MINIMUM DEPTH REQUIREMENTS FOR COMPLIANCE WITH THE VT DEC STREAM ALTERATION PERMIT. EXACT LOCATION OF BENDS/FITTINGS TO BE DETERMINED IN FIELD. REFER TO PERMIT FOR ADDITIONAL REQUIREMENTS.

NOTE: INSTALL TRENCH BREAKERS ON BOTH SIDES OF NATURAL RESOURCE PER DETAILS #2 AND #5 ON PLAN SHEET ANGP-T-G-015 AND ALSO THE TRENCH BREAKER LOCATION SPREADSHEET.

NOTE: STREAM CROSSING MUST BE CONSTRUCTED BETWEEN JUNE 1 AND OCTOBER 1

**STREAM CROSSING PROFILE
UNNAMED TRIBUTARY TO
LITTLE OTTER CREEK
STATION 1536+73±
MILE POST 29.10**

SCALE: HORIZ. 1"=20'
VERT. 1"=4'

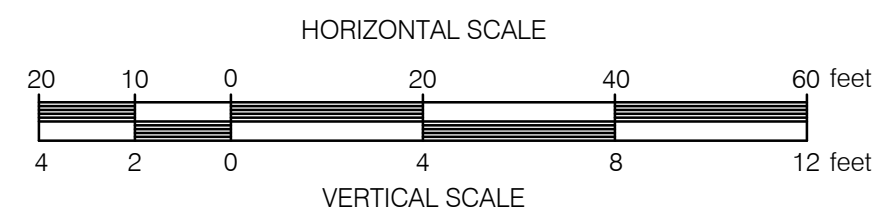

NOTE: THE LIMITS SHOWN FOR THIS STREAM DO NOT MATCH UP WITH WHAT IS SHOWN ON THE ALIGNMENT SHEET PLAN VIEW. FULL FEH COMPLIANCE IS NOT REQUIRED DUE TO THE PROXIMITY TO THE ROADWAY, THEREFORE A TRANSITION BACK TO NORMAL BURIAL DEPTH CAN OCCUR ONCE OUTSIDE OF APPARENT TOP OF BANK (1536+39 AND 1537+05).




DWG. NO.	REFERENCE DWG.	REV	DSN	CK	DESCRIPTION	INITIALS	DATE	INITIALS	DATE	YEAR: 2016	W.O.	SCALE: AS NOTED	DWG. ANGP-T-C-061AA	REV. 0


VHB Vanasse Hangen Brustlin, Inc.




RIGHT-OF-WAY	MATCHLINE	181 N/F HURLBURT, HERRICK & CHARLOTTE	182 OLD STAGE ROAD	188.01 N/F VERMONT GAS SYSTEMS, INC.	MATCHLINE					
SURVEY DATA		S 12 55' E	S 10 59' E	S 13 35' E	S 18 47' E	S 24 14' W S 24 14' W S 24 14' W S 17 44' E	S 11 34' E	S 02 19' E	S 00 44' E	S 02 44' E
		1540+08	1541+48	1543+25	1547+00	1547+00 1547+23 1547+72 1547+88	1548+15	1549+64	1550+96	1553+17

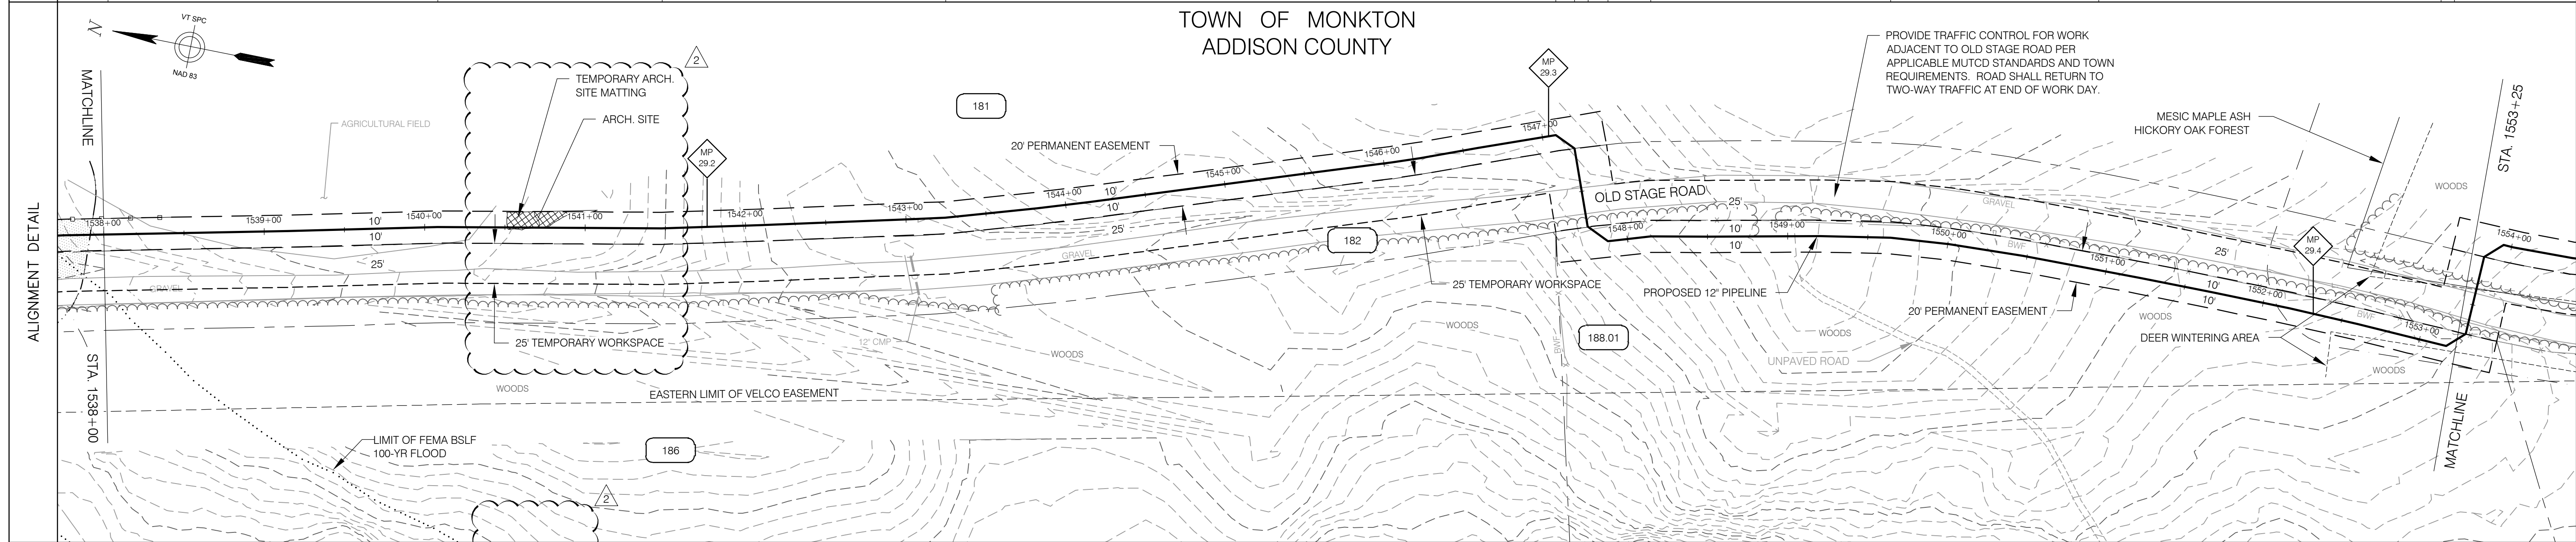

CONST. TYPE		(A)	(4A)	(11)	(4B)
-------------	--	-----	------	------	------

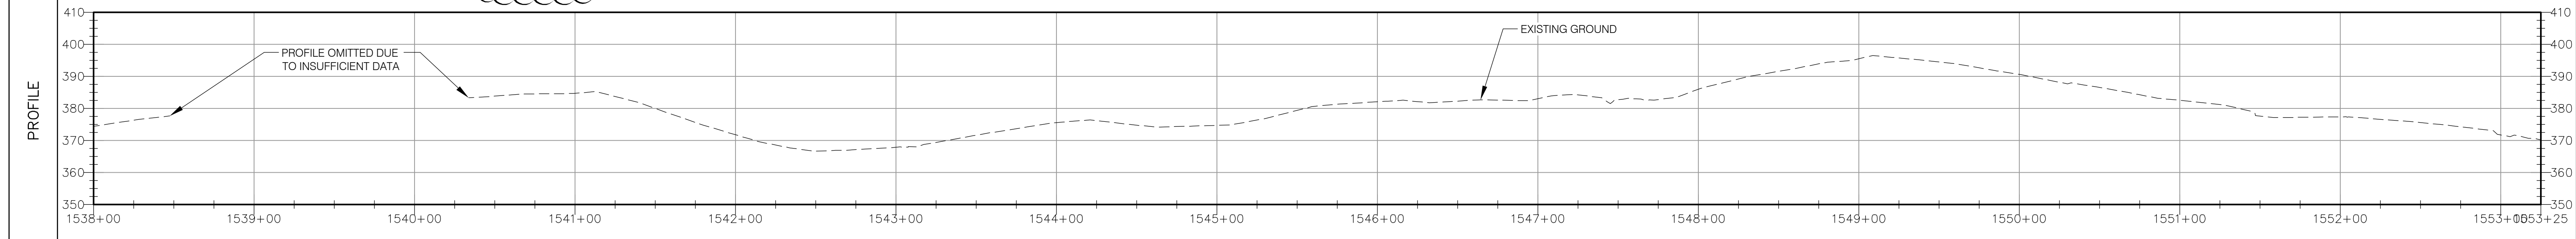

MATERIALS	MATCHLINE	(1) 931 FT A	(1) 50 FT C	(1) 544 FT A	MATCHLINE
COATING		A	C	A	
CLASSIFICATION			1		
DESIGN FACTOR			0.5		




PIPE MATERIAL:		1,525 FT
1	12.75" O.D. X 0.312" WT, API-5L, GR. X65, PSL-2, AND ADDITIONAL SPECIFICATIONS IN 192.112	
2	20" O.D. X 0.375" WT, API-5L, GR. B	0 FT
PIPE COATING:		1,475 FT
A	EPOXY POLYETHYLENE 10/40	
B	FBE, ABRASION RESISTANT OVERCOAT, 14-16 MILS/40 MILS, 54-56 MILS TOTAL	0 FT
C	FBE 14-16 MILS, W/ 1-1/2" REINFORCED CONCRETE W/ 140 LBS/FT'	50 FT




ANGP-EPSC-061B	EPSC PLAN	2	GJM	BCK	IFC 2016 EDITS (05/2016)	BID	JLS	06/28/13	JLS	05/2016	VERMONT GAS PROPOSED 12" PIPELINE ADDISON NATURAL GAS PROJECT ALIGNMENT SHEET			
G-001 - 010	COVER, INDEX, LEGEND & NOTES, AND CONSTRUCTION DETAILS	1	VGS	VGS	OLD STAGE ROAD RE-ROUTE (11/13/15)	CONSTRUCTION	GIL	06/28/13	GJM	05/2016				LOC. ADDISON COUNTY, VERMONT
DWG. NO.	REFERENCE DWG.	REV	DSN	CK	DESCRIPTION	INITIALS	DATE	INITIALS	DATE	YEAR: 2016	W.O.	SCALE: 1" = 50'	DWG. ANGP-T-C-061B	REV. 2


RIGHT-OF-WAY	MATCHLINE	181 N/F HULBURT, HERRICK & CHARLOTTE	182 OLD STAGE ROAD	192 N/F HERRICK JR; MICHAEL, DAVID & HURLBURT, JOSHUA	MATCHLINE
	188.01 N/F VERMONT GAS SYSTEMS, INC.	PIPE ALIGNMENT PARALLELS ROAD RIGHT-OF-WAY, FOR CLARITY, NOT ALL SURVEY DATA IS SHOWN			
SURVEY DATA	1553+31	S 42° 44' E	45'00" LT	06'54" LT	04'29" RT
	1553+81	S 87° 44' E	45'00" RT		14'26" LT
	1553+95	S 42° 44' E	45'00" RT		04'48" RT
	1554+01	S 02° 16' W	65'55" LT		
	1555+04	S 03° 39' E			
	1556+11	S 09° 20' E			
	1559+38	S 04° 51' E			
	1562+30	S 19° 17' E			
	1564+00	S 14° 29' E			
	1565+19	07°59' LT			
	1565+25	S 22° 28' E	45'00" RT		
	1565+40	S 22° 32' W	45'00" RT		
		S 67° 32' W			

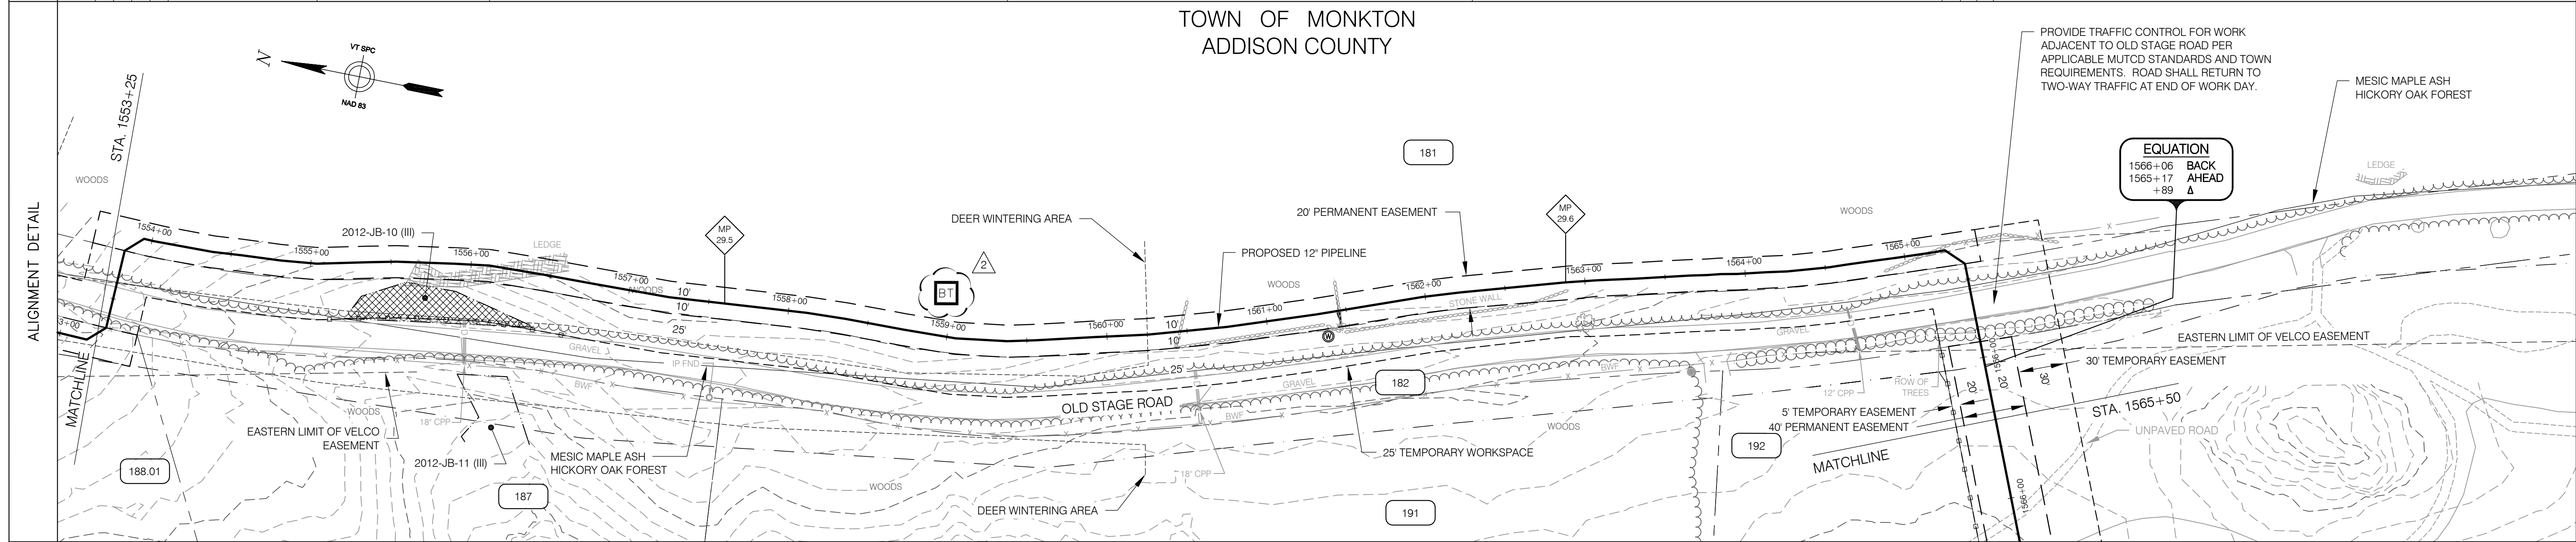



CONST. TYPE	11	W	4A	11	1H
-------------	----	---	----	----	----

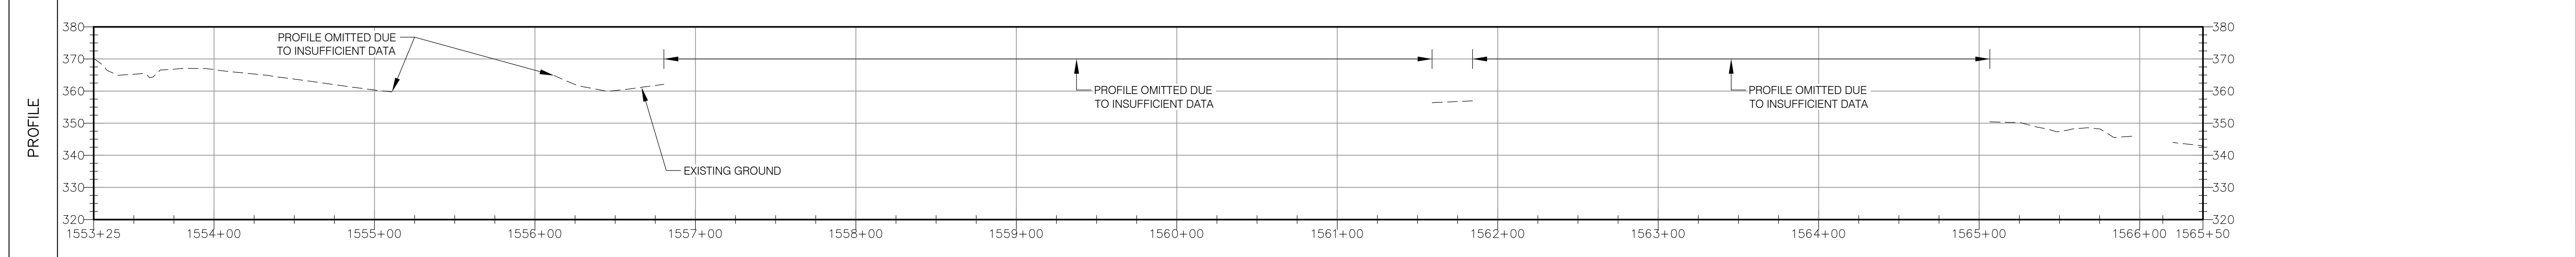

MATERIALS	MATCHLINE	1	1,074 FT	1	50 FT	51 FT	MATCHLINE
COATING	C	A	C	A			
CLASSIFICATION		1					
DESIGN FACTOR		0.5					





PIPE MATERIAL:	1 12.75" O.D. X 0.312" WT, API-5L, GR. X65, PSL-2, AND ADDITIONAL SPECIFICATIONS IN 192.112	1,225 FT
	2 20" O.D. X 0.375" WT, API-5L, GR. B	0 FT
PIPE COATING:	A EPOXY POLYETHYLENE 10/40	1,125 FT
	B FBE, ABRASION RESISTANT OVERCOAT, 14-16 MILS/40 MILS, 54-56 MILS TOTAL	0 FT
	C FBE 14-16 MILS, W/ 1-1/2" REINFORCED CONCRETE W/ 140 LBS/FT'	100 FT

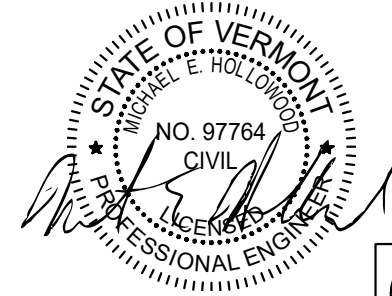


ANGP-EPSC-062	EPSC PLAN	2	GJM	BCK	IFC 2016 EDITS (05/2016)	ENVIRONMENTAL	JLS	06/28/13	JLS	05/2016	VERMONT GAS PROPOSED 12" PIPELINE ADDISON NATURAL GAS PROJECT ALIGNMENT SHEET	LOC. ADDISON COUNTY, VERMONT	YEAR: 2016	W.O.	SCALE: 1" = 50'	DWG. ANGP-T-C-062	REV. 2
G-001 - 010	COVER, INDEX, LEGEND & NOTES, AND CONSTRUCTION DETAILS	1	VGS	VGS	OLD STAGE ROAD RE-ROUTE (11/13/15)	DRAFTING DESIGNER	GIL	06/28/13	GJM	05/2016							
DWG. NO.	REFERENCE DWG.	REV	DSN	CK	DESCRIPTION	DRAFTING SUPERVISOR	BZD	06/28/13	BCK	05/2016							
						DESIGN ENGINEER	MDF	06/28/13	GEW	05/2016							
						DESIGN MANAGER	SAB	06/28/13	JEO	05/2016							
							INITIALS	DATE	INITIALS	DATE							


RIGHT-OF-WAY				192 N/F HURLBURT, HERRICK & CHARLOTTE		194 N/F GRACE, LAWRENCE JR. & SANDRA L.		195 PARKS- HURLBURT ROAD		196 N/F HURLBURT, HERRICK & CHARLOTTE	
SURVEY DATA		S 67° 32' W 4570' LT 1568+40	S 22° 32' W -8.2' FT 1568+60 1568+68 ARC: 34.40' LT	S 12° 09' E 00'01' LT 1570+39	S 12° 10' E 00'07' RT 1575+12	S 12° 03' E 00'05' LT 1579+95	S 12° 08' E 00'04' LT 1584+58	S 12° 13' E 00'03' RT 1587+58	S 12° 09' E 00'03' RT 1592+26	S 12° 06' E	

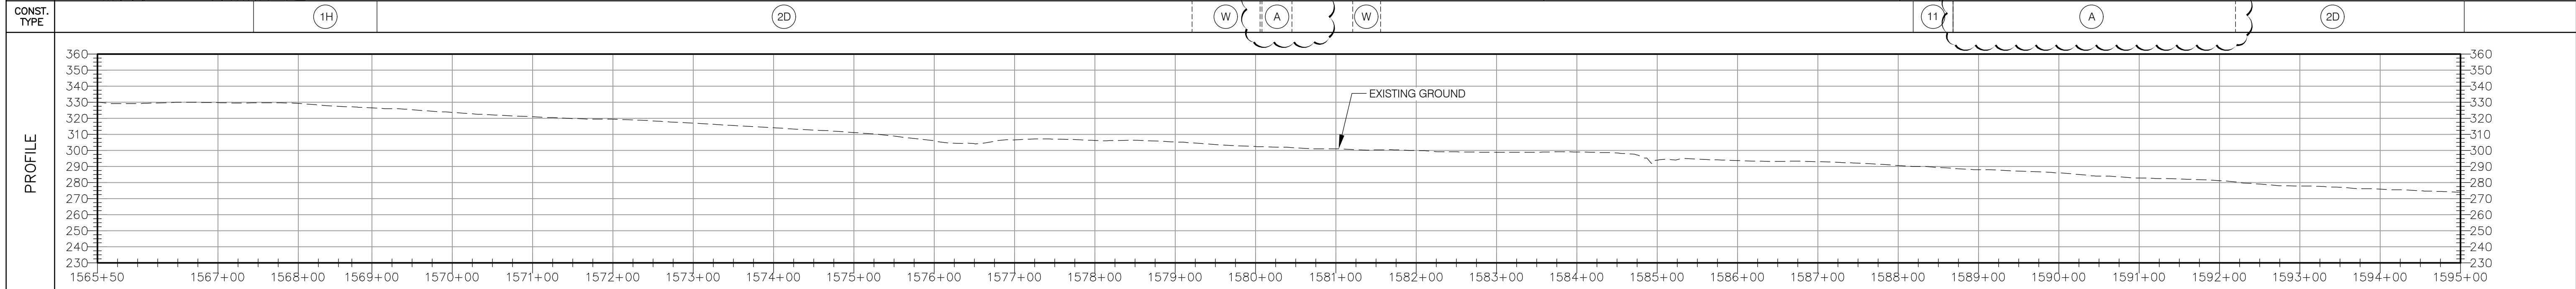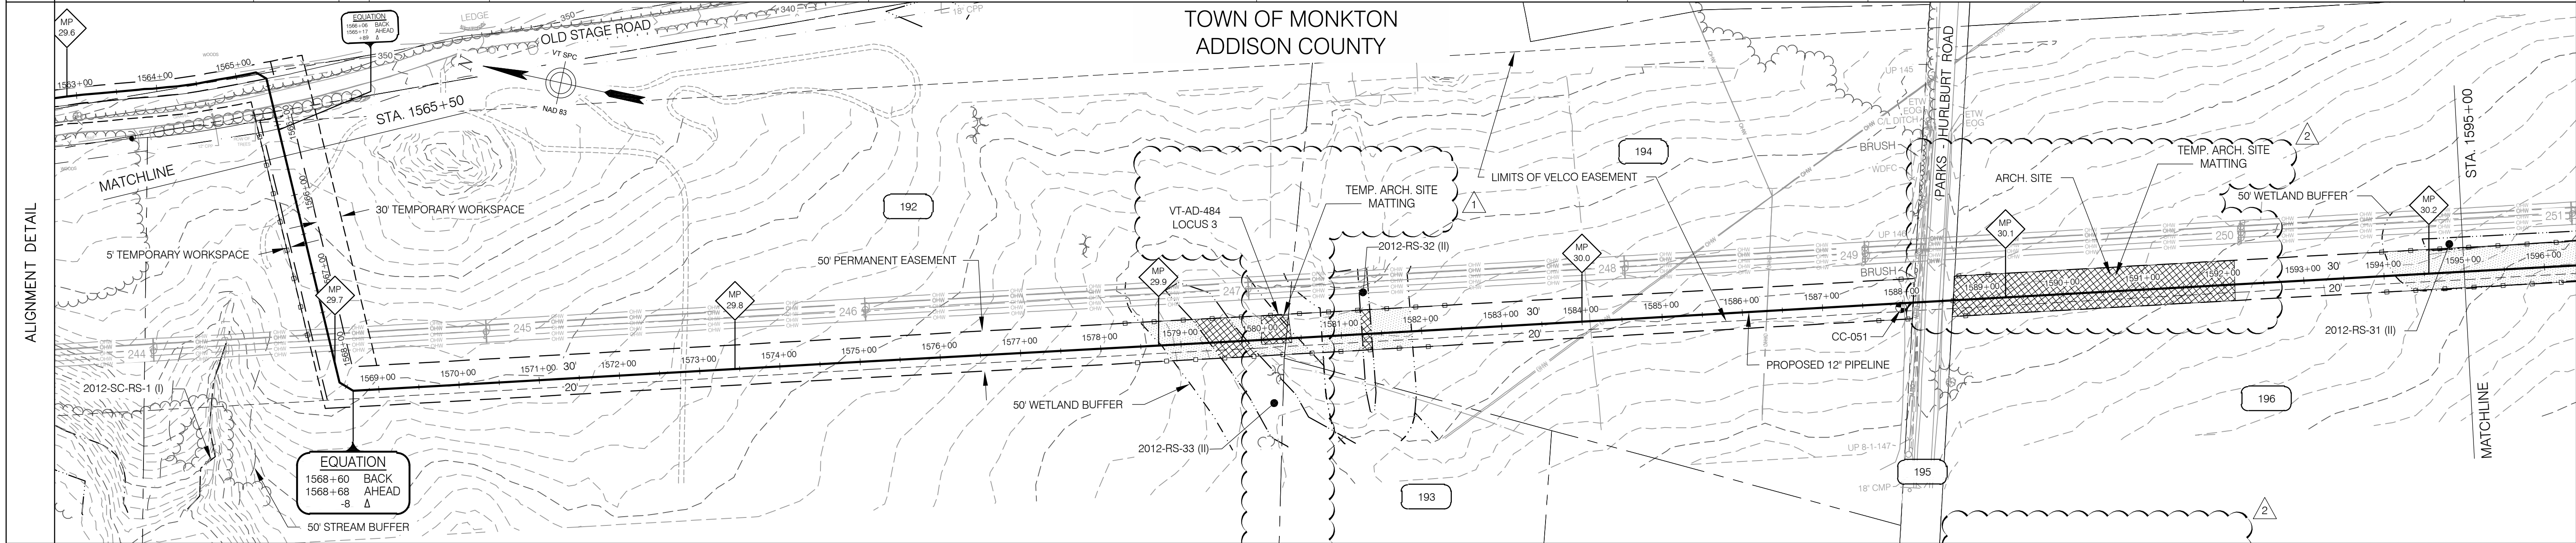

MATERIALS												
CONST. TYPE		(1H)		(2D)		(W)	(A)	(W)		(11)	(A)	(2D)
COATING												
CLASSIFICATION												
DESIGN FACTOR												




PIPE MATERIAL:		
1	12.75" O.D. X 0.312" WT, API-5L, GR. X65, PSL-2, AND ADDITIONAL SPECIFICATIONS IN 192.112	2,942 FT
2	20" O.D. X 0.375" WT, API-5L, GR. B	0 FT
PIPE COATING:		
A	EPOXY POLYETHYLENE 10/40	2,493 FT
B	FBE, ABRASION RESISTANT OVERCOAT, 14-16 MILS/40 MILS, 54-56 MILS TOTAL	0 FT
C	FBE 14-16 MILS, W/ 1-1/2" REINFORCED CONCRETE W/ 140 LBS/FT'	449 FT

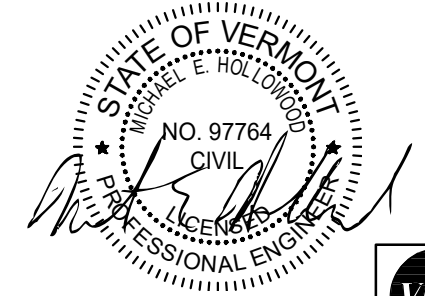


				<table border="1"> <tr> <th colspan="2">ENVIRONMENTAL</th> <th colspan="2">BID</th> <th colspan="2">CONSTRUCTION</th> </tr> <tr> <td>JLS</td> <td>06/28/13</td> <td>JLS</td> <td>05/2016</td> <td>JLS</td> <td>05/2016</td> </tr> <tr> <td>GIL</td> <td>06/28/13</td> <td>GJM</td> <td>05/2016</td> <td>GJM</td> <td>05/2016</td> </tr> <tr> <td>BZD</td> <td>06/28/13</td> <td>BCK</td> <td>05/2016</td> <td>BCK</td> <td>05/2016</td> </tr> <tr> <td>MDF</td> <td>06/28/13</td> <td>GEW</td> <td>05/2016</td> <td>GEW</td> <td>05/2016</td> </tr> <tr> <td>SAB</td> <td>06/28/13</td> <td>JEO</td> <td>05/2016</td> <td>JEO</td> <td>05/2016</td> </tr> <tr> <td>INITIALS</td> <td>DATE</td> <td>INITIALS</td> <td>DATE</td> <td>INITIALS</td> <td>DATE</td> </tr> </table>				ENVIRONMENTAL		BID		CONSTRUCTION		JLS	06/28/13	JLS	05/2016	JLS	05/2016	GIL	06/28/13	GJM	05/2016	GJM	05/2016	BZD	06/28/13	BCK	05/2016	BCK	05/2016	MDF	06/28/13	GEW	05/2016	GEW	05/2016	SAB	06/28/13	JEO	05/2016	JEO	05/2016	INITIALS	DATE	INITIALS	DATE	INITIALS	DATE	<p>VERMONT GAS PROPOSED 12" PIPELINE ADDISON NATURAL GAS PROJECT ALIGNMENT SHEET</p> <p>LOC. ADDISON COUNTY, VERMONT</p> <p>YEAR: 2016 W.O. SCALE: 1" = 100' DWG. ANGP-T-C-063 REV. 2</p>			
ENVIRONMENTAL		BID		CONSTRUCTION																																																	
JLS	06/28/13	JLS	05/2016	JLS	05/2016																																																
GIL	06/28/13	GJM	05/2016	GJM	05/2016																																																
BZD	06/28/13	BCK	05/2016	BCK	05/2016																																																
MDF	06/28/13	GEW	05/2016	GEW	05/2016																																																
SAB	06/28/13	JEO	05/2016	JEO	05/2016																																																
INITIALS	DATE	INITIALS	DATE	INITIALS	DATE																																																
ANGP-EPSC-063	EPSC PLAN	2	GJM	BCK	IFC 2016 EDITS (05/2016)																																																
G-001 - 010	COVER, INDEX, LEGEND & NOTES, AND CONSTRUCTION DETAILS	1	VGS	VGS	ARCH SITE ADDED (11/13/15)																																																
DWG. NO.	REFERENCE DWG.	REV	DSN	CK	DESCRIPTION																																																



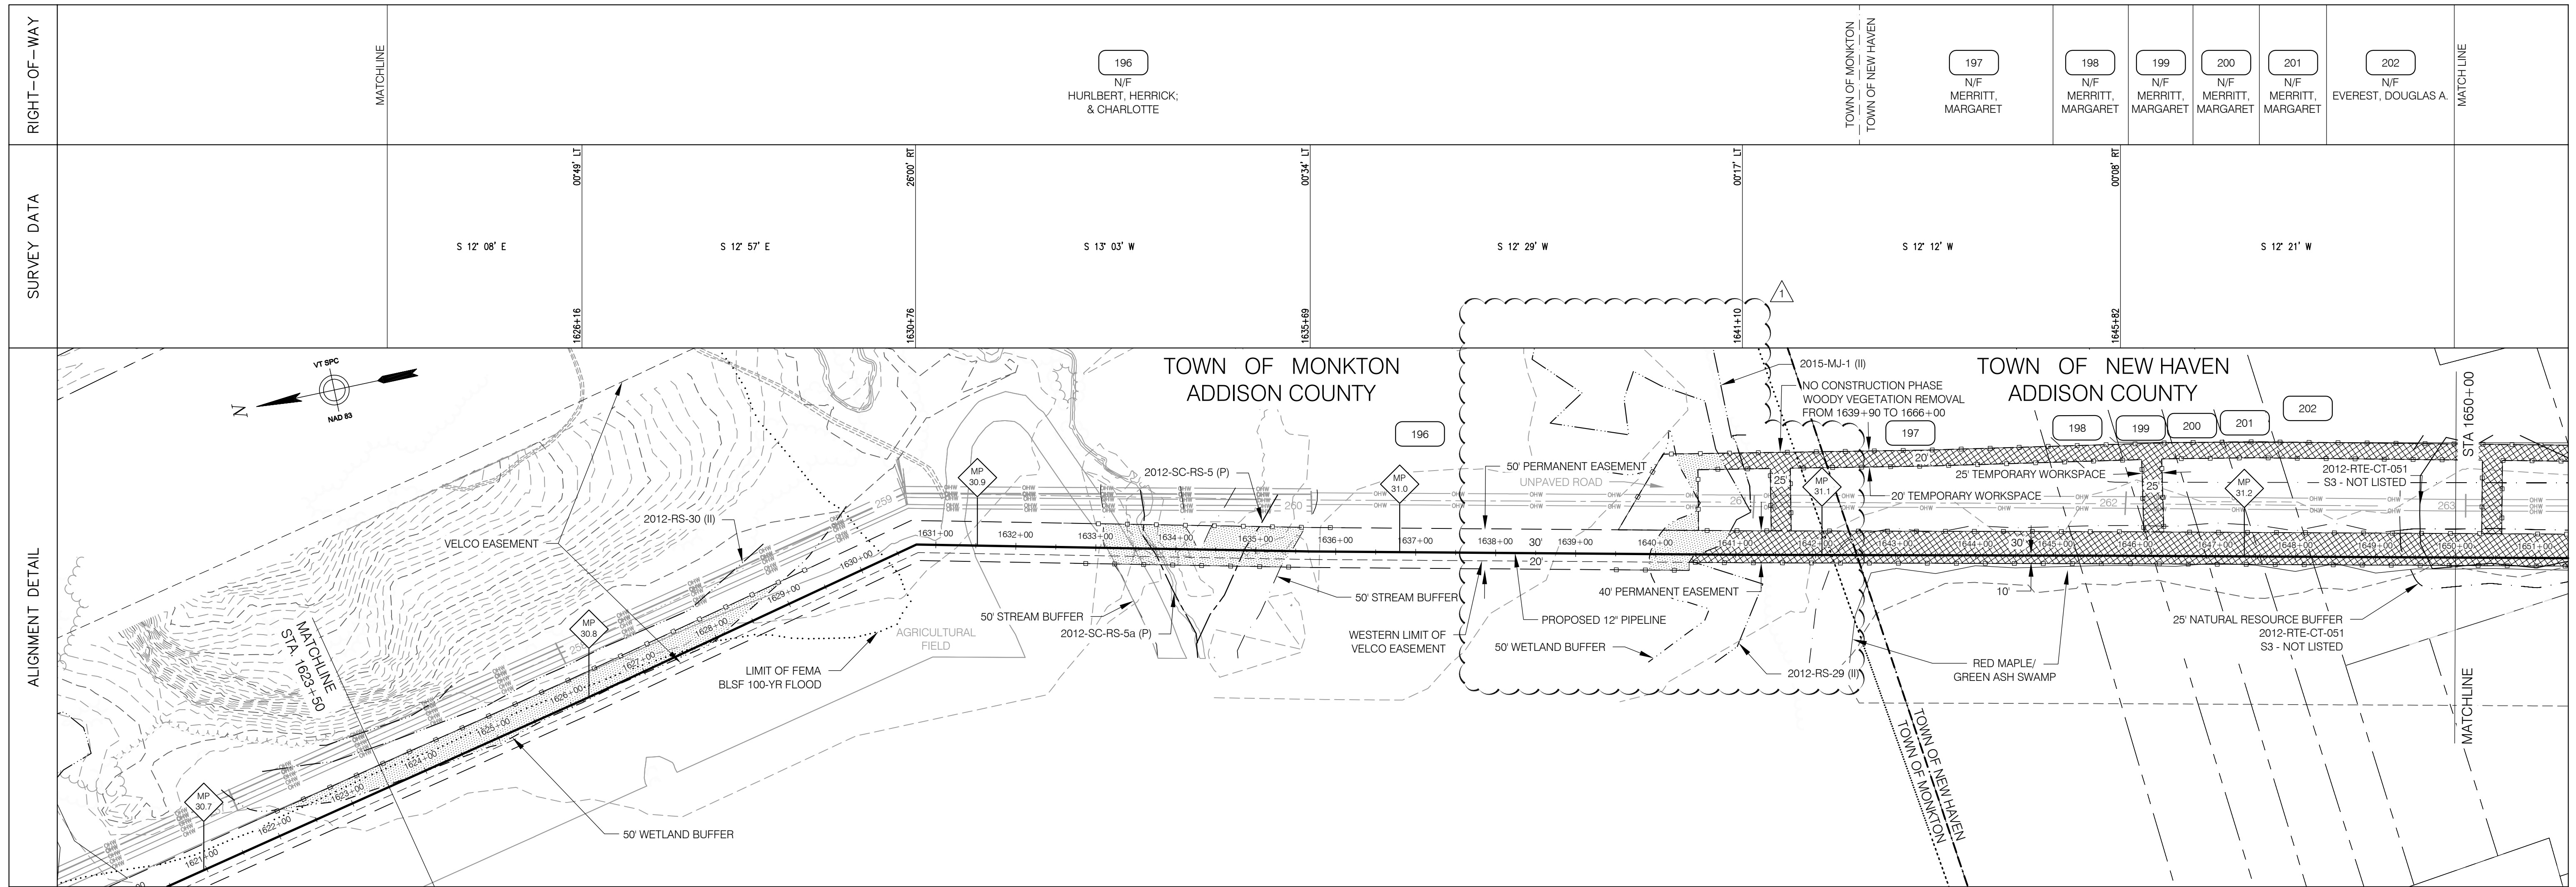

CONST. TYPE	(2D)	(7)	(2D)	(W)
-------------	------	-----	------	-----

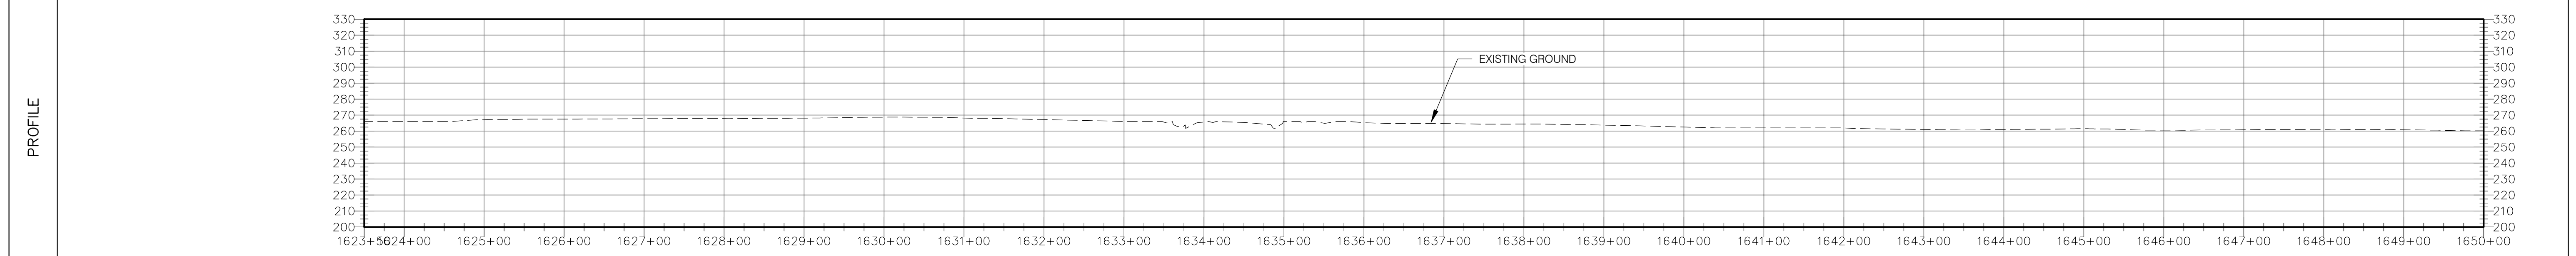


MATERIALS	455 FT	506 FT	233 FT	449 FT	1,007 FT
-----------	--------	--------	--------	--------	----------

COATING	C	A	C	A	C
---------	---	---	---	---	---

CLASSIFICATION	1				
----------------	---	--	--	--	--

DESIGN FACTOR	0.5				
---------------	-----	--	--	--	--





PIPE MATERIAL:

1 12.75" O.D. X 0.312" WT, API-5L, GR. X65, PSL-2, AND ADDITIONAL SPECIFICATIONS IN 192.112	2,650 FT
2 20" O.D. X 0.375" WT, API-5L, GR. B	0 FT


PIPE COATING:

A EPOXY POLYETHYLENE 10/40	955 FT
B FBE, ABRASION RESISTANT OVERCOAT, 14-16 MILS/40 MILS, 54-56 MILS TOTAL	0 FT
C FBE 14-16 MILS, W/ 1-1/2" REINFORCED CONCRETE W/ 140 LBS/FT'	1,695 FT

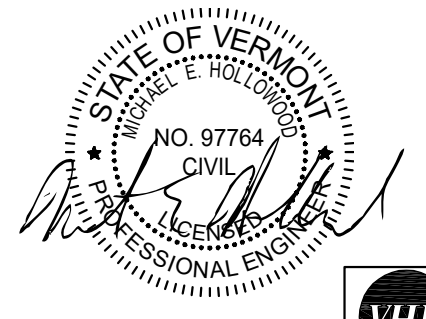

				<table border="1"> <tr> <th colspan="2">ENVIRONMENTAL</th> <th colspan="2">CONSTRUCTION</th> <th colspan="2">VERMONT GAS</th> </tr> <tr> <td>JLS</td> <td>06/28/13</td> <td>JLS</td> <td>05/2016</td> <td colspan="2">PROPOSED 12" PIPELINE</td> </tr> <tr> <td>GIL</td> <td>06/28/13</td> <td>GJM</td> <td>05/2016</td> <td colspan="2">ADDISON NATURAL GAS PROJECT</td> </tr> <tr> <td>BZD</td> <td>06/28/13</td> <td>BCK</td> <td>05/2016</td> <td colspan="2">ALIGNMENT SHEET</td> </tr> <tr> <td>MDF</td> <td>06/28/13</td> <td>GEW</td> <td>05/2016</td> <td colspan="2">LOC. ADDISON COUNTY, VERMONT</td> </tr> <tr> <td>SAB</td> <td>06/28/13</td> <td>JEO</td> <td>05/2016</td> <td colspan="2">YEAR: 2016 W.O.</td> </tr> </table>				ENVIRONMENTAL		CONSTRUCTION		VERMONT GAS		JLS	06/28/13	JLS	05/2016	PROPOSED 12" PIPELINE		GIL	06/28/13	GJM	05/2016	ADDISON NATURAL GAS PROJECT		BZD	06/28/13	BCK	05/2016	ALIGNMENT SHEET		MDF	06/28/13	GEW	05/2016	LOC. ADDISON COUNTY, VERMONT		SAB	06/28/13	JEO	05/2016	YEAR: 2016 W.O.					
ENVIRONMENTAL		CONSTRUCTION		VERMONT GAS																																											
JLS	06/28/13	JLS	05/2016	PROPOSED 12" PIPELINE																																											
GIL	06/28/13	GJM	05/2016	ADDISON NATURAL GAS PROJECT																																											
BZD	06/28/13	BCK	05/2016	ALIGNMENT SHEET																																											
MDF	06/28/13	GEW	05/2016	LOC. ADDISON COUNTY, VERMONT																																											
SAB	06/28/13	JEO	05/2016	YEAR: 2016 W.O.																																											
ANGP-T-G-07-010	ACCESS ROAD DETAILS																																														
ANGP-EPSC-065	EPSC PLAN																																														
G-001 - 010	COVER, INDEX, LEGEND & NOTES, AND CONSTRUCTION DETAILS	1	VGS	VGS	ACCESS ROAD "AL" REMOVED (11/13/15)																																										
DWG. NO.	REFERENCE DWG.	REV	DSN	CK	DESCRIPTION	INITIALS	DATE	INITIALS	DATE	SCALE: 1" = 100'	DWG. ANGP-T-C-065 REV. 1																																				

PROFILE

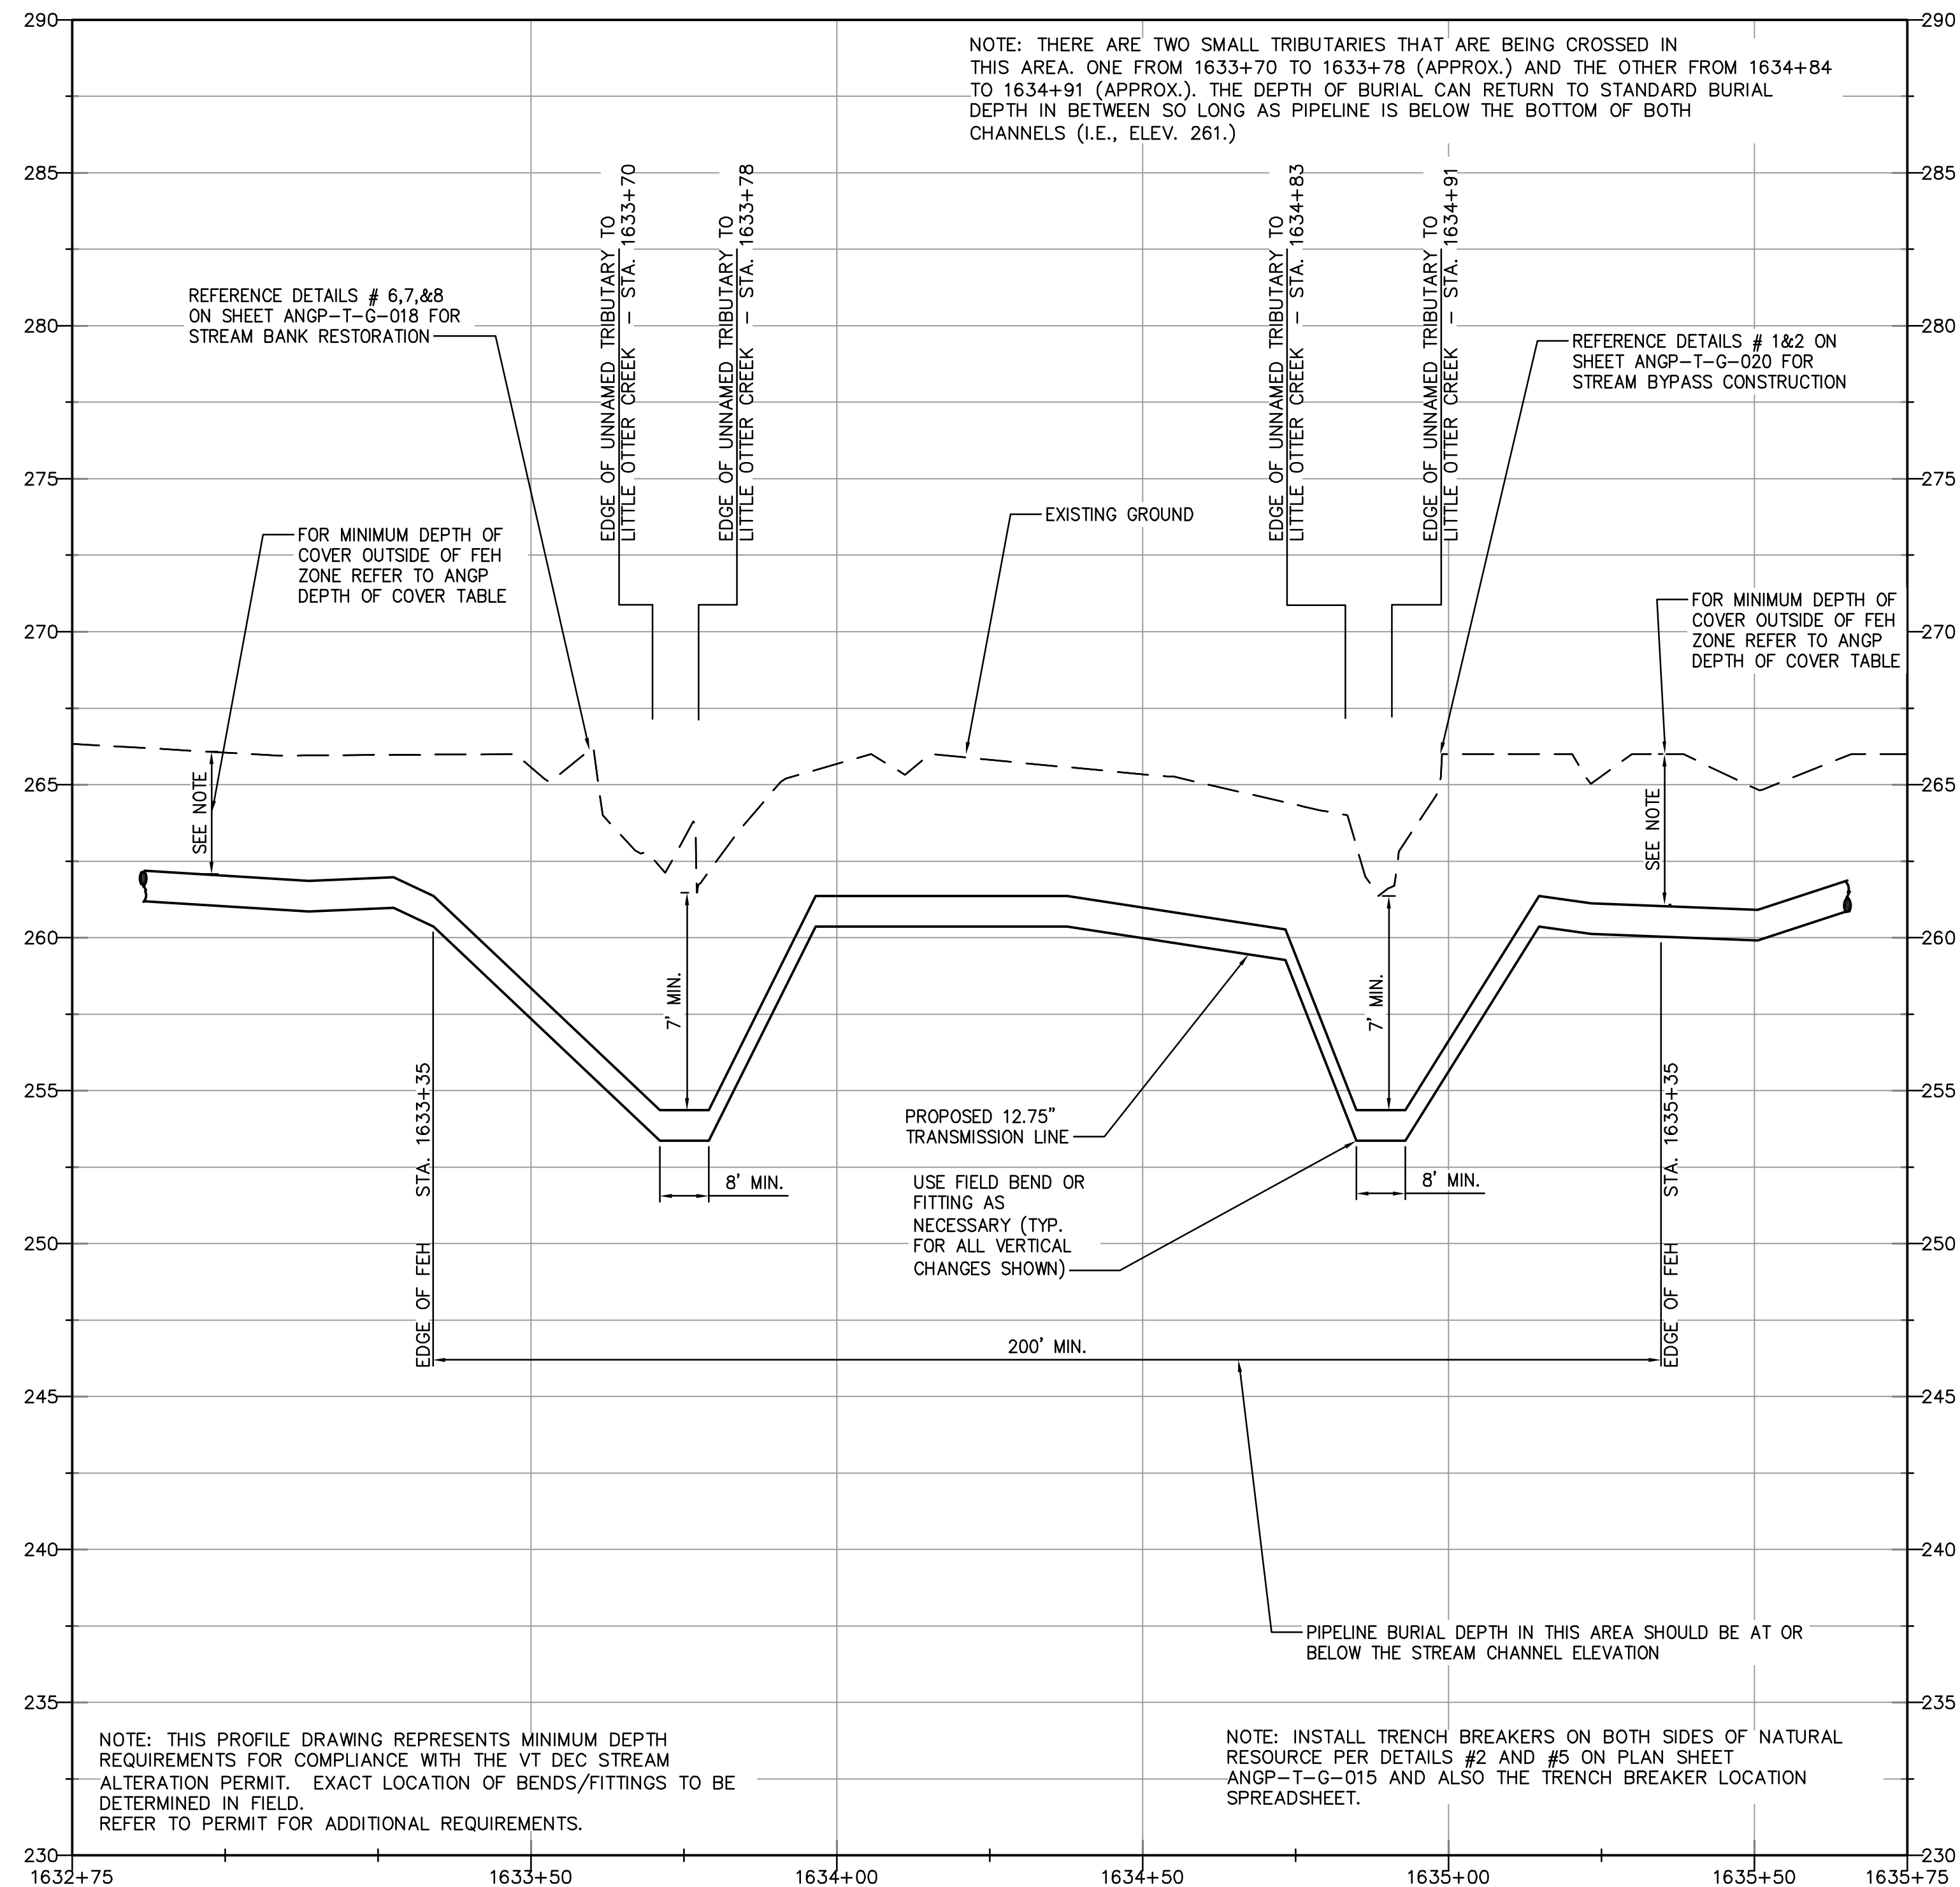

NOTE: THERE ARE TWO SMALL TRIBUTARIES THAT ARE BEING CROSSED IN THIS AREA. ONE FROM 1633+70 TO 1633+78 (APPROX.) AND THE OTHER FROM 1634+84 TO 1634+91 (APPROX.). THE DEPTH OF BURIAL CAN RETURN TO STANDARD BURIAL DEPTH IN BETWEEN SO LONG AS PIPELINE IS BELOW THE BOTTOM OF BOTH CHANNELS (I.E., ELEV. 261.)

REFERENCE DETAILS # 6,7,&8 ON SHEET ANGP-T-G-018 FOR STREAM BANK RESTORATION

REFERENCE DETAILS # 1&2 ON SHEET ANGP-T-G-020 FOR STREAM BYPASS CONSTRUCTION

FOR MINIMUM DEPTH OF COVER OUTSIDE OF FEH ZONE REFER TO ANGP DEPTH OF COVER TABLE

FOR MINIMUM DEPTH OF COVER OUTSIDE OF FEH ZONE REFER TO ANGP DEPTH OF COVER TABLE

SEE NOTE

SEE NOTE

PROPOSED 12.75" TRANSMISSION LINE

USE FIELD BEND OR FITTING AS NECESSARY (TYP. FOR ALL VERTICAL CHANGES SHOWN)

200' MIN.


PIPELINE BURIAL DEPTH IN THIS AREA SHOULD BE AT OR BELOW THE STREAM CHANNEL ELEVATION

NOTE: THIS PROFILE DRAWING REPRESENTS MINIMUM DEPTH REQUIREMENTS FOR COMPLIANCE WITH THE VT DEC STREAM ALTERATION PERMIT. EXACT LOCATION OF BENDS/FITTINGS TO BE DETERMINED IN FIELD. REFER TO PERMIT FOR ADDITIONAL REQUIREMENTS.


NOTE: INSTALL TRENCH BREAKERS ON BOTH SIDES OF NATURAL RESOURCE PER DETAILS #2 AND #5 ON PLAN SHEET ANGP-T-G-015 AND ALSO THE TRENCH BREAKER LOCATION SPREADSHEET.

**STREAM CROSSING PROFILE
UNNAMED TRIBUTARY TO
LITTLE OTTER CREEK
STATION 1634+27±
MILE POST 30.95**

SCALE: HORIZ. 1"=20'
VERT. 1"=4'

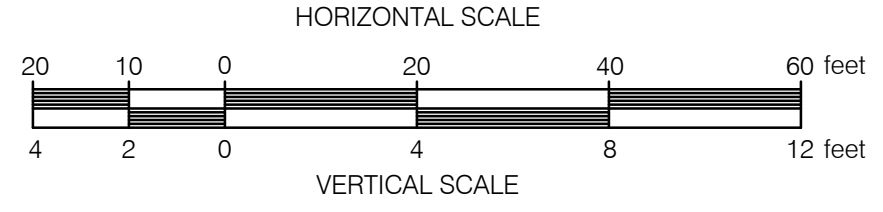

NOTE: STREAM CROSSING MUST BE CONSTRUCTED BETWEEN JUNE 1 AND OCTOBER 1

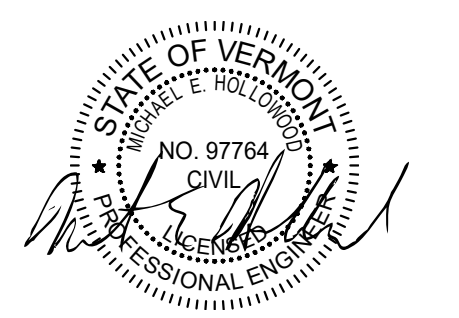


DWG. NO.	REFERENCE DWG.	REV	DSN	CK	DESCRIPTION	INITIALS	DATE	INITIALS	DATE	YEAR: 2016	W.O.	SCALE: AS NOTED	DWG. ANGP-T-C-065A	REV. 0

VHB Vanasse Hangen Brustlin, Inc.

CIA



38 Eastwood Drive, Suite 105
South Burlington, VT 05403
Main: (802) 735-0372 • www.chacompanies.com



VERMONT GAS
PROPOSED 12" PIPELINE
ADDISON NATURAL GAS PROJECT
OPEN TRENCH STREAM CROSSING PROFILE
LOC. ADDISON COUNTY, VERMONT

	BID	CONSTRUCTION
ENVIRONMENTAL	JLS 06/28/13	JLS 05/2016
DRAFTING DESIGNER	GIL 06/28/13	GJM 05/2016
DRAFTING SUPERVISOR	BZD 06/28/13	BCK 05/2016
DESIGN ENGINEER	MDF 06/28/13	GEW 05/2016
DESIGN MANAGER	SAB 06/28/13	JEO 05/2016

RIGHT-OF-WAY	213 N/F CHOINIÈRE, JAMES & SHERRY	214 N/F ELGIN SPRING FARM	215 N/F SMITH, HARVEY	216 N/F FOUR-HILLS FARM PARTNERSHIP	MATCH LINE
SURVEY DATA	S 12° 17' W	S 12° 28' W	S 12° 17' W	S 12° 19' W	S 12° 19' W

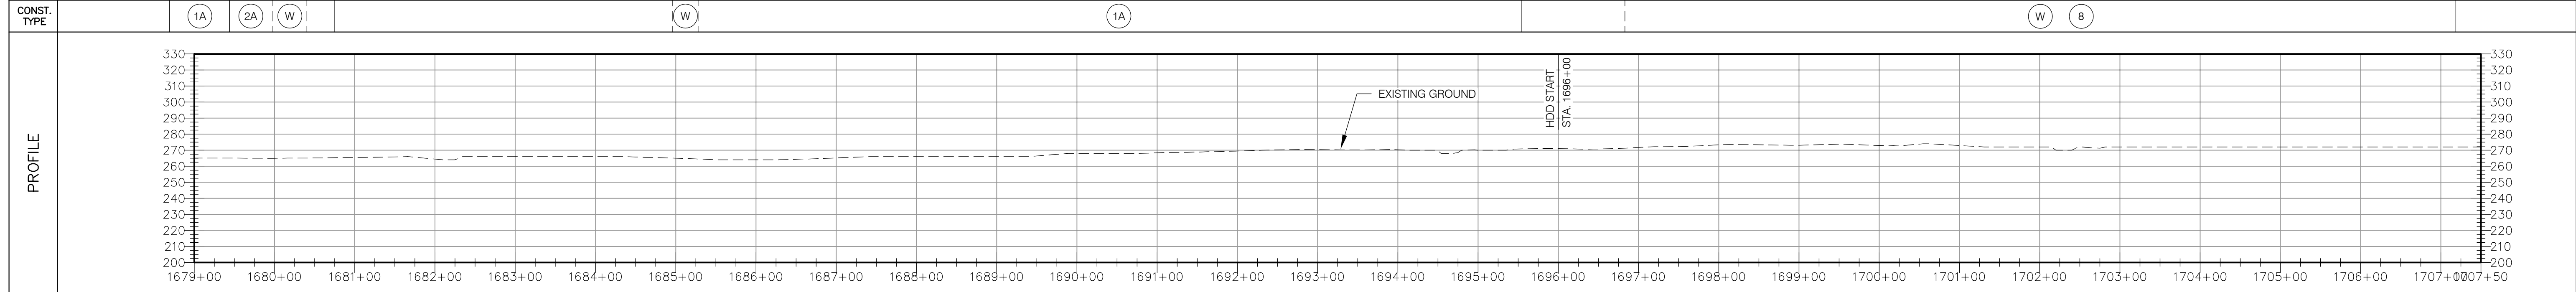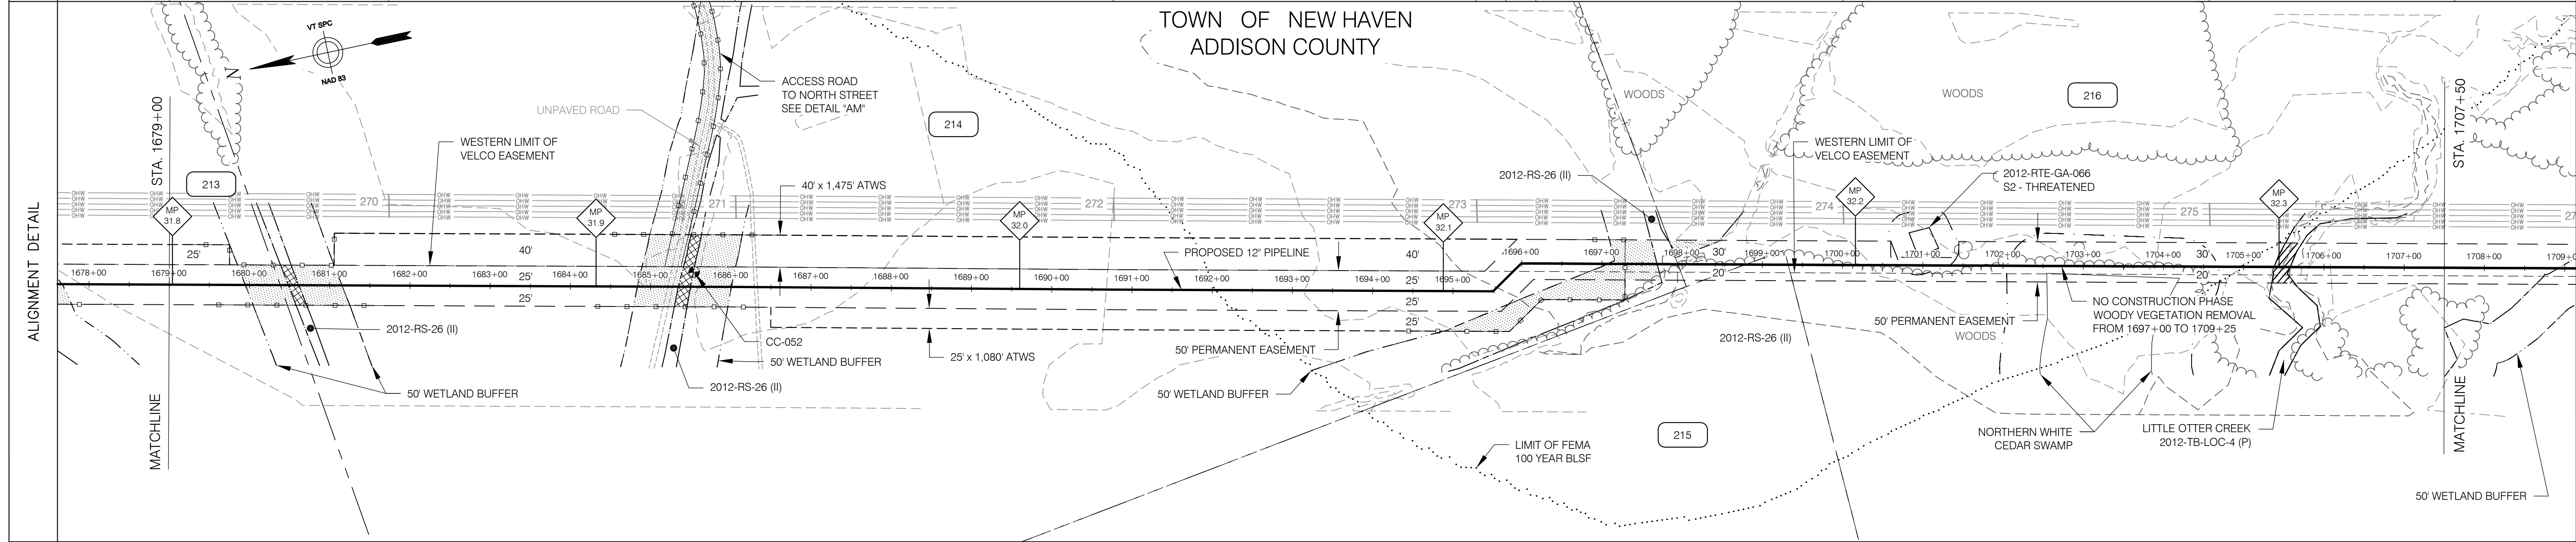

MATERIALS	1A	2A	W	1A	W	8
COATING	A	C	A	C	A	B
CLASSIFICATION					1	
DESIGN FACTOR					0.5	



PIPE MATERIAL:
 1 12.75" O.D. X 0.312" WT, API-5L, GR. X65, PSL-2, AND ADDITIONAL SPECIFICATIONS IN 192.112 2,850 FT
 2 20" O.D. X 0.375" WT, API-5L, GR. B 0 FT
PIPE COATING:
 A EPOXY POLYETHYLENE 10/40 1,462 FT
 B FBE, ABRASION RESISTANT OVERCOAT, 14-16 MILS/40 MILS, 54-56 MILS TOTAL 1,150 FT
 C FBE 14-16 MILS, W/ 1-1/2" REINFORCED CONCRETE W/ 140 LBS/FT' 238 FT

SCALE:
 HORIZONTAL SCALE: 1" = 100'
 VERTICAL SCALE: 1" = 10'
 100 50 0 100 200 300 feet
 50 25 0 50 100 150 feet



ANGP-T-G-07-010	ACCESS ROAD DETAILS									ENVIRONMENTAL	JLS	06/28/13	JLS	05/2016	VERMONT GAS PROPOSED 12" PIPELINE ADDISON NATURAL GAS PROJECT ALIGNMENT SHEET LOC. ADDISON COUNTY, VERMONT YEAR: 2016 W.O. SCALE: 1" = 100' DWG. ANGP-T-G-067 REV. 0
ANGP-EPSC-067	EPSC PLAN									DRAFTING DESIGNER	GIL	06/28/13	GJM	05/2016	
G-001 - 010	COVER, INDEX, LEGEND & NOTES, AND CONSTRUCTION DETAILS									DRAFTING SUPERVISOR	BZD	06/28/13	BCK	05/2016	
DWG. NO.	REFERENCE DWG.	REV	DSN	CK						DESIGN ENGINEER	MDF	06/28/13	GEW	05/2016	
										DESIGN MANAGER	SAB	06/28/13	JEO	05/2016	

RIGHT-OF-WAY	216 N/F FOUR-HILLS FARM	216.01 PLANK ROAD	217 N/F ELGIN SPRING FARM	219 N/F LUTTON, DAVID	218 N/F ELGIN SPRING FARM
SURVEY DATA	S 12' 19" W	S 12' 06" W	S 12' 18" W	S 01' 01" W	S 02' 07" W

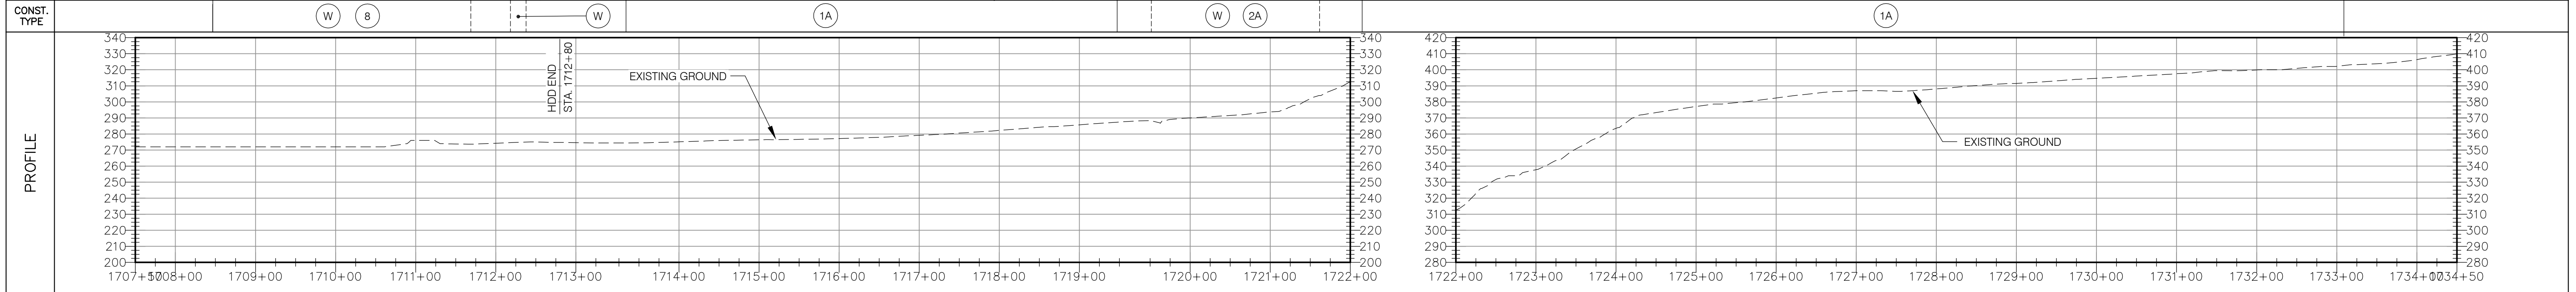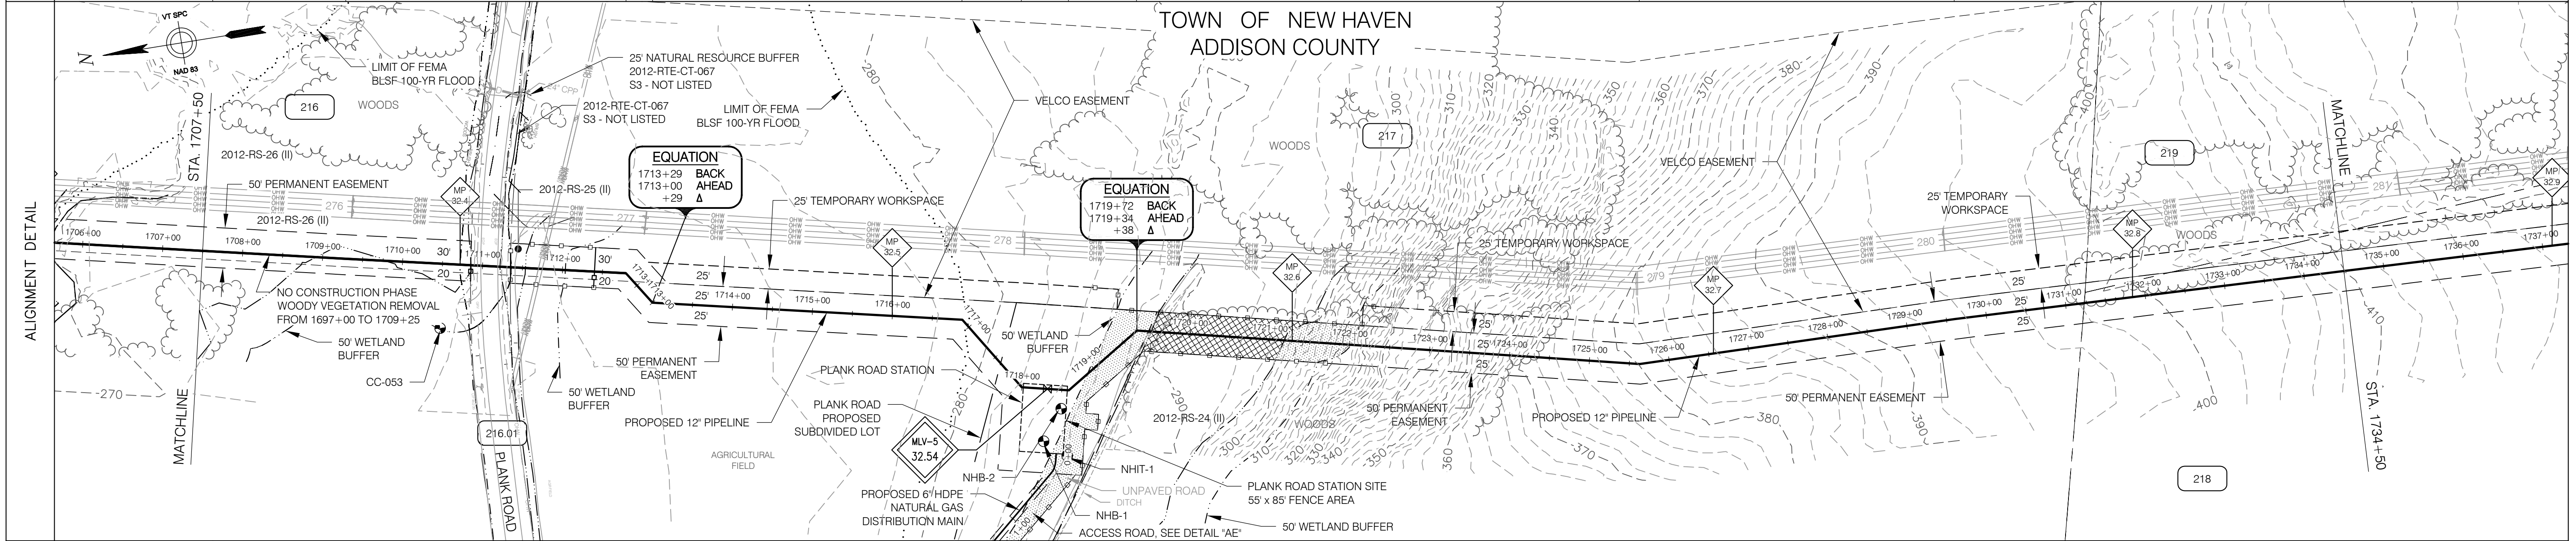

MATERIALS	MATCHLINE	(1) 529 FT	(1) 640 FT	(1) 351 FT	(1) 1,247 FT	MATCHLINE
-----------	-----------	------------	------------	------------	--------------	-----------

COATING	B	A	C	A
CLASSIFICATION			1	
DESIGN FACTOR			0.5	

HORIZONTAL SCALE

VERTICAL SCALE

PIPE MATERIAL:

1 12.75" O.D. X 0.312" WT, API-5L, GR. X65, PSL-2, AND ADDITIONAL SPECIFICATIONS IN 192.112 2,767 FT

2 20" O.D. X 0.375" WT, API-5L, GR. B 0 FT

PIPE COATING:

A EPOXY POLYETHYLENE 10/40 1,887 FT



B FBE, ABRASION RESISTANT OVERCOAT, 14-16 MILS/40 MILS, 54-56 MILS TOTAL 529 FT

C FBE 14-16 MILS, W/ 1-1/2" REINFORCED CONCRETE W/ 140 LBS/FT' 351 FT

VHB Vanasse Hangen Brustlin, Inc.

ANGP-T-G-07-010	ACCESS ROAD DETAILS							BID	CONSTRUCTION	VERMONT GAS PROPOSED 12" PIPELINE ADDISON NATURAL GAS PROJECT ALIGNMENT SHEET	 Vermont Gas	 CIA 38 Eastwood Drive, Suite 105 South Burlington, VT 05403 Main: (802) 735-0372 - www.ciacompanies.com
ANGP-EPSC-V001	EPSC PLAN							ENVIRONMENTAL	JLS 06/28/13			
ANGP-T-G-021	STATION AND VALVE DETAILS							DRAFTING DESIGNER	GIL 06/28/13	GJM 05/2016	LOC. ADDISON COUNTY, VERMONT	
ANGP-EPSC-068	EPSC PLAN							DRAFTING SUPERVISOR	BZD 06/28/13	BCK 05/2016	YEAR: 2016	W.O.
G-001 - 010	COVER, INDEX, LEGEND & NOTES, AND CONSTRUCTION DETAILS	1	GJM	TDB	VHB HDD AREA REVISIONS (6/24/15)			DESIGN ENGINEER	MDF 06/28/13	GEW 05/2016	SCALE: 1" = 100'	DWG. ANGP-T-C-068
DWG. NO.	REFERENCE DWG.	REV	DSN	CK	DESCRIPTION			DESIGN MANAGER	SAB 06/28/13	JEO 05/2016	SCALE: 1" = 100'	REV. 1

RIGHT-OF-WAY	MATCHLINE												MATCHLINE
SURVEY DATA	S 02° 07' W	00096' RT	S 02° 14' W	00095' LT	S 02° 08' W	-1.1' LT	S 02° 15' W	00001' LT	S 02° 13' W	00004' LT	S 02° 08' W	00002' RT	S 02° 12' W

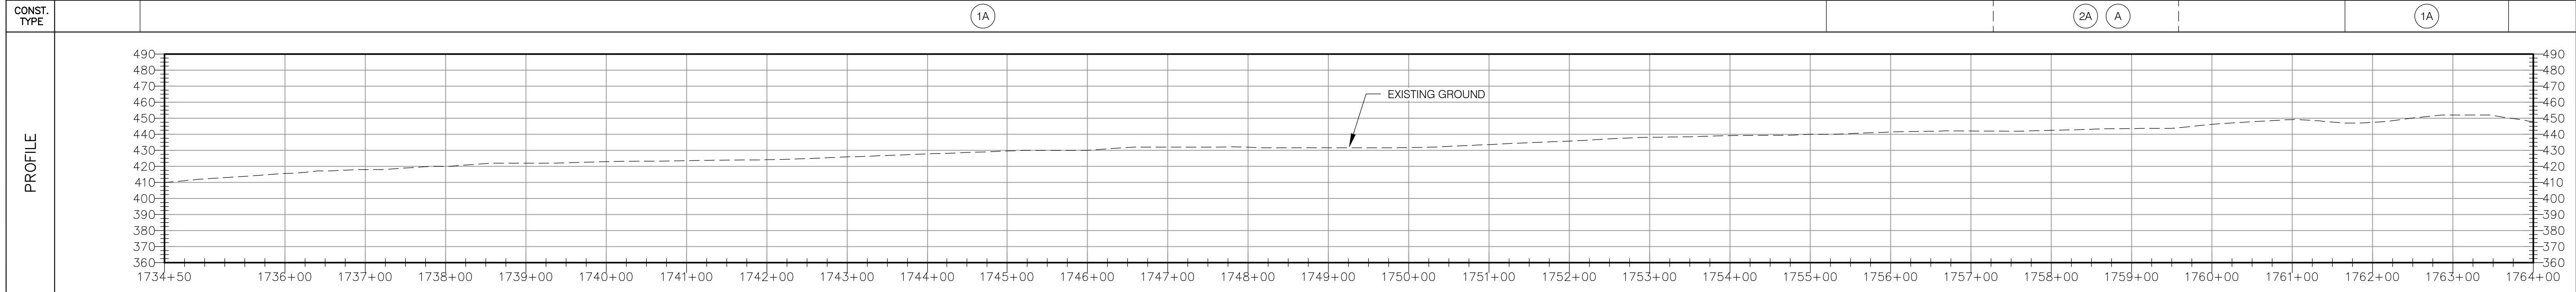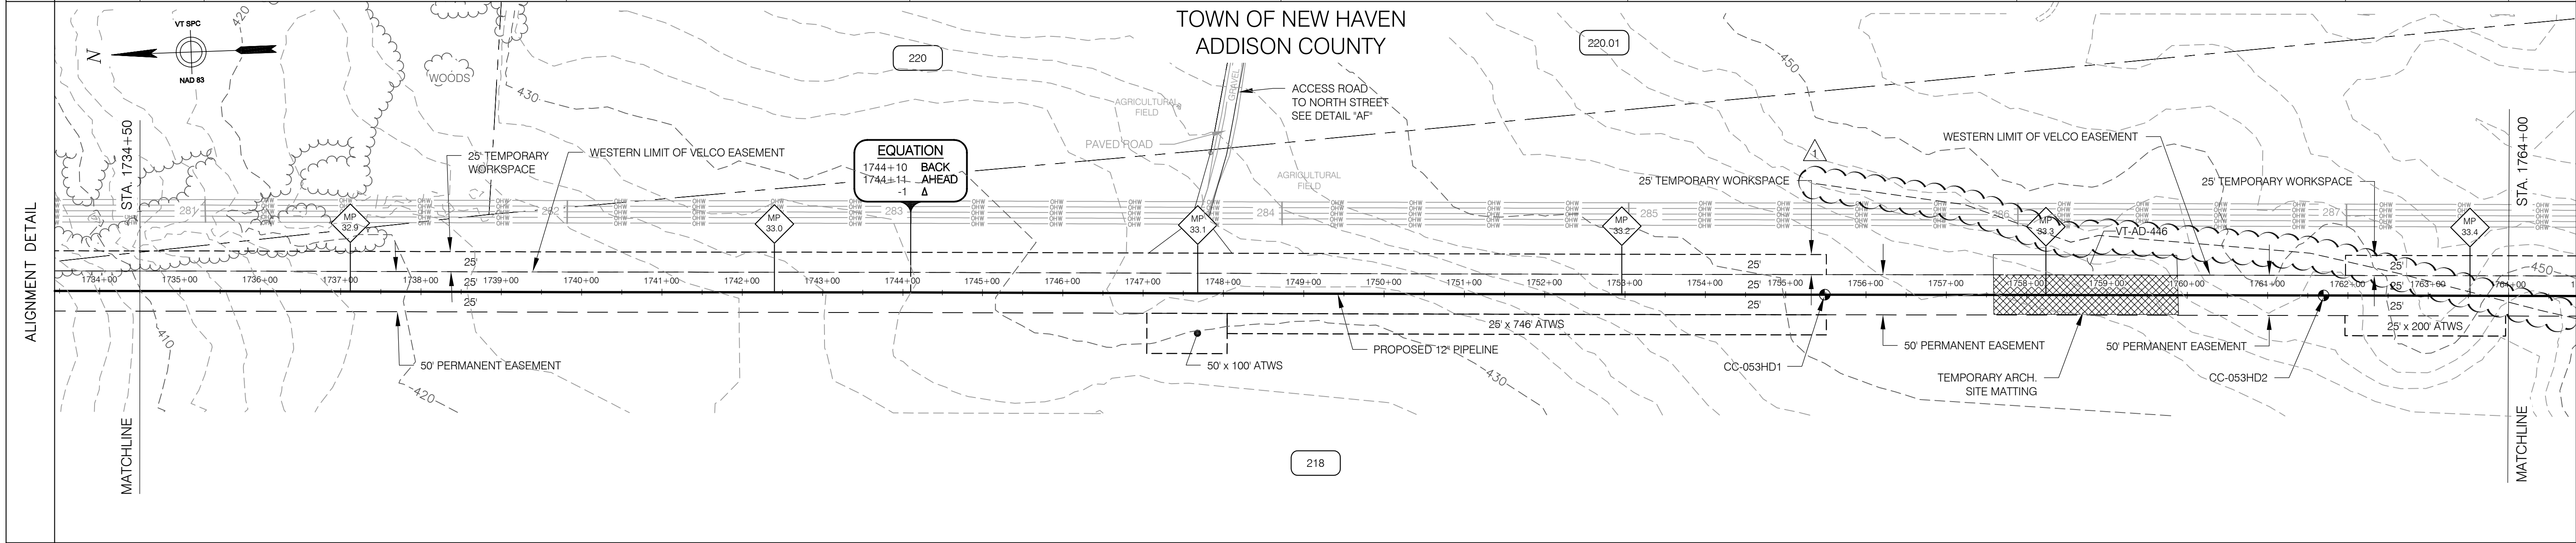

MATERIALS	MATCHLINE													MATCHLINE
-----------	-----------	--	--	--	--	--	--	--	--	--	--	--	--	-----------

COATING	A
CLASSIFICATION	1
DESIGN FACTOR	0.5

PIPE MATERIAL:

- 1 12.75" O.D. X 0.312" WT, API-5L, GR. X65, PSL-2, AND ADDITIONAL SPECIFICATIONS IN 192.112 2,949 FT
- 2 20" O.D. X 0.375" WT, API-5L, GR. B 0 FT

PIPE COATING:


- A EPOXY POLYETHYLENE 10/40 2,949 FT
- B FBE, ABRASION RESISTANT OVERCOAT, 14-16 MILS/40 MILS, 54-56 MILS TOTAL 0 FT
- C FBE 14-16 MILS, W/ 1-1/2" REINFORCED CONCRETE W/ 140 LBS/FT' 0 FT

HORIZONTAL SCALE


VERTICAL SCALE

ANGP-T-G-07-010 ACCESS ROAD DETAILS										ENVIRONMENTAL JLS 06/28/13 JLS 05/2016		VERMONT GAS PROPOSED 12" PIPELINE ADDISON NATURAL GAS PROJECT ALIGNMENT SHEET											
ANGP-EPSC-069 EPSC PLAN										DRAFTING DESIGNER GIL 06/28/13 GJM 05/2016		LOC. ADDISON COUNTY, VERMONT											
G-001 - 010 COVER, INDEX, LEGEND & NOTES, AND CONSTRUCTION DETAILS		1	GJM	BCK	IFC 2016 EDITS (05/2016)						DESIGN SUPERVISOR BZD 06/28/13 BCK 05/2016		YEAR: 2016		W.O.		SCALE: 1" = 100'		DWG. ANGP-T-C-069		REV. 1		
DWG. NO.		REV		DSN		CK		DESCRIPTION		INITIALS		DATE		INITIALS		DATE							

RIGHT-OF-WAY		218 N/F ELGIN SPRING FARM	220.02 QUARRY ROAD	221 N/F FARNWORTH, RALPH & YVONNE		222 N/F SMITH, JEAN		
SURVEY DATA		S 02° 12' W	S 02° 11' W	S 02° 11' W	S 02° 18' W	S 02° 07' W	S 02° 09' W	S 02° 17' W

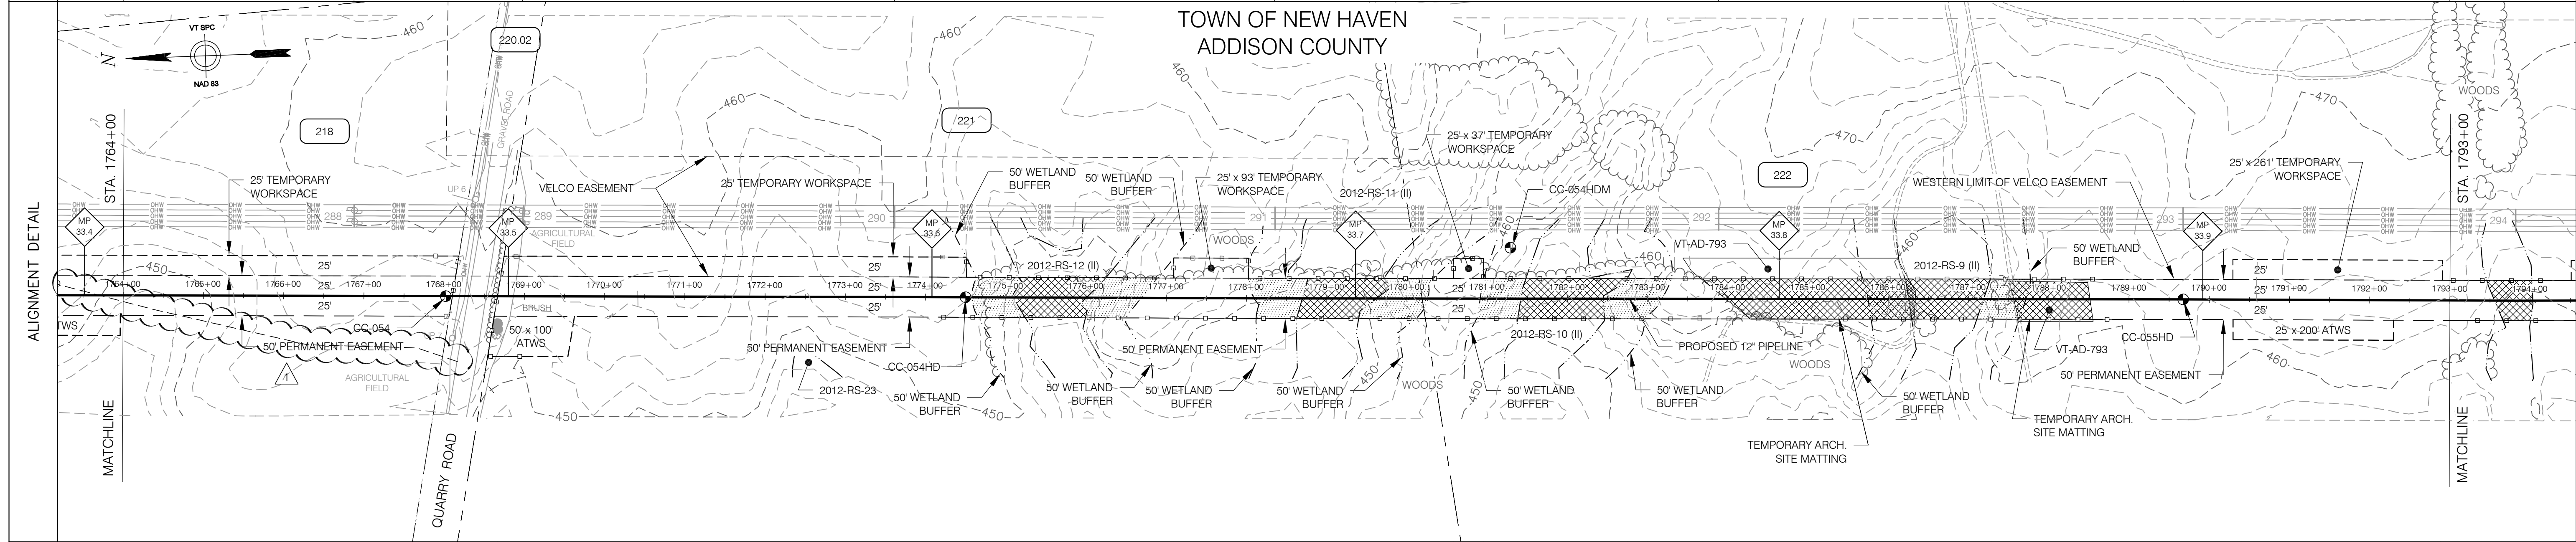

CONST. TYPE	1A	11	1A	W	2A	1A	W	2A	1A	2A	W	A	2A	W	A	1A	2A
-------------	----	----	----	---	----	----	---	----	----	----	---	---	----	---	---	----	----

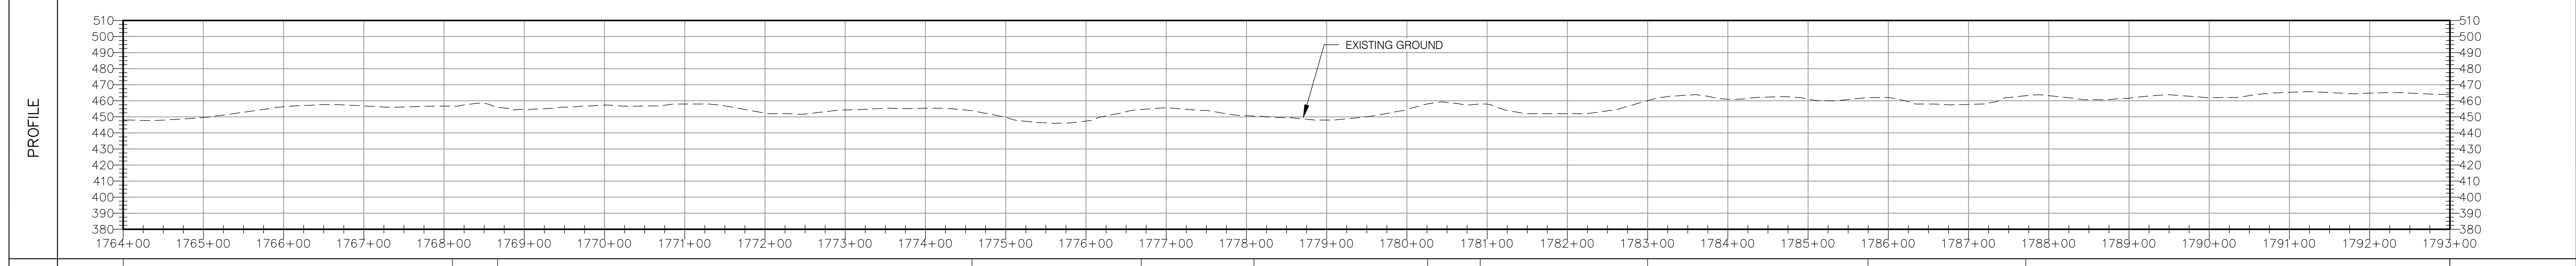

MATERIALS	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
LENGTH	410 FT	57 FT	590 FT	212 FT	140 FT	218 FT	64 FT	209 FT	274 FT	197 FT	517 FT						

COATING	A	C	A	C	A	C	A	C	A	C	A	C	A	C	A	C	A
---------	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---	---

CLASSIFICATION	1																	
----------------	---	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--

DESIGN FACTOR	0.5																	
---------------	-----	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--

PIPE MATERIAL:
 1 12.75" O.D. X 0.312" WT, API-5L, GR. X65, PSL-2, AND ADDITIONAL SPECIFICATIONS IN 192.112 2,888 FT
 2 20" O.D. X 0.375" WT, API-5L, GR. B 0 FT

PIPE COATING:
 A EPOXY POLYETHYLENE 10/40 1995 FT
 B FBE, ABRASION RESISTANT OVERCOAT, 14-16 MILS/40 MILS, 54-56 MILS TOTAL 0 FT
 C FBE 14-16 MILS, W/ 1-1/2" REINFORCED CONCRETE W/ 140 LBS/FT' 893 FT

HORIZONTAL SCALE: 1" = 100'


VERTICAL SCALE: 1" = 10'

STATE OF VERMONT PROFESSIONAL ENGINEER: [Signature and Seal]


VHB Vanasse Hangen Brustlin, Inc.

ANGP-EPSC-070						EPSC PLAN						VERMONT GAS PROPOSED 12" PIPELINE ADDISON NATURAL GAS PROJECT ALIGNMENT SHEET					
G-001 - 010						COVER, INDEX, LEGEND & NOTES, AND CONSTRUCTION DETAILS						LOC. ADDISON COUNTY, VERMONT					
DWG. NO.						REFERENCE DWG.						SCALE: 1" = 100'					
REV	DSN	BCK	CK	DESCRIPTION		INITIALS	DATE	INITIALS	DATE	YEAR:	W.O.	DWG.	ANGP-T-C-070	REV.	1		
				IFC 2016 EDITS (05/2016)						2016							

RIGHT-OF-WAY	MATCHLINE	222 N/F SMITH, JEAN	223 N/F SMITH, JEAN	224 N/F FOUR-HILLS FARM	225 N/F FOUR-HILLS FARM	MATCHLINE			
SURVEY DATA	00'15" LT S 02° 17' W 1794+82	S 02° 02' W	S 02° 08' W	S 02° 15' W	S 02° 10' W	S 02° 05' W	S 02° 12' W	S 02° 21' W	00'06" RT 1821+38

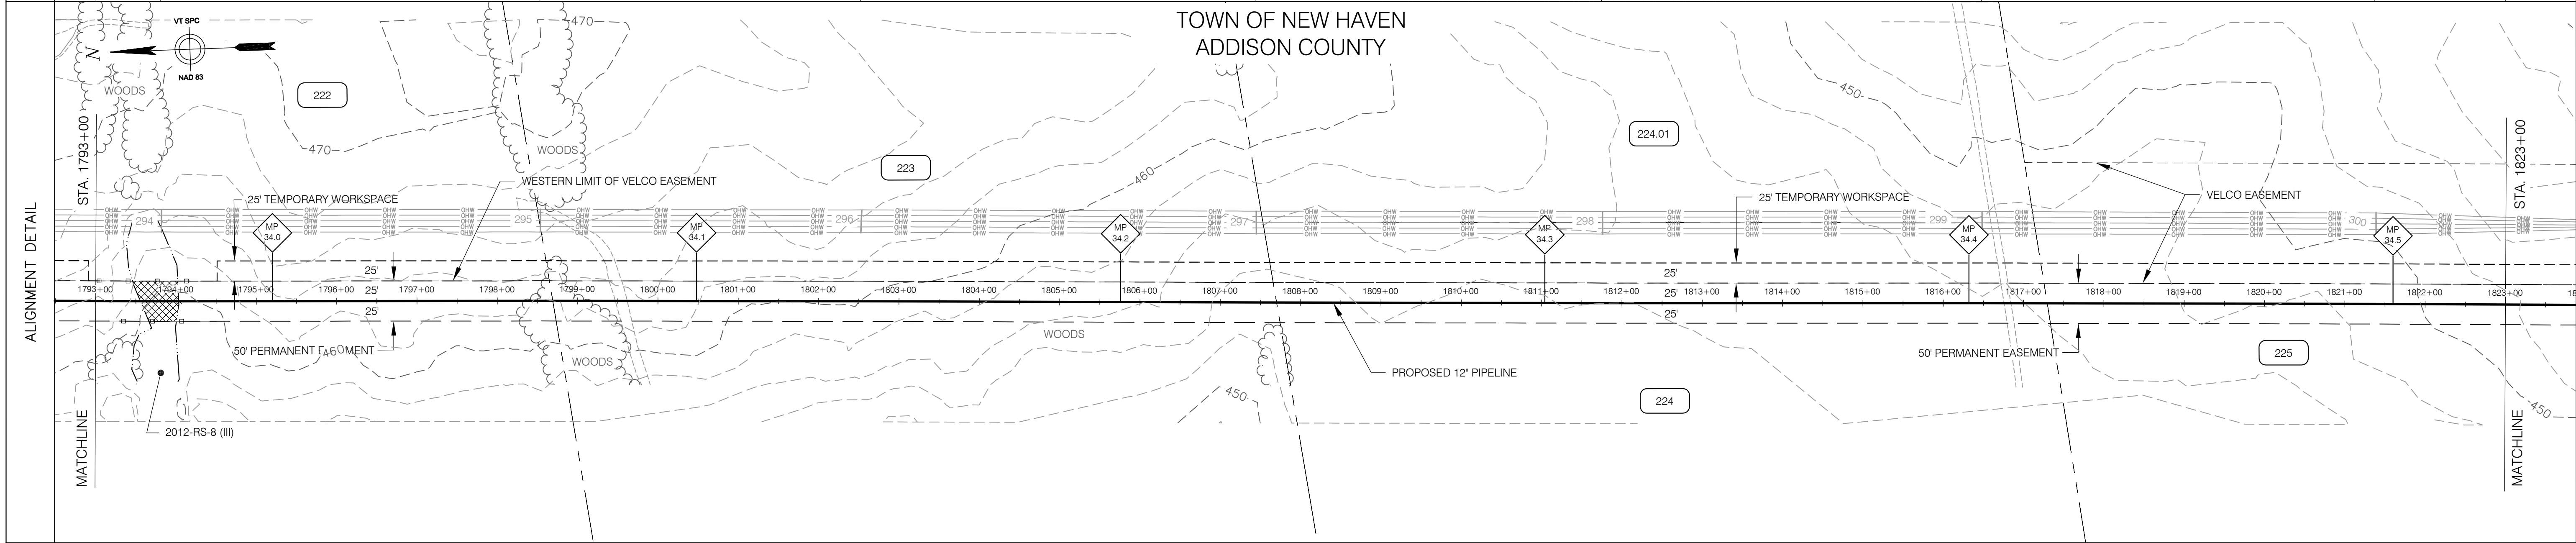

CONST. TYPE	(2A) (W)	(1A)
-------------	----------	------

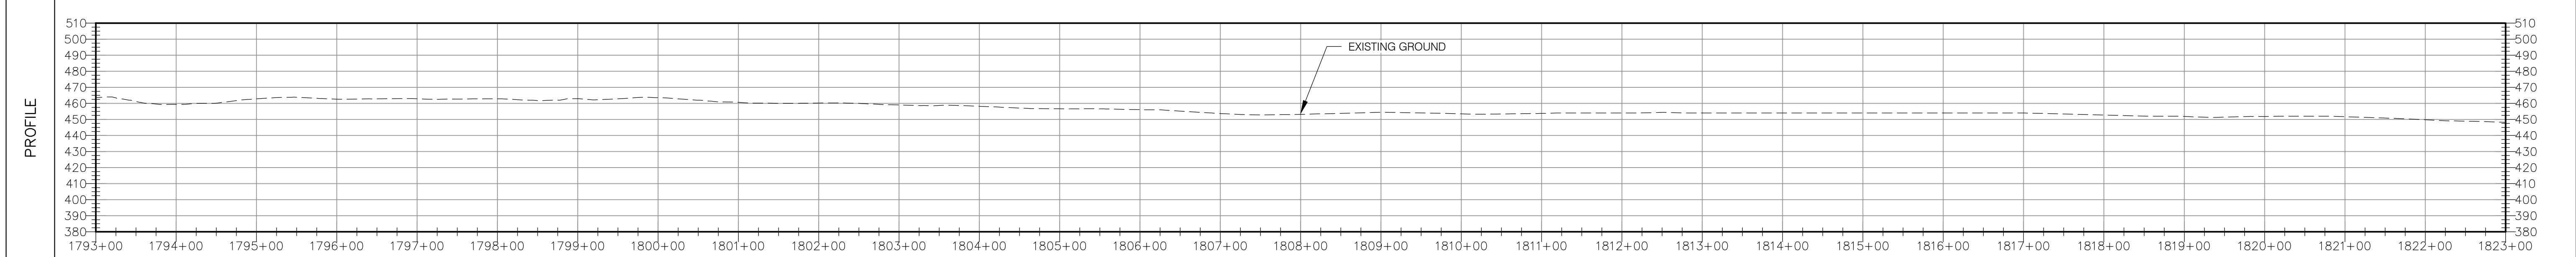

MATERIALS	MATCHLINE	(2) 56 FT	(2) 48 FT	(1) 2,896 FT	MATCHLINE
COATING	A	C	A	A	
CLASSIFICATION			1		
DESIGN FACTOR			0.5		

HORIZONTAL SCALE

VERTICAL SCALE

PIPE MATERIAL:



1 12.75" O.D. X 0.312" WT, API-5L, GR. X65, PSL-2, AND ADDITIONAL SPECIFICATIONS IN 192.112	3,000 FT
2 20" O.D. X 0.375" WT, API-5L, GR. B	0 FT

PIPE COATING:


A EPOXY POLYETHYLENE 10/40	2,952 FT
B FBE, ABRASION RESISTANT OVERCOAT, 14-16 MILS/40 MILS, 54-56 MILS TOTAL	0 FT
C FBE 14-16 MILS, W/ 1-1/2" REINFORCED CONCRETE W/ 140 LBS/FT'	48 FT

ANGP-EPSC-071 EPSC PLAN		REV DSN CK		DESCRIPTION		<table border="1" style="font-size: small;"> <thead> <tr> <th colspan="2">ENVIRONMENTAL</th> <th colspan="2">BID</th> <th colspan="2">CONSTRUCTION</th> </tr> </thead> <tbody> <tr> <td>JLS</td><td>06/28/13</td> <td>JLS</td><td>06/28/13</td> <td>JLS</td><td>05/2016</td> </tr> <tr> <td>GJM</td><td>06/28/13</td> <td>GJM</td><td>06/28/13</td> <td>GJM</td><td>05/2016</td> </tr> <tr> <td>BZD</td><td>06/28/13</td> <td>BZD</td><td>06/28/13</td> <td>BCK</td><td>05/2016</td> </tr> <tr> <td>MDF</td><td>06/28/13</td> <td>MDF</td><td>06/28/13</td> <td>GEW</td><td>05/2016</td> </tr> <tr> <td>SAB</td><td>06/28/13</td> <td>SAB</td><td>06/28/13</td> <td>JEO</td><td>05/2016</td> </tr> </tbody> </table>		ENVIRONMENTAL		BID		CONSTRUCTION		JLS	06/28/13	JLS	06/28/13	JLS	05/2016	GJM	06/28/13	GJM	06/28/13	GJM	05/2016	BZD	06/28/13	BZD	06/28/13	BCK	05/2016	MDF	06/28/13	MDF	06/28/13	GEW	05/2016	SAB	06/28/13	SAB	06/28/13	JEO	05/2016	VERMONT GAS PROPOSED 12" PIPELINE ADDISON NATURAL GAS PROJECT ALIGNMENT SHEET					
ENVIRONMENTAL		BID		CONSTRUCTION																																													
JLS	06/28/13	JLS	06/28/13	JLS	05/2016																																												
GJM	06/28/13	GJM	06/28/13	GJM	05/2016																																												
BZD	06/28/13	BZD	06/28/13	BCK	05/2016																																												
MDF	06/28/13	MDF	06/28/13	GEW	05/2016																																												
SAB	06/28/13	SAB	06/28/13	JEO	05/2016																																												
G-001 - 010 COVER, INDEX, LEGEND & NOTES, AND CONSTRUCTION DETAILS						LOC. ADDISON COUNTY, VERMONT YEAR: 2016 W.O. SCALE: 1" = 100' DWG. ANGP-T-C-071 REV. 0																																											


RIGHT-OF-WAY	MATCHLINE	225 N/F FOUR-HILLS FARM	226 N/F ELGIN SPRING FARM	226.01 ROUTE 17	229 N/F VERMONT TRANSOCO, LLC	231 N/F VERMONT TRANSOCO LLC	MATCHLINE																								
SURVEY DATA	S 02° 21' W	44° 59' RT 1824+59 S 47° 21' W 35° 32' RT 1824+79 S 82° 54' W 00° 00' LT 1826+30	S 82° 54' W	33° 15' LT 1824+69 S 49° 38' W 45° 00' LT 1825+91 S 04° 38' W -14.0 ft Bk: 1830+30 Afc: 1830+44	S 04° 38' W	S 04° 38' W	S 32° 48' W	S 13° 17' W	S 05° 13' E	S 12° 46' W																					
		1823+00	1824+00	1825+00	1826+00	1827+00	1828+00	1829+00	1830+00	1831+00	1832+00	1833+00	1834+00	1835+00	1836+00	1837+00	1838+00	1839+00	1840+00	1841+00	1842+00	1843+00	1844+00	1845+00	1846+00	1847+00	1848+00	1849+00	1850+00	1851+00	1851+50

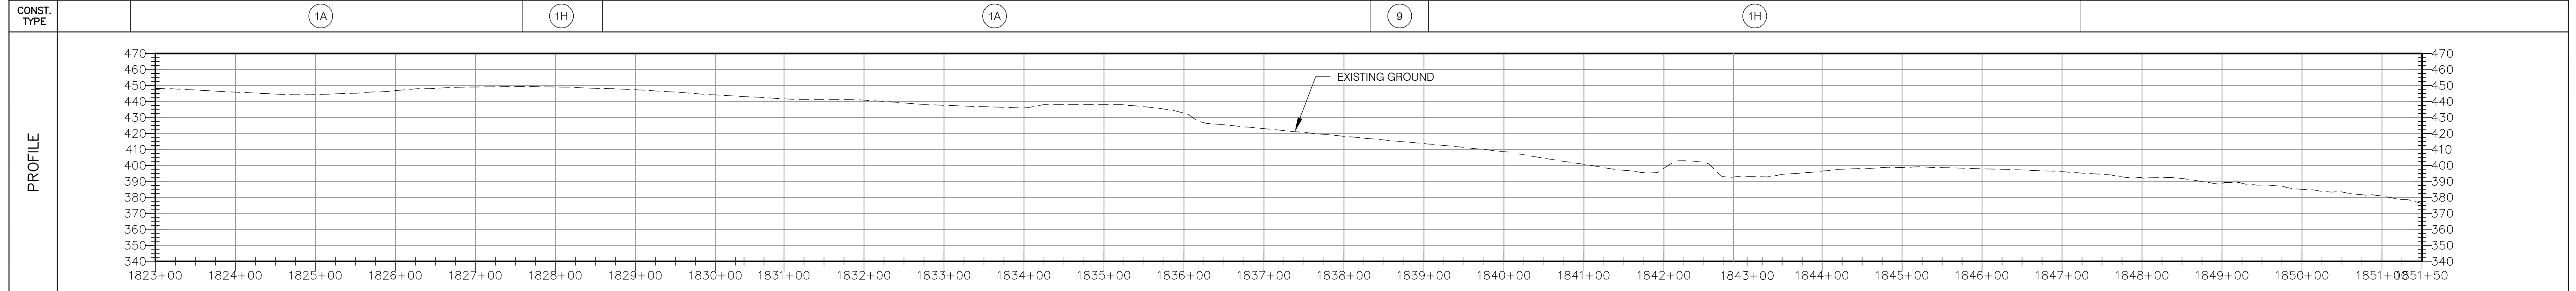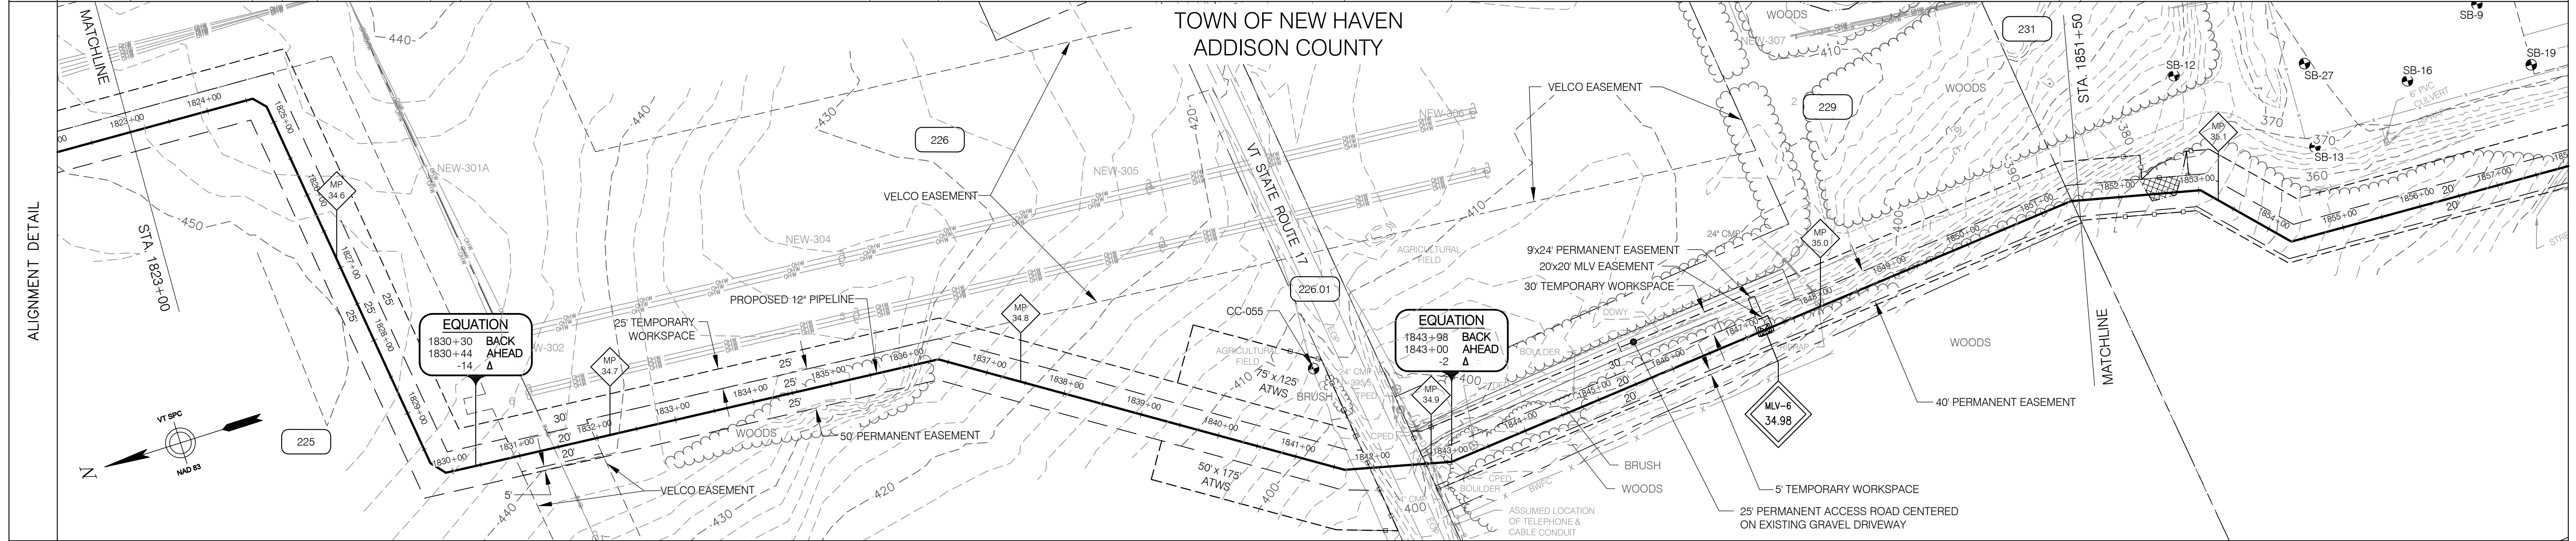

MATERIALS	MATCHLINE	1 1881 FT A	70 FT C	1 883 FT A	MATCHLINE
COATING		A	C	A	
CLASSIFICATION			1		
DESIGN FACTOR			0.5		





PIPE MATERIAL:	2,834 FT
1 12.75" O.D. X 0.312" WT, API-5L, GR. X65, PSL-2, AND ADDITIONAL SPECIFICATIONS IN 192.112	
2 20" O.D. X 0.375" WT, API-5L, GR. B	0 FT
PIPE COATING:	2,764 FT
A EPOXY POLYETHYLENE 10/40	
B FBE, ABRASION RESISTANT OVERCOAT, 14-16 MILS/40 MILS, 54-56 MILS TOTAL	0 FT
C FBE 14-16 MILS, W/ 1-1/2" REINFORCED CONCRETE W/ 140 LBS/FT'	70 FT

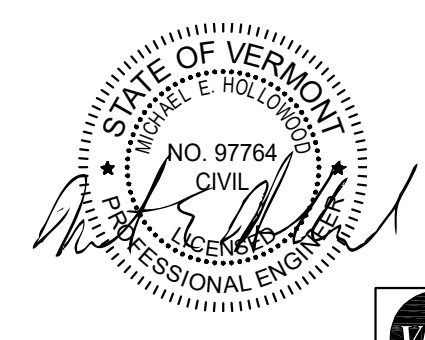

ANGP-T-C-072A		VAOT PROFILE VT STATE RTE. 17 (MAIN ST.) CROSSING DETAIL	ENVIRONMENTAL	JLS	06/28/13	JLS	05/2016	VERMONT GAS PROPOSED 12" PIPELINE ADDISON NATURAL GAS PROJECT ALIGNMENT SHEET					
ANGP-EPSC-072		EPSC PLAN	DRAFTING DESIGNER	GIL	06/28/13	GJM	05/2016	LOC. ADDISON COUNTY, VERMONT	YEAR: 2016			W.O.	SCALE: 1" = 100'
G-001 - 010		COVER, INDEX, LEGEND & NOTES, AND CONSTRUCTION DETAILS	DRAFTING SUPERVISOR	BZD	06/28/13	BCK	05/2016						
DWG. NO.		REFERENCE DWG.	DESIGN ENGINEER	MDF	06/28/13	GEW	05/2016						
			DESIGN MANAGER	SAB	06/28/13	JEO	05/2016						
REV	DSN	CK	DESCRIPTION	INITIALS	DATE	INITIALS	DATE						

RIGHT-OF-WAY	
SURVEY DATA	<p style="text-align: center;">231 N/F VERMONT TRANSCO</p> <p style="text-align: center;">MATCH LINE</p> <p style="text-align: center;">34'15" RT S 12° 46' W</p> <p style="text-align: center;">44'39" LT S 47° 02' W</p> <p style="text-align: center;">55'34" LT S 02° 22' W</p> <p style="text-align: center;">20'23" RT S 53° 12' E</p> <p style="text-align: center;">01'03" LT S 32° 49' E</p> <p style="text-align: center;">MATCH LINE</p>

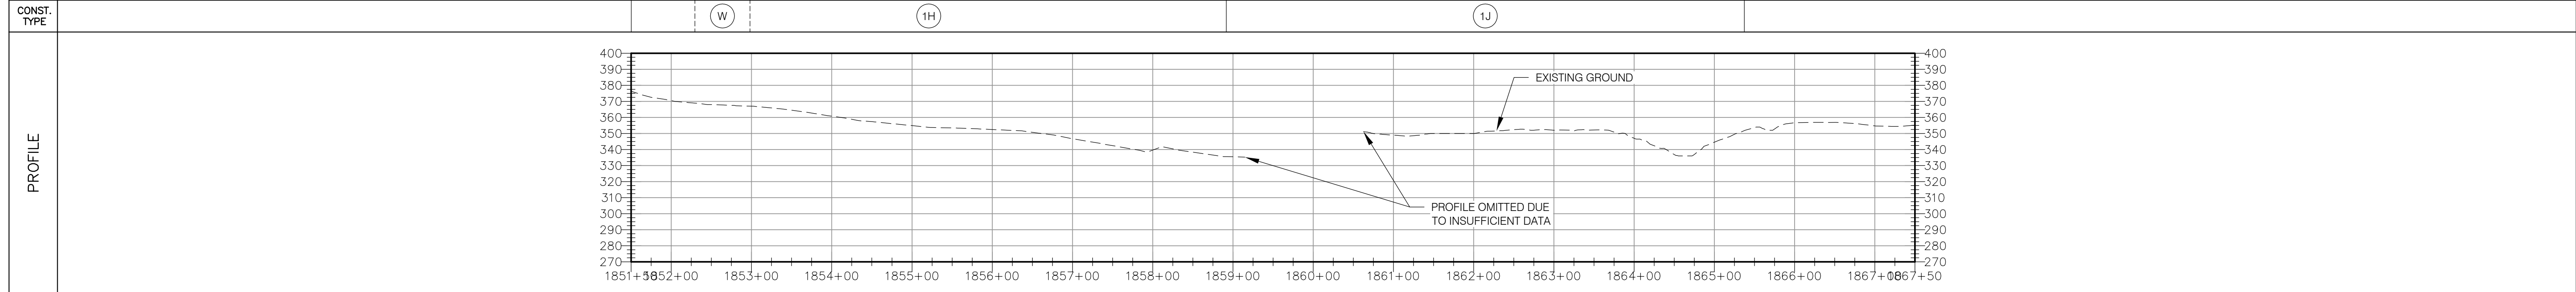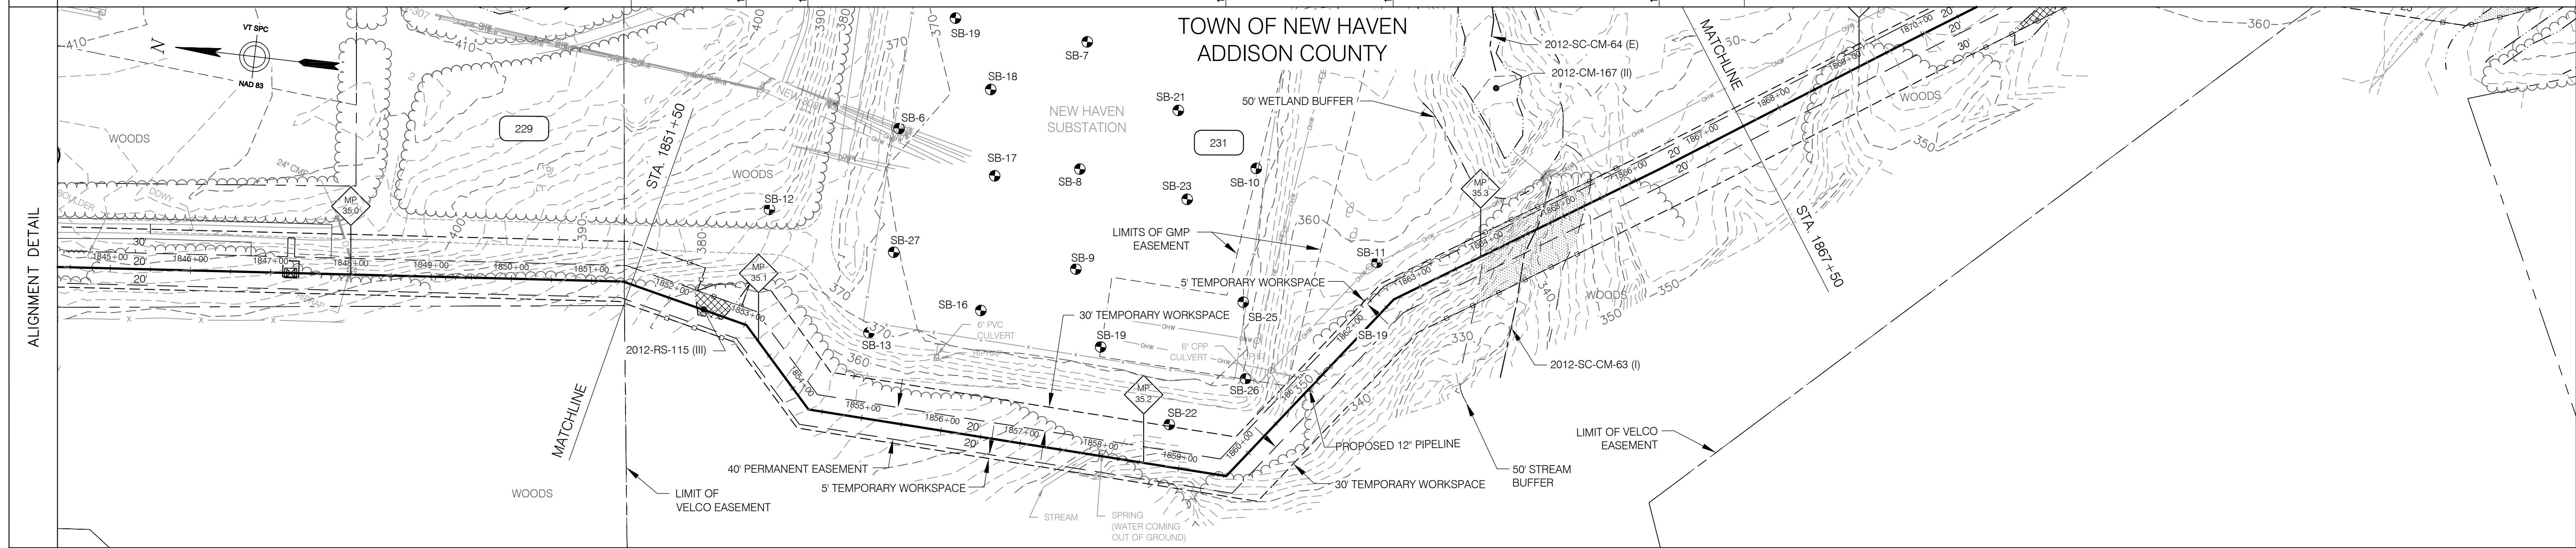

MATERIALS	<p style="text-align: center;">MATCHLINE</p> <p style="text-align: center;">(1) (1)</p> <p style="text-align: center;">78 FT 48 FT</p> <p style="text-align: center;">1,051 FT</p> <p style="text-align: center;">(1) (1)</p> <p style="text-align: center;">MATCHLINE</p>
COATING	<p style="text-align: center;">A C</p>
CLASSIFICATION	1
DESIGN FACTOR	0.5

HORIZONTAL SCALE

VERTICAL SCALE

PIPE MATERIAL:

1 12.75" O.D. X 0.312" WT, API-5L, GR. X65, PSL-2, AND ADDITIONAL SPECIFICATIONS IN 192.112 1,600 FT

2 20" O.D. X 0.375" WT, API-5L, GR. B 0 FT

PIPE COATING:

A EPOXY POLYETHYLENE 10/40 1,398 FT


B FBE, ABRASION RESISTANT OVERCOAT, 14-16 MILS/40 MILS, 54-56 MILS TOTAL 0 FT

C FBE 14-16 MILS, W/ 1-1/2" REINFORCED CONCRETE W/ 140 LBS/FT' 202 FT


VHB Vanasse Hangen Brustlin, Inc.

				ENVIRONMENTAL		DRAFTING DESIGNER		DRAFTING SUPERVISOR		DESIGN ENGINEER		DESIGN MANAGER		VERMONT GAS PROPOSED 12" PIPELINE ADDISON NATURAL GAS PROJECT ALIGNMENT SHEET		LOC. ADDISON COUNTY, VERMONT		YEAR: 2016	W.O.	SCALE: 1" = 100'	DWG. ANGP-T-C-073	REV. 0	
ANGP-EPSC-073	EPSC PLAN			JLS	06/28/13	GIL	06/28/13	BZD	06/28/13	MDF	06/28/13	SAB	06/28/13	JLS	05/2016	GJM	05/2016						BCK
G-001 - 010	COVER, INDEX, LEGEND & NOTES, AND CONSTRUCTION DETAILS																						
DWG. NO.	REFERENCE DWG.	REV	DSN	CK	DESCRIPTION		INITIALS	DATE	INITIALS	DATE	INITIALS	DATE	INITIALS	DATE									

RIGHT-OF-WAY			231 N/F VERMONT TRANSCO	232 N/F COUSINO, EUGENE & LINDA	233.01 TOWN HILL ROAD	234.01 N/F SHORTSLEEVE, GEORGE & JANE	234 N/F SHORTSLEEVE, GEORGE & JANE	236 N/F MAINE DRILLING AND BLASTING		
SURVEY DATA		00°25' RT	S 33° 52' E	S 33° 26' E	S 01° 54' W	-15.9 ft.	S 21° 01' E	S 42° 38' E	S 28° 30' E	S 02° 12' W

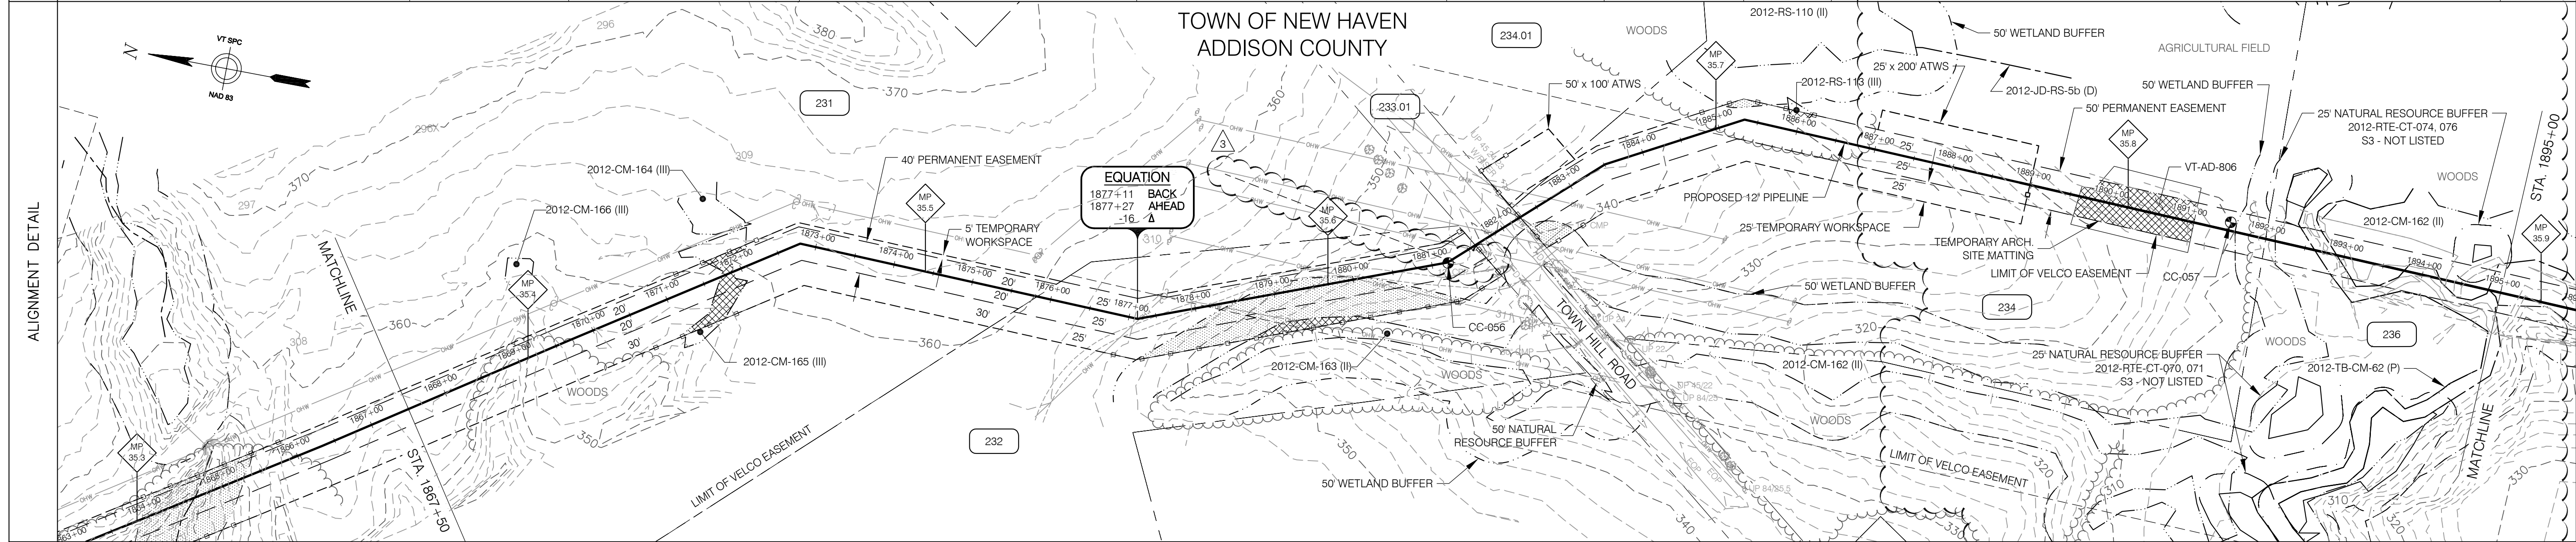

CONST. TYPE			1J W	1E	1J W	9	1J	1E	A	8
-------------	--	--	------	----	------	---	----	----	---	---

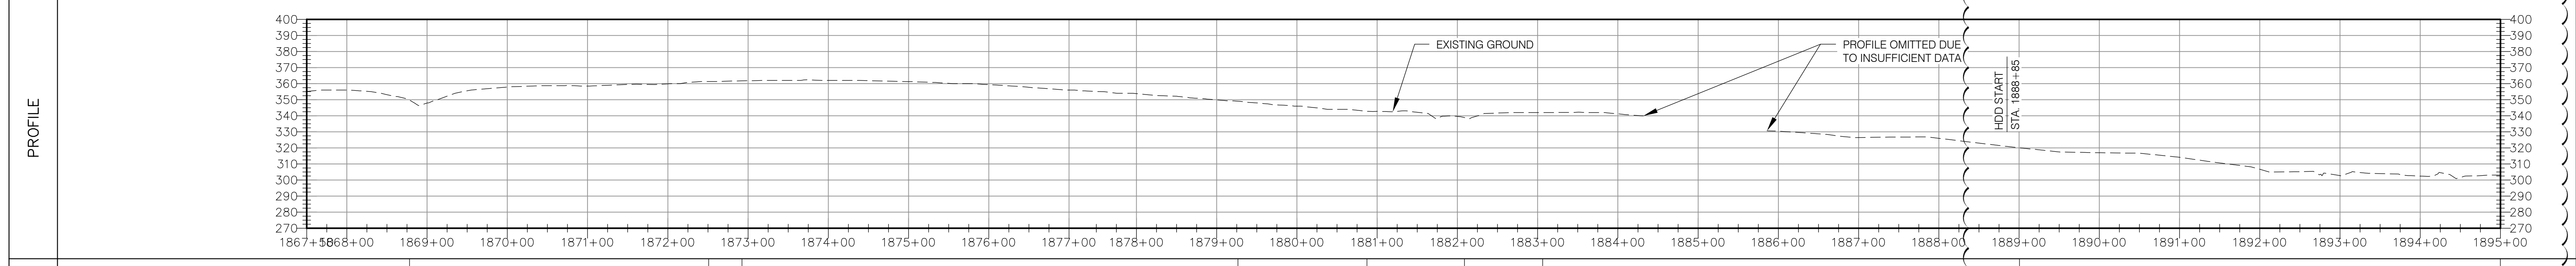

MATERIALS			1	1	1	1	1	1	1	1
COATING			A	C	A	C	A	C	A	B
CLASSIFICATION			423 FT	17 FT	648 FT	163 FT	143 FT	66 FT	659 FT	615 FT
DESIGN FACTOR										0.5

COATING			A	C	A	C	A	C	A	B
CLASSIFICATION										1
DESIGN FACTOR										0.5

HORIZONTAL SCALE

VERTICAL SCALE

PIPE MATERIAL:

1 12.75" O.D. X 0.312" WT, API-5L, GR. X65, PSL-2, AND ADDITIONAL SPECIFICATIONS IN 192.112 2,734 FT

2 20" O.D. X 0.375" WT, API-5L, GR. B 0 FT

PIPE COATING:



A EPOXY POLYETHYLENE 10/40 1,873 FT

B FBE, ABRASION RESISTANT OVERCOAT, 14-16 MILS/40 MILS, 54-56 MILS TOTAL 615 FT

C FBE 14-16 MILS, W/ 1-1/2" REINFORCED CONCRETE W/ 140 LBS/FT' 246 FT


ANGP-EPSC-074		EPSC PLAN		3	GJM	BCK	IFC 2016 EDITS (05/2016)	ENVIRONMENTAL	JLS	06/28/13	JLS	05/2016	VERMONT GAS PROPOSED 12" PIPELINE ADDISON NATURAL GAS PROJECT ALIGNMENT SHEET					
G-001 - 010		COVER, INDEX, LEGEND & NOTES, AND CONSTRUCTION DETAILS		2	BCK	BCK	SUPPLEMENTAL SURFACE INFO ADDED (3/16/16)	DRAFTING DESIGNER	GIL	06/28/13	GJM	05/2016	LOC. ADDISON COUNTY, VERMONT	YEAR: 2016			W.O.	SCALE: 1" = 100'
DWG. NO.		REFERENCE DWG.		1	GJM	TDB	VHB HDD AREA REVISIONS (6/24/15)	DRAFTING SUPERVISOR	BZD	06/28/13	BCK	05/2016						
				REV	DSN	CK	DESCRIPTION	DESIGN ENGINEER	MDF	06/28/13	GEW	05/2016						
								DESIGN MANAGER	SAB	06/28/13	JEO	05/2016						
									INITIALS	DATE	INITIALS	DATE						

RIGHT-OF-WAY	MATCHLINE	236 N/F MAINE DRILLING AND BLASTING	237 N/F PALMER, JOHN & CARMEN	MATCHLINE		
SURVEY DATA		S 02 16' E	S 02 09' E	S 02 16' E	S 02 09' E	S 47 07' W

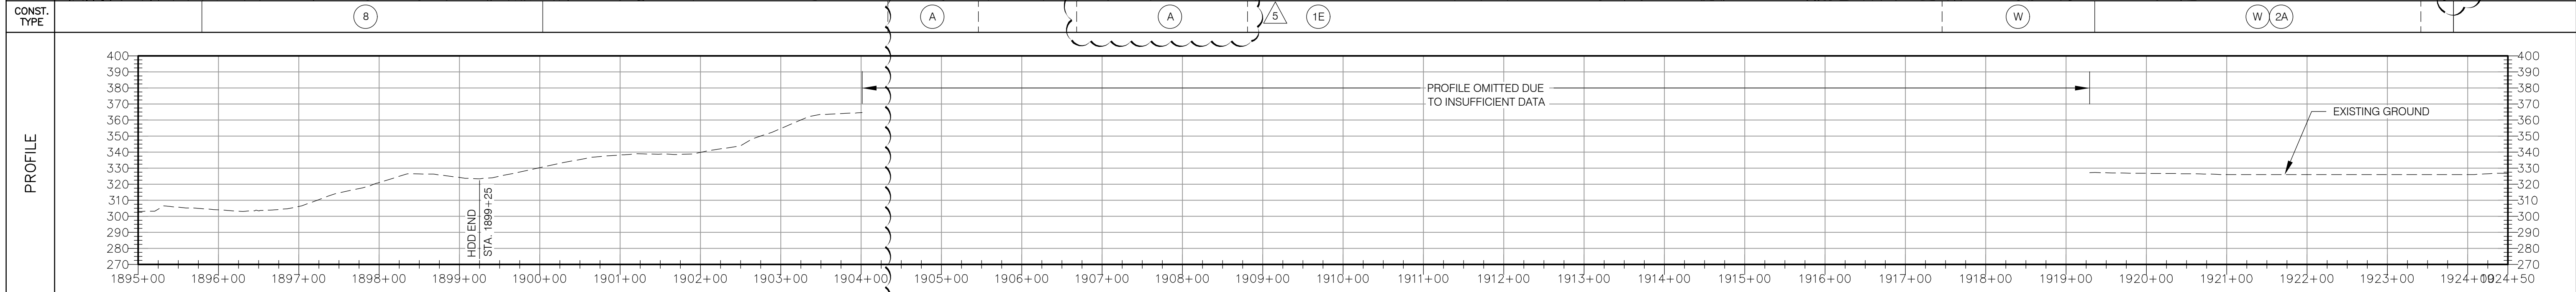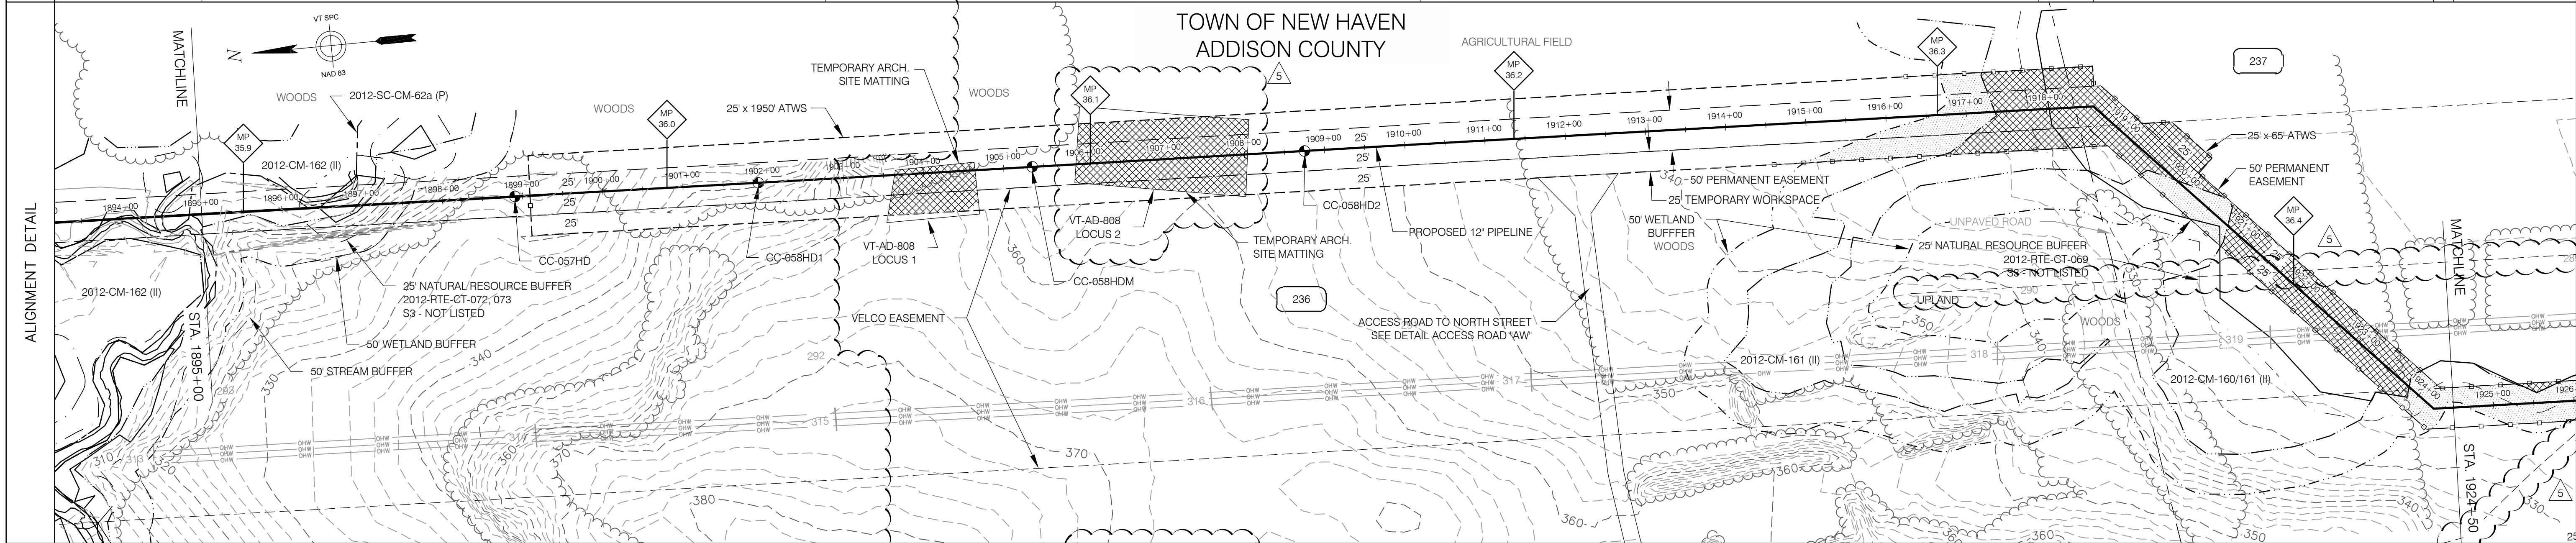


MATERIALS	MATCHLINE	1 425 FT	1 1,733 FT	1 792 FT	MATCHLINE
-----------	-----------	-------------	---------------	-------------	-----------

COATING	B	A	C
CLASSIFICATION	1		
DESIGN FACTOR	0.5		




PIPE MATERIAL:		
1 12.75" O.D. X 0.312" WT, API-5L, GR. X65, PSL-2, AND ADDITIONAL SPECIFICATIONS IN 192.112	2,950 FT	
2 20" O.D. X 0.375" WT, API-5L, GR. B	0 FT	
PIPE COATING:		
A EPOXY POLYETHYLENE 10/40	1,733 FT	
B FBE, ABRASION RESISTANT OVERCOAT, 14-16 MILS/40 MILS, 54-56 MILS TOTAL	425 FT	
C FBE 14-16 MILS, W/ 1-1/2" REINFORCED CONCRETE W/ 140 LBS/FT'	792 FT	

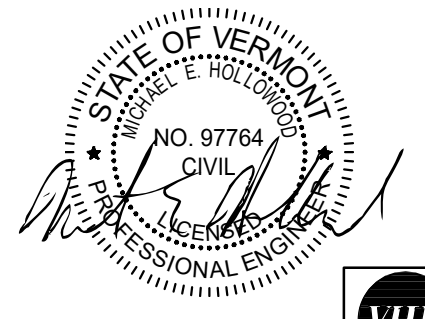


ANGP-T-G-07-010	ACCESS ROAD DETAILS	5	GJM	BCK	IFC 2016 EDITS (05/2016)	ENVIRONMENTAL	JLS	06/28/13	JLS	05/2016	VERMONT GAS PROPOSED 12" PIPELINE ADDISON NATURAL GAS PROJECT ALIGNMENT SHEET	LOC. ADDISON COUNTY, VERMONT	YEAR: 2016	W.O.	SCALE: 1" = 100'	DWG. ANGP-T-C-075	REV. 5
ANGP-EPSC-075	EPSC PLAN	4	BCK	BCK	SUPPLEMENTAL SURFACE INFO ADDED (3/16/16)	DRAFTING DESIGNER	GIL	06/28/13	GJM	05/2016							
G-001 - 010	COVER, INDEX, LEGEND & NOTES, AND CONSTRUCTION DETAILS	3	GJM	TDB	VHB HDD AREA REVISIONS (6/24/15)	DRAFTING SUPERVISOR	BZD	06/28/13	BCK	05/2016							
DWG. NO.	REFERENCE DWG.	2	BCK	TDB	VHB EDITS (6/09/15)	DESIGN ENGINEER	MDF	06/28/13	GEW	05/2016							
		1	BCK	TDB	ACCESS ROAD "AG" REMOVED (5/14/15)	DESIGN MANAGER	SAB	06/28/13	JEO	05/2016							
		REV	DSN	CK	DESCRIPTION		INITIALS	DATE	INITIALS	DATE							

RIGHT-OF-WAY	MATCHLINE	240 N/F LIVINGSTON, PHIL	241 N/F PIDGEON, DAVID	242 N/F HALL, DOUG	246 N/F SWEENEY, MICHAEL & LINDA	244 N/F GREEN, DARIN, HAYES & NANCY	MATCHLINE	
SURVEY DATA		S 02' 12" W	S 02' 03" W	S 02' 11" W	S 02' 20" W	S 02' 10" W	S 02' 01" W	S 03' 08" W

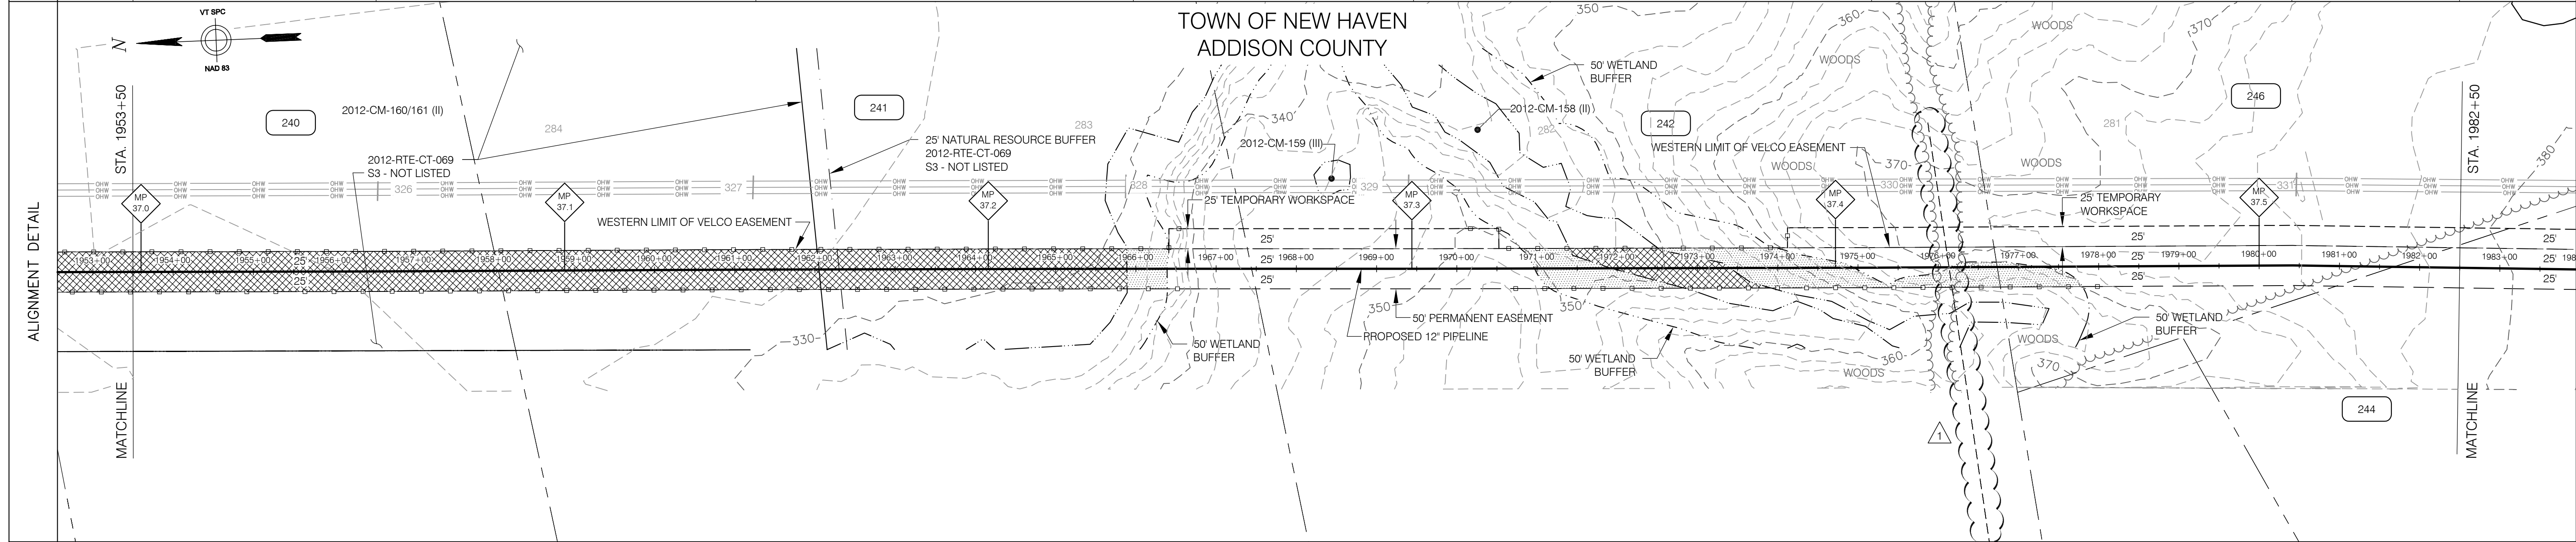


CONST. TYPE		(2A) (W)	(1A)	(2A) (W)	(1A)
-------------	--	----------	------	----------	------

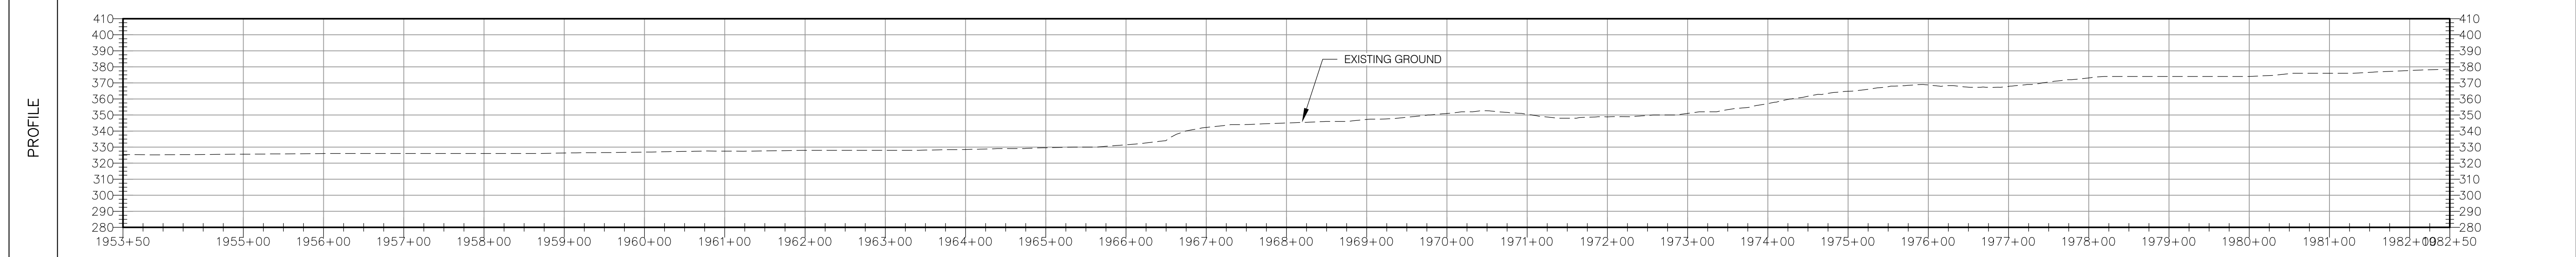


MATERIALS	MATCHLINE	(1) 1,289 FT	(1) 458 FT	(1) 630 FT	(1) 523 FT	MATCHLINE
-----------	-----------	-----------------	---------------	---------------	---------------	-----------

COATING	C	A	C	A
CLASSIFICATION		1		
DESIGN FACTOR		0.5		




PIPE MATERIAL:	2,900 FT
1 12.75" O.D. X 0.312" WT, API-5L, GR. X65, PSL-2, AND ADDITIONAL SPECIFICATIONS IN 192.112	
2 20" O.D. X 0.375" WT, API-5L, GR. B	0 FT
PIPE COATING:	981 FT
A EPOXY POLYETHYLENE 10/40	
B FBE, ABRASION RESISTANT OVERCOAT, 14-16 MILS/40 MILS, 54-56 MILS TOTAL	0 FT
C FBE 14-16 MILS, W/ 1-1/2" REINFORCED CONCRETE W/ 140 LBS/FT'	1,919 FT




ANGP-EPSC-077					EPSC PLAN					VERMONT GAS PROPOSED 12" PIPELINE ADDISON NATURAL GAS PROJECT ALIGNMENT SHEET					LOC. ADDISON COUNTY, VERMONT					YEAR: 2016 W.O. SCALE: 1" = 100' DWG. ANGP-T-C-077 REV. 1																			
G-001 - 010					COVER, INDEX, LEGEND & NOTES, AND CONSTRUCTION DETAILS					IFC 2016 EDITS (05/2016)					ENVIRONMENTAL JLS 06/28/13 JLS 05/2016					DRAFTING DESIGNER GJM 06/28/13 GJM 05/2016					DRAFTING SUPERVISOR BZD 06/28/13 BCK 05/2016					DESIGN ENGINEER MDF 06/28/13 GEW 05/2016					DESIGN MANAGER SAB 06/28/13 JEO 05/2016				
DWG. NO.					REFERENCE DWG.					DESCRIPTION					INITIALS DATE INITIALS DATE																								

RIGHT-OF-WAY	MATCHLINE		246	244	245	246	MATCHLINE	
	N/F SWEENEY, MICHAEL & LINDA			N/F GREEN, DARIN, HAYES & NANCY	N/F REISS, SCOTT & LYNDIA	N/F SWEENEY, MICHAEL & LINDA		
SURVEY DATA	04°03' RT	307°24' LT		S 07° 11' W	S 23° 14' E		S 17° 42' E	
	1984+21	1985+69		1986+95	1991+08		1996+31	2000+41
								2005+62

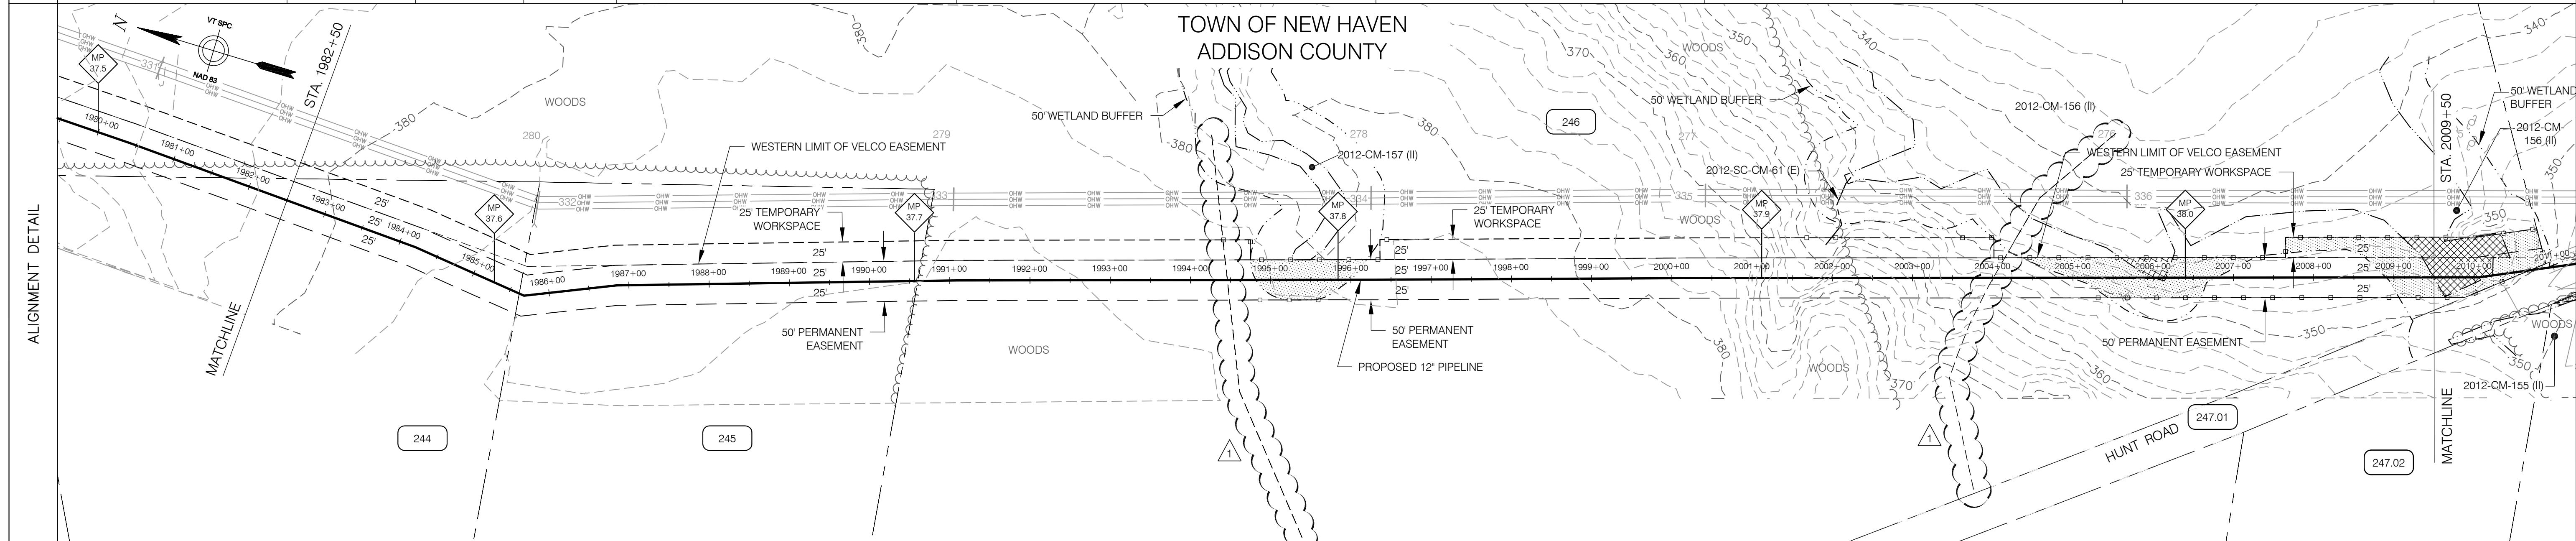

CONST. TYPE	1A	2A	1A	2A	W	1A	W
-------------	----	----	----	----	---	----	---

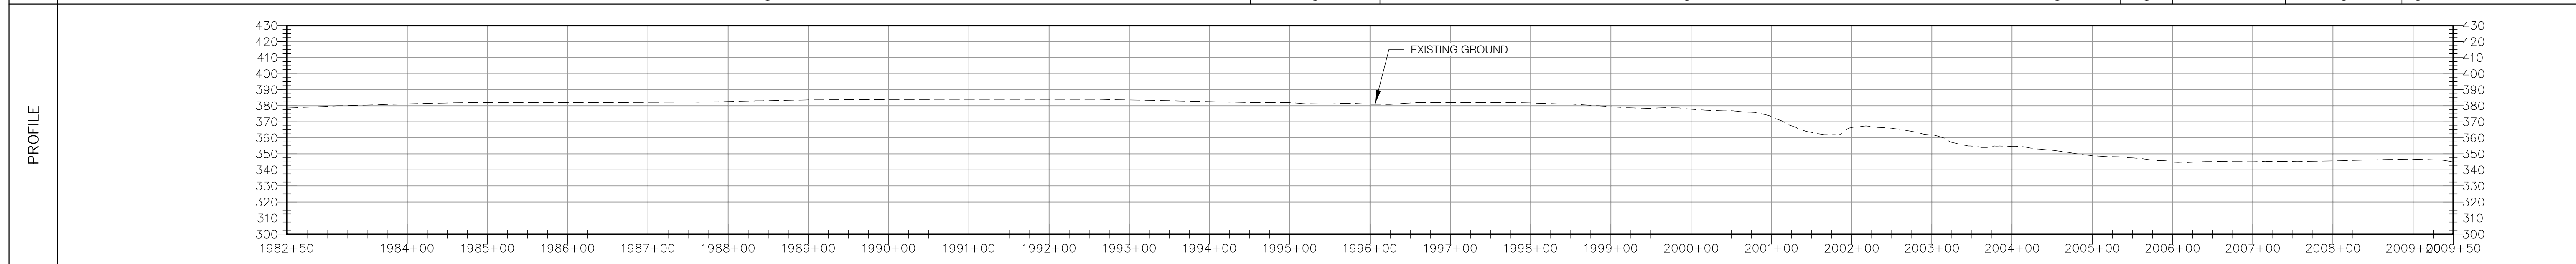

MATERIALS	MATCHLINE	1	1	1	1	1	MATCHLINE
		1,232 FT	118 FT	898 FT	180 FT	212 FT	60 FT

COATING	A	C	A	C	A	C
---------	---	---	---	---	---	---

CLASSIFICATION	1						
----------------	---	--	--	--	--	--	--

DESIGN FACTOR	0.5						
---------------	-----	--	--	--	--	--	--

HORIZONTAL SCALE

VERTICAL SCALE

PIPE MATERIAL:

1 12.75" O.D. X 0.312" WT, API-5L, GR. X65, PSL-2, AND ADDITIONAL SPECIFICATIONS IN 192.112 2,700 FT

2 20" O.D. X 0.375" WT, API-5L, GR. B 0 FT

PIPE COATING:

A EPOXY POLYETHYLENE 10/40 2,342 FT



B FBE, ABRASION RESISTANT OVERCOAT, 14-16 MILS/40 MILS, 54-56 MILS TOTAL 0 FT

C FBE 14-16 MILS, W/ 1-1/2" REINFORCED CONCRETE W/ 140 LBS/FT' 358 FT


VHB Vanasse Hangen Brustlin, Inc.

ANGP-EPSC-078		EPSC PLAN		1	GJM	BCK	IFC 2016 EDITS (05/2016)	ENVIRONMENTAL		JLS	06/28/13	JLS	05/2016	VERMONT GAS				38 Eastwood Drive, Suite 105 South Burlington, VT 05403 Main: (802) 735-0372 - www.cia.companies.com
G-001 - 010		COVER, INDEX, LEGEND & NOTES, AND CONSTRUCTION DETAILS						DRAFTING DESIGNER		GIL	06/28/13	GJM	05/2016	LOC. ADDISON COUNTY, VERMONT				
DWG. NO.		REFERENCE DWG.		REV	DSN	CK	DESCRIPTION	INITIALS	DATE	INITIALS	DATE	INITIALS	DATE	YEAR: 2016	W.O.			

RIGHT-OF-WAY	255.01 RIVER ROAD		255 N/F FOUR-HILLS FARM PARTNERSHIP	
	MATCHLINE			
SURVEY DATA	01'14" RT		00'45" RT	
	S 84° 35' W		S 86° 10' W	
ALIGNMENT DETAIL	2089+25		2089+72	
	S 86° 55' W		S 87° 20' W	
ALIGNMENT DETAIL	00'24" RT		17'28" RT	
	S 87° 20' W		N 75° 11' W	
ALIGNMENT DETAIL	2090+21		2090+27	
	S 87° 20' W		N 75° 11' W	
ALIGNMENT DETAIL	15'17" LT		27'09" LT	
	S 89° 31' W		S 62° 23' W	
ALIGNMENT DETAIL	2090+94		2097+13	
	S 89° 31' W		S 79° 35' W	
ALIGNMENT DETAIL	2097+13		2098+18	
	S 62° 23' W		S 77° 17' W	
ALIGNMENT DETAIL	2098+67		2098+67	
	S 75° 52' W		S 75° 52' W	
ALIGNMENT DETAIL	2098+22		2098+22	
	S 74° 24' W		S 73° 45' W	
ALIGNMENT DETAIL	2098+69		2100+18	
	S 73° 45' W		S 72° 42' W	
ALIGNMENT DETAIL	2100+18		2100+18	
	S 72° 42' W		S 72° 09' W	
ALIGNMENT DETAIL	2100+71		2100+71	
	S 72° 09' W		MATCHLINE	

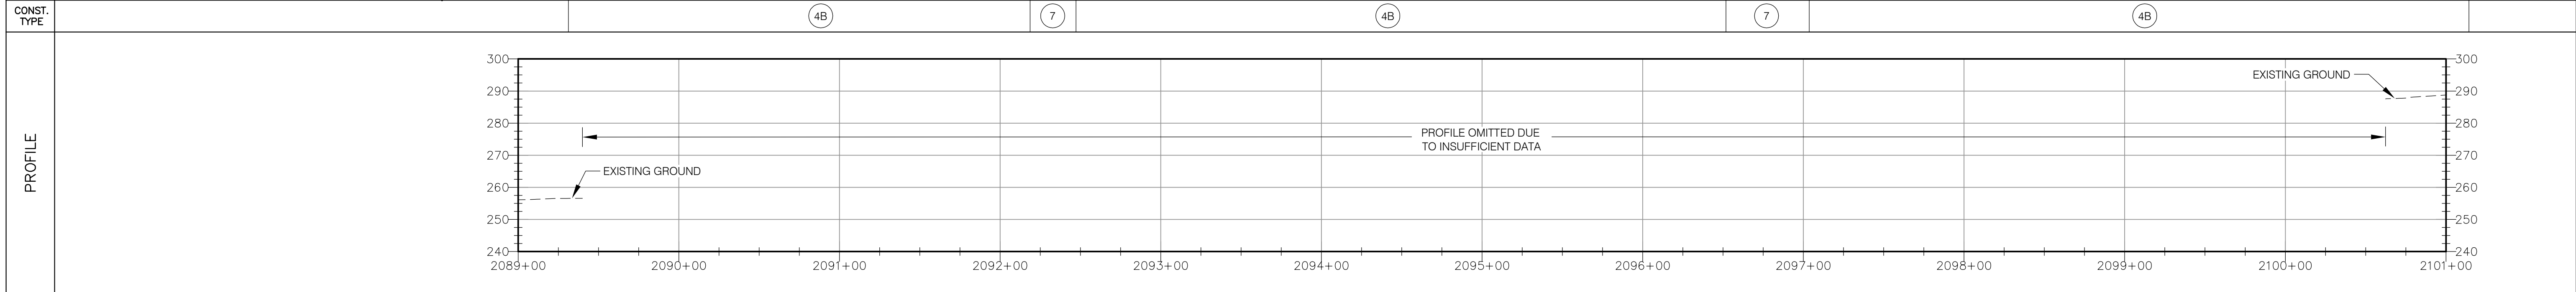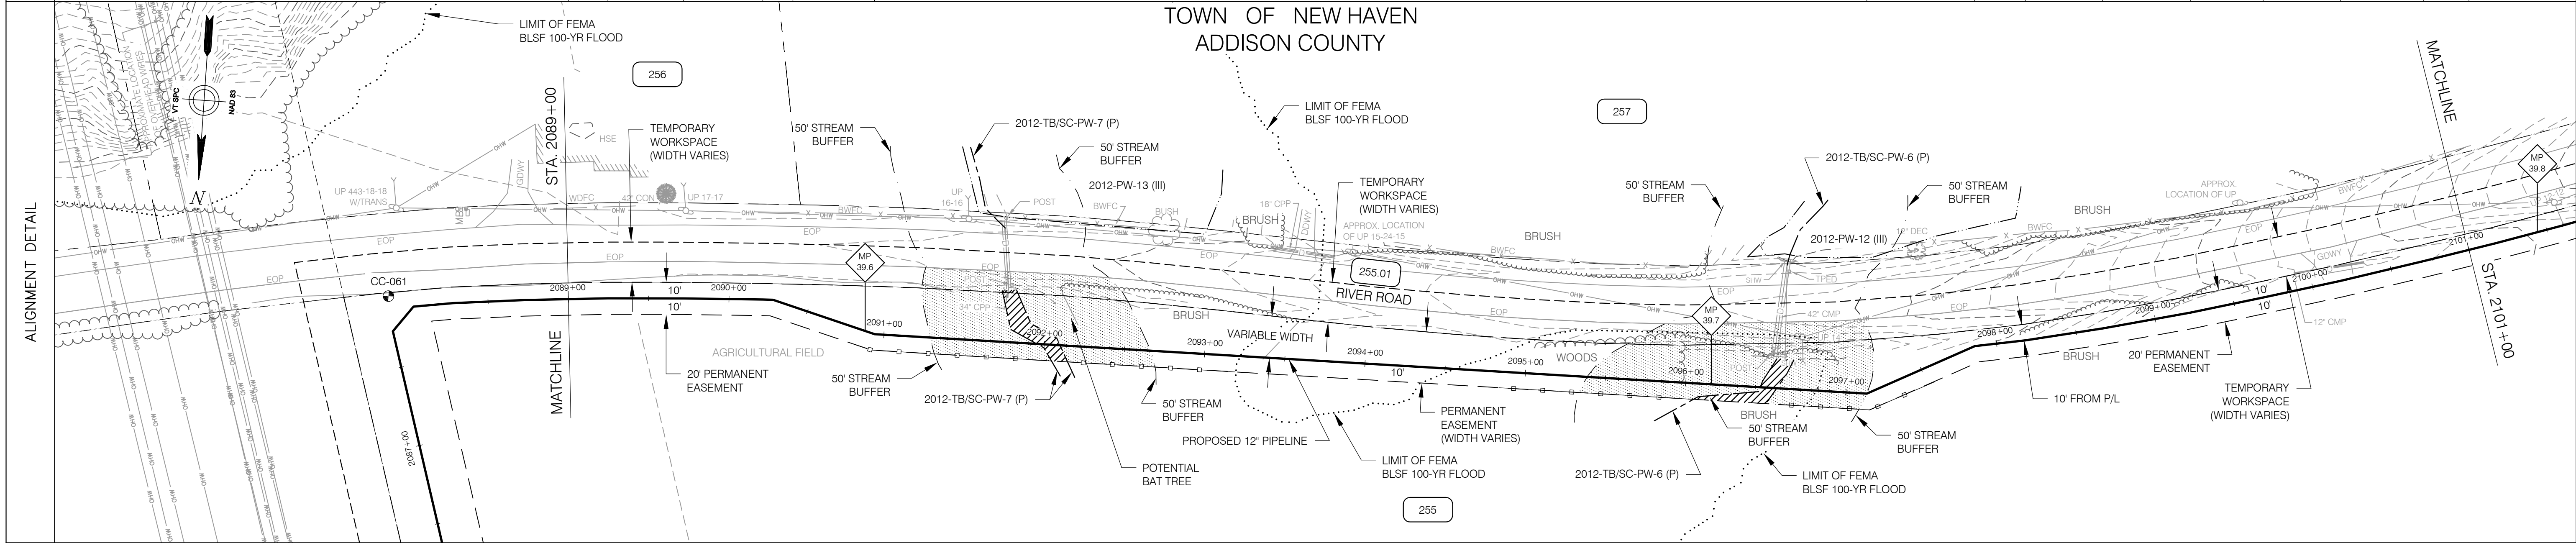

MATERIALS	MATCHLINE		MATCHLINE	
	229 FT		387 FT	
COATING	A		A	
CLASSIFICATION	1		1	
DESIGN FACTOR	0.5		0.5	




PIPE MATERIAL:
 1 12.75" O.D. X 0.312" WT, API-5L, GR. X65, PSL-2, AND ADDITIONAL SPECIFICATIONS IN 192.112 1,200 FT
 2 20" O.D. X 0.375" WT, API-5L, GR. B 0 FT

PIPE COATING:
 A EPOXY POLYETHYLENE 10/40 888 FT
 B FBE, ABRASION RESISTANT OVERCOAT, 14-16 MILS/40 MILS, 54-56 MILS TOTAL 0 FT
 C FBE 14-16 MILS, W/ 1-1/2" REINFORCED CONCRETE W/ 140 LBS/FT' 312 FT




ANGP-EPSC-082A		EPSC PLAN				ENVIRONMENTAL		JLS	06/28/13	JLS	05/2016	VERMONT GAS PROPOSED 12" PIPELINE ADDISON NATURAL GAS PROJECT ALIGNMENT SHEET					
G-001 - 010		COVER, INDEX, LEGEND & NOTES, AND CONSTRUCTION DETAILS				DRAFTING DESIGNER		GIL	06/28/13	GJM	05/2016	LOC. ADDISON COUNTY, VERMONT				YEAR: 2016	W.O.
DWG. NO.		REFERENCE DWG.		REV	DSN	CK	DESIGN SUPERVISOR		BZD	06/28/13	BCK	05/2016	SCALE: 1" = 50'		DWG.	ANGP-T-C-082A	REV. 0
							DESIGN ENGINEER		MDF	06/28/13	GEW	05/2016					
							DESIGN MANAGER		SAB	06/28/13	JEO	05/2016					
							INITIALS	DATE		INITIALS	DATE						

RIGHT-OF-WAY	MATCHLINE	255 N/F FOUR-HILLS FARM PARTNERSHIP										257.01 N/F LONDON, BEVERLY; & WILLIAM		255 N/F FOUR-HILLS FARM PARTNERSHIP				259.01 N/F CUNNINGHAM, BARBARA			MATCHLINE						
	SURVEY DATA	2101+17	2101+60	2102+12	2102+61	2102+98	2103+55	2104+12	2104+62	2105+08	2105+39	2105+49	2105+89	2106+35	2106+73	2107+24	2107+72	2108+22	2108+37	2108+72	2112+85	2113+24	2113+26	2113+39	2113+85	2114+32	2114+81

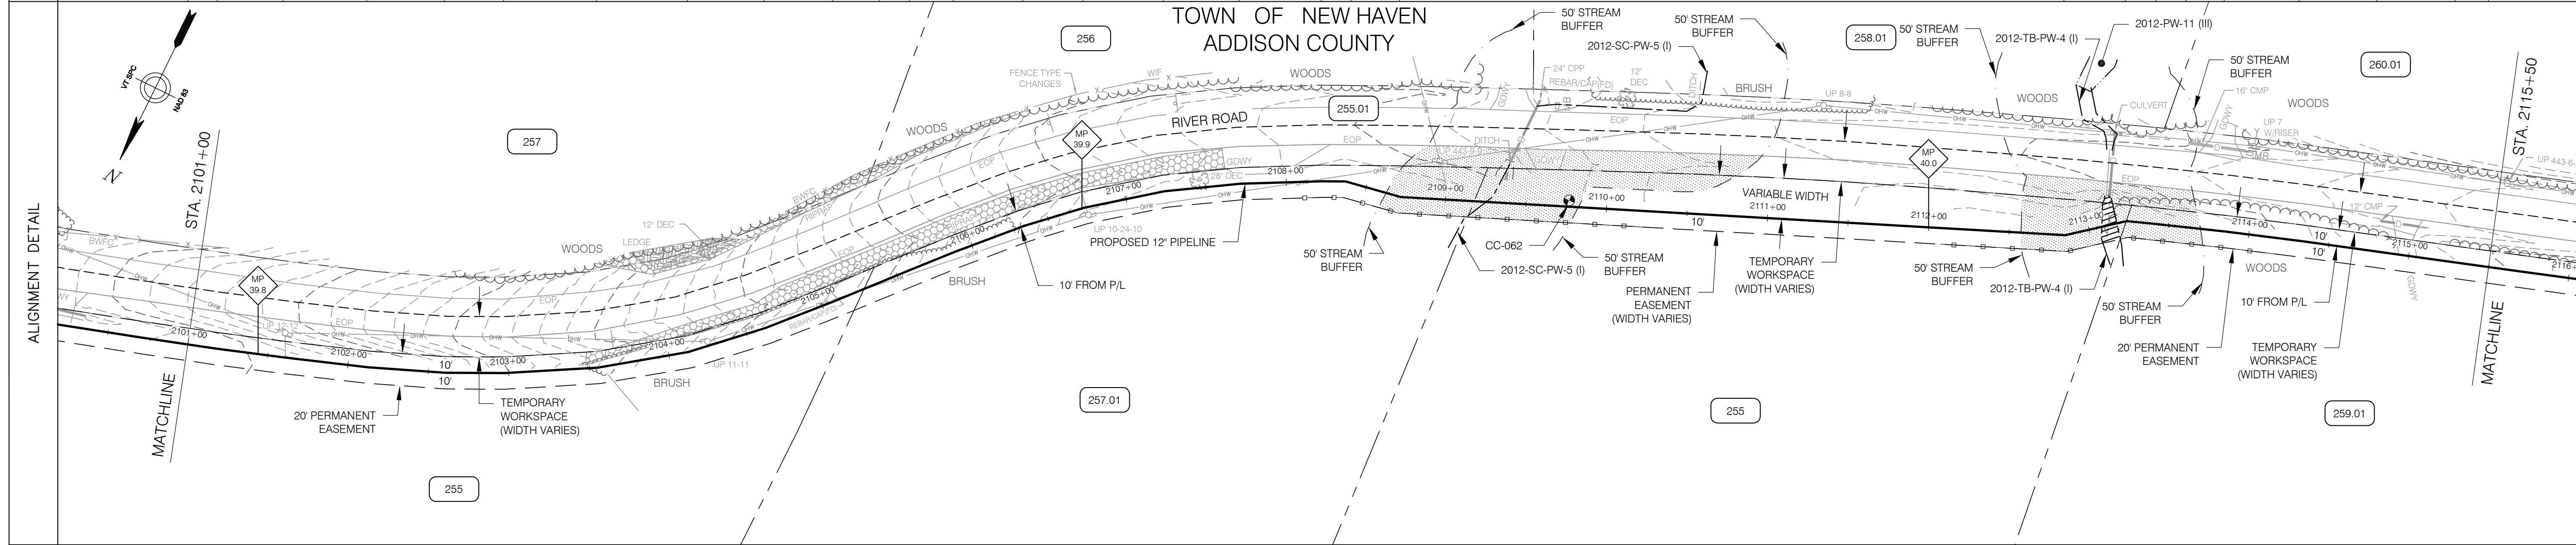

CONST. TYPE			4B		7		4B		7		4B	
-------------	--	--	----	--	---	--	----	--	---	--	----	--

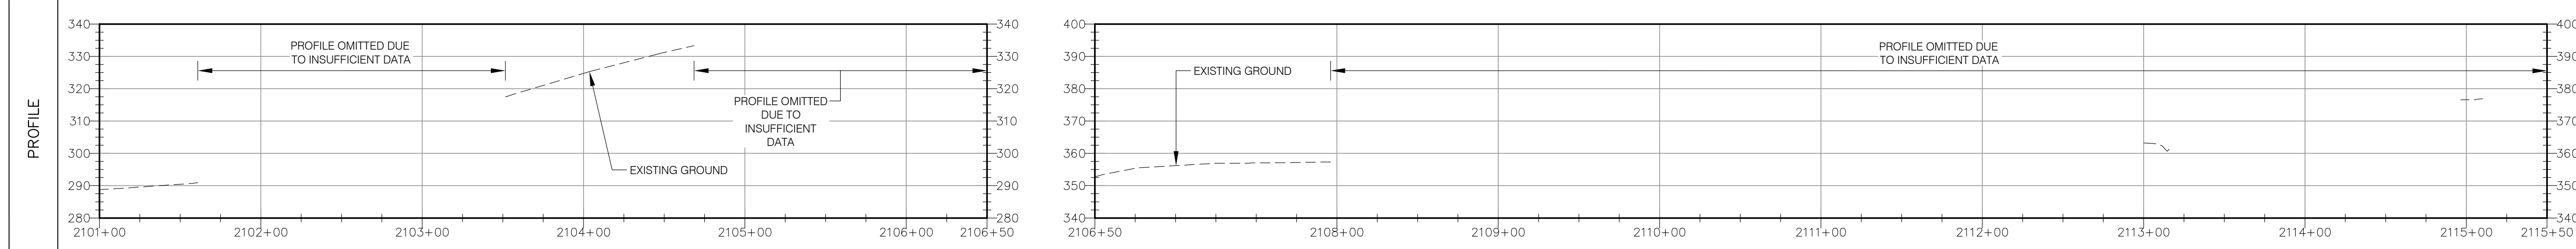

MATERIALS	MATCHLINE		1		1		1		1		1	MATCHLINE
COATING			A		C		A		C		A	
CLASSIFICATION			1		0.5		3					
DESIGN FACTOR												

PIPE MATERIAL:

1 12.75" O.D. X 0.312" WT, API-5L, GR. X65, PSL-2, AND ADDITIONAL SPECIFICATIONS IN 192.112 1,450 FT

2 20" O.D. X 0.375" WT, API-5L, GR. B 0 FT

PIPE COATING:

A EPOXY POLYETHYLENE 10/40 1,218 FT


B FBE, ABRASION RESISTANT OVERCOAT, 14-16 MILS/40 MILS, 54-56 MILS TOTAL 0 FT

C FBE 14-16 MILS, W/ 1-1/2" REINFORCED CONCRETE W/ 140 LBS/FT' 232 FT


ANGP-EPSC-082B	EPSC PLAN	REV	DSN	CK	DESCRIPTION	ENVIRONMENTAL		CONSTRUCTION		VERMONT GAS PROPOSED 12" PIPELINE ADDISON NATURAL GAS PROJECT ALIGNMENT SHEET		LOC. ADDISON COUNTY, VERMONT	YEAR: 2016	W.O.	SCALE: 1" = 50'	DWG. ANGP-T-C-082B	REV. 0
	G-001 - 010					COVER, INDEX, LEGEND & NOTES, AND CONSTRUCTION DETAILS	INITIALS	DATE	INITIALS								



RIGHT-OF-WAY	MATCHLINE		255.01 RIVER ROAD	MATCHLINE		265.01 ROUTE 7		MATCHLINE																																								
	259.01 N/F CUNNINGHAM, BARBARA		261.01 N/F LAFRAMBOISE, EDWARD, & BONNIE		263.01 N/F MANY, BRUCE, & BECKY		267.01 NERI, ANTHONY, & NANCY		271.01 BELDEN ROAD	273.01 N/F DUPOISE, STEPHEN, & MARCIA																																						
SURVEY DATA	S 71° 38' W 00'08" LT 2115+79		S 71° 29' W 00'05" LT 2116+28		S 71° 24' W 00'14" LT 2116+77		S 71° 09' W 00'24" RT 2117+25		S 71° 33' W 00'00" LT 2117+44		S 71° 24' W 00'09" LT 2117+78		S 71° 32' W 00'07" RT 2118+26		S 71° 32' W 00'07" RT 2118+85		S 71° 40' W 00'07" RT 2119+36		S 71° 18' W 24'34" RT 2119+39		N 84° 08' W 24'08" LT 2119+73		S 71° 44' W		S 71° 01' W 00'42" LT 2125+19		S 71° 15' W 00'13" RT 2125+41		S 70° 59' W 00'15" LT 2125+89		S 23° 49' W 47'09" LT 2126+25		S 70° 59' W 47'09" RT 2126+46		S 70° 59' W 00'02" RT 2126+61		S 71° 01' W		S 26° 01' W 45'00" LT 2128+95		S 21° 50' E 44'01" LT 2128+38		S 21° 50' E 00'01" LT 2128+61		S 22° 02' E 09'32" LT 2128+88		S 31° 34' E	
	2115+79		2116+28		2116+77		2117+25		2117+44		2117+78		2118+26		2118+85		2119+36		2119+39		2119+73																											

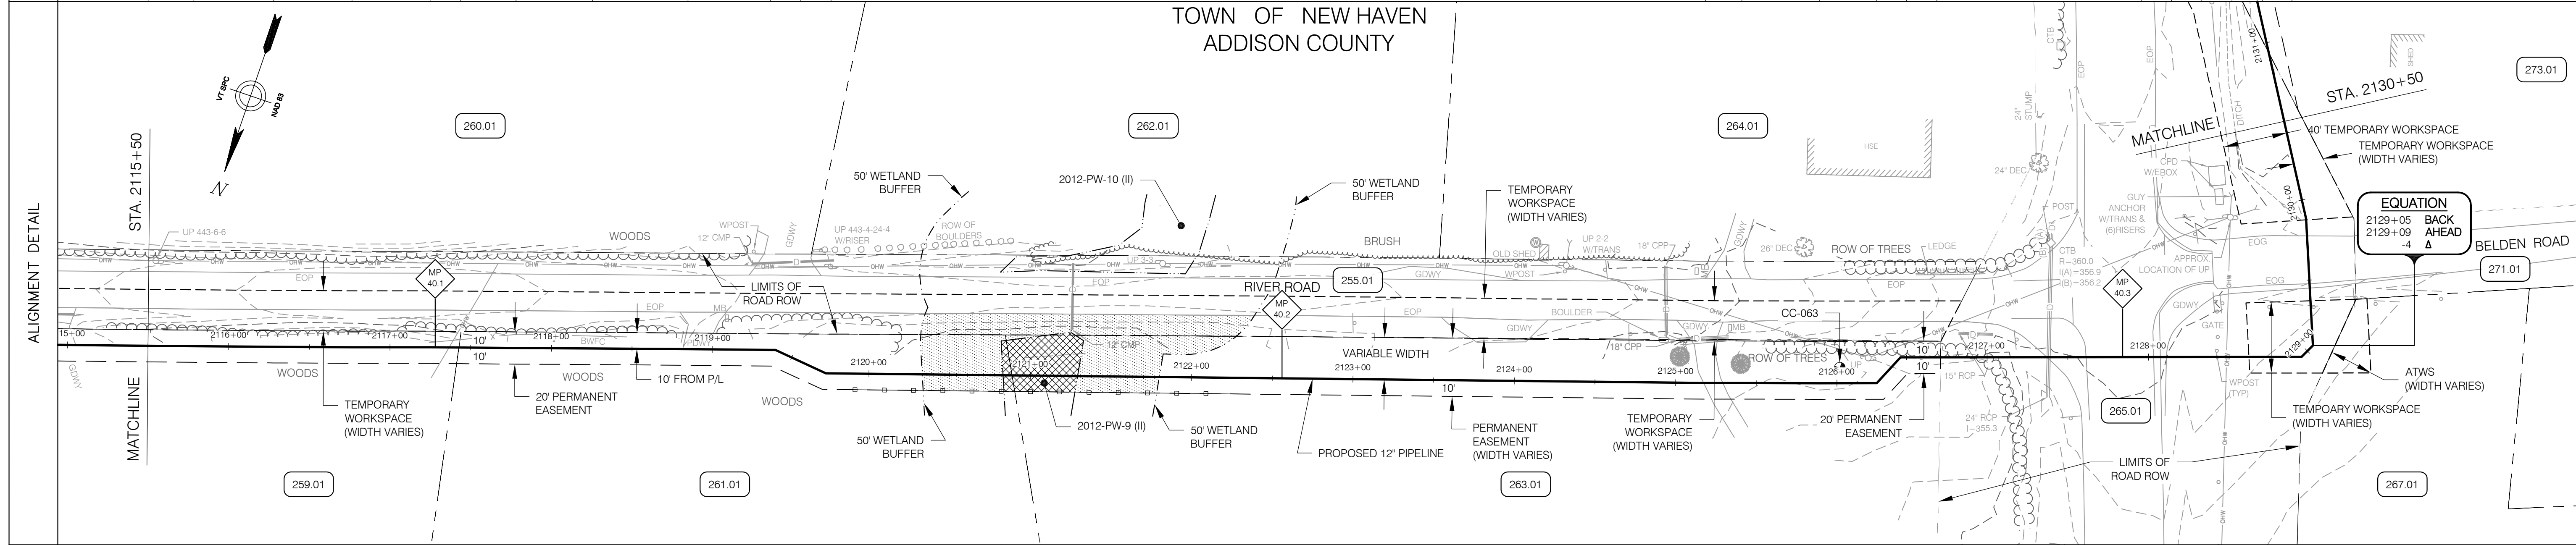


CONST. TYPE				(W)	(4B)					(9)	(11)		
-------------	--	--	--	-----	------	--	--	--	--	-----	------	--	--


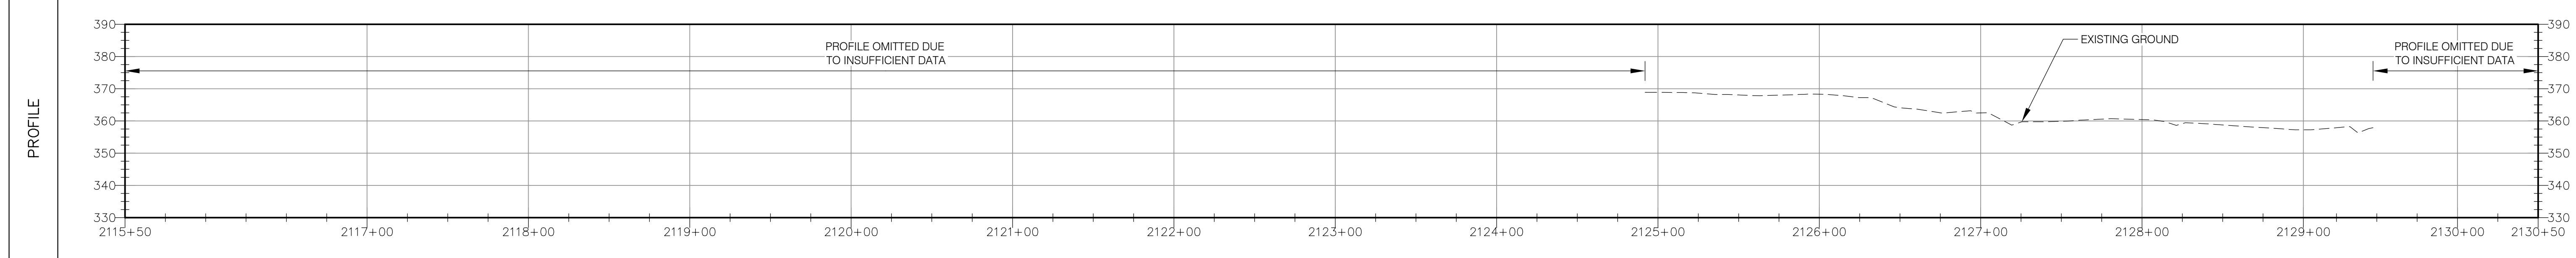


MATERIALS	MATCHLINE	① 483 FT	① 147 FT	① 491 FT	① 375 FT	MATCHLINE
-----------	-----------	-------------	-------------	-------------	-------------	-----------

COATING	A	C	A	C
CLASSIFICATION			3	
DESIGN FACTOR			0.5	




PIPE MATERIAL:
 1 12.75" O.D. X 0.312" WT, API-5L, GR. X65, PSL-2, AND ADDITIONAL SPECIFICATIONS IN 192.112
 2 20" O.D. X 0.375" WT, API-5L, GR. B
 PIPE COATING:
 A EPOXY POLYETHYLENE 10/40 974 FT
 B FBE, ABRASION RESISTANT OVERCOAT, 14-16 MILS/40 MILS, 54-56 MILS TOTAL 0 FT
 C FBE 14-16 MILS, W/ 1-1/2" REINFORCED CONCRETE W/ 140 LBS/FT' 522 FT

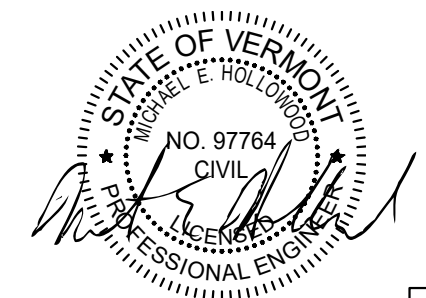


ANGP-VAOT-083C	VAOT PROFILE RTE. 7 (ETHAN ALLEN HGWY) CROSSING DETAIL				ENVIRONMENTAL	JLS	06/28/13	JLS	05/2016	VERMONT GAS PROPOSED 12" PIPELINE ADDISON NATURAL GAS PROJECT ALIGNMENT SHEET	LOC. ADDISON COUNTY, VERMONT	YEAR: 2016	W.O.	SCALE: 1" = 50'	DWG. ANGP-T-C-083A	REV. 0
ANGP-VAOT-083A	VAOT ALIGNMENT SHEET				DRAFTING DESIGNER	GIL	06/28/13	GJM	05/2016							
ANGP-EPSC-083A	EPSC PLAN				DRAFTING SUPERVISOR	BZD	06/28/13	BCK	05/2016							
G-001 - 010	COVER, INDEX, LEGEND & NOTES, AND CONSTRUCTION DETAILS				DESIGN ENGINEER	MDF	06/28/13	GEW	05/2016							
DWG. NO.	REFERENCE DWG.	REV	DSN	CK	DESCRIPTION	INITIALS	DATE	INITIALS	DATE							

RIGHT-OF-WAY	MATCHLINE		265.01 ROUTE 7		MATCHLINE
			273.01 N/F DUPOISE, STEPHEN; & MARCIA		
SURVEY DATA		S 31° 34' E		S 19° 08' E	
		14°29' LT 2131+34	26°55' RT 2131+69		

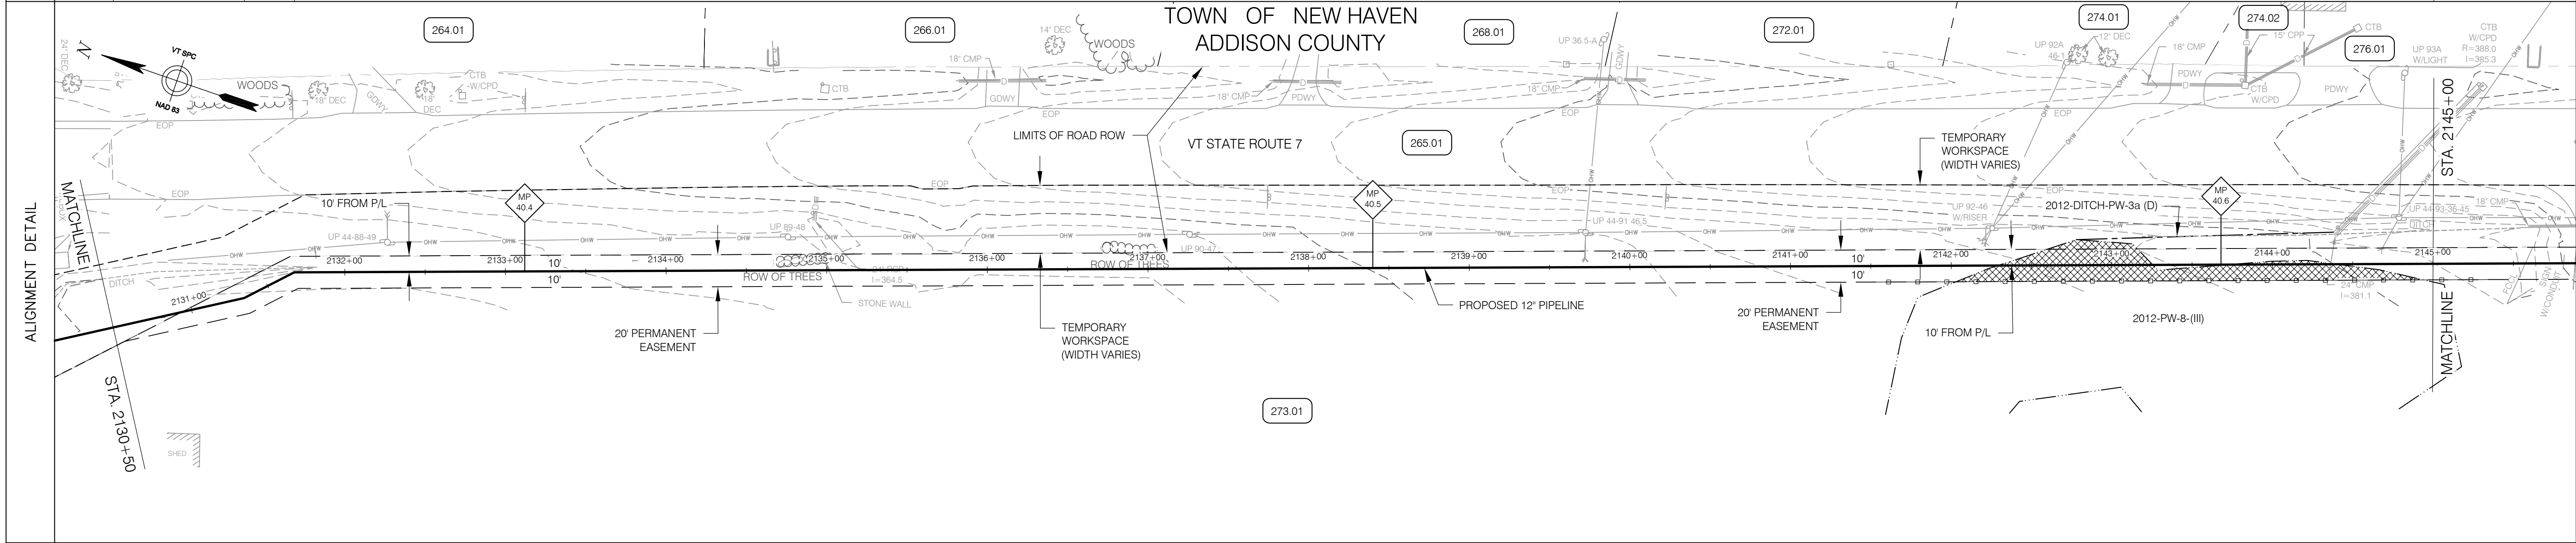


CONST. TYPE	11	4B	W
-------------	----	----	---

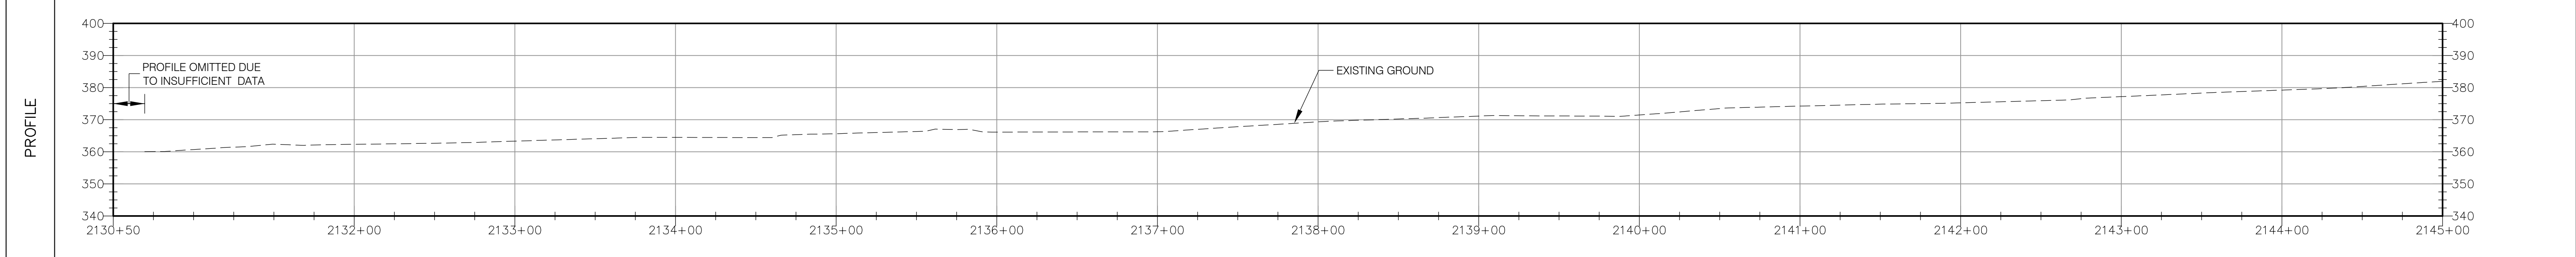

MATERIALS	MATCHLINE	1	1	1	1	MATCHLINE
	44 FT	1,136 FT	210 FT	60 FT		

COATING	C	A		C	A
CLASSIFICATION			3		
DESIGN FACTOR			0.5		



PIPE MATERIAL:
 1 12.75" O.D. X 0.312" WT, API-5L, GR. X65, PSL-2, AND ADDITIONAL SPECIFICATIONS IN 192.112 1,450 FT
 2 20" O.D. X 0.375" WT, API-5L, GR. B 0 FT
 PIPE COATING:
 A EPOXY POLYETHYLENE 10/40 1,196 FT
 B FBE, ABRASION RESISTANT OVERCOAT, 14-16 MILS/40 MILS, 54-56 MILS TOTAL 0 FT
 C FBE 14-16 MILS, W/ 1-1/2" REINFORCED CONCRETE W/ 140 LBS/FT' 254 FT



ANGP-VAOT-083B VAO T ALIGNMENT SHEET		ANGP-EPSC-083B EPSC PLAN		G-001 - 010 COVER, INDEX, LEGEND & NOTES, AND CONSTRUCTION DETAILS		DWG. NO. REFERENCE DWG.		REV	DSN	CK	DESCRIPTION	INITIALS	DATE	INITIALS	DATE	YEAR: 2016	W.O.	SCALE: 1" = 50'	DWG. ANGP-T-C-083B	REV. 0



VERMONT GAS
 PROPOSED 12" PIPELINE
 ADDISON NATURAL GAS PROJECT
 ALIGNMENT SHEET

LOC. ADDISON COUNTY, VERMONT

VERMONT GAS
 38 Eastwood Drive, Suite 105
 South Burlington, VT 05403
 Main: (802) 735-0372 - www.vermontgas.com

CIA
 38 Eastwood Drive, Suite 105
 South Burlington, VT 05403
 Main: (802) 735-0372 - www.ciacompanies.com

RIGHT-OF-WAY	
SURVEY DATA	<p>273.01 N/F DUPOISE, STEPHEN; & MARCIA</p> <p>265.01 ROUTE 7</p> <p>275.01 N/F DELINEATION CORPORATION; WEBER, STEVE</p> <p>02'08" RT S 19° 08' E 2147+89 S 21° 16' E 2148+35 S 19° 24' E 00'02" RT 2148+98 00'32" LT 2149+77 S 19° 54' E 43'42" RT 2151+13 35'22" LT 2151+91 48'40" LT 2152+62 41'14" RT 2153+60 S 19° 02' E 00'78" RT 2153+97 S 18° 33' E 00'33" RT 2154+56 S 18° 01' E 00'39" RT 2155+11 S 17° 22' E 00'50" RT 2156+23 S 16° 32' E 00'16" RT 2156+63 S 16° 17' E 00'37" RT 2157+91 S 15° 40' E 00'12" RT 2158+47 S 15° 52' E</p>

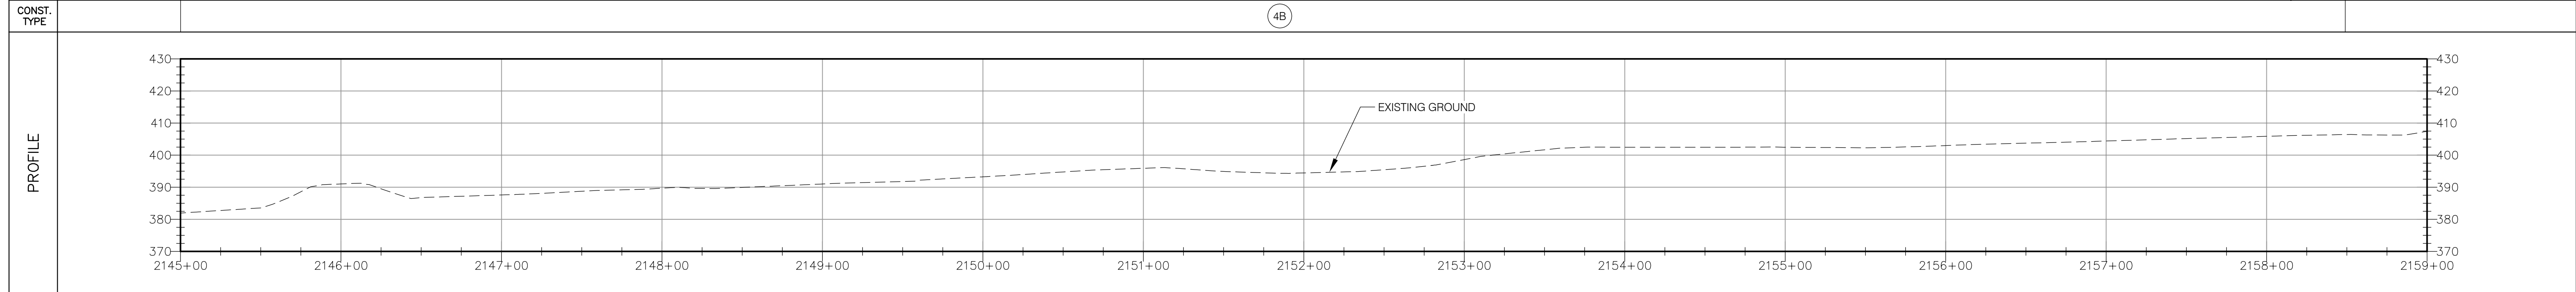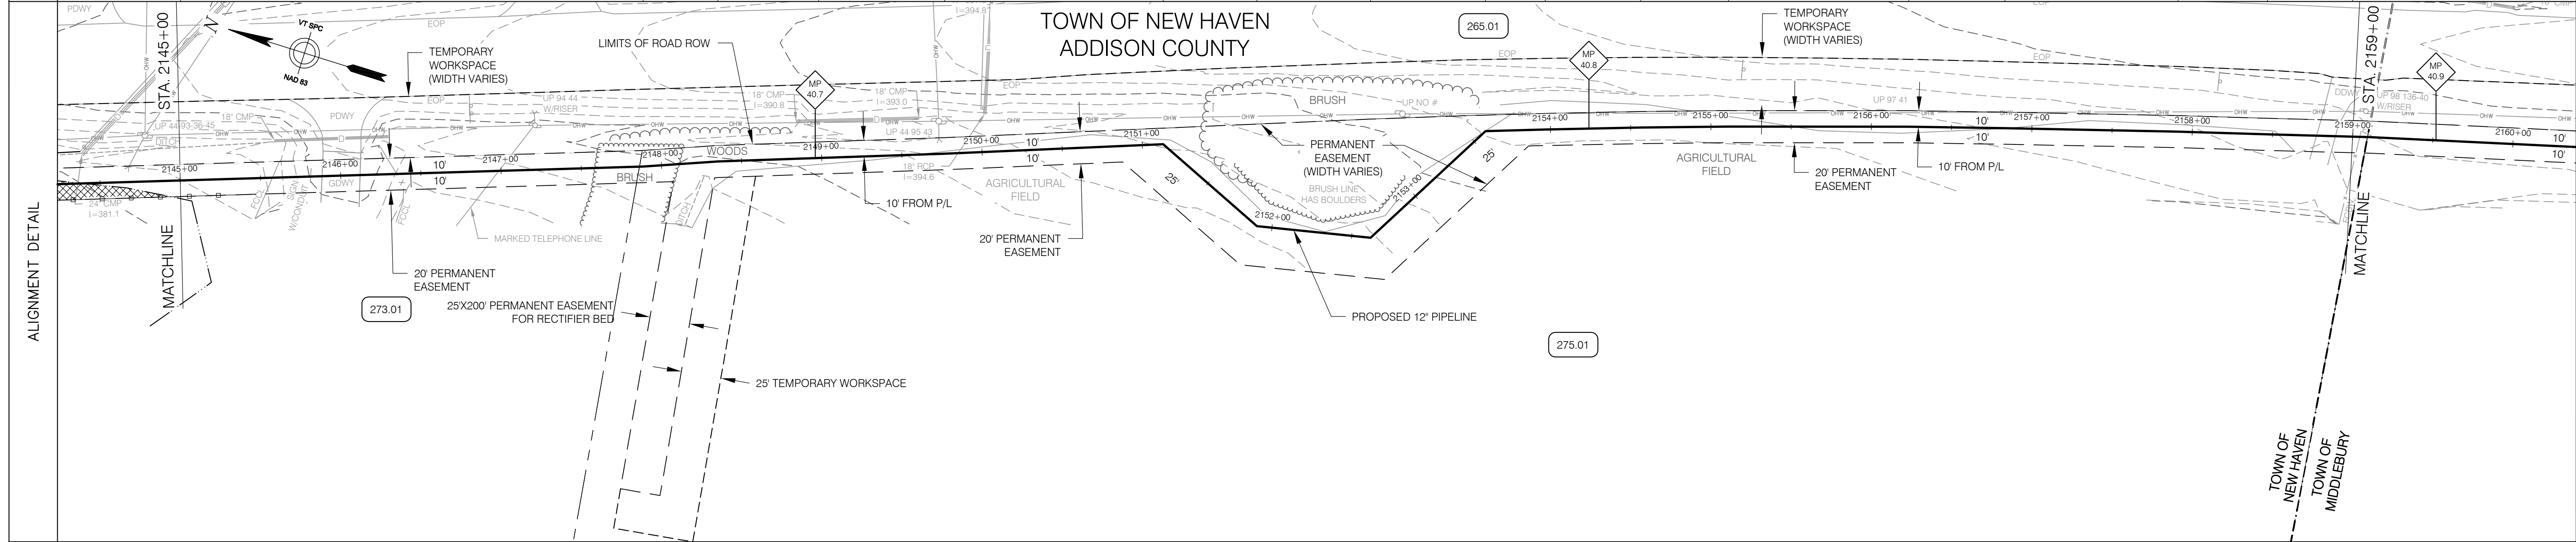

MATERIALS	<p>1 1,400 FT</p> <p>A</p> <p>3</p> <p>0.5</p>
-----------	--

COATING	1	1,400 FT
CLASSIFICATION	A	0 FT
DESIGN FACTOR	3	0 FT
	0.5	0 FT

HORIZONTAL SCALE

VERTICAL SCALE

PIPE MATERIAL:

1 12.75" O.D. X 0.312" WT, API-5L, GR. X65, PSL-2, AND ADDITIONAL SPECIFICATIONS IN 192.112 1,400 FT

2 20" O.D. X 0.375" WT, API-5L, GR. B 0 FT

PIPE COATING:


A EPOXY POLYETHYLENE 10/40 1,400 FT

B FBE, ABRASION RESISTANT OVERCOAT, 14-16 MILS/40 MILS, 54-56 MILS TOTAL 0 FT


C FBE 14-16 MILS, W/ 1-1/2" REINFORCED CONCRETE W/ 140 LBS/FT' 0 FT

ANGP-VAOT-084A VAOT ALIGNMENT SHEET ANGP-EPSC-084A EPSC PLAN G-001 - 010 COVER, INDEX, LEGEND & NOTES, AND CONSTRUCTION DETAILS DWG. NO. REFERENCE DWG.		ENVIRONMENTAL JLS 06/28/13 DRAFTING DESIGNER GIL 06/28/13 DRAFTING SUPERVISOR BZD 06/28/13 DESIGN ENGINEER MDF 06/28/13 DESIGN MANAGER SAB 06/28/13	BID 06/28/13 06/28/13 06/28/13 06/28/13	CONSTRUCTION JLS 05/2016 GJM 05/2016 BCK 05/2016 GEW 05/2016 JEO 05/2016	VERMONT GAS PROPOSED 12" PIPELINE ADDISON NATURAL GAS PROJECT ALIGNMENT SHEET LOC. ADDISON COUNTY, VERMONT				YEAR: 2016 W.O. SCALE: 1" = 50' DWG. ANGP-T-C-084A REV. 0
--	--	---	---	---	--	--	--	--	---

RIGHT-OF-WAY	SURVEY DATA
MATCHLINE 265.01 ROUTE 7 N/F DELINEATION CORPORATION; CORBIN, THOMAS TOWN OF NEW-HAVEN TOWN OF MIDDLEBURY	S 15° 52' E 01'12" LT 2158+15 S 14° 40' E 2163+90 44°55' LT S 59° 35' E 44°55' RT 2164+32 S 14° 40' E 00°08' RT 2164+32 265.02 ROUTE 7 N/F DRAGON, SANDRA JEANNE 265.01 N/F DELINEATION CORPORATION; CORBIN, THOMAS 266.01 N/F DELINEATION CORPORATION; CORBIN, THOMAS 267.01 N/F DELINEATION CORPORATION; CORBIN, THOMAS 279.01 N/F DELINEATION CORPORATION; CORBIN, THOMAS 277.01 N/F DELINEATION CORPORATION; CORBIN, THOMAS 277.01 N/F DELINEATION CORPORATION; CORBIN, THOMAS 260 MATCHLINE

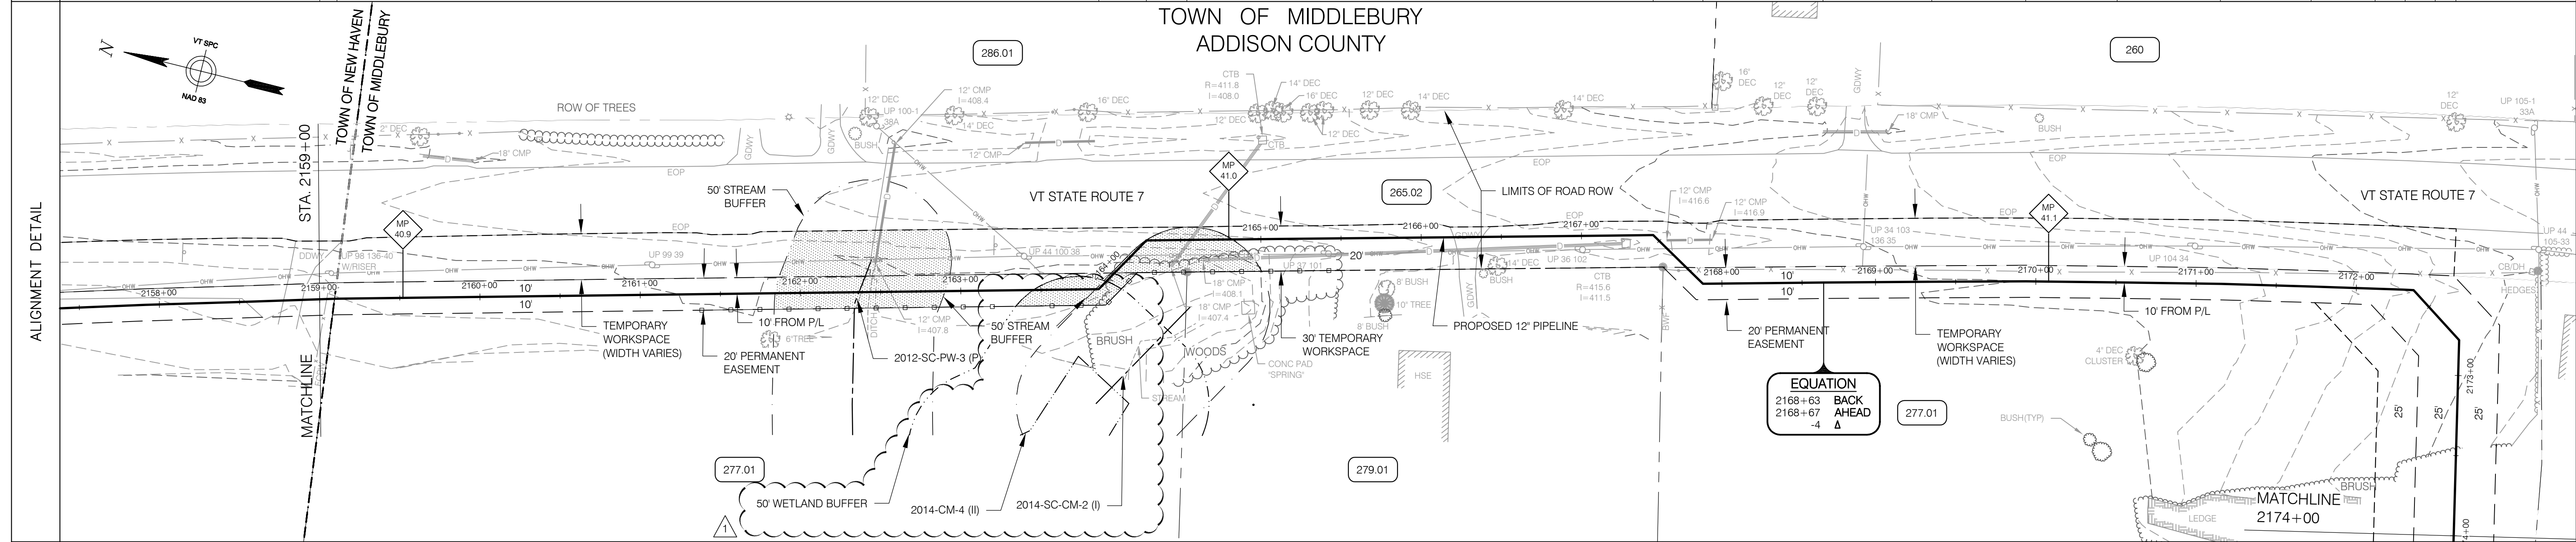

CONST. TYPE
4B 7 4B 4E 4B 1E

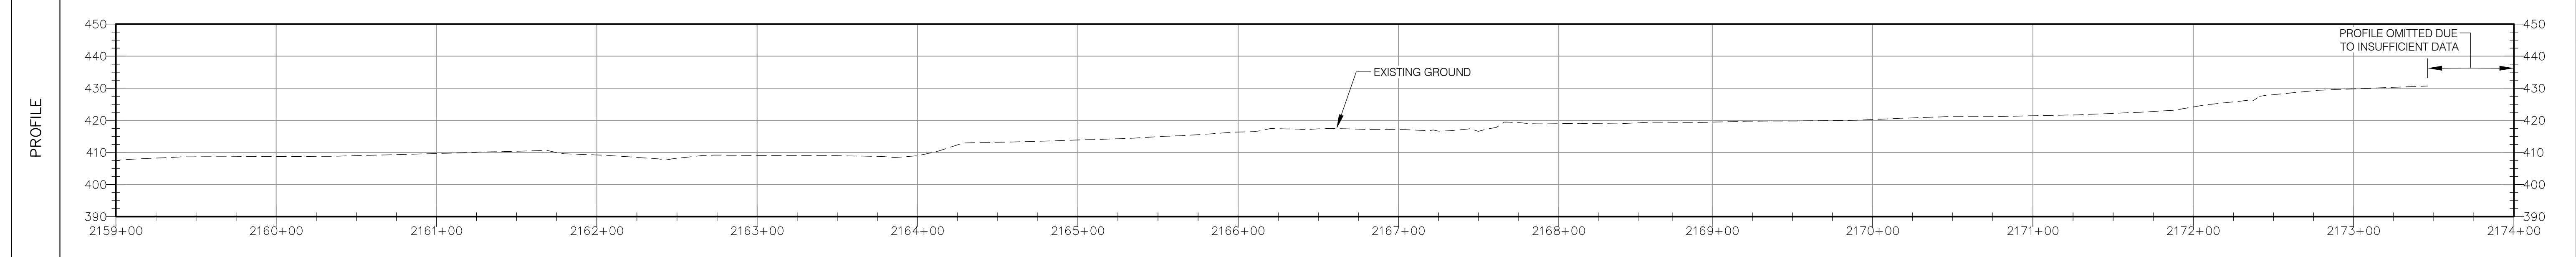

MATERIALS
MATCHLINE 1 284 FT 1 296 FT 1 916 FT MATCHLINE

COATING	CLASSIFICATION	DESIGN FACTOR
A	3	0.5

PIPE MATERIAL:

- 1 12.75" O.D. X 0.312" WT, API-5L, GR. X65, PSL-2, AND ADDITIONAL SPECIFICATIONS IN 192.112 1,496 FT
- 2 20" O.D. X 0.375" WT, API-5L, GR. B 0 FT

PIPE COATING:

- A EPOXY POLYETHYLENE 10/40 1,200 FT
- B FBE, ABRASION RESISTANT OVERCOAT, 14-16 MILS/40 MILS, 54-56 MILS TOTAL 0 FT
- C FBE 14-16 MILS, W/ 1-1/2" REINFORCED CONCRETE W/ 140 LBS/FT' 296 FT

HORIZONTAL SCALE

VERTICAL SCALE

VHB Vanasse Hangen Brustlin, Inc.

NO.	DESCRIPTION	REV	DSN	CK	DATE	BID	CONSTRUCTION	YEAR	W.O.	SCALE	DWG.	REV.
ANGP-VAOT-084B	VAOT ALIGNMENT SHEET					JLS	06/28/13	JLS	05/2016			
ANGP-EPSC-084B	EPSC PLAN					GJM	06/28/13	GJM	05/2016			
G-001 - 010	COVER, INDEX, LEGEND & NOTES, AND CONSTRUCTION DETAILS	1	BCK	TDB	ENV. EDITS (6/08/15)	BZD	06/28/13	BCK	05/2016	1" = 50'	ANGP-T-C-084B	1
DWG. NO.	REFERENCE DWG.					MDF	06/28/13	GEW	05/2016			
						SAB	06/28/13	JEO	05/2016			

VERMONT GAS
 PROPOSED 12" PIPELINE
 ADDISON NATURAL GAS PROJECT
 ALIGNMENT SHEET

LOC. ADDISON COUNTY, VERMONT

YEAR: 2016 W.O. SCALE: 1" = 50' DWG. ANGP-T-C-084B REV. 1